



Illinois Department of Transportation

# Portland Cement Concrete

## Level III Technician Course





**PORTLAND CEMENT CONCRETE LEVEL III TECHNICIAN COURSE - MANUAL OF INSTRUCTIONS FOR DESIGN OF CONCRETE MIXTURES**

**1. POLICY**

It is the policy of the Department of Transportation to publish and maintain a manual that provides guidelines for designing concrete mixtures.

**2. PERSONS AFFECTED**

Division of Highways (DOH)

**3. PURPOSE**

The purpose of this policy is to provide for the publication of a manual to serve as a guide and source of reference for the practices and procedures for those involved in the designing of concrete mixtures.

**4. GUIDELINES FOR IMPLEMENTATION**

- A.** The manual is prepared with emphasis on practices and procedures currently used by the department.
- B.** The manual is intended to train individuals in the design of concrete mixtures.
- C.** Department training classes shall utilize the current edition of the manual for all applicable procedures.
- D.** The manual contains design procedures that will promote uniformity of work performed by the contractor, the department or consultants retained by either.

**5. RESPONSIBILITIES**

The following outlines the individual and office responsibilities to ensure compliance with the provisions of this policy and its accompanying manual.

- A.** The **Bureau of Materials and Physical Research (BMPR)** is responsible for issuance and maintenance of this policy.

- B.** The **DOH' regions/districts** are responsible for ensuring compliance with this policy.
- C.** The **Engineer of Concrete and Soils** of BMPR's Materials Testing Section should be contacted when questions arise regarding the application of these procedures.

## **6. REVISION HISTORY**

Changes to this policy included in this version include:

- Minor editorial changes and updates, and
- Approval signature removed from policy.

Archived versions of this policy may be obtained by contacting BMPR

## **CLOSING NOTICE**

Manual: [Portland Cement Concrete Level III Technician Course](#)

Supersedes: Departmental Policy MAT-12: Portland Cement Concrete Level III Technician Course - Manual of Instructions for Design of Concrete Mixtures, Effective: December 1, 2007

Signature: On file

**LAKE LAND COLLEGE  
INSTRUCTOR AND COURSE EVALUATION**

**Course:** PCC Level III Technician Course      **Section:** \_\_\_\_\_ **Date:** \_\_\_\_\_

**PURPOSE:** The main emphasis at Lake Land College is teaching. In this regard, each instructor must be continuously informed of the quality of his/her teaching and the respects in which that teaching can be improved. As a student, you are in a position to judge the quality of teaching from direct experience, and in order to help maintain the quality of instruction at Lake Land, you are asked to complete this evaluation.

**DIRECTIONS:** **DO NOT SIGN YOUR NAME.** Your frankness and honesty are appreciated.

First, please record your general impressions and/or comments on the following:

Course \_\_\_\_\_

Instructor \_\_\_\_\_

For each remaining item, circle the number from the scale which seems most appropriate to you for the instructor and course that you are evaluating. You are strongly encouraged to make any comments that will clarify particular rating on the back of this form; please refer to each item you are discussing by its number.

WEAK                      SUPERIOR

**OBJECTIVES AND APPROPRIATENESS OF THE COURSE:**

- |    |                              |   |   |   |   |   |   |
|----|------------------------------|---|---|---|---|---|---|
| 1. | <b>Clarity of Objectives</b> | The objectives of the course were clearly identified. Objectives were adequately covered. | 1 | 2 | 3 | 4 | 5 |
| 2. | <b>Selection content</b>     | Content was relevant and met the level of the class.                                      | 1 | 2 | 3 | 4 | 5 |

**ORGANIZATION AND CONTENT OF LESSONS:**

- |    |                                |  |   |   |   |   |   |
|----|--------------------------------|--|---|---|---|---|---|
| 3. | <b>Teacher preparation</b>     | Instructor was organized and knowledgeable in subject matter and prepared for each class.                          | 1 | 2 | 3 | 4 | 5 |
| 4. | <b>Organization of classes</b> | Classroom activities were well organized and clearly related to each other.  | 1 | 2 | 3 | 4 | 5 |
| 5. | <b>Selection of materials</b>  | Instructional materials and resources used specific, current, and clearly related to the objectives of the course. | 1 | 2 | 3 | 4 | 5 |
| 6. | <b>Clarity of presentation</b> | Content of lessons was presented so that it was understandable to the students.                                    | 1 | 2 | 3 | 4 | 5 |
| 7. | <b>Clarity of presentation</b> | Different point of view and/or methods with specific illustrations were used when appropriate.                     | 1 | 2 | 3 | 4 | 5 |

**OVER**

**LAKE LAND COLLEGE  
INSTRUCTOR AND COURSE EVALUATION  
(PAGE 2)**

|   |   | <u>WEAK</u>  | <u>SUPERIOR</u> |   |   |   |   |
|---|---|--|-----------------|---|---|---|---|
| <b><u>PERSONAL CHARACTERISTICS AND STUDENT RAPPORT:</u></b> |   |  |                 |   |   |   |   |
| 8.  | <b>Vocabulary</b>                       | Instructor's vocabulary level was appropriate for the class.                       | 1               | 2 | 3 | 4 | 5 |
| 9.  | <b>Pupil participation and interest</b> | Instructor encouraged students to ask questions and actively participate in class. | 1               | 2 | 3 | 4 | 5 |
| 10.   | <b>Personal attributes</b>              | Instructor indicated an interest and enthusiasm for teaching the subject matter.   | 1               | 2 | 3 | 4 | 5 |
| 11.   | <b>Personal attributes</b>              | Instructor was familiar with current industry practices.                           | 1               | 2 | 3 | 4 | 5 |
| 12.   | <b>Personal attributes</b>              | Instructor's mannerisms were pleasing.   | 1               | 2 | 3 | 4 | 5 |
| 13.   | <b>Instructor-student rapport</b>       | Instructor indicated a willingness to help you in times of difficulty.             | 1               | 2 | 3 | 4 | 5 |
| 14.   | <b>Instructor-student rapport</b>       | Instructor was fair and impartial in dealings with you.                            | 1               | 2 | 3 | 4 | 5 |

**EXAMINATION:**

|     |                      |  |   |   |   |   |   |
|-----|----------------------|--|---|---|---|---|---|
| 15. | <b>Exam material</b> | The exam correlated to the materials being covered in class. | 1 | 2 | 3 | 4 | 5 |
|-----|----------------------|--|---|---|---|---|---|

**SUMMARY:**

|     |   |   |   |   |   |   |
|-----|---|---|---|---|---|---|
| 16. | Considering everything, how would you rate this instructor? | 1 | 2 | 3 | 4 | 5 |
| 17. | Considering everything, how would you rate this course?     | 1 | 2 | 3 | 4 | 5 |

**LAPTOP COMPUTER:**

|     |   |   |   |   |   |   |
|-----|---|---|---|---|---|---|
| 18. | If you brought a laptop computer, was the class training adequate for learning the PCC Mix Design software? | 1 | 2 | 3 | 4 | 5 |
|-----|---|---|---|---|---|---|

**COMMENTS:** (Please use the area below to add any additional comments regarding the class and exam.)

---



---

# **COURSE REQUIREMENTS FOR SUCCESSFUL COMPLETION**

## **Student must attend all class sessions.**

- **PREREQUISITE COURSES** — Either the Mixture Aggregate Technician Course (3-day) or the Aggregate Technician Course (5-day), and the Portland Cement Concrete Level I & II Technician Courses are required.
- **WRITTEN TEST** — The test is open book. The time limit is 2.5 hours. A minimum grade of 70 is required.

Note: The Department has no out-of-state reciprocity.

- **WRITTEN RETEST** — If the student fails the written test, a retest can be performed. The retest is open book. The time limit is 2.5 hours. A minimum grade of 70 is required. A retest will not be given on the same day as the initial test. A retest must be taken by the end of the academic year that the initial test was taken. The academic year runs from September 1<sup>st</sup> to August 31<sup>st</sup>. Failure of a written retest, or failure to comply with the academic year retest time limit, shall require the student to retake the class and the test. The student shall be required to pay the appropriate fee for the additional class.
- **NOTIFICATION** — The student will be notified by letter of their test score. A certificate of completion will be issued if the student passes the course, and 12 professional development hours earned will be indicated on the certificate. Once trained, the Department will not require the individual to take the class again for recertification purposes.





# **PREFACE**

This manual has been prepared to train the student to become a Level III Portland Cement Concrete (PCC) Technician. The main focus of the manual is to provide a procedure to design concrete mixes for Illinois Department of Transportation (herein referred to as "IDOT" or the "Department") Quality Control/Quality Assurance (QC/QA) projects. The manual summarizes various specifications, but project contract specifications shall govern in all cases. The manual provides basic information and is intended to be a useful reference tool. This manual is applicable for the April 1, 2016, Standard Specifications for Road and Bridge Construction, and the Supplemental Specifications and Recurring Special Provisions, Adopted: April 1, 2016.

The American Concrete Institute (ACI) procedure for determining the mix design target strength from the minimum specification strength requirement, statistical average/standard deviation, workability and other information in this manual were obtained from a course sponsored by the Federal Highway Administration (FHWA) and the Iowa Department of Transportation (DOT). The course "Introduction to Designing and Proportioning Portland Cement Concrete Mixtures" explained the American Concrete Institute's method for concrete mix design. Portions from that manual have been reproduced herein as permitted by the FHWA and Iowa DOT.



### Revision History and Document Control

The Portland Cement Concrete Level III Technician Course Manual will be reviewed annually by the Engineer of Concrete and Soils for adequacy and updated as necessary to reflect current policies and technology changes. Updates are made to the electronic file as needed and hard copies are uncontrolled. Archive versions are available to examine in the Bureau of Materials and Physical Research.

| <u>Revision Date</u> | <u>Description</u>   | <u>Approval</u> |
|----------------------|--|-----------------|
| February 1, 2016     | Updated reference in Preface to Standard Specifications and Supplemental Specifications and Recurring Special Provisions.  | Dan Tobias      |
| February 1, 2016     | Updated links and website directions throughout manual.  | Dan Tobias      |
| February 1, 2016     | Applicable Specifications section: Updated reference to Standard Specifications, updated reference to CAM II article, and added reference to Drilled Shafts GBSP.          | Dan Tobias      |
| February 1, 2016     | 1.2.2: Updated website link for ConcreteWorks software.  | Dan Tobias      |
| February 1, 2016     | 2.8.2.2: Added discussion regarding cases allowing mortar factors greater than 1.00.   | Dan Tobias      |
| February 1, 2016     | 2.8.3: Corrected reference regarding volume fraction.  | Dan Tobias      |
| February 1, 2016     | 8.0: Corrected reference regarding Design Mortar Factor section, and added verbiage allowing mortar factor greater than 0.86 for Class BS structural lightweight concrete. | Dan Tobias      |
| February 1, 2016     | Appendix B-A: Updated 5 figures.   | Dan Tobias      |
| February 1, 2016     | Appendix F: Updated reference to CAM II article.   | Dan Tobias      |



# **TABLE OF CONTENTS**

|   |              |
|---|--------------|
| <b>DEFINITIONS .....</b>  | <b>xi</b>    |
| <b>APPLICABLE SPECIFICATIONS .....</b>  | <b>xiv</b>   |
| <b>CLASS OF CONCRETE .....</b>  | <b>xv</b>    |
| <b>UNITS OF MEASURE CONVERSION .....</b>  | <b>xvi</b>   |
| <b>SIGNIFICANT DIGITS AND ROUNDING .....</b>  | <b>xvii</b>  |
| <b>ABBREVIATIONS .....</b>  | <b>xviii</b> |
| <b>1.0 MIX DESIGN OVERVIEW .....</b>  | <b>1</b>     |
| 1.1 MIX DESIGN SUBMITTAL  |              |
| 1.2 MIX DESIGN SOFTWARE   |              |
| 1.2.1 Department Software   |              |
| 1.2.2 Available Software Applications   |              |
| <b>2.0 CONCRETE MIX DESIGN DEVELOPMENT USING IDOT METHOD .....</b>  | <b>3</b>     |
| 2.1 INTRODUCTION – ABSOLUTE VOLUME  |              |
| 2.2 CEMENT FACTOR   |              |
| 2.2.1 Cement Factor for Class or Type of Concrete   |              |
| 2.2.2 Allowable Cement Factor Reduction – Admixture   |              |
| 2.3 CEMENT ABSOLUTE VOLUME CALCULATION  |              |
| 2.4 FINELY DIVIDED MINERALS ABSOLUTE VOLUME CALCULATION   |              |
| 2.4.1 Cement Replacement with Finely Divided Minerals and The Optional Use of<br>Microsilica and High Reactivity Metakaolin (HRM) |              |
| 2.4.1.1 Fly Ash   |              |
| 2.4.1.2 Ground Granulated Blast-Furnace Slag  |              |
| 2.4.1.3 Microsilica   |              |
| 2.4.1.4 High-Reactivity Metakaolin (HRM)  |              |
| 2.4.2 Use of Finely Divided Minerals in Ternary Concrete Mix Designs  |              |
| 2.4.3 Mitigation of Alkali-Silica Reaction with Finely Divided Minerals   |              |
| 2.4.4 Use of Finely Divided Minerals in Mass Concrete   |              |
| 2.5 WATER ABSOLUTE VOLUME CALCULATION   |              |
| 2.5.1 Basic Water Requirement   |              |
| 2.5.1.1 Fine Aggregate Basic Water Requirement  |              |
| 2.5.1.2 Coarse Aggregate Basic Water Requirement  |              |
| 2.5.1.3 Basic Water Requirement Total   |              |
| 2.5.2 Adjustment to Basic Water Requirement   |              |
| 2.5.3 Required Use of Admixtures  |              |
| 2.5.4 Optional Use of Admixtures  |              |

|            |   |           |
|------------|---|-----------|
| 2.6        | ADJUSTED BASIC WATER REQUIREMENT AND WATER/CEMENT RATIO           |           |
| 2.7        | AIR CONTENT ABSOLUTE VOLUME CALCULATION                           |           |
| 2.7.1      | Minimum Air Content   |           |
| 2.8        | FINE AND COARSE AGGREGATE ABSOLUTE VOLUMES CALCULATIONS           |           |
| 2.8.1      | Voids in Coarse Aggregate   |           |
| 2.8.2      | Mortar Factor   |           |
| 2.8.2.1    | General Concept   |           |
| 2.8.2.2    | Design Mortar Factor  |           |
| 2.8.3      | Coarse Aggregate Absolute Volume Calculation                      |           |
| 2.8.4      | Fine Aggregate Absolute Volume Calculation                        |           |
| 2.8.5      | Converting Aggregate Absolute Volume to Mass (Weight)             |           |
| 2.9        | EXAMPLE PROBLEM   |           |
| 2.9.1      | Example Using Metric Units  |           |
| 2.9.2      | Example Using English Units                                       |           |
| 2.10       | SUMMARY OF MIX DESIGN EQUATIONS                                   |           |
| <b>3.0</b> | <b>SPECIALTY MIXES .....</b>                                      | <b>32</b> |
| 3.1        | HIGH-EARLY-STRENGTH CONCRETE MIXTURES                             |           |
| 3.2        | OTHER MIXTURES  |           |
| 3.3        | SYNTHETIC FIBERS  |           |
| <b>4.0</b> | <b>TERNARY CONCRETE MIX DESIGNS .....</b>                         | <b>34</b> |
| <b>5.0</b> | <b>MASS CONCRETE MIX DESIGNS .....</b>                            | <b>35</b> |
| <b>6.0</b> | <b>CONCRETE MIX DESIGN—TRIAL MIXTURE .....</b>                    | <b>36</b> |
| 6.1        | SLUMP   |           |
| 6.2        | STRENGTH  |           |
| 6.3        | PROCEDURE FOR TRIAL MIXTURE                                       |           |
| <b>7.0</b> | <b>DETERMINING THE CONCRETE MIX DESIGN TARGET STRENGTH .....</b>  | <b>41</b> |
| <b>8.0</b> | <b>REQUIREMENTS FOR CONCRETE DURABILITY TEST DATA .....</b>       | <b>43</b> |
| <b>9.0</b> | <b>DEPARTMENT CONCRETE MIX DESIGN VERIFICATION .....</b>          | <b>44</b> |
| 9.1        | VERIFICATION BY THE ENGINEER                                      |           |
| 9.2        | TESTING PERFORMED BY THE ENGINEER                                 |           |
| 9.2.1      | Procedure for Trial Batch   |           |
| 9.2.1.1    | Verification of Trial Batch, Voids Test, and Durability Test Data |           |

# **TABLE OF CONTENTS**

## **(Continued)**

### **Appendices**

- Appendix A** Special Provision for Concrete Mix Design – Department Provided (BDE)
- Appendix B** PCC Mix Design MISTIC Printout and Instructions  
PCC Mix Design Software Tutorial (Version 2.4)
- Appendix C** Illinois Test Procedure 306 – Voids Test of Coarse Aggregate for Concrete Mixtures
- Appendix D** Workability
- Appendix E** Aggregate Blending
- Appendix F** Cement Aggregate Mixture II (CAM II)
- Appendix G** Controlled Low-Strength Material (CLSM)
- Appendix H** Stamped or Integrally Colored Concrete
- Appendix I** Concrete Revetment Mats
- Appendix J** Insertion Lining of Pipe Culverts (Grout)
- Appendix K** Insertion Lining of Pipe Culverts (Cellular Concrete)
- Appendix L** Class SI Concrete Between Precast Concrete Box Culverts
- Appendix M** Pervious Concrete
- Appendix N** Average and Standard Deviation
- Appendix O** Alkali-Silica Reaction Mitigation Flow Chart
- Appendix P** Bridge Deck Latex Concrete Overlay Mix Design





## DEFINITIONS

**Absolute Volume** — The solid volume, excluding the voids between the particles. It is expressed as the ratio of the loose materials mass (weight), to the solid mass (weight) per volume, of the same material.

**Absorption** — The moisture content at which the saturated surface-dry condition occurs.

**Alkali-Silica Reaction** — The reaction of alkalis in cement with siliceous material in some aggregates. The reaction requires water and produces a gel which expands and cracks the concrete.

**Blended Cement** — A hydraulic cement which meets the requirements of AASHTO M 240 (ASTM C 595). The hydraulic cement consists of portland cement and one or more inorganic constituents.

**Cement Aggregate Mixture II (CAM II)** — A lean (low cement and finely divided mineral) concrete mixture for stabilized subbase.

**Cement Factor** — The number of kilograms of cement per cubic meter (metric). The number of pounds of cement per cubic yard (English). Cement factor is the same as cement content. Cement is packaged in bags of 42.6 kg (94 lb) nominal weight.

**Cementitious Material** — A general term to indicate fly ash, ground granulated blast-furnace slag, microsilica, or high-reactivity metakaolin. However, the term is misleading because none of these materials have cementitious characteristics. The term may be used interchangeably with Finely Divided Mineral.

**Chips** — The aggregate particle size range between the 4.75 mm (No.4) and 12.5 mm (1/2 in.) sieves.

**Coarse Aggregate** — A gradation number CA 1-19 as defined by the Standard Specifications. For an aggregate blend, the coarse aggregate portion is normally considered to be all material retained on or above the 4.75 mm (No. 4) sieve.

**Concrete** — A mixture consisting of cement, water, and aggregates as a minimum. Admixtures and finely divided minerals may be added.

**Consistency** — The ability of freshly mixed concrete to flow. Consistency is measured by the slump test.

**Controlled Low-Strength Material (CLSM)** — A self-consolidating mortar mixture, which is typically used as a backfill.

**Final Set** — The point of time where the concrete is no longer plastic and finishing no longer can take place. This will typically occur 5 to 8 hours after batching the concrete.

**Fine Aggregate** — A gradation number FA 1-10, 20, and 21 as defined by the Standard Specifications. For an aggregate blend, the fine aggregate portion is normally considered to be all material passing the 4.75 mm (No. 4) sieve.

**Finely Divided Mineral** — A general term to indicate fly ash, ground granulated blast-furnace slag, microsilica, or high-reactivity metakaolin. The term may be used interchangeably with Cementitious Material.

**Fineness Modulus** — The Fineness Modulus (FM) is an index of the fineness of an aggregate. The higher the FM, the coarser the aggregate. The Fineness Modulus is used to estimate proportions of fine and coarse aggregate in concrete mixtures.

**Fly Ash** — The fine residue that results from the combustion of ground or powdered coal.

**Gap Graded** — Aggregates which have specific particle sizes omitted, or the specific particle sizes are minimal.

**Ground Granulated Blast-Furnace (GGBF) Slag** — The glassy granular material formed when molten blast-furnace slag is rapidly chilled, and then finely ground.

**High-Reactivity Metakaolin (HRM)** — A manufactured product formed by calcining purified kaolinite, at a specific temperature range.

**Hundredweight (cwt)** — A unit of measure equal to 100 pounds.

**Initial Set** — The point of time where the concrete begins to become firm. This will typically occur 2 to 4 hours after batching the concrete.

**Maximum Size** — The smallest sieve on which 100 percent of the aggregate sample particles pass.

**Microsilica** — The extremely fine by-product that results from the manufacture of silicon or silicon alloys.

**Mix Design Target Strength** — The average strength the concrete mix must attain to ensure the specified strength is met.

**Mortar** — The fine aggregate, cement, finely divided minerals, water, and air in a concrete mixture.

**Mortar Factor** — The volume of mortar per volume of dry rodded coarse aggregate.

**Nominal Maximum Size** — The largest sieve which retains any of the aggregate sample particles.

**Oven-Dry Condition** — The aggregates have been heated until completely dry. There is no free moisture on the surface of the individual aggregate particles. There is no absorbed moisture in the pores of the individual aggregate particles.

**Oven-Dry Specific Gravity** — The ratio of the mass (weight) of a volume of oven dry material, to the mass (weight) of an equal volume of water.

**Paste** — The cement, finely divided minerals, water, and air in a concrete mixture.

**Plasticity** — The ease of molding the concrete. A plastic concrete mixture will maintain suspension of the aggregates.

**Pervious Concrete** — A permeable concrete that allows water to infiltrate the concrete and drain into the soil beneath it. The zero slump concrete mixture has little or no fine aggregate.

**Portland Cement** — A hydraulic cement which meets the requirements of AASHTO M 85 (ASTM C 150).

**Saturated Surface-Dry Condition** — There is no free moisture on the surface of the individual aggregate particles. All possible moisture which can be absorbed into the pores of the individual aggregate particles has occurred.

**Saturated Surface-Dry Specific Gravity** — The ratio of the mass (weight) of a volume of saturated surface-dry material, to the mass (weight) of an equal volume of water.

**Standard Specifications** — The Standard Specifications for Road and Bridge Construction.

**Supplementary Cementitious Material** — See definition for Cementitious Material.

**Ternary Mix Design** — A mix design consisting of cement and two finely divided minerals. The finely divided mineral in portland-pozzolan cement or portland blast-furnace slag cement shall count as one of the two finely divided minerals allowed.

**Trial Batch** — A batch of concrete tested by the Engineer to verify the Contractor's mix design will meet specification requirements.

**Trial Mixture** — A batch of concrete tested by the Contractor to verify the Contractor's mix design will meet specification requirements.

**Uniformly Graded** — Aggregates which do not have a large deficiency or excess of any particle size.

**Voids** — The volume of voids per unit volume of dry rodded coarse aggregate. In other words, voids is the ratio of the volume of empty spaces in a unit volume of coarse aggregate to the unit volume of coarse aggregate.

**Wash Water** — Residual rinse water in the drum of a truck mixer or truck agitator.

**Water/Cement Ratio** — The mass (weight) of water, divided by the mass (weight) of cement. The water shall include mixing water, water in admixtures, free moisture on the aggregates, and water added at the job site.

When fly ash, ground granulated blast-furnace slag, microsilica, or high-reactivity metakaolin are used in a concrete mix, the water/cement ratio will be based on the total cement and finely divided minerals contained in the mixture.

**Workability** — A measure of how easy or difficult it is to place, consolidate, and finish concrete.

**Yield** — The volume of freshly mixed concrete from a known quantity of materials.

# APPLICABLE SPECIFICATIONS

## Standard Specifications for Road and Bridge Construction

The Level III PCC Technician shall be familiar with the following Sections or Articles of the April 1, 2016, Standard Specifications for Road and Bridge Construction.

|                |   |
|----------------|---|
| Article 285.05 | Fabric Formed Concrete Revetment Mat                      |
| Article 312.09 | Proportioning (Cement Aggregate Mixture II)               |
| Article 540.06 | Precast Concrete Box Culverts (Class SI Between Sections) |
| Section 543    | Insertion Lining of Pipe Culverts                         |
| Section 1001   | Cement  |
| Section 1003   | Fine Aggregate  |
| Section 1004   | Coarse Aggregate  |
| Section 1010   | Finely Divided Minerals                                   |
| Section 1019   | Controlled Low-Strength Material                          |
| Section 1020   | Portland Cement Concrete                                  |
| Section 1021   | Concrete Admixtures                                       |

To view or download the [Standard Specifications for Road and Bridge Construction](#) (link embedded) on the Internet go to <http://www.idot.illinois.gov/>; Doing Business; Procurements; Engineering, Architectural & Professional Services; Consultant Resources; Standard Specifications. In addition to the Standard Specifications, it is important for the Level III PCC Technician to be familiar with the [Supplemental Specifications and Recurring Special Provisions](#) (link embedded) document and the [Bureau of Design and Environment \(BDE\) Special Provisions](#) (link embedded). They are also found under Consultant Resources (scroll down to Letting Specific Items to find the BDE Special Provisions) and may be downloaded. The Supplemental Specifications are a supplement to the Standard Specifications. The Recurring Special Provisions are frequently included by reference, in selected contracts. The BDE Special Provisions are frequently included, by insertion, in selected contracts.

## Guide Bridge Special Provisions

The Level III PCC Technician shall also be familiar with the following [Guide Bridge Special Provisions \(GBSP\)](#) (link embedded).

Deck Slab Repair  
 Bridge Deck Microsilica Concrete Overlay  
 Bridge Deck Latex Concrete Overlay  
 Bridge Deck High-Reactivity Metakaolin (HRM) Concrete Overlay  
 Concrete Wearing Surface  
 Structural Repair of Concrete  
 Bridge Deck Fly Ash or Ground Granulated Blast-Furnace Slag Overlay  
 Bridge Deck Construction  
 Drilled Shafts

To view or download the GBSP, go to <http://www.idot.illinois.gov/>; Doing Business; Procurements; Engineering, Architectural & Professional Services; Consultant Resources; Supplemental Specifications and Recurring Special Provisions. The GBSP are frequently included, by insertion, in selected contracts.

## **CLASS OF CONCRETE**

| <b>Class Designation</b> | <b>Description</b>                    |
|--------------------------|---------------------------------------|
| PV                       | Pavement                              |
| PP                       | PCC Patching                          |
| RR                       | Railroad Crossing                     |
| BS                       | Bridge Superstructure                 |
| PC                       | Precast Concrete                      |
| PS                       | Precast Prestressed                   |
| DS                       | Drilled Shaft                         |
| SC                       | Seal Coat                             |
| SI                       | Structures<br>(except superstructure) |

Refer to Article 1020.04 for additional information.

## UNITS OF MEASURE CONVERSION

| Conversion  | From English   | To Metric                      | Multiply Quantity by* |
|-------------|--|--------------------------------|-----------------------|
| LENGTH      | inch (in.)   | millimeter (mm)                | 25.4                  |
|             | foot (ft)  | millimeter (mm)                | 304.8                 |
|             | foot (ft)  | meter (m)                      | 0.3048                |
|             | yard (yd)  | meter (m)                      | 0.9144                |
| AREA        | square inch (in. <sup>2</sup> )  | square mm (mm <sup>2</sup> )   | 645.16                |
|             | square foot (ft <sup>2</sup> )   | square meter (m <sup>2</sup> ) | 0.092903              |
|             | square yard (yd <sup>2</sup> )   | square meter (m <sup>2</sup> ) | 0.836127              |
| VOLUME      | cubic inch (in. <sup>3</sup> )   | cubic mm (mm <sup>3</sup> )    | 16387.06              |
|             | cubic foot (ft <sup>3</sup> )  | cubic meter (m <sup>3</sup> )  | 0.028316              |
|             | cubic yard (yd <sup>3</sup> )  | cubic meter (m <sup>3</sup> )  | 0.764555              |
|             | gallon (gal)   | liter (L)                      | 3.78541               |
| MASS        | ounces (oz)  | grams (g)                      | 28.349523             |
|             | pound (lb)   | kilogram (kg)                  | 0.453592              |
| FORCE       | pound (lb)   | Newton (N)                     | 4.44822               |
| MASS/AREA   | oz/yd <sup>2</sup>   | kg/m <sup>2</sup>              | 0.0339057             |
|             | lb/ft <sup>2</sup>   | kg/m <sup>2</sup>              | 4.8824                |
|             | lb/yd <sup>2</sup>   | kg/m <sup>2</sup>              | 0.5425                |
| MASS/VOLUME | lb/ft <sup>3</sup>   | kg/m <sup>3</sup>              | 16.01894              |
|             | lb/yd <sup>3</sup>   | kg/m <sup>3</sup>              | 0.5933                |
| TEMPERATURE | English to Metric: $^{\circ}\text{C} = \frac{(^{\circ}\text{F} - 32)}{1.8}$ Metric to English: $^{\circ}\text{F} = 1.8 \times ^{\circ}\text{C} + 32$ |                                |                       |

\* To convert from metric to English, **divide** metric quantity by value given in table. For example, 380 mm equals 15.0 in. ( $380 \div 25.4 = 14.96$ ).

# **SIGNIFICANT DIGITS AND ROUNDING**

## **Significant Digits:**

Whole Number: Cement, Finely Divided Minerals, Coarse and Fine Aggregate, Batch Water

One Digit to Right of Decimal: Basic Water Requirement (English), Air Content

Two Digits to Right of Decimal: Specific Gravity, Unit Weight, Water/Cement Ratio,  
Basic Water Requirement (Metric), Mortar Factor, Voids

Three Digits to Right of Decimal: Absolute Volume

## **Rounding:**

When the digit beyond the last place to be retained (or reported) is equal to or greater than 5, increase by 1 the digit in the last place retained.

# **ABBREVIATIONS**

|           |  |
|-----------|--|
| AASHTO    | American Association of State Highway and Transportation Officials |
| ACI       | American Concrete Institute  |
| ASR       | Alkali-Silica Reaction   |
| ASTM      | American Society for Testing and Materials                         |
| BDE       | Bureau of Design and Environment                                   |
| CA        | Coarse Aggregate   |
| CAM II    | Cement Aggregate Mixture II  |
| CCRL      | Cement and Concrete Reference Laboratory                           |
| CLSM      | Controlled Low-Strength Material                                   |
| DEF       | Delayed Ettringite Formation                                       |
| DOT       | Department of Transportation                                       |
| FA        | Fine Aggregate   |
| FM        | Fineness Modulus   |
| FDM       | Finely Divided Mineral   |
| FHWA      | Federal Highway Administration                                     |
| GBSP      | Guide Bridge Special Provision                                     |
| GGBF Slag | Ground Granulated Blast-Furnace Slag                               |
| HRM       | High-Reactivity Metakaolin   |
| ITP       | Illinois Test Procedure  |
| MISTIC    | Materials Integrated System for Test Information and Communication |
| NIST      | National Institute of Standards and Technology                     |
| PCA       | Portland Cement Association  |
| PCC       | Portland Cement Concrete   |
| QC/QA     | Quality Control/Quality Assurance                                  |
| SSD       | Saturated Surface-Dry  |



## 1.0 MIX DESIGN OVERVIEW

### 1.1 MIX DESIGN SUBMITTAL

The Department's mix design method is based upon previously established properties of the materials and the intended use of the concrete. The original design criteria for the Department's method can be found in the University of Illinois Engineering Experiment Station Bulletin No. 137, which was published in October, 1923. The document is entitled "The Strength of Concrete and Its Relation to the Cement Aggregates and Water" by Arthur N. Talbot and Frank E. Richart.

The requirements for providing a mix design are specified in Article 1020.05. This Article states, "For all Classes of concrete, it shall be the Contractor's responsibility to determine mix design material proportions and to proportion each batch of concrete. A Level III PCC Technician shall develop the mix design for all Classes of concrete, except Classes PC and PS." However, refer to Appendix A for a special provision that allows a District to provide a mix design. The special provision only applies when it is inserted into a contract.

The Contractor mix design submittal shall include the following: date, Class or type of concrete, source of materials, fine aggregate Type (a classification provided by Department's District office that is related to water demand), gradation of fine and coarse aggregates, coarse aggregate voids (determined by the Contractor, unless provided by the District), specific gravities (provided by Department's District office), material proportions (batch weights or mass), water/cement ratio, mortar factor, type and proposed dosage of admixtures, target slump, target air content, and mix design strength. The submittal of trial mixture and target strength information is recommended. For submittal of durability test data, refer to 8.0 "Requirements for Concrete Durability Test Data."

For self-consolidating concrete, the submittal is the same except target slump flow (instead of slump), and target J-ring value or L-box blocking ratio are required.

Once the Engineer verifies the Contractor's mix design according to 9.0 "Department Concrete Mix Design Verification," the mix design information will be entered into the Department's Materials Integrated System for Test Information and Communication (MISTIC) database. The Contractor will be provided a printout of the mix design from MISTIC, which will include the Department's mix design number. Refer to Appendix B for a copy of the printout and input instructions.

During construction, changes may occur which will affect the mix design. The following items will require re-submittal and verification of a mix design:

- Voids of the coarse aggregate change more than 0.02 from the original mix design.
- Specific gravity of an aggregate changes more than 0.02 from the original mix design.
- Specific gravity of the cement or a finely divided mineral changes more than 0.04 from the original mix design.
- Mortar factor is changed more than 0.05 from the original mix design.
- Water/cement ratio is increased more than 0.04 from the original mix design.
- A change in materials.

## 1.2 MIX DESIGN SOFTWARE

### 1.2.1 Department Software

An Excel spreadsheet, “PCC Mix Design,” is available from the Department’s internet site to facilitate the calculation and submittal of a PCC mix design using the IDOT method. To download the program, go to <http://www.idot.illinois.gov/>; Doing Business; Material Approvals; Concrete, References; Guides/Spreadsheets.

### 1.2.2 Available Software Applications

For those individuals who want to expand their mix design knowledge, the following websites have useful information.

- **COST, developed by the Federal highway Administration (FHWA) and the National Institute of Standards and Technology (NIST).**

The website is <http://ciks.cbt.nist.gov/cost/>.

COST (Concrete Optimization Software Tool) is an online design/analysis system to assist in determining optimal mixture proportions for concrete.

- **COMPASS, developed by The Transtec Group, Inc. through funding from FHWA.**

The website is <http://www.pccmix.com/>.

COMPASS (Concrete Mixture Performance Analysis System Software) grew out of the web-based application tool COST. COMPASS has two key components, a knowledge base and a set of four computer modules. The knowledge base supplies information on concrete properties, testing methods, and material characteristics and compatibilities. The computer modules allow the user to define inputs such as importance of the project, type of pavement, climatic conditions, construction constraints, environmental exposures, and criteria (such as strength, cost, and permeability) that are specific to the project.

- **ConcreteWorks** developed at the Concrete Durability Center at the University of Texas as part of research funded by the Texas Department of Transportation.

The website is <http://www.txdot.gov/inside-txdot/division/information-technology/engineering-software.external.html>.

The ConcreteWorks software includes ConcreteWorks and MixProportions. The ConcreteWorks program can calculate mass concrete temperature development. The MixProportions is a concrete mixture proportioning program based on the recommendations of ACI 211.

The above software applications are not to replace the Department’s software, but may be used to improve the Department’s mix design.

## 2.0 CONCRETE MIX DESIGN DEVELOPMENT USING IDOT METHOD

### 2.1 INTRODUCTION – ABSOLUTE VOLUME

The basic materials required for concrete are cement, finely divided minerals, fine and coarse aggregates, water, and entrained air. Concrete meeting the requirements of strength and durability will demand accurate proportioning of these basic materials.

The Department's mix design method is based on a volume of 1 cubic yard (1 cubic meter) of concrete. Therefore, the basis of concrete proportioning is determining the absolute volume of the component materials. Absolute volume is defined as the solid volume, excluding the voids between the particles. Therefore, 1 cubic yard (1 cubic meter) of concrete is the sum of the absolute volumes of all the materials.

### 2.2 CEMENT FACTOR

Through years of laboratory experimentation and field experience, the Department has determined the approximate amount of cement needed to meet durability requirements after construction. The cement factor is obtained from 2.2.1 "Cement Factor for Class or Type of Concrete." The cement factor may be reduced based on the type of admixture used, refer to 2.2.2 "Allowable Cement Factor Reduction – Admixture."

Note: For the various Classes of concrete, the portland cement content in the mixture shall be a minimum of 400 lb/cu yd (237 kg/cu m), unless the mix design is shown to be freeze-thaw durable according to AASHTO T 161. Refer to Articles 1020.04 and 1020.05(a) for additional information. Furthermore, the minimum portland cement content may be lower when required to control the heat of hydration for structures according to Article 1020.15.

#### 2.2.1 Cement Factor for Class or Type of Concrete

Cement is specified in terms of hundredweights per cubic yard (kilograms per cubic meter). The number of hundredweights of cement used per cubic yard (kilograms per cubic meter) of concrete is the cement factor.

Refer to Table 2.2.1 for the required cement factor when using portland cement, portland-pozzolan cement, portland blast-furnace slag cement, or portland-limestone cement.

#### 2.2.2 Allowable Cement Factor Reduction – Admixture

For Class PV, PP-1, RR, SC, and SI concrete, a water-reducing admixture or a high range water-reducing admixture may reduce the cement factor a maximum 0.30 cwt/yd<sup>3</sup> (18 kg/m<sup>3</sup>). However, a cement factor reduction will not be allowed for concrete placed underwater.

**Table 2.2.1 Cement Factor for Class or Type of Concrete**

| Class or Type of Concrete   | Minimum Cement Factor<br>cwt/yd <sup>3</sup> (kg/m <sup>3</sup> ) | Maximum Cement Factor<br>cwt/yd <sup>3</sup> (kg/m <sup>3</sup> ) |
|---|---|---|
| PV  | 5.65 (335) <sup>1,2</sup><br>6.05 (360) <sup>1,3</sup>            | 7.05 (418)  |
| PP-1  | 6.50 (385) <sup>1</sup><br>6.20 (365) <sup>1,4</sup>              | 7.50 (445)<br>7.20 (425) <sup>4</sup>                             |
| PP-2  | 7.35 (435)  | 8.20 (485)  |
| PP-3  | 7.35 (435) <sup>5</sup>   | 7.35 (435) <sup>5</sup>   |
| PP-4  | 6.00 (355) <sup>6</sup>   | 6.25 (370) <sup>6</sup>   |
| PP-5  | 6.75 (400) <sup>7</sup>   | 6.75 (400) <sup>7</sup>   |
| RR  | 6.50 (385) <sup>1</sup><br>6.20 (365) <sup>1,4</sup>              | 7.50 (445)<br>7.20 (425) <sup>4</sup>                             |
| BS  | 6.05 (360)  | 7.05 (418)  |
| PC  | Wet Cast: 5.65 (335)<br>Dry Cast: 5.65 (335) <sup>4</sup>         | Wet Cast: 7.05 (418)<br>Dry Cast: 7.05 (418) <sup>4</sup>         |
| PS  | 5.65 (335)  | 7.05 (418)  |
|   | 5.65 (335) <sup>4</sup>   | 7.05 (418) <sup>4</sup>   |
| DS  | 6.65 (395)  | 7.05 (418)  |
| SC <sup>8</sup>   | 5.65 (335) <sup>1,2</sup><br>6.05 (360) <sup>1,3</sup>            | 7.05 (418)  |
|   | 5.65 (335) <sup>1,2</sup><br>6.05 (360) <sup>1,3</sup>            | 7.05 (418)  |
| SI  | 5.65 (335) <sup>1,2</sup><br>6.05 (360) <sup>1,3</sup>            | 7.05 (418)  |
| Deck Slab Repair  | Refer to PP-1, 2, 3, 4, and 5                                     | Refer to PP-1, 2, 3, 4, and 5                                     |
| Formed Concrete Repair  | 6.65 (395)  | 6.65 (395)  |
| Concrete Wearing Surface  | Refer to Class BS Concrete  | Refer to Class BS Concrete  |
| Bridge Deck Fly Ash or<br>GGBF Slag<br>Concrete Overlay <sup>9</sup>        | Refer to Class BS Concrete  | Refer to Class BS Concrete  |
| Bridge Deck Microsilica<br>Concrete Overlay <sup>10</sup>                   | 5.65 (335)  | 5.65 (335)  |
| Bridge Deck High-Reactivity<br>Metakaolin Concrete<br>Overlay <sup>11</sup> | 5.65 (335)  | 5.65 (335)  |
| Bridge Deck Latex Concrete<br>Overlay <sup>12</sup>                         | 6.58 (390)  | 6.58 (390)  |

## Notes:

1. Refer to 2.2.2 "Allowable Cement Factor Reduction – Admixture" for allowable cement factor reduction.
2. Central-mixed.
3. Truck-mixed or shrink-mixed.
4. Type III cement.
5. In addition to the Type III portland cement, 100 lb/yd<sup>3</sup> (60 kg/m<sup>3</sup>) of ground granulated blast-furnace slag and 50 lb/yd<sup>3</sup> (30 kg/m<sup>3</sup>) of microsilica (silica fume) shall be used. For an air temperature greater than 85 °F (30 °C), the Type III portland cement may be replaced with Type I or II cement.
6. The cement shall be a rapid hardening cement from the Department's "Approved/Qualified Product List of Packaged, Dry, Rapid Hardening, Cementitious Materials for Concrete Repair" for PP-4.
7. The cement shall be calcium aluminate cement for PP-5.
8. For Class SC concrete and for any class of concrete that is to be placed under water, except Class DS concrete, the cement factor shall be increased by ten percent.
9. The portland cement shall be replaced with 25 percent Class F fly ash, or 25-30 percent Class C fly ash, or 25-35 percent ground granulated blast-furnace slag.
10. In addition to the cement, 33 lb/yd<sup>3</sup> (20 kg/m<sup>3</sup>) of microsilica is required in the mix design.
11. In addition to the cement, 37 lb/yd<sup>3</sup> (22 kg/m<sup>3</sup>) of high-reactivity metakaolin is required in the mix design.
12. In addition to the cement, 24.5 gallons (121.3 liters) of latex admixture is required in the mix design.

### 2.3 CEMENT ABSOLUTE VOLUME CALCULATION

The absolute volume of the cement can be determined as follows:

*English* (per cubic yard):

$$\text{The absolute volume of cement, } V_{\text{Cement}} = \frac{\text{Weight of Cement}}{\text{Specific Gravity of Cement} \times \text{Unit Weight of Water}}$$

The “weight of cement” is provided by the cement factor (hundredweights per cubic yard) converted to pounds per cubic yard by multiplying by 100. The “specific gravity of cement” is normally assumed to be 3.15, but the actual value may be used. The “unit weight of water” is 1,683.99 pounds per cubic yard.

*Metric* (per cubic meter):

$$\text{The absolute volume of cement, } V_{\text{Cement}} = \frac{\text{Mass of Cement}}{\text{Specific Gravity of Cement} \times \text{Unit Weight of Water}}$$

The “mass of cement” is provided by the cement factor in kilograms per cubic meter. The “specific gravity of cement” is assumed to be 3.15, but the actual value may be used. The “unit weight of water” is 1,000.00 kilograms per cubic meter.

However, be advised that blended cement (e.g., portland-pozzolan, portland-limestone, etc.) may have a specific gravity which is significantly different from 3.15, and this value should be verified with the District.

**If the specific gravity of the cement changes more than 0.04 from the original mix design value, a new mix design will be required.**

### 2.4 FINELY DIVIDED MINERALS ABSOLUTE VOLUME CALCULATION

A portion of cement may be replaced with finely divided minerals. The replacement is commonly done for economic reasons, to mitigate for alkali-silica reaction, to lower the heat of hydration, and/or to lower the concrete’s permeability, which will slow down chloride penetration.

Finely divided minerals (FDMs) are measured in pounds (kilograms). The absolute volume of a finely divided mineral is determined as follows:

*English* (per cubic yard):

The absolute volume of a finely divided mineral,

$$V_{\text{FDM}} = \frac{\text{Weight of FDM}}{\text{Specific Gravity of FDM} \times \text{Unit Weight of Water}}$$

The “weight of FDM” is provided in pounds per cubic yard. The “unit weight of water” is 1,683.99 pounds per cubic yard.

*Metric* (per cubic meter):

The absolute volume of a finely divided mineral,

$$V_{\text{FDM}} = \frac{\text{Mass of FDM}}{\text{Specific Gravity of FDM} \times \text{Unit Weight of Water}}$$

The “mass of FDM” is provided in kilograms per cubic meter. The “unit weight of water” is 1,000.00 kilograms per cubic meter.

The specific gravity of a finely divided mineral is obtained from the “Approved/Qualified Producer List of Finely Divided Minerals.” It is found under the “Average Specific Gravity” column. To view or download this list on the Internet, go to <http://www.idot.illinois.gov>; Doing Business; Materials; Cement; Qualified Product Lists.

**If the specific gravity of a finely divided mineral changes more than 0.04 from the original mix design value, a new mix design will be required.**

For Class PP-3 concrete, bridge deck fly ash or GGBF slag overlay, bridge deck microsilica overlay, and bridge deck high-reactivity metakaolin overlay, refer to 2.2.1 “Cement Factor for Class or Type of Concrete” for additional information regarding required use of finely divided minerals.

#### 2.4.1 Cement Replacement with Finely Divided Minerals and the Optional Use of Microsilica and High Reactivity Metakaolin (HRM)

##### 2.4.1.1 Fly Ash

The following information is according to Article 1020.05(c)(1).

Fly ash may partially replace portland cement in cement aggregate mixture II and the following Classes PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, and SI.

When Class F fly ash is used in cement aggregate mixture II, Class PV, BS, PC, PS, DS, SC, and SI concrete, the amount of cement replaced shall not exceed 25 percent by weight (mass).

When Class C fly ash is used in cement aggregate mixture II, Class PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, and SI concrete, the amount of cement replaced shall not exceed 30 percent by weight (mass).

Measurements of fly ash shall be rounded up the nearest 5 lb/yd<sup>3</sup> (2.5 kg/m<sup>3</sup>).

The following information is according to the applicable Guide Bridge Special Provisions (GBSP):

- For bridge deck microsilica and high-reactivity metakaolin concrete overlays, only Class C fly ash may be used to replace portland cement. The amount of cement replaced shall not exceed 30 percent by weight (mass).
- For bridge deck fly ash or GGBF slag concrete overlay, the portland cement content shall be replaced with 25 percent Class F Fly ash or 25 – 30 percent Class C fly ash.

##### 2.4.1.2 Ground Granulated Blast-Furnace Slag

The following information is according to Article 1020.05(c)(2).

Ground granulated blast-furnace (GGBF) slag may partially replace portland cement in the following Classes: PV, PP-1, PP-2, PP-3, RR, BS, PC, PS, DS, SC, and SI.

When GGBF slag is used in Class PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, and SI concrete, the amount of cement replaced by GGBF slag shall not exceed 35 percent by weight (mass). For Class PP-3 concrete, GGBF slag shall be used according to Article 1020.04, Table 1, Note 8.

Measurements of GGBF slag shall be rounded up to the nearest 5 lb/ yd<sup>3</sup> (2.5 kg/m<sup>3</sup>).

The following information is according to the applicable Guide Bridge Special Provisions (GBSP):

- For bridge deck microsilica and high-reactivity metakaolin concrete overlays, the portland cement may be replaced with GGBF slag. The replacement shall not result in a mixture with portland cement content less than 400 lb/cu yd (237 kg/cu m).
- For bridge deck fly ash or GGBF slag concrete overlay, the portland cement content shall be replaced with 25 – 35 percent GGBF slag.

#### 2.4.1.3 Microsilica

According to Article 1020.05(c)(3), at the Contractor's option, microsilica may be added at a maximum 5.0 percent by weight (mass) of the cement and finely divided minerals summed together.

Microsilica shall be used in Class PP-3 concrete according to Article 1020.04.

#### 2.4.1.4 High Reactivity Metakaolin (HRM)

According to Article 1020.05(b)(4), at the Contractor's option, HRM may be added at a maximum 5.0 percent by weight (mass) of the cement and finely divided minerals summed together.

### 2.4.2 Use of Finely Divided Minerals in Ternary Concrete Mix Designs

Refer to Article 1020.(c)(5) for allowable use of finely divided minerals in ternary mix designs.

### 2.4.3 Mitigation of Alkali-Silica Reaction with Finely Divided Minerals

Alkali-silica reaction (ASR) is the reaction of alkalis in cement with siliceous material in some aggregates. The reaction requires water and produces a gel which expands and cracks the concrete. Refer to Article 1020.05(d) for required use of finely divided minerals to mitigate alkali-silica reaction. Also, it may be helpful to refer to the alkali-silica reaction specification flow chart in Appendix P.

### 2.4.4 Use of Finely Divided Minerals in Mass Concrete

Refer to Article 1020.15 for use of finely divided minerals to reduce heat of hydration in massive structures.

## 2.5 WATER ABSOLUTE VOLUME CALCULATION

The Basic Water Requirement is measured in gallons per hundredweights (liters per kilograms) of total cement and finely divided minerals. The absolute volume of water is determined as follows:

*English* (per cubic yard):

$$\text{The absolute volume of water, } V_{\text{Water}} = \frac{\text{Weight of Water}}{\text{Specific Gravity of Water} \times \text{Unit Weight of Water}}$$

The “weight of water” is provided in pounds per cubic yard. One gallon of water equals 8.33 pounds. The “specific gravity of water” is 1.00. The “unit weight of water” is 1,683.99 pounds per cubic yard.

*Metric* (per cubic meter):

$$\text{The absolute volume of water, } V_{\text{Water}} = \frac{\text{Mass of Water}}{\text{Specific Gravity of Water} \times \text{Unit Weight of Water}}$$

The “mass of water” is provided in kilograms per cubic meter. One liter of water equals 1 kilogram. The “specific gravity of water” is 1.00. The “unit weight of water” is 1,000.00 kilograms per cubic meter.

### 2.5.1 Basic Water Requirement

Since the amount of cement and finely divided minerals used in concrete is specified for the various types of construction, the amount of water used is the most important variable of the design.

The Department determines the basic water requirement by the angularity of the aggregates. As the angularity of the particles increases, the amount of water required in the concrete increases.

#### 2.5.1.1 Fine Aggregate Basic Water Requirement

For fine aggregate angularity, the Department will classify the aggregate as Type A, B, or C, according to the Illinois Method for Fine Aggregate Classification:

- “Type A” fine aggregate is composed completely of rounded particles.
- “Type C” fine aggregate is composed completely of angular particles.
- “Type B” fine aggregate is composed of a mixture of rounded and angular particles.

Therefore, a Type A fine aggregate has the least water demand, and a Type C fine Aggregate has the highest water demand, summarized as follows:

| <b>FA Type</b> | <b>Basic Water Requirement* for<br/>Cement and Finely Divided Minerals</b> |
|----------------|--|
| A              | 5.1 gal/cwt (0.42 L/kg)  |
| B              | 5.3 gal/cwt (0.44 L/kg)  |
| C              | 5.5 gal/cwt (0.46 L/kg)  |

\*In MISTIC, A = 0.426 L/kg, B = 0.442 L/kg, and C = 0.459 L/kg.



If blending fine aggregates that are not the same Type, select the highest water requirement.

The fine aggregate classification as a Type A, B, or C will be provided by the Department's District office.

#### 2.5.1.2 Coarse Aggregate Basic Water Requirement

Due to a greater surface area, crushed coarse aggregate will have greater water demand than rounded coarse aggregate. Furthermore, aggregate particles that are flat and elongated will increase water demand because of greater surface area. If necessary, ITP 4791 can be used to determine the percentage of flat and elongated particles.

Based on experience, the Department allows an additional 0.1 to 0.4 gal/cwt (0.008 to 0.033 L/kg) for the coarse aggregate as follows:

- 0 gal/cwt (0 L/kg) is commonly used for rounded gravel
- 0.2 gal/cwt (0.017 L/kg) is commonly used for crushed gravel and stone
- 0.4 gal/cwt (0.033 L/kg) is commonly used for a lightweight slag aggregate.

Contact the Department's District office if you have any questions.

#### 2.5.1.3 Basic Water Requirement Total

The basic water requirement total is the summation of the water required based on the fine and coarse aggregate angularity. An example calculation for determining basic water requirement is as follows:

**Given:** Fine Aggregate: Type B  
Coarse Aggregate: Crushed Stone

#### **Calculations:**

*English:*

$$\begin{aligned}\text{Basic Water Requirement Total} &= 5.3_{\text{FA}} + 0.2_{\text{CA}} \\ &= 5.5 \text{ gallons/cwt}\end{aligned}$$

*Metric:*

$$\begin{aligned}\text{Basic Water Requirement Total} &= 0.44_{\text{FA}} + 0.017_{\text{CA}} \\ &= 0.46 \text{ liter/kg}\end{aligned}$$

Remember, the Basic Water Requirement is determined in terms of gallons per hundredweight (liters per kilogram) of total cement and finely divided minerals.

### 2.5.2 Adjustment to Basic Water Requirement

The Basic Water Requirement can be adjusted using Table 2.5.2. An example calculation for adjusting the basic water requirement is as follows:

**Given:** A water-reducing admixture is used, and the water content reduction is assumed to be 10 percent. The basic water requirement is 5.5 gal/cwt (0.46 L/kg).

**Calculations:**

*English:*

$$\begin{aligned}\text{Adjusted Basic Water Requirement} &= 5.5 - (5.5 \times 0.10) \\ &= 5.0 \text{ gal/cwt}\end{aligned}$$

*Metric:*

$$\begin{aligned}\text{Adjusted Basic Water Requirement} &= 0.46 - (0.46 \times 0.10) \\ &= 0.41 \text{ L/kg}\end{aligned}$$

If a significant amount of admixtures (such as latex) are to be used, the Contractor shall take this into account when checking the water/cement ratio. Refer to 2.6 “Adjusted Basic Water Requirement and Water/Cement Ratio” for more information. Also, refer to Appendix P “Bridge Deck Latex Concrete Overlay Mix Design” for more information about one way to account for latex admixtures in volumetric mix design.

**Table 2.5.2 Adjustment to Basic Water Requirement**

| <b>Water Adjustment</b>  | <b>Suggested Range</b>   | <b>Adjustment Percentage</b> |
|--|--|------------------------------|
| <i>Aggregate shape and texture:</i> (Note 1)<br>Baseline (cubical crushed stone)<br>Rounded, smooth<br>Flat, elongated, rough  | (0%)<br>(-5 to 0%)<br>(0 to +5%)   |                              |
| <i>Combined aggregate grading:</i><br>Well-graded<br>Gap-graded  | (-10 to 0%)<br>(0 to +10%)   |                              |
| <i>Admixture(s):</i><br>Air-entraining admixture<br>Note: Use allowable minimum specification air content to select the appropriate range at right.  | 1 to 3% air content (0%)<br>4 to 5% air content (-5%)<br>6 to 10% air content (-10%) |                              |
| Normal range water-reducing admixture<br>Mid-range water-reducing admixture<br>High range water-reducing admixture (superplasticizer) (Note 2)   | (-10 to -5%)<br>(-15 to -8%)<br>(-30 to -12%)  |                              |
| <i>Finely Divided Minerals:</i><br>Fly Ash (Note 3)<br>Microsilica<br>High-Reactivity Metakaolin (HRM)<br>Ground Granulated Blast-Furnace (GGBF) Slag  | (-10 to 0%)<br>(0 to +15%)<br>(-5 to +5%)<br>(0%)                                    |                              |
| <i>Other factors:</i><br>Coarse cement, water/cement ratio >0.45,<br>concrete temperature <60 °F (15 °C)   | (-10 to 0%)  |                              |
| Fine cement, water/cement ratio <0.40,<br>concrete temperature >80 °F (27 °C)  | (0 to +10%)  |                              |
| Enter the sum of the adjustment percentages. The suggested maximum water reduction recognizing overlapping effects of individual factors is -30%. The required minimum water/cement ratio also needs to be considered. |  |                              |

Notes:

1. For aggregate shape and texture; it is recommended to make the adjustment as described in 2.5.1.2 "Coarse Aggregate Water Requirement" and 2.5.1.3 "Basic Water Requirement."
2. A polycarboxylate high range water-reducing admixture may be able to reduce the water content up to 40%.
3. For each 10% of fly ash in the total cementitious, it is recommended to allow a water reduction of at least 3%.

### 2.5.3 Required Use of Admixtures

Note: To view or download the Approved/Qualified Product List of Air-Entraining Admixtures for Controlled Low-Strength Material (CLSM), Approved/Qualified Product List of Concrete Admixtures, and Approved/Qualified Product List of Corrosion Inhibitors, go to <http://www.idot.illinois.gov/>; Doing Business; Material Approvals; Concrete; Qualified Product Lists.

The following information on admixtures is found in Article 1020.05(b).

#### Air-Entraining Admixture

Except for Class SC concrete (see 2.5.4 “Optional Use of Admixtures”) and bridge deck latex concrete overlays, all concrete and cement aggregate mixture II shall contain entrained air. Normally, an air-entraining admixture is used in lieu of air-entraining cement.

For CLSM, based on the mix design selected, an air-entraining admixture may be required (refer to Article 1019.02).

#### Retarding Admixture<sup>1</sup>

When the atmospheric or concrete temperature is 65 °F (18 °C) or higher, a retarding admixture shall be used for Class BS concrete and concrete bridge deck overlays.

For Class PP-4 concrete, a retarding admixture shall be used for stationary or truck-mixed concrete.

For Class DS concrete, a retarding admixture shall be used. In addition, the concrete mixture shall be designed to remain fluid throughout the anticipated duration of the pour plus one hour.

#### Water-Reducing Admixture<sup>1</sup>

A water-reducing admixture shall be used for cement aggregate mixture II.

If Class C fly ash or GGBF slag is used in Class PP-1 or RR concrete, a water-reducing or high range water-reducing admixture shall be used.

For Class DS concrete involving dry excavations 10 ft (3 m) or less, a high range water-reducing admixture may be replaced with a water-reducing admixture if the concrete is vibrated.

#### High Range Water-Reducing Admixture (Superplasticizer)<sup>1</sup>

A superplasticizer shall be used for Class PP-2, PP-3, PP-4, PP-5 concrete, formed concrete repair, bridge deck, concrete wearing surface, bridge deck fly ash or GGBF slag overlay, bridge deck microsilica concrete overlay, or bridge deck high-reactivity metakaolin concrete overlay.

If Class C fly ash or GGBF slag is used in Class PP-1 or RR concrete, a water-reducing admixture or superplasticizer shall be used.

A superplasticizer shall be used for Class DS concrete, except a water-reducing admixture may be used as discussed in the previous paragraph.

<sup>1</sup> Refer to 2.2.2 “Allowable Cement Factor Reduction – Admixture” for allowable cement factor reduction.

Accelerating Admixture

A non-chloride accelerating admixture shall be used for Class PP-2, PP-3, and PP-5 concrete. For Class PP-2 concrete, the non-chloride accelerating admixture shall be calcium nitrite when the air temperature is less than 55 °F (13 °C). For Class PP-3 concrete, the accelerating admixture shall be calcium nitrite.

A calcium chloride accelerator is allowed only by special provision in the contract. If a special provision is used, it normally involves Class PP-2 concrete.

Latex Admixture

A latex admixture shall be used for bridge deck latex concrete overlay. The latex admixture dosage is 24.5 gal/yd<sup>3</sup> (121.1 L/m<sup>3</sup>). Also, refer to Appendix P regarding latex admixture in bridge deck latex concrete overlay mix designs.

Corrosion Inhibitor

In some instances, the contract documents may require the use of a corrosion inhibitor. Refer to Article 1020.05(b)(10).

Other Applications

The Contractor shall be responsible for using admixtures and determining dosages for all Classes of concrete that will produce a mixture with suitable workability, consistency, and plasticity.

#### 2.5.4 Optional Use of Admixtures

The following information on admixtures is found in Article 1020.05(b).

Air-Entraining Admixture

An air-entraining admixture may be used in Class SC concrete at the option of the Contractor.

Retarding Admixture

A retarding admixture may be used in Class PP-4 concrete when using a mobile portland cement concrete plant, provided it is approved by the Engineer.

Water-Reducing Admixture

A water-reducing admixture may be used in Class PV, PP-1, PP-2, PP-3, PP-4, RR, BS, SC, and SI concrete. This also applies to bridge deck microsilica concrete overlay and bridge deck high-reactivity metakaolin concrete overlay.

High-Range Water-Reducing Admixture (Superplasticizer)

A high range water-reducing admixture may be used in Class PP-1 or RR concrete.

Accelerator

A non-chloride accelerator may be used in Class PP-1 or RR concrete. The non-chloride accelerating admixture shall be calcium nitrite when the air temperature is less than 55 °F (13 °C).

Other Applications

The Contractor has the option to determine the use of additional admixtures in the various concrete Classes and other applications. However, the Contractor

shall obtain the approval from the Engineer to use an accelerator when the concrete temperature is greater than 60 °F (16 °C), except for Class PP, RR, PC, and PS concrete. Note that a calcium chloride accelerator is only allowed by special provision.

## 2.6 ADJUSTED BASIC WATER REQUIREMENT AND WATER/CEMENT RATIO

The water/cement ratio is defined as the weight (mass) of water divided by the weight (mass) of cement plus any finely divided minerals. The water shall include mixing water, water in admixtures, free moisture on the aggregates (i.e., water on the surface of the individual particles), and water added at the job site.

Refer to Table 2.6 “Water/Cement Ratio” for the specified water/cement ratio. Many mix designs use a water/cement ratio in the 0.40 to 0.44 range to ensure complete hydration of the cement, as well as to reduce the dependence on admixtures for workability (as may be the case when the water/cement ratio is less than 0.40). If a maximum water/cement ratio is not specified, it shall not exceed 0.45 to ensure durability of the concrete. In addition, the water content shall not be reduced to a level which restricts cement hydration; that is, the water-cement ratio shall not be lower than 0.32, except as allowed for bridge deck latex concrete overlay and dry cast Class PC items.

Remember to consider the water content in admixtures, which is most often significant when using a high range water-reducing admixture (superplasticizer), calcium chloride accelerator, or latex admixture. Generally, when water from admixtures is significant, Article 1020.05(b) states the Contractor shall calculate 70 percent of the admixture dosage as water, except for a latex admixture, in which case, refer to Appendix P for more information.

Refer to the Portland Cement Concrete Level II Technician Course manual for additional information on water in admixtures.

**A new mix design will be required if the water/cement ratio is increased more than 0.04 from the original mix design value. The value shall not exceed specified limits.**

An example calculation for determining water/cement ratio is as follows:

**Given:** Adjusted Basic Water Requirement = 5.0 gal/cwt (0.41 L/kg)  
1 gallon of water = 8.33 lb of water  
1 liter of water = 1 kg of water

*English:*

**Calculation:** Water/Cement Ratio =  $(5.0 \text{ gal/cwt} \times 8.33 \text{ lb/gal}) \div 100 \text{ lb/cwt}$   
Water/Cement Ratio = 0.42

*Metric:*

**Calculation:** Water/Cement Ratio =  $0.41 \text{ L/kg} \times 1 \text{ kg/L}$   
Water/Cement Ratio = 0.41

**Table 2.6 Water/Cement Ratio**

| Class or Type of Concrete                               | Water/Cement Ratio            |
|---|-------------------------------|
| PV  | 0.32 – 0.42                   |
| PP-1  | 0.32 – 0.44                   |
| PP-2  | 0.32 – 0.38                   |
| PP-3  | 0.32 – 0.35                   |
| PP-4  | 0.32 – 0.50                   |
| PP-5  | 0.32 – 0.40                   |
| RR  | 0.32 – 0.44                   |
| BS  | 0.32 – 0.44                   |
| PC  | Wet Cast: 0.32 – 0.44         |
|   | Dry Cast: 0.25 – 0.40         |
| PS  | 0.32 – 0.44                   |
| DS  | 0.32 – 0.44                   |
| SC  | 0.32 – 0.44                   |
| SI  | 0.32 – 0.44                   |
| Deck Slab Repair  | Refer to PP-1, 2, 3, 4, and 5 |
| Formed Concrete Repair                                  | Refer to Class SI Concrete    |
| Concrete Wearing Surface                                | Refer to Class BS Concrete    |
| Bridge Deck Fly Ash or GGBF Slag Concrete Overlay       | Refer to Class BS Concrete    |
| Bridge Deck Microsilica Concrete Overlay                | 0.37 – 0.41                   |
| Bridge Deck High-Reactivity Metakaolin Concrete Overlay | 0.37 – 0.41                   |
| Bridge Deck Latex Concrete Overlay                      | 0.30 – 0.40 <sup>1</sup>      |

Notes:

1. In addition, the maximum water content (including free moisture on the fine and coarse aggregates) is 157 lb (93.1 kg).

## 2.7 AIR CONTENT ABSOLUTE VOLUME CALCULATION

The next step is calculating the volume of air to be entrained into the mix. Table 2.7 “Air Content” contains a listing of air content ranges specified for all Department mix design classes and types. In general, use the midpoint of the range to select an air content value for calculating volume. However, since it can be more difficult to entrain air when slipforming Class PV, BS, and SI concrete, a value lower than the midpoint may be used in these cases.

While the specified ranges for air content are in terms of the total volume of concrete, the volume of air is based on what is required to provide adequate air entrainment in the paste (water, cement, and finely divided minerals). The specification air content is in terms of the total volume because it is a value that is easy to measure.

The absolute volume of air is determined as follows:

*English (Metric):*

$$\text{The absolute volume of air, } V_{Air} = \frac{\%Air}{100}$$

**Table 2.7 Air Content**

| Class or Type of Concrete                               | Air Content, Percent                |
|---|-------------------------------------|
| PV  | 5.0 <sup>1</sup> – 8.0              |
| PP-1  | 4.0 – 7.0                           |
| PP-2  | 4.0 – 6.0                           |
| PP-3  | 4.0 – 6.0                           |
| PP-4  | 4.0 – 6.0                           |
| PP-5  | 4.0 – 6.0                           |
| RR  | 4.0 – 7.0                           |
| BS  | 5.0 <sup>1</sup> – 8.0              |
| PC  | 5.0 – 8.0                           |
| PS  | 5.0 – 8.0                           |
| DS  | 5.0 – 8.0                           |
| SC  | Optional <sup>2</sup> (6.0 Maximum) |
| SI  | 5.0 <sup>1</sup> – 8.0              |
| Deck Slab Repair  | Refer to PP-1, 2, 3, 4, and 5       |
| Formed Concrete Repair                                  | Refer to Class SI Concrete          |
| Concrete Wearing Surface                                | Refer to Class BS Concrete          |
| Bridge Deck Fly Ash or GGBF Slag Concrete Overlay       | Refer to Class BS Concrete          |
| Bridge Deck Microsilica Concrete Overlay                | 5.0 – 8.0                           |
| Bridge Deck High-Reactivity Metakaolin Concrete Overlay | 5.0 – 8.0                           |
| Bridge Deck Latex Concrete Overlay                      | 7 Maximum                           |

Notes:

1. For slipform construction, the minimum air content is 5.5 percent.
2. When not using an air-entraining admixture, 2.0 percent air content is assumed.

### 2.7.1 Minimum Air Content

If air content is not specified for a concrete mix design, a value can be calculated as follows:

*English (Metric):*

$$\text{Minimum Air Content (\%)} = [0.18 \times (V_{\text{Water}} + V_{\text{Cement}} + \sum V_{\text{FDM}})] \times 100$$

Where:  $V_{\text{Water}}$  = Absolute Volume of Water per  $\text{yd}^3$  ( $\text{m}^3$ ),  
 $V_{\text{Cement}}$  = Absolute Volume of Cement per  $\text{yd}^3$  ( $\text{m}^3$ ), and  
 $\sum V_{\text{FDM}}$  = Sum of Absolute Volumes of each Finely Divided Mineral per  $\text{yd}^3$  ( $\text{m}^3$ )

This is based on needing a minimum 18 percent air content in the paste (i.e., water, cement, and finely divided minerals) for moderate or extreme freeze/thaw exposures, which are typical in Illinois.




## 2.8 FINE AND COARSE AGGREGATE ABSOLUTE VOLUME CALCULATIONS

Knowing the amount of cement, finely divided minerals, water, and air needed, only the absolute volumes of the fine and coarse aggregates are unknown. In order to determine these volumes, certain characteristics of the coarse aggregate must first be examined.

### 2.8.1 Voids in Coarse Aggregate

The first characteristic is the volume of voids in the coarse aggregate. Voids ( $V$ ) is defined as the volume of voids per unit volume of dry rodded coarse aggregate. In other words, voids is the ratio of the volume of empty spaces in a unit volume of coarse aggregate as illustrated in Figure 2.8.1.

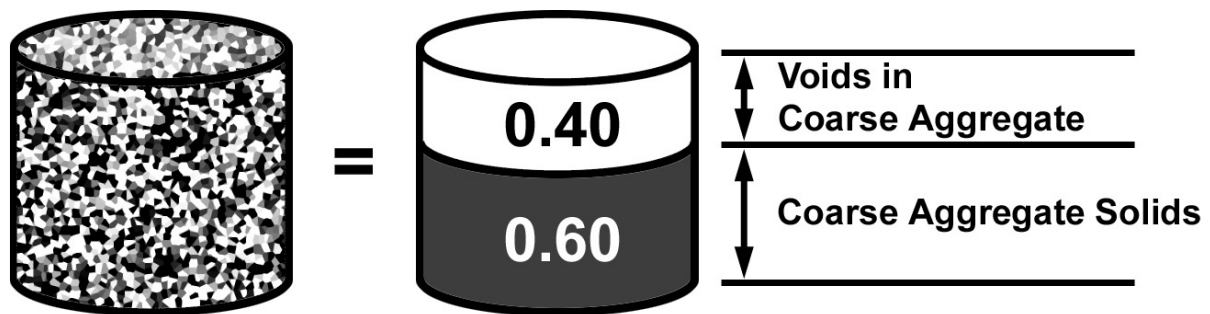

$$1.00_{(\text{Aggregate Volume})} = 0.40_{(\text{Voids Volume})} + 0.60_{(\text{Solids Volume})}$$

**Figure 2.8.1 Voids in Coarse Aggregate**

The coarse aggregate voids are determined according to Illinois Test Procedure 306 (refer to Appendix C). The test shall be performed at least twice to ensure an accurate value is obtained. If the coarse aggregate is furnished in two or more sizes, the voids test shall be performed on the combination of the coarse aggregates.

It is important to know that a change in coarse aggregate particle shape will change the voids as it will change how the particles pack. Refer to the Portland Cement Concrete Level II Technician Course for additional information on aggregate particle shape.

**If the voids of a coarse aggregate change more than 0.02 from the original mix design value, a new mix design will be required.** A change of 0.02 will change the coarse aggregate batch weight (mass) approximately 3 times more than a similar change in saturated surface-dry (SSD) specific gravity.

The coarse aggregate voids will typically range from 0.36 to 0.41 for non-crushed gravel and 0.39 to 0.45 for crushed gravel or crushed stone. The overall range for coarse aggregate is normally from 0.30 to 0.50.


The coarse aggregate voids are to be provided to the Department's District office. However, the District may provide a value to use.

2.8.2 Mortar Factor

2.8.2.1 General Concept


The second coarse aggregate characteristic of concern is the amount of mortar used to fill the voids between, as well as disperse, the coarse aggregate particles for workability (refer to Appendix D for additional information).

Mortar is the total amount of fine aggregate, cement, finely divided minerals, water, and air (i.e., everything but the coarse aggregate) in a concrete mixture. The volume of mortar per volume of dry rodded coarse aggregate in a unit volume of concrete is called the Mortar Factor. In other words, mortar factor is the ratio of total volume of mortar to total volume of coarse aggregate solids and voids.

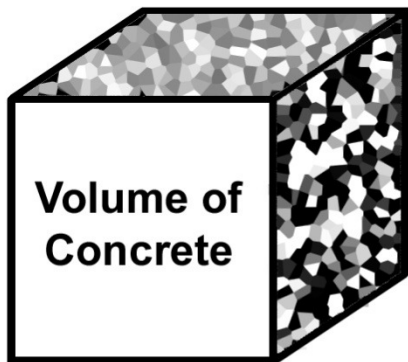



Imagine a unit volume of concrete consisting entirely of coarse aggregate. Everything else in the concrete mixture (i.e., mortar) would be limited to filling the spaces (voids) between coarse aggregate particles.

A concrete mixture consisting entirely of coarse aggregate and only enough mortar to fill the voids between coarse aggregate particles would have poor workability.

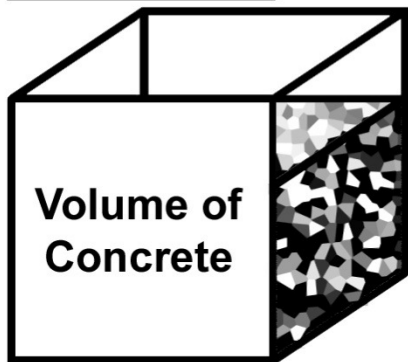

To increase workability, the coarse aggregate particles need to be dispersed. Thus, in order to maintain the same unit volume of concrete, some of the coarse aggregate needs to be removed.

If we add mortar to replace what was removed, we will have a more workable concrete mixture because the mortar will disperse and lubricate the remaining coarse aggregate particles.

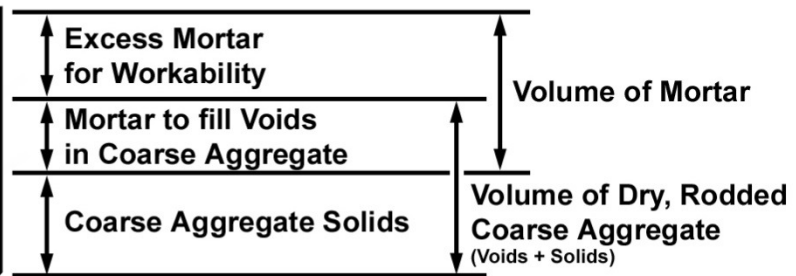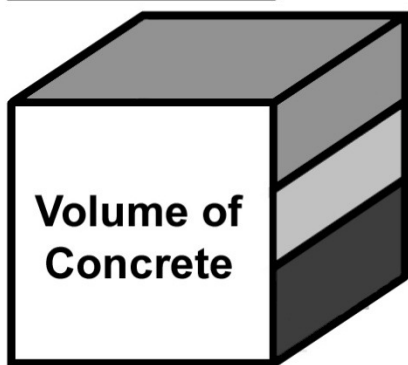


$$\text{MORTAR FACTOR} = \frac{\text{Volume of Mortar}}{\text{Volume of Dry, Rodded Coarse Aggregate}}$$


To quantify the concept of Mortar Factor, first determine the volume fraction of coarse aggregate solids based on the volume of voids ( $V$ ) in a unit volume of dry rodded coarse aggregate as follows:

$$\text{Volume Fraction of Coarse Aggregate Solids} = 1 - V$$

For example, consider a unit volume of crushed stone with  $V$  equal to 0.40. The mortar can fill the voids between coarse aggregate particles as illustrated in the figure below, but this will not result in a workable mixture.

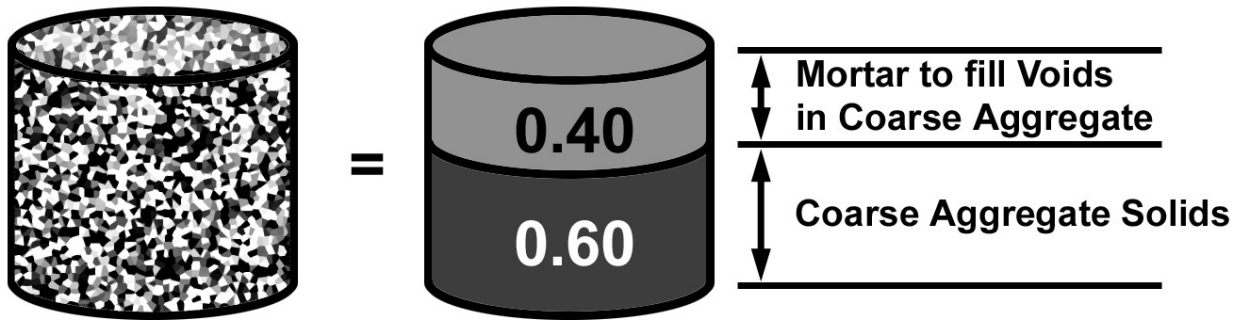

An additional volume of mortar must be added. The amount of mortar added for workability is represented as a fraction of the volume of dry rodded coarse aggregate volume as illustrated in the figure below.

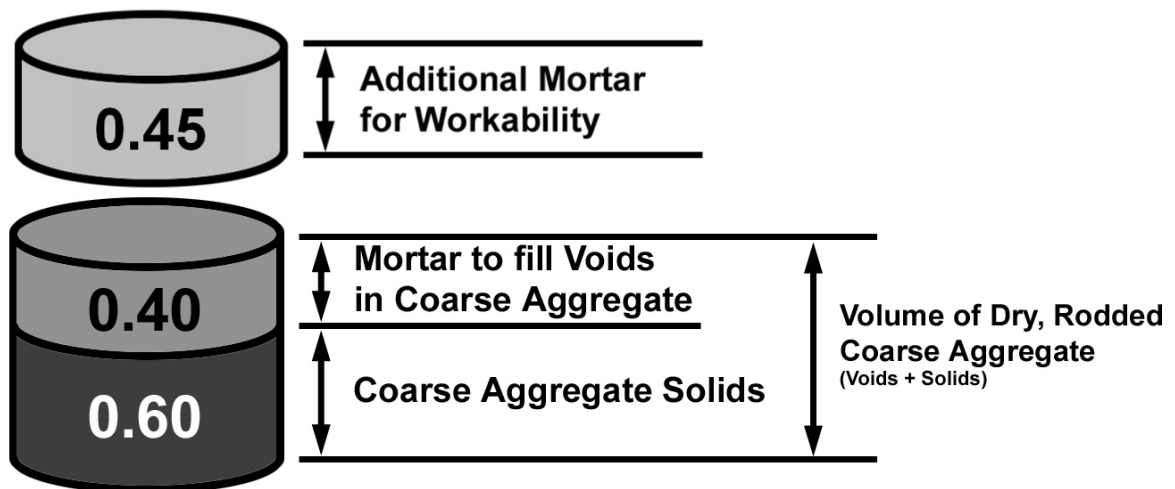

The volume fraction of mortar to fill the voids plus the volume fraction of mortar added for workability is the Mortar Factor ( $0.40 + 0.45 = 0.85$ ).

In terms of the resulting unit volume of concrete, the volume fraction of mortar per unit volume of concrete can be determined as follows:

$$\begin{aligned} \text{Volume Fraction of Mortar} &= \frac{\text{Mortar Factor}}{\text{CA Solids} + \text{CA Voids} + \text{Additional Mortar}} \\ \text{Per Unit Volume of Concrete} &= \frac{0.85}{0.60 + 0.40 + 0.45} = 0.59 \end{aligned}$$

Alternatively, knowing the mortar factor is 0.90 and the volume fraction of coarse aggregate solids is 0.60, the volume fraction of mortar per unit volume of concrete can be determined as follows:

$$\begin{aligned} \text{Volume Fraction of Mortar} & & & \text{Mortar Factor} \\ \text{Per Unit Volume of Concrete} & = & \frac{\text{CA Solids} + \text{Mortar Factor}}{\text{CA Solids} + \text{Mortar Factor}} \\ & = & \frac{0.85}{0.60 + 0.85} = 0.59 \end{aligned}$$

### 2.8.2.2 Design Mortar Factor

This concept of Mortar Factor is unique to the Department's mix design method; for example, the ACI or PCA methods do not utilize mortar factor as a design input. For the Department mix design method, mortar factors are selected on the basis of construction application and experience with local materials.

A higher mortar factor is used to facilitate placement and finishing, and to improve the finish of the formed surface. A higher mortar factor may also be needed to ensure sufficient sand content to entrain air. Refer to Table 2.8.2.2 for allowable mortar factor ranges, as well as allowable coarse aggregate gradation, per Class of Concrete or type of construction.

**A new mix design will be required if the mortar factor is changed  $\pm 0.05$  or more from the original mix design value.**

As noted in Table 2.8.2.2, for self-consolidating concrete, in order for the fine aggregate proportion to be a maximum 50 percent by weight (mass) of the total aggregate used, the maximum mortar factor shall not apply. In most cases, for the fine aggregate proportion to be 50 percent by weight (mass) of the total aggregate used, the mortar factor will be greater than 1.00.

Another case in which the mortar factor may be greater than 1.00 is when proportioning structural lightweight concrete (e.g., unit weight between 90 and 115 lb/ft<sup>3</sup>) using lightweight coarse aggregate. In this case, the mortar factor can be greater than 1.00 so as to adjust the proportions to achieve the desired unit weight of concrete, pumpability, strength, and so on.

**Table 2.8.2.2 Design Mortar Factor**

| Class or Type of Concrete   | Coarse Aggregate Gradation <sup>1</sup>                              | Mortar Factor Range for Department Mix Design |
|---|--|---|
| PV  | CA 5 & CA 7, CA 5 & CA 11, CA 7, CA 11, or CA 14                     | 0.70 – 0.90 <sup>5</sup>                      |
| PP-1 <sup>2</sup> , PP-2 <sup>2</sup> , PP-3 <sup>2</sup> , PP-4 <sup>2</sup> , PP-5 <sup>2</sup> | CA 7, CA 11,   | 0.70 – 0.93 <sup>5</sup>                      |
|   | CA 13, CA 14, or CA 16   | 0.79 – 0.99 <sup>5</sup>                      |
| RR  | CA 7, CA 11, or CA 14  | 0.70 – 0.90 <sup>5</sup>                      |
| BS <sup>2,3,7</sup>   | CA 7, CA 11, or CA 14  | 0.70 – 0.86 <sup>5,6</sup>                    |
| PC <sup>7</sup>   | CA 7, CA 11, CA 13, CA 14, CA 16, or CA 7 & CA 16                    | 0.70 – 0.90 <sup>5</sup>                      |
| PS <sup>7</sup>   | CA 11 <sup>4</sup> , CA 13, CA 14, or CA 16 <sup>4</sup>             | 0.79 – 0.99 <sup>5</sup>                      |
| DS <sup>7,8</sup>   | CA 13, CA 14, CA 16, or a blend of these gradations                  | Not Applicable                                |
| SC  | CA 3 & CA 7, CA 3 & CA 11, CA 5 & CA 7, CA 5 & CA 11, CA 7, or CA 11 | 0.79 – 0.90 <sup>5</sup>                      |
| SI <sup>7,9</sup>   | CA 3 & CA 7, CA 3 & CA 11, CA 5 & CA 7, CA 5 & CA 11                 | 0.71 – 0.83                                   |
|   | CA 7, CA 11, CA 13, CA 14, or CA 16                                  | 0.70 – 0.90 <sup>5</sup>                      |
| Deck Slab Repair  | Refer to PP-1, 2, 3, 4, and 5  | Refer to PP-1, 2, 3, 4, and 5                 |
| Formed Concrete Repair  | CA 16  | Refer to Class SI Concrete                    |
| Concrete Wearing Surface  | Refer to Class BS Concrete   | Refer to Class BS Concrete                    |
| Bridge Deck Fly Ash or GGBF Slag Concrete Overlay   | CA 11, CA 13, CA 14, or CA 16  | Refer to Class BS Concrete                    |
| Bridge Deck Microsilica Concrete Overlay  | CA 11, CA 13, CA 14, or CA 16  | 0.88 – 0.92                                   |
| Bridge Deck High-Reactivity Metakaolin Concrete Overlay   | CA 11, CA 13, CA 14, or CA 16  | 0.88 – 0.92                                   |
| Bridge Deck Latex Concrete Overlay <sup>10</sup>  | CA 13, CA 14, or CA 16   | Not Applicable                                |

## Notes:

1. Alternate combinations of gradation sizes may be used with the approval of the Engineer. Refer also to Article 1004.02(d) for additional information on combining sizes.
2. For Class BS or PP concrete used in bridge deck patching, the coarse aggregate gradation shall be CA 13, CA 14, or CA 16, except CA 11 may be used for full-depth patching.
3. When Class BS concrete is to be pumped, the coarse aggregate gradation shall have a minimum of 45 percent passing the 1/2 in. (12.5 mm) sieve. The Contractor may combine two or more coarse aggregate sizes, consisting of CA 7, CA 11, CA 13, CA 14, and CA 16, provided a CA 7 or CA 11 is included in the blend.
4. The nominal maximum size permitted is 3/4 in. Nominal maximum size is defined as the largest sieve which retains any of the aggregate sample particles.
5. If the fine aggregate is one hundred percent stone sand, the maximum mortar factor shall be 0.85.
6. May be increased to 0.95 if slipformed.
7. For self-consolidating concrete, the coarse aggregate gradations shall be CA 11, CA 13, CA 14, CA 16, or a blend of these gradations. However, the final gradation when using a single coarse aggregate or combination of coarse aggregates shall have 100 percent pass the 1 in. (25 mm) sieve, and minimum 95 percent pass the 3/4 in. (19 mm) sieve. The fine aggregate proportion shall be a maximum 50 percent by weight (mass) of the total aggregate used. Therefore, the maximum mortar factor shall not apply.
8. The coarse aggregate shall be 55 to 65 percent by weight (mass) of total aggregate. The only exception is self-consolidating concrete. See Note 7.
9. CA 3 or CA 5 may be used when the nominal maximum size does not exceed two-thirds the clear distance between parallel reinforcement bars, or between the reinforcement bar and the form. Nominal maximum size is defined in Note 4.
10. The coarse aggregate shall be 42 to 50 percent by weight (mass) of total aggregate.

### 2.8.3 Coarse Aggregate Absolute Volume Calculation

Knowing the volume fraction of mortar, the absolute volume of coarse aggregate can be determined as follows:

*English (Metric):*

Absolute Volume of Coarse Aggregate,  $V_{CA}$  = 1 - Volume Fraction of Mortar

For example, from 2.8.2.1:

Absolute Volume of Coarse Aggregate,  $V_{CA}$  = 1 - Volume Fraction of Mortar  
 = 1 - 0.59  
 = 0.41

The absolute volume of coarse aggregate per cubic yard (cubic meter) of concrete is a total encompassing all coarse aggregates used. If more than one coarse aggregate is used, the total coarse aggregate absolute volume is divided by the percentage of each coarse aggregate to be used. This will provide the absolute volume of each coarse aggregate. Typically, two coarse aggregates are blended to improve a gap graded coarse aggregate. The more uniformly graded combined aggregate will reduce water demand and improve the pumping characteristics of the mix. Refer to Appendix E "Aggregate Blending" for additional information.

Note: The equation below is used in the Department's Excel PCC Mix Design program, as well as in MISTIC, to simplify the calculation from two steps (calculating volume fraction of mortar to calculate absolute volume of coarse aggregate) to one:

$$\text{Absolute Volume of Coarse Aggregate } (V_{CA}) = \frac{1}{1 + \left( \frac{\text{Mortar Factor}}{1 - \text{Voids}} \right)}$$

### 2.8.4 Fine Aggregate Absolute Volume Calculation

Knowing the amount of cement, finely divided minerals, water, air, and coarse aggregate needed, the only unknown is the absolute volume of fine aggregate. This is easily found by subtracting all of the known absolute volumes from 1.

*English (Metric):*

The absolute volume of fine aggregate = 1 - ( $V_{Cement} + \sum V_{FDM} + V_{Water} + V_{Air} + V_{CA}$ )

The absolute volume of fine aggregate per cubic yard (cubic meter) of concrete is a total encompassing all fine aggregates used. If more than one fine aggregate is used, the total fine aggregate absolute volume is divided by the percentage of each fine aggregate to be used. This will provide the absolute volume of each fine aggregate. Two fine aggregates may be blended for economic purposes such as when using a natural sand and a stone sand. Blending of fine aggregate may also be done to improve the overall gradation of the mix for air entrainment and pumping. Refer to Appendix E "Aggregate Blending" for additional information.

### 2.8.5 Converting Aggregate Absolute Volume to Weight (Mass)

Finally, to convert the absolute volume of aggregate to pounds (kilograms), the saturated surface-dry (SSD) specific gravity of the aggregate is required, which will be provided by the Department's District office. If it is suspected that the SSD specific gravity has changed or is incorrect, notify the District.

**Whenever the specific gravity of any aggregate deviates by more than 0.02 from the original mix design value, a new mix design will be required.**

*English:*

pounds of aggregate = absolute volume × SSD specific gravity × unit weight of water

Where the "unit weight of water" is 1,683.99 pounds per cubic yard.

*Metric:*

kilograms of aggregate = absolute volume × SSD specific gravity × unit weight of water

Where the "unit weight of water" is 1,000.00 kilograms per cubic meter.

Refer to the Portland Cement Concrete Level II Technician Course manual for additional information on SSD specific gravity.

## 2.9 EXAMPLE PROBLEM

### Given:

- Continuous reinforced Portland cement concrete pavement to be built using central mixed concrete and slipform equipment.
- Type I cement with >0.60 alkalis will be used.
- Class C fly ash with a calcium oxide of 25.1 percent and specific gravity of 2.61 will be used.
- A Type B fine aggregate (027FA01) with a saturated surface-dry specific gravity of 2.66 will be used. The alkali-silica reaction expansion for the fine aggregate sand is in the >0.16% – 0.27% range.
- A non-crushed gravel coarse aggregate (020CA07) with a saturated surface-dry specific gravity of 2.68 will be used. The coarse aggregate voids are 0.37. The alkali-silica reaction expansion for the coarse aggregate limestone is an assigned value of 0.05%. The aggregate is freeze/thaw durable.
- A water-reducing admixture will be used to take advantage of a cement reduction and meet the water/cement ratio requirement. The target water reduction is 6 percent.

### Significant Digits:

- Whole Number: Cement, Batch Water, Finely Divided Minerals, Coarse and Fine Aggregate
- One Digit to Right of Decimal: Basic Water Requirement (English), Air Content
- Two Digits to Right of Decimal: Specific Gravity, Unit Weight, Water/Cement Ratio, Basic Water Requirement (Metric), Mortar Factor, Voids
- Three Digits to Right of Decimal: Absolute Volume

### Rounding:

- When the digit next beyond the last place to be retained is equal to or greater than 5, increase by 1 the digit in the last place retained.

### 2.9.1 Example Using English Units

Step 1 Determine the absolute volume of cement and finely divided minerals.

- From Table 2.2.1 “Cement Factor for Class or Type of Concrete,” the minimum cement factor is 5.65 cwt/yd<sup>3</sup> for Class PV concrete from a central mixed plant.
- From 2.2.2 “Allowable Cement Factor Reduction – Admixture,” the cement factor may be reduced by 0.30 cwt/yd<sup>3</sup> when using a water-reducing admixture.

The resulting cement factor is  $5.65 - 0.30 = 5.35$  cwt/yd<sup>3</sup>

- From 2.4.1.1 “Fly Ash,” the Class C fly ash can replace up to 30 percent of the cement. From 2.4.3 “Mitigation of Alkali-Silica Reaction with Finely Divided Minerals,” it is determined that the aggregate combination is in Group II. Thus, a minimum 25.0 percent Class C fly ash is required to reduce the risk of a deleterious alkali-silica reaction. It is decided to use 25 percent fly ash since a larger replacement would reduce the portland cement content below 400 lb/yd<sup>3</sup>.

The calculation is  $5.35 \times 0.25 = 1.34$  cwt/yd<sup>3</sup> of fly ash.

The calculation for the cement is  $5.35 - 1.34 = 4.01$  cwt/yd<sup>3</sup>

After rounding up to the nearest 5 lb/ yd<sup>3</sup>, the values are 4.05 cwt/yd<sup>3</sup> for cement and 1.35 cwt/yd<sup>3</sup> for fly ash.

The absolute volume of cement per cubic yard of concrete  
 $= (4.05 \text{ cwt/yd}^3 \times 100 \text{ lb/cwt}) \div (3.15 \times 1,683.99 \text{ lb/yd}^3) = 0.076 \text{ yd}^3$

The absolute volume of fly ash per cubic yard of concrete  
 $= (1.35 \text{ cwt/yd}^3 \times 100 \text{ lb/cwt}) \div (2.61 \times 1,683.99 \text{ lb/yd}^3) = 0.031 \text{ yd}^3$

Step 2 Determine the absolute volume of water. Note: The water from admixtures is not considered significant in this example.

- From 2.5.1.1 “Fine Aggregate Basic Water Requirement,” the fine aggregate water requirement is 5.3 gallons/cwt of cement and fly ash.
- From 2.5.1.2 “Coarse Aggregate Basic Water Requirement,” the coarse aggregate water requirement is 0.0 gallon/cwt of cement and fly ash.
- From 2.5.1.3 “Basic Water Requirement Total,” the design water is  $5.3 + 0.0 = 5.3$  gallons/cwt of cement and fly ash.
- As given, the target water reduction is 6 percent.

The design water based on using a water-reducing admixture  
 $= 5.3 - (5.3 \times 0.06) = 5.0$  gallons/cwt of cement and fly ash when rounded.

Additional adjustments to the design water, which are allowed by 2.5.2 “Adjustment to Basic Water Requirement” were ignored.



- Verify the water/cement ratio is not exceeded in 2.6.1 “Water/Cement Ratio.”

The initial calculation is  $(5.0 \text{ gallons/cwt} \times 8.33 \text{ lb/gallon}) = 41.7 \text{ lb/cwt}$

Then, the water/cement ratio is easily obtained knowing that water/cement ratio is pounds of water divided by pounds of total cementitious material.

The water/cement ratio =  $41.7 \text{ lb/cwt} \div 100 \text{ lb/cwt} = 0.417$  or 0.42, after rounding.

The alternate method to calculate water/cement ratio is to determine the number of pounds of water in one cubic yard and divide by the number of pounds of cement and fly ash in one cubic yard.

The number of pounds of water per cubic yard  
 $= (5.0 \text{ gallons/cwt} \times 8.33 \text{ lb/gallon}) \times (4.05 \text{ cwt/yd}^3 + 1.35 \text{ cwt/yd}^3)$   
 $= 225 \text{ lb/yd}^3$

The number of pounds of cementitious material per cubic yard  
 $= (4.05 \text{ cwt/yd}^3 + 1.35 \text{ cwt/yd}^3) \times 100 \text{ lb/cwt}$   
 $= 540 \text{ lb/yd}^3$

The water cement ratio =  $225 \text{ lb/yd}^3 \div 540 \text{ lb/yd}^3 = 0.42$  after rounding.

This value meets the 0.42 maximum water/cement ratio allowed for Class PV concrete in 2.6.1 “Water/Cement Ratio.”

The absolute volume of water per cubic yard of concrete  
 $= [41.7 \text{ lb/cwt} \times (4.05 \text{ cwt/yd}^3 + 1.35 \text{ cwt/yd}^3)] \div (1.00 \times 1,683.99 \text{ lb/yd}^3)$   
 $= 0.134 \text{ yd}^3$

Step 3 Determine the absolute volume of air.

- From 2.7.1 “Air Content,” the midpoint of the air content range for Class PV concrete is 6.5 percent.

The absolute volume of air per cubic yard of concrete =  $6.5 \text{ percent} \div 100 = 0.065$

Step 4 Determine the absolute volume of coarse aggregate.

Select a mortar factor for Class PV concrete from 2.8.2.1 “Design Mortar Factor.” A mortar factor value of 0.83 is a good starting point. The coarse aggregate voids are 0.37.

The absolute volume of coarse aggregate per cubic yard of concrete  
 $= \frac{1}{1 + \left( \frac{0.83}{1 - 0.37} \right)} = 0.432 \text{ yd}^3$

Another way to determine absolute volume of coarse aggregate is to calculate percent mortar volume in decimal form and subtract it from 1. If it is not mortar, it must be coarse aggregate.

The absolute volume of coarse aggregate per cubic yard of concrete

$$= 1 - \text{Volume Fraction of Mortar}$$

$$= 1 - \frac{M_o}{M_o + (1 - V)}$$

$$= 1 - \frac{0.83}{0.83 + (1 - 0.37)} = 0.432 \text{ yd}^3$$

Step 5 Determine the absolute volume of fine aggregate.

The absolute volume of fine aggregate is found by subtracting all of the known volumes from 1. Therefore,

The absolute volume of fine aggregate per cubic yard

$$= 1 - (0.076 + 0.031 + 0.134 + 0.065 + 0.432) = 0.262 \text{ yd}^3$$

Step 6 Convert the absolute volume of the coarse and fine aggregate to pounds.

$$\text{Coarse aggregate} = 0.432 \text{ yd}^3 \times 2.68 \times 1,683.99 \text{ lb/yd}^3 = 1,950 \text{ lb}$$

$$\text{Fine aggregate} = 0.262 \text{ yd}^3 \times 2.66 \times 1,683.99 \text{ lb/yd}^3 = 1,174 \text{ lb}$$

Step 7 Summarize the mix design.

|                      |   |
|----------------------|---|
| Cement               | = 4.05 cwt/yd <sup>3</sup> or 405 lb/yd <sup>3</sup>  |
| Fly Ash              | = 1.35 cwt/yd <sup>3</sup> or 135 lb/yd <sup>3</sup>  |
| Batch Water          | = 5.0 gallons/cwt of cement and fly ash   |
|                      | = 5.0 gallons/cwt × (4.05 cwt/yd <sup>3</sup> + 1.35 cwt/yd <sup>3</sup> ) = 27 gal/yd <sup>3</sup> |
|                      | or  |
|                      | = 41.7 lb/cwt of cement and fly ash   |
|                      | = 41.7 lb/cwt (4.05 cwt/yd <sup>3</sup> + 1.35 cwt/yd <sup>3</sup> ) = 225 lb/yd <sup>3</sup>       |
| Air Content (Target) | = 6.5 percent   |
| Coarse Aggregate     | = 1,950 lb/yd <sup>3</sup>  |
| Fine Aggregate       | = 1,174 lb/yd <sup>3</sup>  |
| Admixture            | = water-reducing admixture (target reduction of 6 percent)  |
| Mortar Factor        | = 0.83  |
| Voids                | = 0.37  |
| Slump (Target)       | = 1-1/2 inch*   |
| Strength (Minimum)   | = 3500 psi at 14 days   |
| Water/Cement Ratio   | = 0.42  |

\* Experience has been that the slump at the paver will most likely be 1-1/2 inches to aid in achieving a smooth pavement.

## 2.9.2 Example Using Metric Units

Step 1 Determine the absolute volume of cement and finely divided minerals.

- From Table 2.2.1 “Cement Factor for Type or Class of Concrete,” the minimum cement factor is  $335 \text{ kg/m}^3$  for Class PV concrete from a central mixed plant.
- From 2.2.2 “Allowable Cement Factor Reduction – Admixture,” the cement factor may be reduced by  $18 \text{ kg/m}^3$  when using a water-reducing admixture.

The resulting cement factor is  $335 - 18 = 317 \text{ kg/m}^3$

- From 2.4.1.1 “Fly Ash,” the Class C fly ash can replace up to 30 percent of the cement. From 2.4.3 “Mitigation of Alkali-Silica Reaction with Finely Divided Minerals,” it is determined that the aggregate combination is in Group II. Thus, a minimum 25.0 percent Class C fly ash is required to reduce the risk of a deleterious alkali-silica reaction. It is decided to use 25 percent fly ash since a larger replacement would reduce the portland cement content below  $237 \text{ kg/m}^3$ .

The calculation is  $317 \times 0.25 = 79 \text{ kg/m}^3$  of fly ash

The calculation for the cement is  $317 - 79 = 238 \text{ kg/m}^3$

After rounding up to the nearest  $2.5 \text{ kg/m}^3$ , the values are  $240 \text{ kg/m}^3$  for cement and  $80 \text{ kg/m}^3$  for fly ash.

The absolute volume of cement per cubic meter of concrete  
 $= 240 \text{ kg/m}^3 \div (3.15 \times 1,000.00 \text{ kg/m}^3) = 0.076 \text{ m}^3$

The absolute volume of fly ash per cubic meter of concrete  
 $= 80 \text{ kg/m}^3 \div (2.61 \times 1,000.00 \text{ kg/m}^3) = 0.031 \text{ m}^3$

Step 2 Determine the absolute volume of water. Note: The water from admixtures is not considered significant in this example.

- From 2.5.1.1 “Fine Aggregate Basic Water Requirement,” the fine aggregate water requirement is 0.44 liter/kg of cement and fly ash.
- From 2.5.1.2 “Coarse Aggregate Basic Water Requirement,” the coarse aggregate water requirement is 0.00 liter/kg of cement and fly ash.
- From 2.5.1.3 “Basic Water Requirement Total,” the (design water) is  $0.44 + 0.00 = 0.44$  liter/kg of cement and fly ash.
- As given, the target water reduction is 6 percent.

The design water based on using a water-reducing admixture  
 $= 0.44 - (0.44 \times 0.06) = 0.41$  liter/kg of cement and fly ash when rounded.

Additional adjustments to the design water, which are allowed by 2.5.2 “Adjustment to Basic Water Requirement” were ignored.

- Verify the water/cement ratio is not exceeded in 2.6.1 “Water/Cement Ratio.”

The water/cement ratio is easily obtained knowing that water/cement ratio is kilograms of water divided by kilograms of total cementitious material. In addition, remember that 1 liter of water equals 1 kilogram of water.

$$\text{The water/cement ratio} = 0.41 \text{ kg} \div 1 \text{ kg} = 0.41$$

The alternate method to calculate water/cement ratio is to determine the number of kilograms of water in one cubic meter and divide by the number of kilograms of cement and fly ash in one cubic meter.

$$\begin{aligned} \text{The number of kilograms of water per cubic meter} \\ &= (0.41 \text{ liter/kg} \times 1 \text{ kg/liter}) \times (240 \text{ kg/m}^3 + 80 \text{ kg/m}^3) \\ &= 131 \text{ kg/m}^3 \end{aligned}$$

$$\begin{aligned} \text{The number of kilograms of cementitious material per cubic meter} \\ &= (240 \text{ kg/m}^3 + 80 \text{ kg/m}^3) \\ &= 320 \text{ kg/m}^3 \end{aligned}$$

$$\text{The water cement ratio} = 131 \text{ kg/m}^3 \div 320 \text{ kg/m}^3 = 0.41 \text{ after rounding.}$$

This value meets the 0.42 maximum water/cement ratio allowed for Class PV concrete in 2.6.1 “Water/Cement Ratio.”

$$\begin{aligned} \text{The absolute volume of water per cubic meter of concrete} \\ &= [(0.41 \text{ liter/kg} \times 1 \text{ kg/liter}) \times (240 \text{ kg/m}^3 + 80 \text{ kg/m}^3)] \div (1.0 \times 1,000.00 \text{ kg/m}^3) \\ &= 0.131 \text{ m}^3 \end{aligned}$$

Step 3 Determine the absolute volume of air.

- From 2.7.1 “Air Content,” the midpoint of the air content range for Class PV concrete is 6.5 percent.

$$\text{The absolute volume of air per cubic meter of concrete} = 6.5 \text{ percent} \div 100 = 0.065$$

Step 4 Determine the absolute volume of coarse aggregate.

Select a mortar factor for Class PV concrete from 2.8.2.1 “Design Mortar Factor.” A mortar factor value of 0.83 is a good starting point. The coarse aggregate voids are 0.37.

$$\begin{aligned} \text{The absolute volume of coarse aggregate per cubic meter of concrete} \\ &= \frac{1}{1 + \left( \frac{0.83}{1 - 0.37} \right)} = 0.432 \text{ m}^3 \end{aligned}$$

Another way to determine absolute volume of coarse aggregate is to calculate percent mortar volume in decimal form and subtract it from 1. If it is not mortar, it must be coarse aggregate.

The absolute volume of coarse aggregate per cubic yard of concrete

$$= 1 - \text{Volume Fraction of Mortar}$$

$$= 1 - \frac{M_o}{M_o + (1 - V)}$$

$$= 1 - \frac{0.83}{0.83 + (1 - 0.37)} = 0.432 \text{ m}^3$$

Step 5 Determine the absolute volume of fine aggregate.

The absolute volume of fine aggregate is found by subtracting all of the known volumes from 1. Therefore,

$$\begin{aligned} \text{The absolute volume of fine aggregate per cubic meter} \\ = 1 - (0.076 + 0.031 + 0.131 + 0.065 + 0.432) = 0.265 \text{ m}^3 \end{aligned}$$

Step 6 Convert the absolute volume of the coarse and fine aggregate to kilograms.

$$\text{Coarse aggregate} = 0.432 \text{ m}^3 \times 2.68 \times 1,000.00 \text{ kg/m}^3 = 1,158 \text{ kg}$$

$$\text{Fine aggregate} = 0.265 \text{ m}^3 \times 2.66 \times 1,000.00 \text{ kg/m}^3 = 705 \text{ kg}$$

Step 7 Summarize the mix design.

|                      |   |
|----------------------|---|
| Cement               | = 240 kg/m <sup>3</sup>   |
| Fly Ash              | = 80 kg/m <sup>3</sup>  |
| Batch Water          | = 0.41 liter/kg of cement and fly ash                             |
|                      | = 0.41 liter/kg × (240 kg/m <sup>3</sup> + 80 kg/m <sup>3</sup> ) |
|                      | = 131.2 liters/m <sup>3</sup>                                     |
|                      | or  |
|                      | = 131.2 kg/m <sup>3</sup> since 1 liter of water = 1 kilogram     |
| Air Content (Target) | = 6.5 percent   |
| Coarse Aggregate     | = 1,158 kg/m <sup>3</sup>   |
| Fine Aggregate       | = 705 kg/m <sup>3</sup>   |
| Admixture            | = water-reducing admixture (target reduction of 6 percent)        |
| Mortar Factor        | = 0.83  |
| Voids                | = 0.37  |
| Slump (Target)       | = 38 mm*  |
| Strength (Minimum)   | = 24,000 kPa at 14 days   |
| Water/Cement Ratio   | = 0.41  |

\* Experience has been that the slump at the paver will most likely be 38 mm to aid in achieving a smooth pavement.

**2.10 SUMMARY OF MIX DESIGN EQUATIONS**

| Volume of Cement & Finely Divided Minerals |  | Variable     | Definition  |
|--|--|--------------|---|
| English                                    | Absolute Volume, $V_{Cement} = \frac{Weight}{G_{sp} \times 1,683.99}$<br>$V_{FDM} = \frac{Weight}{G_{sp} \times 1,683.99}$ | $V_{Cement}$ | Absolute Volume of Cement, yd <sup>3</sup> (m <sup>3</sup> )                  |
|  |  | $V_{FDM}$    | Absolute Volume of Finely Divided Minerals, yd <sup>3</sup> (m <sup>3</sup> ) |
|  |  | Weight       | Weight of Material (lb)   |
|  |  | $G_{sp}$     | Specific Gravity of Material*   |
| Metric                                     | Absolute Volume, $V_{Cement} = \frac{Mass}{G_{sp} \times 1,000.00}$<br>$V_{FDM} = \frac{Mass}{G_{sp} \times 1,000.00}$     | Mass         | Mass of Material (kg)   |
|  |  | 1,683.99     | Unit Weight of Water (lb/yd <sup>3</sup> )                                    |
|  |  | 1,000.00     | Unit Weight of Water (kg/m <sup>3</sup> )                                     |
|  |  |              |   |
| Basic Water Requirement—IDOT Method        |  |              |   |
| English & Metric                           | Basic Water Requirement, $W_{Basic} = W_{FA} + W_{CA}$   | $W_{Basic}$  | Basic Water Requirement, gal/cwt (L/kg)                                       |
|  |  | $W_{FA}$     | Fine Aggregate Water Requirement, gal/cwt (L/kg)                              |
|  |  | $W_{CA}$     | Coarse Aggregate Water Requirement, gal/cwt (L/kg)                            |
| Adjusted Basic Water Requirement           |  |              |   |
| English & Metric                           | Adjusted Basic Water Requirement, $W_{Adj} = W_{Basic} - (W_{Basic} \times \frac{\%Adjustment}{100})$                      | $W_{Adj}$    | Adjusted Basic Water Requirement, gal/cwt (L/kg)                              |
|  |  | $W_{Basic}$  | Basic Water Requirement, gal/cwt (L/kg)                                       |
|  |  | %Adjustment  | Adjustment (± percent)  |
| Water/Cement Ratio                         |  |              |   |
| English                                    | Water/Cement Ratio, $W/C = \frac{W_{Adj} \times 8.33}{100}$  | $W/C$        | Water/Cement Ratio  |
|  |  | $W_{Adj}$    | Adjusted Basic Water Requirement (gal/cwt)                                    |
|  |  | 8.33         | Conversion Factor (lb/gal)  |
|  |  | 100          | Conversion Factor (lb/cwt)  |
| Metric                                     | Water/Cement Ratio, $W/C = W_{Adj} \times 1.00$  | $W_{Adj}$    | Adjusted Basic Water Requirement (L/kg)                                       |
|  |  | 1.00         | Conversion Factor (kg/L)  |
| Volume of Water                            |  |              |   |
| English                                    | Absolute Volume, $V_{Water} = \frac{Weight}{1,683.99}$   | Weight       | Weight of Water (lb)  |
| Metric                                     | Absolute Volume, $V_{Water} = \frac{Mass}{1,000.00}$   | Mass         | Mass of Water (kg)  |
|  |  | 1,683.99     | Unit Weight of Water (lb/yd <sup>3</sup> )                                    |
|  |  | 1,000.00     | Unit Weight of Water (kg/m <sup>3</sup> )                                     |
| Volume of Entrained Air                    |  |              |   |
| English & Metric                           | Absolute Volume, $V_{Air} = \frac{\%Air}{100}$   | $V_{Air}$    | Absolute Volume of Air, yd <sup>3</sup> (m <sup>3</sup> )                     |
|  |  | % Air        | Air Content (percent)   |

| Minimum Percent Air Content                  |  | Variable         | Definition  |
|--|--|------------------|---|
| <i>English &amp; Metric</i>                  | Minimum Percent Air<br>= $[0.18 \times (V_{Water} + V_{Cement} + \Sigma V_{FDM})] \times 100$  | $V_{Water}$      | Absolute Volume of Water, yd <sup>3</sup> (m <sup>3</sup> )                                 |
|  |  | $V_{Cement}$     | Absolute Volume of Cement, yd <sup>3</sup> (m <sup>3</sup> )                                |
|  |  | $\Sigma V_{FDM}$ | Sum Total of Absolute Volumes of Finely Divided Minerals, yd <sup>3</sup> (m <sup>3</sup> ) |
| Volume Fraction of Coarse Aggregate & Mortar |  |                  |   |
| <i>English &amp; Metric</i>                  | Fraction of CA Solids = 1 - V  | V                | Voids in Coarse Aggregate   |
|  | Volume Fraction of Mortar = $\frac{M_O}{M_O + F_{CA}}$   | $M_O$            | Mortar Factor   |
| Volume of Coarse Aggregate                   |  |                  |   |
| <i>English &amp; Metric</i>                  | Absolute Volume,<br>$V_{CA} = 1 - \text{Volume Fraction of Mortar}$<br>OR<br>$V_{CA} = \frac{1}{1 + \left(\frac{M_O}{1 - V}\right)}$ | $V_{CA}$         | Absolute Volume of Coarse Aggregate, yd <sup>3</sup> (m <sup>3</sup> )                      |
|  |  | $M_O$            | Mortar Factor   |
|  |  | V                | Voids in Coarse Aggregate   |
| Volume of Fine Aggregate                     |  |                  |   |
| <i>English &amp; Metric</i>                  | Absolute Volume,<br>$V_{FA} = 1 - (V_{Cement} + \Sigma V_{FDM} + V_{Water} + V_{Air} + V_{CA})$                                      | $V_{FA}$         | Absolute Volume of Fine Aggregate, yd <sup>3</sup> (m <sup>3</sup> )                        |
|  |  | $V_{Cement}$     | Absolute Volume of Cement, yd <sup>3</sup> (m <sup>3</sup> )                                |
|  |  | $\Sigma V_{FDM}$ | Sum Total of Absolute Volume of Finely Divided Minerals, yd <sup>3</sup> (m <sup>3</sup> )  |
|  |  | $V_{Water}$      | Absolute Volume of Water, yd <sup>3</sup> (m <sup>3</sup> )                                 |
|  |  | $V_{Air}$        | Absolute Volume of Air, yd <sup>3</sup> (m <sup>3</sup> )                                   |
|  |  | $V_{CA}$         | Absolute Volume of Coarse Aggregate, yd <sup>3</sup> (m <sup>3</sup> )                      |
| Aggregate Content                            |  |                  |   |
| <i>English</i>                               | Weight of Aggregate (lb)<br>= $V_{CA} \times G_{SSD} \times 1,683.99$<br>= $V_{FA} \times G_{SSD} \times 1,683.99$                   | $V_{CA}$         | Absolute Volume of Coarse Aggregate, yd <sup>3</sup> (m <sup>3</sup> )                      |
|  |  | $V_{FA}$         | Absolute Volume of Fine Aggregate, yd <sup>3</sup> (m <sup>3</sup> )                        |
|  |  | $G_{SSD}$        | Specific Gravity of Aggregate @ Saturated Surface-Dry Condition                             |
| <i>Metric</i>                                | Mass of Aggregate (kg)<br>= $V_{CA} \times G_{SSD} \times 1,000.00$<br>= $V_{FA} \times G_{SSD} \times 1,000.00$                     | 1,683.99         | Unit Weight of Water (lb/yd <sup>3</sup> )  |
|  |  | 1,000.00         | Unit Weight of Water (kg/m <sup>3</sup> )   |

\* For cement and finely divided minerals, there are no pores for the material to absorb water. Therefore, a saturated surface-dry condition cannot exist as it can for aggregates. Thus, the term "apparent specific gravity" may be used to describe this type of specific gravity.

### 3.0 SPECIALTY MIXTURES

#### 3.1 HIGH-EARLY STRENGTH CONCRETE MIXTURES

Projects will frequently have requirements for high-early-strength portland cement concrete pavement (jointed and continuously reinforced), base course, and base course widening. A high-early-strength portland cement concrete mix is defined as follows: “A concrete mix that will meet mix design strength requirements prior to the test of record. Typically, the concrete strength is obtained in 3 days or less.”

Projects requiring high-early-strength concrete mixtures frequently involve intersections and entrances to business establishments. In addition, portland cement concrete railroad crossings are always a high-early-strength mixture because the required strength is to be obtained in 48 hours. The accelerated strength is needed to minimize disruptions to the public.

The following options are used to obtain a high-early-strength concrete mixture. The Contractor may submit other options for approval by the Engineer.

- Option 1. Replace the cement with Type III high-early-strength cement.
- Option 2. Increase the amount of cement to 7 bags. This would be 658 lb/yd<sup>3</sup> (390 kg/m<sup>3</sup>). However, such mix designs typically use 650 lb/yd<sup>3</sup> (386 kg/m<sup>3</sup>) or 655 lb/yd<sup>3</sup> (389 kg/m<sup>3</sup>).

In addition, limit the total aggregate water requirement to 4.9 – 5.1 gal/cwt (0.41 – 0.43 L/kg). As a result of the water limitation, a water-reducing admixture is frequently used.

- Option 3. Use a non-chloride accelerator. Normally, only a non-chloride accelerator is allowed in new concrete construction. For concrete repairs, the District has the option to allow a chloride accelerator, which is normally only done for Class PP-2 concrete. Refer also to 2.5.3 “Required Use of Admixtures” and 2.5.4 “Optional Use of Admixtures” for additional information on accelerators.

#### 3.2 OTHER MIXTURES

The following appendices provide additional information on other specialty mixtures:

- Appendix F “CEMENT AGGREGATE MIXTURE (CAM) II”
- Appendix G “CONTROLLED LOW STRENGTH MATERIAL (CLSM)”
- Appendix H “STAMPED OR INTEGRALLY COLORED CONCRETE
- Appendix I “CONCRETE REVETMENT MATS”
- Appendix J “INSERTION LINING OF PIPE CULVERTS (GROUT)”
- Appendix K “INSERTION LINING OF PIPE CULVERTS (CELLULAR CONCRETE)”
- Appendix L “CLASS SI CONCRETE BETWEEN PRECAST CONCRETE BOX CULVERTS”
- Appendix M “PERVIOUS CONCRETE”
- Appendix P “BRIDGE DECK LATEX CONCRETE OVERLAY MIX DESIGN”



### 3.3 SYNTHETIC FIBERS

The Department may require synthetic fibers for thin concrete overlays. The fibers are used as reinforcement to improve the concrete's resistance to cracking. Contractors also have the option to use synthetic fibers in slipformed concrete for gutter, curb, median, and paved ditch. The synthetic fibers reduce concrete tearing, which is a labor savings for finishing operations.

In terms of mix design, it is suggested to ensure adequate mortar is available to coat the fibers. This may require a slightly higher mortar factor, or a small increase in the total amount of cement and finely divided minerals in the mixture. It is best to consult with the supplier of the fibers when developing the mix design. The Level III PCC Technician is also reminded that the slump test is not a good indicator of workability for a mixture containing fiber reinforcement.

#### 4.0 TERNARY CONCRETE MIX DESIGNS

A ternary concrete mix design consists of cement and two finely divided minerals. The finely divided mineral in portland-pozzolan cement or portland blast-furnace slag cement shall count as one of the two finely divided minerals. Article 1020.05(c)(5) provides the specification for mixtures with multiple finely divided minerals. The Department encourages the use of a high percentage of finely divided minerals in a mix design for the following reasons:

- The risk of alkali-silica reaction is further reduced.
- The concrete permeability will be lower which increases the time before steel reinforcement will corrode.
- Improved workability and less slump loss in hot weather.
- Higher long term strengths.
- A more economical and environmentally friendly mix.

The one disadvantage of concrete mixtures with a high percentage of finely divided minerals is when cool weather occurs, which can cause slower strength gain.

## 5.0 MASS CONCRETE MIX DESIGNS

According to Article 1020.15, the Contractor shall control the heat of hydration for concrete structures when the least dimension for a drilled shaft, foundation, footing, substructure, or superstructure concrete pour exceeds 5.0 ft (1.5 m). The primary purpose is to control volume changes induced by the high concrete temperatures. Excessive volume changes may crack the concrete. Very high concrete temperatures may also produce a phenomenon known as delayed ettringite formation (DEF), which is an expansive distress that will crack the concrete. This ettringite will form after the concrete has hardened, provided there is adequate moisture.

In terms of designing a mass concrete pour mix design, specifications recommend a uniformly graded mix with preference given to larger size aggregate. The purpose is to reduce the total amount of cement and finely divided minerals required to coat the aggregate surface area, which will also help reduce the total heat of hydration. Per Department specifications, the total required cement and finely divided minerals may be lower for mass concrete pours.

Mass concrete pour mix designs will also normally have a high percentage of finely divided minerals to control the heat of hydration. For example, the finely divided minerals may constitute a maximum of 65.0 percent of the total cement and finely divided minerals in a mix design.

If the Level III PCC Technician is required to develop a mass concrete pour mix design, the Department recommends the use of a Consultant that specializes in this area. Various field methods for pre-cooling and post-cooling the concrete are available, and these methods will dictate the required mix design.

## 6.0 CONCRETE MIX DESIGN—TRIAL MIXTURE

Once a mix design is completed, a trial mixture is recommended to verify the mix design will meet slump, air content, and strength requirements as summarized in 2.7.1 “Air Content,” 6.1 “Slump,” and 6.2 “Strength.” If a trial mixture is performed, it is a good idea to notify the Department’s District office. The District may wish to observe the trial mixture or possibly perform some of its own testing.

### 6.1 SLUMP

The slump test (Illinois Modified AASHTO T 119) is used to determine the batch-to-batch consistency of concrete. Per Article 1020.04, different slump ranges are specified for different construction applications (also refer to Table 6.1).

Mix design target slump values near the maximum of the specified range are recommended to aid finishing and handwork, as well as potentially improving the effectiveness of air-entraining admixtures (that is, additional water benefits air-entraining admixtures). Furthermore, high slumps at the plant can help anticipate slump loss due to high temperature and long haul time, which otherwise could result in a mixture that may be difficult to place and finish in the field. For example, experience has shown that for slipformed pavement construction on a very hot day, a slump of 2-1/2 inches (64 mm) at the plant can fall up to 1-1/2 inches (38 mm) by the time it reaches the paver. A slump of 1/2 to 1-1/2 inches (13 to 38 mm) at the paver is typical for slipform construction, but many Contractors desire 1-1/2 inches (38 mm) to obtain a smooth pavement.

### 6.2 STRENGTH

One of the most important properties of concrete is its strength. The purpose of strength testing is to verify the strength potential of the concrete. Per Article 1020.04, different minimum strengths are specified for different construction applications (also refer to Table 6.2).

Additional information regarding determining target strength can be found in 7.0 “Determining the Concrete Mix Design Target Strength.”

**Table 6.1 Slump**

| <b>Class or Type of Concrete</b>                        | <b>Slump<br/>inches (mm)</b>        |
|---|-------------------------------------|
| PV  | 2-4 (50-100) <sup>1</sup>           |
| PP-1  | 2-4 (50-100) <sup>2</sup>           |
| PP-2  | 2-6 (50-150)                        |
| PP-3  | 2-4 (50-100)                        |
| PP-4  | 2-6 (50-150)                        |
| PP-5  | 2-8 (50-200)                        |
| RR  | 2-4 (50-100) <sup>3</sup>           |
| BS  | 2-4 (50-100) <sup>3</sup>           |
| PC  | Wet Cast: 1-4 (25-100) <sup>3</sup> |
|   | Dry Cast: 0-1 (0-25)                |
| PS  | 1-4 (25-100) <sup>3,4</sup>         |
| DS  | 6-8 (150-200) <sup>5</sup>          |
| SC  | 3-5 (75-125) <sup>6</sup>           |
| SI  | 2-4 (50-100) <sup>3</sup>           |
| Deck Slab Repair  | Refer to PP-1, 2, 3, 4, and 5       |
| Formed Concrete Repair                                  | 5-7 (125-175)                       |
| Concrete Wearing Surface                                | Refer to Class BS Concrete          |
| Bridge Deck Fly Ash or GGBF Slag Concrete Overlay       | Refer to Class BS Concrete          |
| Bridge Deck Microsilica Concrete Overlay                | 3-6 (75-150)                        |
| Bridge Deck High-Reactivity Metakaolin Concrete Overlay | 3-6 (75-150)                        |
| Bridge Deck Latex Concrete Overlay                      | 3-6 (75-150)                        |

## Notes:

1. The slump range for slipform construction shall be 1/2-2 1/2 in. (13-64 mm).
2. The maximum slump may be increased to 6 in. (150 mm), when a high range water-reducing admixture is used.
3. The maximum slump may be increased to 7 in. (175 mm), when a high range water-reducing admixture is used.
4. For Class PS, the 7 in. (175 mm) maximum slump may be increased to 8 1/2 in. (215 mm) if the high range water-reducing admixture is the polycarboxylate type.
5. If concrete is placed to displace drilling fluid, or against temporary casing, the slump shall be 8-10 in. (200-250 mm) at the point of placement. If a water-reducing admixture is used in lieu of a high range water-reducing admixture according to Article 1020.05(b)(7), the slump shall be 2-4 in. (50-100 mm).
6. The maximum slump may be increased to 200 mm (8 in.), when a high range water-reducing admixture is used.

**Table 6.2 Strength**

| <b>Class or Type of Concrete</b>                        | <b>Compressive Strength<br/>psi (kPa)</b> | <b>Flexural Strength<br/>psi (kPa)</b>  |
|---|---|---|
| PV  | 3,500 (24,000) <sup>1,2</sup>             | 650 (4,500) <sup>1,2</sup>              |
| PP-1  | 3,200 (22,100) <sup>3,8</sup>             | 600 (4,150) <sup>3,8</sup>              |
| PP-2  | 3,200 (22,100) <sup>4,8</sup>             | 600 (4,150) <sup>4,8</sup>              |
| PP-3  | 3,200 (22,100) <sup>5,8</sup>             | 600 (4,150) <sup>5,8</sup>              |
| PP-4  | 3,200 (22,100) <sup>6,8</sup>             | 600 (4,150) <sup>6,8</sup>              |
| PP-5  | 3,200 (22,100) <sup>7,8</sup>             | 600 (4,150) <sup>7,8</sup>              |
| RR  | 3,500 (24,000) <sup>3</sup>               | 650 (4,500) <sup>3</sup>                |
| BS  | 4,000 (27,500) <sup>1</sup>               | 675 (4,650) <sup>1</sup>                |
| PC  | Refer to Section 1042                     | Refer to Section 1042                   |
| PS  | Refer to Section 1020                     | Refer to Section 1020                   |
| DS  | 4,000 (27,500) <sup>1</sup>               | 675 (4,650) <sup>1</sup>                |
| SC  | 3,500 (24,000) <sup>1</sup>               | 650 (4,500) <sup>1</sup>                |
| SI  | 3,500 (24,000) <sup>1</sup>               | 650 (4,500) <sup>1</sup>                |
| Deck Slab Repair  | Refer to PP-1, 2, 3, 4, and 5             | Refer to PP-1, 2, 3, 4, and 5           |
| Formed Concrete Repair                                  | 4,000 (27,500) <sup>1</sup>               | 675 (4,650) <sup>1</sup>                |
| Concrete Wearing Surface                                | Refer to Class BS Concrete <sup>9</sup>   | Refer to Class BS Concrete <sup>9</sup> |
| Bridge Deck Fly Ash or GGBF Slag Concrete Overlay       | Refer to Class BS Concrete                | Refer to Class BS Concrete              |
| Bridge Deck Microsilica Concrete Overlay                | 4,000 (27,500) <sup>1</sup>               | 675 (4,650) <sup>1</sup>                |
| Bridge Deck High-Reactivity Metakaolin Concrete Overlay | 4,000 (27,500) <sup>1</sup>               | 675 (4,650) <sup>1</sup>                |
| Bridge Deck Latex Concrete Overlay                      | 4,000 (27,500) <sup>1</sup>               | 675 (4,650) <sup>1</sup>                |

## Notes:

1. 14 day strength
2. If Type III cement is used, the indicated strength shall be achieved in 3 days.
3. 48 hour strength
4. 24 hour strength
5. 16 hour strength
6. 8 hour strength
7. 4 hour strength
8. For Class PP concrete used in bridge deck patching, the mix design shall have 72 hours to obtain a 4,000 psi (27,500 kPa) compressive or 675 psi (4,650 kPa) flexural strength.
9. When Steel Bridge Rail is used in conjunction with concrete wearing surface, the 14 day mix design shall be replaced by a 28 day mix design with a compressive strength of 5,000 psi (34,500 kPa) and a flexural strength of 800 psi (5,500 kPa).

### 6.3 PROCEDURE FOR TRIAL MIXTURE

The applicable test methods for a conventional concrete trial mixture are Illinois Modified AASHTO R 60, T 22, T 23, T 119, T 121, T 152, T 177, T 196, and Illinois Modified ASTM C 1064. Testing shall be performed by an individual who has successfully completed the Portland Cement Concrete Level I Technician training.

For self-consolidating concrete, applicable test methods for a trial mixture are Illinois Test Procedures SCC-1, SCC-2, SCC-3, SCC-4, SCC-6, and Illinois Modified AASHTO R 60, T 22, T 23, T 121, T 152, T 177, T 196, and Illinois Modified ASTM C 1064. Refer to Article 1020.04 to review the self-consolidating concrete specifications.

A unit weight test (Illinois Modified AASHTO T 121), which also provides yield, should be performed to check the accuracy of proportioning.

The Contractor is reminded that when a trial mixture is done, the water in admixtures shall be taken into account. Refer to 2.6 "Adjusted Basic Water Requirement and Water/Cement Ratio."

A trial mixture may be mixed in the laboratory according to AASHTO R 39 or in the field. The volume of the laboratory trial mixture is determined by the laboratory equipment. The volume of the field trial mixture shall be a minimum of 2 yd<sup>3</sup> (1.5 m<sup>3</sup>), but 4 yd<sup>3</sup> (3.0 m<sup>3</sup>) is strongly recommended to more accurately evaluate the influence of mixing.

The Portland Cement Concrete (PCC) Laboratory used to perform a trial mixture shall be approved according to the Bureau of Materials and Physical Research Policy Memorandum, "Minimum Private Laboratory Requirements for Construction Materials Testing or Mix Design." Field equipment used to perform a trial mixture shall be approved according to the Bureau of Materials and Physical Research Policy Memorandum, "Approval of Concrete Plants and Delivery Trucks."

For the trial mixture, it is recommended to batch the mixture at or near the maximum water/cement ratio. The air content should be within 0.5 percent of the maximum allowable specification value. Since it is difficult to entrain air in slipformed concrete, a value below the midpoint of the range is permissible. The slump should be within the allowable specification range. If batching self-consolidating concrete (SCC), applicable SCC tests should be within the allowable specification range. Determine the concrete temperature, and if desired, perform a unit weight test which also provides yield.

It needs to be mentioned that concrete temperature will have a significant influence on strength gain. If a cold weather concrete mix is being developed, a temperature in the 50 to 60 °F (10 to 16 °C) range may be more appropriate for the trial mixture. The same may be said for developing a warm weather concrete mix with a concrete temperature in the 80 to 90 °F (27 to 32 °C) range.

Once the mix design is within the allowable tolerance for slump and air content, or applicable SCC tests, evaluate the mix for consistency, plasticity, and workability. After this is done, make strength specimens. The Contractor has the option to make compressive or flexural specimens, or a combination of both. The Contractor is advised that in some instances flexural strength is specified, and compressive strength may be used only with the approval of the Engineer (refer to Articles 503.05

and 503.06 of the Standard Specifications). As a minimum, make strength specimens to determine the test of record. The test of record shall be the day indicated in the Standard Specifications, and is the minimum required strength. However, the Department recommends the development of a strength curve with testing at 3, 7, 14, 28, and 56 days. (Note: A 56 day break is not needed for a cement only mixture.) In the case of patching mixes, testing is measured in terms of hours. Therefore, a strength curve should be generated as recommended by the Engineer. For the test of record, or for testing at other ages, strength will be based on the average of a minimum two 6- by 12-in. (150- by 300-mm) cylinder breaks, three 4- by 8-in. (100- by 200-mm) cylinder breaks, or two beam breaks tested according to Illinois Modified AASHTO T 22 or T 177. Per Illinois Modified AASHTO T 23, cylinders shall be 6 by 12 in. (150 by 300 mm) when the nominal maximum aggregate size of the coarse aggregate exceeds 1 in. (25 mm). Nominal maximum size is defined as the largest sieve which retains any of the aggregate sample particles.

After the Contractor has evaluated the test results for specification compliance and the characteristics of the mix for field placement, the Contractor can accept it as is, adjust it, or re-design it. If the mix design is adjusted or re-designed, another trial mixture is recommended.



## 7.0 DETERMINING THE CONCRETE MIX DESIGN TARGET STRENGTH

Since the Department's mix design method is very conservative, often resulting in strength test results exceeding the minimum strength requirement, a statistical analysis of strength test results is not normally performed. However, the American Concrete Institute (ACI) has developed a statistical method to determine a mix design target strength.

The mix design target strength ( $f'_{cr}$ ) is defined as the average strength the concrete mix must attain to ensure the specified strength ( $f'_c$ ) is met. Note that "average" strength implies that half of the samples tested are stronger than the average, and half of the samples tested are weaker than the average. Thus, the mix design target strength must be a value higher than the minimum strength requirement.

The mix design target strength is based on statistics, and will vary between concrete producers. The purpose of the target strength is to allow for variations in water, air content, aggregate gradation, concrete mixing, producer quality control, and other parameters which affect strength. The mix design target strength ensures that the variations will not cause individual strength test results to drop below the minimum specification strength requirement.

Ultimately, the adjustment of the average to obtain the target strength for a given mix design depends on the precision of test results. The precision is quantified as the standard deviation from a series of test results on a similar mix design. Refer to Appendix N "Average and Standard Deviation" for additional information.

Procedures for determining the mix design target strength from the minimum specification strength requirement can be found in the ACI Building Code (ACI 318), summarized below:

- The average strength of any three consecutive tests\* may not be below the specified value of compressive strength,  $f'_c$ .
- The strength of any one test\* may not exceed 500 psi (3,450 kPa) below  $f'_c$  when  $f'_c$  is 5000 psi (34,475 kPa) or less; or may not exceed  $0.10f'_c$  below  $f'_c$  when  $f'_c$  is more than 5000 psi (34,475 kPa).

\* One test is the average of two 6- by 12-in. (150- by 300-mm) cylinder breaks or three 4- by 8-in. (100- by 200-mm) cylinder breaks.

To achieve these criteria, the mix design target strength ( $f'_{cr}$ ) is adjusted upwards of the specified strength  $f'_c$ .

Using the above criteria, there is only a 1 percent chance that the average of any three consecutive test values will be less than the specified strength ( $f'_c$ ). In addition, there is only a 1 percent chance that the strength of any one test will be more than 500 psi (3,450 kPa) below the specified strength ( $f'_c$ ) when  $f'_c$  is no more than 5000 psi (34,475 kPa); or will be more than 10 percent below the specified strength ( $f'_c$ ) when  $f'_c$  is more than 5000 psi (34,475 kPa).

In order to calculate the mix design target strength, the standard deviation ( $S$ ) must be determined. The standard deviation shall be based on: actual tests of the mix design using materials, quality control procedures, and conditions similar to those expected; test results within 1,000 psi (6,900 kPa) of the strength requirement for the mix design; and at least 30 consecutive tests or two groups of consecutive tests totaling at least 30 tests are

required. For 30 tests, this means that 30 separate batches of concrete have been tested. The time period for the 30 tests may be up to one year, or as determined by the Engineer.

The standard deviation shall be based on at least 30 test results. Smaller data sets may be used when a modification factor ( $m$ ) is applied to  $S$  as follows:

| Number of Tests | Modification Factor ( $m$ ) |
|-----------------|-----------------------------|
| $\geq 30$       | 1.00                        |
| 25              | 1.03                        |
| 20              | 1.08                        |
| 15              | 1.16                        |

After the standard deviation is determined, the mix design target strength ( $f'_{cr}$ ) can be determined using the larger value calculated from the following two equations:

For  $f'_c \leq 5000$  psi (34,475 kPa):

$$f'_{cr} = f'_c + (1.34 \times mS) \text{ (English and Metric), or}$$

$$f'_{cr} = f'_c + (2.33 \times mS) - 500 \text{ psi (English); } f'_{cr} = f'_c + (2.33 \times mS) - 3,450 \text{ kPa (Metric)}$$

For  $f'_c > 5000$  psi (34,475 kPa):

$$f'_{cr} = f'_c + (1.34 \times mS) \text{ (English and Metric), or}$$

$$f'_{cr} = 0.90f'_c + (2.33 \times mS) \text{ (English and Metric)}$$

If there are less than 15 tests or no test data available, the mix design target strength ( $f'_{cr}$ ) is determined as follows:

| Less Than 15 Tests or No Test Data Available: | Mix Design Target Strength      |
|---|---------------------------------|
| If $f'_c < 3,000$ psi                         | $f'_{cr} = f'_c + 1,000$ psi    |
| If $f'_c$ is 3,000 – 5,000 psi                | $f'_{cr} = f'_c + 1,200$ psi    |
| If $f'_c > 5,000$ psi                         | $f'_{cr} = 1.10 f'_c + 700$ psi |

| Less Than 15 Tests or No Test Data Available: | Mix Design Target Strength        |
|---|-----------------------------------|
| If $f'_c < 20,685$ kPa                        | $f'_{cr} = f'_c + 6,895$ kPa      |
| If $f'_c$ is 20,685 – 34,475 kPa              | $f'_{cr} = f'_c + 8,274$ kPa      |
| If $f'_c > 34,475$ kPa                        | $f'_{cr} = 1.10 f'_c + 4,826$ kPa |

Per ACI,  $f'_c$  is based on 28 day tests or as otherwise specified. For Department mix designs,  $f'_c$  will frequently be based on 14 day tests when  $f'_c$  is no more than 4000 psi (4,650 kPa) and 28 day tests when  $f'_c$  is greater than 4000 psi (4,650 kPa).

## 8.0 REQUIREMENTS FOR CONCRETE DURABILITY TEST DATA

The Department does not normally test concrete for freeze/thaw and salt scaling durability because of the following requirements:

- Concrete mix design procedures are specified.
- Concrete mix design parameters are specified, such as minimum cement, maximum finely divided minerals, maximum water/cement ratio and amount of air entrainment.
- Concrete coarse aggregates are specified to be freeze/thaw durable for certain construction items.

This is also why the Department does not normally calculate target strengths or require trial batches for non-experimental mix designs.

If the Contractor desires to create a new concrete mix design which is not within the mortar factor limits as listed in 2.8.2.2 "Design Mortar Factor," durability test data will be required by the Engineer. In no case shall the mortar factor exceed 0.86 for Class BS concrete, except when using structural lightweight concrete as noted in 2.8.2.2. Furthermore, in no case shall the fine aggregate portion exceed a maximum 50 percent by weight (mass) of the total aggregate used.

The Contractor shall have the durability tests performed by an independent laboratory accredited by the AASHTO Materials Reference Laboratory (AMRL) for Portland Cement Concrete. Durability test data shall consist of the following:

- The new concrete mix design shall be tested according to AASHTO T 161, Procedure A or B. The new concrete mix design shall have a relative dynamic modulus of elasticity which is a minimum 80 percent of the initial modulus, after 300 cycles.
- The new concrete mix design shall be tested according to Illinois Modified ASTM C 672. An identical control mix shall be tested, except it shall have 565 lb/yd<sup>3</sup> (335 kg/m<sup>3</sup>) of cement and no finely divided minerals. The average visual rating of the new mix design divided by the average visual rating of the control mix design shall not exceed 0.8 after 60 cycles.

## 9.0 DEPARTMENT CONCRETE MIX DESIGN VERIFICATION

### 9.1 VERIFICATION BY THE ENGINEER

A new concrete mix design will be verified by the Engineer from test information provided by the Contractor (optional), testing performed by the Engineer, applicable Department historical test data, target strength calculations, and previous Department experience.

For a mix design previously developed by the Engineer or Contractor, the Engineer will verify the mix design if the Department's historical test data shows compliance with specification requirements.

Verification of a mix design shall in no manner be construed as acceptance of any mixture produced. Tests performed at the jobsite will determine if a mix design can meet specifications.

### 9.2 TESTING PERFORMED BY THE ENGINEER

For a new mix design to be verified, the Engineer may require the Contractor to provide a batch of concrete for testing if one of the following applies:

- Any time the Engineer has a concern the mix design will not meet minimum strength requirements. As an example, this may occur for a mix that will be used in cool weather or requires high-early-strength.
- Any time the Engineer has a concern the mix design will not provide adequate workability, consistency, and plasticity in the field. As an example, this may occur when the mix is to be pumped or stone sand is to be used.
- Any time the District lacks experience or historical test data for the design parameters, gradations, or material sources used in the mix design.
- Any time the Contractor desires to use a mortar factor outside the limits as listed in 2.8.2.1 "Design Mortar Factor." Refer to 8.0 "Requirement for Concrete Durability Test Data" for additional information.

In addition, the Engineer may require the Contractor to provide a trial batch per Articles 1001.01(b); 1001.01(c); 1020.04, Table 1, Note 12; 1020.05(c)(1)d.; and 1020.05(c)(2)c.

The batch of concrete shall be provided at no cost to the Department.

The Engineer may require the Contractor to provide a sample of coarse aggregate, at no cost to the Department, to verify the coarse aggregate voids test value.

The Engineer may require the Contractor to provide material, at no cost to the Department, to perform durability testing according to ITP 161 and Illinois Modified ASTM C 672.

### 9.2.1 Procedure for Trial Batch

The procedure that follows shall be used to perform a trial batch unless specified otherwise in the contract plans.

The trial batch shall be performed in the presence of the Engineer, and the Engineer will perform all tests. The Contractor has the option to perform their own tests. The volume of the trial batch shall be a minimum of 2 yd<sup>3</sup> (1.5 m<sup>3</sup>), but 4 yd<sup>3</sup> (3.0 m<sup>3</sup>) is strongly recommended to more accurately evaluate the influence of mixing. If the mixer has a capacity less than 2 yd<sup>3</sup> (1.5 m<sup>3</sup>), then the volume of the trial batch shall be no less than the capacity of the mixer.

For conventional concrete, batch at or near the maximum water/cement ratio or as requested by the Engineer. The air content should be within 0.5 percent of the maximum allowable specification value or as requested by the Engineer. Since it is difficult to entrain air in slipformed concrete, consult with the Engineer on an acceptable value. The slump should be within the allowable specification range. In addition, concrete temperature will be determined by the Engineer. Testing will be performed according to Illinois Modified AASHTO R 60, T 23, T 119, T 152 or T 196, , and Illinois Modified ASTM C 1064.

For the self-consolidating concrete, batch at or near the maximum water/cement ratio or as requested by the Engineer. The air content should be within 0.5 percent of the maximum allowable specification value or as requested by the Engineer. The slump flow, visual stability index, and J-ring value or L-box blocking ratio should be within the allowable specification range. In addition, hardened visual stability index and concrete temperature will be determined by the Engineer. Testing will be performed according to Illinois Test Procedures SCC-1, SCC-2, SCC-3, SCC-4, SCC-6, and Illinois Modified AASHTO R 60, T 23, T 152 or T 196, and Illinois Modified ASTM C 1064. Refer to Article 1020.04 to review the self-consolidating concrete specifications.

For all trial batches, strength will be determined for the test of record or at other ages determined by the Engineer. The test of record shall be the day indicated in Article 1020.04 or as specified. In all cases, strength will be based on the average of a minimum two 6- by 12-in. (150- by 300-mm) cylinder breaks, three 4- by 8-in. (100- by 200-mm) cylinder breaks, or two beam breaks tested according to Illinois Modified AASHTO T 22 or T 177. Per Illinois Modified AASHTO T 23, cylinders shall be 6 by 12 in. (150 by 300 mm) when the nominal maximum aggregate size of the coarse aggregate exceeds 1 in. (25 mm). Nominal maximum size is defined as the largest sieve which retains any of the aggregate sample particles.

As an option for all trial batches, Illinois Modified AASHTO T 121 may be performed.

#### 9.2.1.1 Verification of Trial Batch, Voids Test, and Durability Test Data

The trial batch will be verified by the Engineer if Department test results meet specification requirements. The coarse aggregate voids will be verified by the Engineer if the Department test result is within 0.02 of the Contractor's value. The Contractor's durability test data will be verified by the Engineer if Department test results meet the requirements of 8.0 "Requirements for Concrete Durability Test Data."

Note: Based on the concrete temperature used in the trial batch, the Engineer may request another trial batch to take into consideration the year round use of a mix design. For example, a mix design evaluated at a warm concrete temperature may need another evaluation at a cool concrete temperature to show the mix design is appropriate for cold weather.



Illinois Department of Transportation

**PORTLAND CEMENT**  
**CONCRETE**  
**LEVEL III**  
**TECHNICIAN COURSE**

**APPENDICES**

Revised: February 1, 2016





# **APPENDIX A**

## **CONCRETE MIX DESIGN – DEPARTMENT PROVIDED (BDE)**

Effective: January 1, 2012

Revised: January 1, 2014

For the concrete mix design requirements in Article 1020.05(a) of the Supplemental Specifications and Recurring Special Provisions, the Contractor has the option to request the Engineer determine mix design material proportions for Class PV, PP, RR, BS, DS, SC, and SI concrete. A single mix design for each class of concrete will be provided. Acceptance by the Contractor to use the mix design developed by the Engineer shall not relieve the Contractor from meeting specification requirements.

80277

This Page Reserved

# APPENDIX B

## PCC MIX DESIGN MISTIC PRINTOUT AND INSTRUCTIONS

```
PROGRAM: DTGMIRFD                PCC MIX DESIGN                MMTY3110.DOC
      TRANS: 110                  CREATE, UPDATE, DELETE SCREEN
      SCREEN: DTY03110            (NEW 7/09/96)
ACTIVATED: /FOR DTY03110
```

```
-----+-----
LN|COLS  ....1.....2.....3.....4.....5.....6.....7.....8
NO|1...5...0...5...0...5...0...5...0...5...0...5...0...5...0
```

```
-----+-----
1|      DTT03110                PCC DESIGN MIX
2|      CREATE: 1      UPDATE:      DELETE:      DATE
3| PCC MIX #: ---3----- MATERIAL: ---4-----5----- EFFECT: --6---
4| REF DESIGN #: ---7----- CLASS: 8- -- -- -- -- LAST YR USED: 9- TERM: -10---
5| RESP: 11- ***12***** LAB: 13 ---14----- REVIEWED BY: --15----- DFLAG:16-
6| MIX PROD: --17-----18----- CONTRACT: ----19-----
7| BATCH      H2O% FINE %      (Z) MORTOR {TYPE} {H2O L/kg} {ABS. VOL}
8| CU m ADX RED MOD AIR VOIDS CEMENT FACTOR ASH FA FA CA CA,B FA,A
9| -20^- -21 22^- -^23 24^ ^25 -26- --^27 28 29 ^30- ^31- ^/32/ ^/33/
10|                                     %BLEND/ %MOIST/ {kg/CU m} LBS/
11| MATERIAL PROD NO PROD NAME      SP G Z RATIO REPL SSD ADJ CU YD
12| --34----- --35--- ****36***** -^37- 38-^- 39^-- /40/ /41/ /42/
13| ----- ***** -^----- --^-- --^-- /43/ /44/ /45/
14| ----- ***** -^----- --^-- --^-- /46/ /47/ /48/
15| ----- ***** -^----- --^-- --^-- /49/ /50/ /51/
16| ----- ***** -^----- --^-- --^-- /52/ /53/ /54/
17| ----- ***** -^----- --^-- --^-- /55/ /56/ /57/
18| {CA + FA} {RATIOS} ADJ H2O(kg:LBS) /43/ /44/
19| MIX H2O: ^/45/ ASH/CMT WT: 46^/ TOTAL BATCH WT(kg:LBS) /47/ /48/
20| RED MIX H2O: ^/49/
21| TOTAL CEMENTITIOUS MATL: /50/ THEO. WATER(kg:LBS) /51/ /52/
22| REMARKS: ---53----- THEO H2O (GAL) 54^/
23| REMARKS: -----55----- ADJ H2O (GAL) 56^/
24| MESSAGES: PROCESS: _
```

```
-----+-----
|0.....1.....2.....3.....4.....5.....6.....7.....8
|1...5...0...5...0...5...0...5...0...5...0...5...0...5...0
```

- NOTES: 1). Messages:
- ?? indicates required info is missing.
  - \$\$ indicates illegal field contents.
  - highlighted fields must be numeric.

LEGEND

- / - Represent Calculated fields; /'s would NOT display on Create\Update screen.
- ^ - Represent the decimal position within a field; ^'s would NOT display on screen.
- > - Represent new fields and or lables; >'s would not appear on the screen.
- \_ - Represent INPUT fields and locations; would be displayed on Create screen.

1. **Create-**: This field may be left blank or a "Y" may be entered. As soon as this screen is fully metricated, the cursor will start in the "Calc" field. Since this is a create transaction, update and delete are not available. Once a mix design has been used, it should never be deleted.
2. **Cal**: Calculation flag. Enter "Y" to have the screen calculate the design. Type "N" and press "Enter" in order to manually enter data into all fields. Once "Enter" has been pressed, the "Calc" field may not be changed in the create mode. This is a new field that is not currently displayed but will be after the screen conversion is complete.
3. **\* ~~PCC Mix #~~**: Mix design number Example: 82PCC1234. Any combination of letters and numbers may be used in the last four digits.
4. **\* ~~Material~~**: Material code for the concrete mix. This should always be **metric**. Example: 21601M or 21605M.
5. **~~Material code name~~**: Based on the input material code, MISTIC displays the associated material code name.
6. **\* ~~Effect~~**: Effective date of the mix design, "mmddy." This represents the date the mix design was available for use.
7. **~~Ref Design #~~**: Reference mix design number. If the mix design that is being created is similar to another one, then the similar design number can be entered here. When the "Enter" key is pressed all the design, component and remarks data will be automatically pulled from the referenced design into the new design. The data can be adjusted after entering a "N" in the process field. This will be working in the near future.
8. **Class**: Class of concrete. Example: BD for bridge deck (see spec book, pages 678-681). This field has five occurrences
9. **~~Last Yr Used~~**: This is the last year the mix design was used. **This is not an input field.** In the future, the year will be inserted/updated automatically each time the 654 screen creates a new record.
10. **Term**: Termination date of the mix design, "mmddy." If a 654 or 655 transaction uses a sample date greater than the termination date of a mix design, then a warning message will be displayed.
11. **\* ~~Resp~~**: Responsible location. Enter the digit "9" followed by the district number. Based on the number entered, MISTIC will generate the responsible location name.
12. **~~Resp Name~~**: Based on the input responsible location number, MISTIC will display the associated responsible location name.
13. **~~Lab~~**: Laboratory associated with the creation of the design. Based on the number entered, MISTIC will generate the laboratory name. Example: FP, for district paper designs; DI, for district laboratory; PP, for producer paper designs; PL, producer laboratory designs etc. This field is not required but it should be used.

14. **Lab Name:** Based on the input lab acronym, MISTIC displays the associated lab name.
15. **Reviewed by:** Name of the person that has reviewed the design.
16. **Dflag:** Delete flag. A "D" should be entered if the mix design is no longer valid or no longer being used.
17. **Mix Prod:** Concrete mix producer number, Example: 1945-01. Based on the number entered, MISTIC will display the concrete mix producer name when the screen is processed. Optional field.
18. **Mix Prod Name:** Based on the input mix producer number, MISTIC will display the associated mix producer name.
19. **Contract:** Contract number. This may be filled in for a contract specific mix design. Optional field.
20. **\* Batch, CU m:** Batch size in cubic meters. This field should always be filled in with the number "1".
21. **Adx:** Admixture type. Enter as follows: "W" = water reducer, "S" = superplasticizer, "R" = Retarder
22. **H<sub>2</sub>O% Red:** Percentage of water reducer used. Example: 2.5.
23. **Fine Mod:** Fineness modulus of the fine aggregate used in the mix design. Example: 2.36. Optional field.
24. **\* % Air:** Percentage of air entraining. Example: 1.5.
25. **\* Voids:** Percentage of voids in the coarse aggregate used in the mix design, entered as a decimal. Example: 0.42.
26. **\* (Z) Cement:** Theoretical or original/target cement quantity in kilograms per cubic meter. This will not be the actual cement quantity if the mix contains any cement replacement products (fly ash, GGBF slag, microsilica, etc.) Conversion Example:  $6.05 \text{ cwt/yd}^3 * 59.327583 = 359 \text{ kg/m}^3$ ,  $605 \text{ lbs./yd}^3 * 0.593276 = 359 \text{ kg/m}^3$ .
27. **\* Mortar Factor:** Ratio of the volume of the mortar to the coarse aggregate volume. Example: .80
28. **Type, Ash:** Single letter designation for the type of fly ash used in the mix design. Use "C" or "F".
29. **Type, FA:** Single letter designation for the type of fine aggregate. Related to the relative angularity. Use "A", "B", or "C".

30. \* **H<sub>2</sub>O L/kg, FA:** Water requirement for fine aggregate in liters per kilogram of cement/cementitious materials. This value is based on what letter is used in the "Type, FA" field. "A" = .426 (5.1), "B" = .442 (5.3), "C" = .459 (5.5) Conversion: gallons/cwt \* .0834541 = liters/kg
31. \* **H<sub>2</sub>O L/kg, CA:** Water requirement for coarse aggregate in liters per kilogram of cement/cementitious material. For gravel, "0" is commonly used; for crushed stone, "0.2" is commonly used. Use the same metric conversion as fine aggregate 0.2 gal/cwt \* .0834541 = 0.017 liters/kg.
32. **Abs. Vol, CA,B:** Absolute volume of coarse aggregate per cubic meter of concrete. Calculated field. The letter "B" is also known as  $V_{CA}$  in 2.10 "Summary of Mix Design Equations".
33. **Abs. Vol, FA,A:** Absolute volume of fine aggregate per cubic meter of concrete. Calculated field. The letter "A" is also known as  $V_{FA}$  in 2.10 "Summary of Mix Design Equations".
34. \* **Material:** Component material codes. There are six occurrences of this field. All material codes must be metric ("M" in the 6th position). All aggregate material codes should be "A" quality or superstructure quality. Fly ash, ground granulated blast furnace slag, or microsilica should be input in the 5th occurrence. The cement material code should always be in the 6th occurrence. MISTIC will check the component material for being an acceptable product under the producer
35. \* **Prod No:** Component material producer number.. It is required for all aggregate and fly ash components but **it is not required for cement.**
36. **Prod Name:** Component material producer name. **This is not an input field.** Based on the producer number input, MISTIC will display the associated producer name.
37. \* **Sp G:** Specific gravity of each component material. The specific gravity value should be entered to the nearest .001. Example: 2.675. The specific gravity to be used for cement is 3.150.
38. \* **%Blend/Z Ratio:** This field has two uses: 1) %Blend for aggregate components - when using a blend of coarse aggregates or a blend of fine aggregates, the blend percentage must be entered for each component type that has a blend. Example: blending CA11 and CA16 @ 75%/25%--a 75 must be entered for the CA11 and a 25 for the CA16. The same would be true for fine aggregates. If there is not a blend, then the value should be "100". **Each component must have a value or the weights will not be calculated!** 2) Z Ratio for Fly ash and Cement components - when using fly ash the percentage of cement being replaced should be entered in this field for the fly ash material code. The remaining percentage should be entered for the cement. Example: 15 for fly ash and 85 for cement. If there is not any fly ash in the mix, then the value for cement should be "100".

39. \* **%Moist/Repl:** This field has two uses: 1) %Moisture for aggregate components - the percentage moisture greater or less than saturated surface dry must be entered using a "+" or "-" sign. Example: +1.00. If the value is zero, it should be entered as "0" without a "+" or "-" sign. 2) Replacement for fly ash and cement - for fly ash enter the replacement ratio. Example: +1.5 or +1.25. A "+1", should always be entered for cement. The requirement for the "+" will be removed in the near future.
40. **kg/CU m, SSD:** The saturated surface dry weight in kilograms per cubic meter for each component. Conversion:  $\text{lbs./yd}^3 * .593276 = \text{kg/m}^3$ . Calculated field.
41. **kg/CU m, ADJ:** The moisture adjusted weight in kilograms per cubic meter for each component. Calculated field.
42. **lbs/CU YD:** The weight of each component in pounds per cubic yard. Calculated field.
43. **ADJ H<sub>2</sub>O, kg:** Adjusted water content in kilograms per cubic meter. Conversion:  $\text{lbs/yd}^3 * .593276 = \text{kg/m}^3$ . Calculated field.
44. **ADJ H<sub>2</sub>O, lbs:** Adjusted water content in pounds per cubic yard. Calculated field.
45. **Mix-H<sub>2</sub>O:** Mix water in liters per kilogram of cement. This is the sum of the water requirements for fine (FA,A) and coarse (CA,B) aggregate. Calculated field.
46. **Ash/Cmt Wt:** Ratio of the weight of fly ash (kg) to the weight of cement (kg) per cubic meter. Calculated field.
47. **Total Batch Wt, kg:** Total weight of the components (including water) in kilograms per cubic meter. Calculated field.
48. **Total Batch Wt, lbs:** Total weight of the components (including water) in pounds per cubic yard. Calculated field.
49. **Red Mix H<sub>2</sub>O:** Reduced mix water. This is the mix water reduced by the amount of water reducer that has been added to the mix. Calculated field.
50. **Total Cementitious Matl:** This is the weight of the cement and the fly ash per cubic meter. This value is the sum of the cement and fly ash from the adjusted weight column. If only cement is used, then this value will be the same as the "Z Factor". If both cement and fly ash are used, then this value will be larger than the "Z Factor". Calculated field.
51. **Theo. Water, kg:** Theoretical water in kilograms per cubic meter. Calculated field.
52. **Theo. Water, lbs:** Theoretical water in pounds per cubic yard. Calculated field.
53. **Remarks:** First remarks line. When required to mitigate against alkali-silica reaction (ASR), indicate the mixture option selected for reducing the risk of deleterious reaction. Additionally, if applicable, indicate if synthetic fibers will be used in the mixture.
54. **Theo H<sub>2</sub>O (Gal):** Theoretical water in gallons per hundredweight of cement. Calculated field.

55. **Remarks:** Second remarks line.

56. **Adj H<sub>2</sub>O (Gal):** Adjusted water in gallons per hundredweight of cement. Calculated field.

**Footnotes:**

\* - Denotes a required input field

**Additional Note:**

Any fields labeled “calculated” are currently input fields but will become calculated fields after the enhancement of this screen is completed (in the very near future).



# APPENDIX B-A

|   |  |
|---|--|
| <h2 style="margin: 0;">PCC MIX DESIGN SOFTWARE TUTORIAL</h2> <p style="text-align: right; margin-top: 20px;"><b>(Version 2.4)</b></p> | <p>For help, comments, and/or suggestions, please contact:</p> <p style="margin-left: 20px;">James M. Krstulovich, Jr.<br/>                 IDOT Bureau of Materials and Physical Research<br/>                 126 East Ash Street<br/>                 Springfield, Illinois 62704<br/>                 Phone: (217) 782-7200<br/>                 email: <a href="mailto:DOT.PCCMIX@illinois.gov">DOT.PCCMIX@illinois.gov</a></p> |
|---|--|

**!!! IMPORTANT !!!** This spreadsheet utilizes macros. Depending on Excel's security settings, the macros may not be enabled. To change the macros settings for Excel, refer to the steps found at the end of this tutorial.


**General**

This spreadsheet is designed to calculate and report PCC mix designs for submittal to IDOT. The spreadsheet is comprised of data inputs based on the mix design methodology provided in the PCC Level III Technician course manual.

Buttons are provided for ease of navigation, and their use is recommended as they ensure proper operation throughout the design process. Using the worksheet tabs, found at the bottom of the Excel screen, will also work.

The blue-shaded areas are cells which require data input, green-shaded areas are optional (unless required by your District), and white cells are calculation fields, which are password protected from accidental overwriting.

Throughout the spreadsheet, comments have been interspersed to offer hints on where to find relevant information. To view comments, hold the cursor over the red tags found in the upper right hand corner of commented cells, as shown below. These comments generally refer to sections of the Course Manual; however, it should be noted that the Department's Standard Specifications and Special Provisions take precedence.

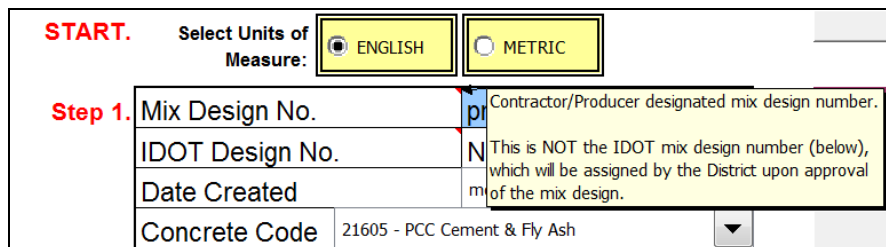


**Figure 1. Example of a comment; note red flag, which indicates the cell has a comment.**

**Tutorial Mix Design**

This tutorial also includes notes for how to input the example mix design discussed in Section 2.9 of the Course Manual. If you follow the notes in order as they are presented herein, you should successfully create a basic PCC paving mix design while also being introduced to all of the spreadsheet's functions and capabilities.

**Step 1. Design Information**

The Design Information page is important to establish the who-what-where of the mix design. This is where the designer decides in which units of measure the mix will be designed, what type of concrete it is, for what Classes of concrete it is valid, and those responsible for the mix design.

|                         |   |   |   |                                   |                                    |                                   |   |                    |    |
|-------------------------|---|---|---|-----------------------------------|------------------------------------|-----------------------------------|---|--------------------|----|
| <b>START.</b>           |   | Select Units of Measure: <input checked="" type="radio"/> ENGLISH <input type="radio"/> METRIC  | <b>FIT TO SCREEN</b>  | Version 2.4                       | Enter IDOT Engineers below...      |                                   |   |                    |    |
| <b>Step 1.</b>          | Mix Design No.  | pmc0001pv   | <b>IMPORTANT:</b> All worksheets are password protected.<br>Cells highlighted <b>BLUE</b> or <b>GREEN</b> can accept data input.<br><b>BLUE</b> cells are mandatory; <b>GREEN</b> cells are optional. | Step 2.<br>Enter Design Variables | View Design Report (English units) | Enockson                          |   |                    |    |
| IDOT Design No.         | Not yet assigned  | Step 3.<br>Enter Aggregate Information  |   |                                   |                                    | View Design Report (metric units) | Jones   |                    |    |
| Date Created            | mo day year   |   |   |                                   |                                    |                                   | Step 4.<br>Enter Finely Divided Minerals & Admixtures | View MISTIC Report | Au |
| Concrete Code           | 21605 - PCC Cement & Fly Ash  |   |   |                                   |                                    |                                   |   |                    |    |
| Class (select up to 5)  | <input checked="" type="checkbox"/> PV-Pavement <input type="checkbox"/> BS-Bridge Super <input type="checkbox"/> SI-Structures<br><input type="checkbox"/> PP-Patching <input type="checkbox"/> DS-Drilled Shaft <input type="checkbox"/> PC-Precast<br><input type="checkbox"/> RR-Railroad <input type="checkbox"/> SC-Seal Coat <input type="checkbox"/> PS-Prestressed |   |   |                                   |                                    |                                   |   |                    |    |
| Responsible Location    | 91 - District 1   |   |   |                                   |                                    |                                   |   |                    |    |
| Lab Type                | PP - Producer Plant Site Lab  |  Illinois Department of Transportation<br>For help, comments, and/or suggestions, please contact:<br>James Krstulovich, P.E.<br>Bureau of Materials & Physical Research<br>Phone: (217) 782-7200<br>email: <a href="mailto:DOT.PCCMIX@Illinois.gov">DOT.PCCMIX@Illinois.gov</a> |   |                                   |                                    |                                   |   |                    |    |
| Company Name:           | Pave Masters Co.  |   |   |                                   |                                    |                                   |   |                    |    |
| Location:               | Chicago   |   |   |                                   |                                    |                                   |   |                    |    |
| Designer Name:          | Smith   |   |   |                                   |                                    |                                   |   |                    |    |
| Phone:                  | 555-555-5555  |   |   |                                   |                                    |                                   |   |                    |    |
| email:                  | jsmith@email.com  |   |   |                                   |                                    |                                   |   |                    |    |
| Mix Producer No.:       | 1234-05   |   |   |                                   |                                    |                                   |   |                    |    |
| Name:                   | Everyman Redi-Mix Co.   |   |   |                                   |                                    |                                   |   |                    |    |
| IDOT Engineer           | Enockson  |   |   |                                   |                                    |                                   |   |                    |    |
| Contract No. (optional) |   |   |   |                                   |                                    |                                   |   |                    |    |

**Fit to Screen [button]:** Click this button to optimize each page of the mix design spreadsheet for viewing on your screen.

**English/Metric [toggle]:** Toggle button for selecting the units of measure for the mix design's inputs. All data inputs will have to be entered in the chosen units of measure. However, the design will be reported in **both** units of measure on the different final mix design reports generated.

|                        |   |
|------------------------|---|
| <b>EXAMPLE PROBLEM</b> | Assuming most of us are more comfortable using English units of measure (lbs, yd <sup>3</sup> , etc.), the example mix design will be designed using English units.<br><br>Click on the <b>ENGLISH</b> toggle button. |
|------------------------|---|

**Mix Design No.:** Alphanumeric designation (up to nine characters in length). This is the Producer's or Contractor's self-designated mix design number; this is not the mix design number assigned by IDOT, see "IDOT Mix Design No." below.

|                        |  |
|------------------------|--|
| <b>EXAMPLE PROBLEM</b> | Because this is the Producer's or Contractor's mix design number, any reasonably succinct and unique identifier can be used here, as long as it is no more than nine characters long. For this example, we will use <b>PMC0001PV</b> (i.e., Pave Masters Co. paving mix #1). |
|------------------------|--|

**IDOT Mix Design No.:** Nine character alphanumeric mix design number reported to the Department's MISTIC database. This number will be assigned by your District to an approved mix design.

|                        |   |
|------------------------|---|
| <b>EXAMPLE PROBLEM</b> | Because this mix design number is assigned by the District upon approval, this cell reads <b>Not yet assigned</b> . |
|------------------------|---|

**Date Created:** The date the mix design was created.

**Step 1. Design Information** (continued)

Concrete Code: Select the appropriate material code. This code is used by the Department's MISTIC database to designate the type of concrete.

|                        |   |
|------------------------|---|
| <b>EXAMPLE PROBLEM</b> | Because this mix will utilize Type I portland cement and Class C fly ash, the appropriate Concrete Code to select from the drop-down list is <b>21605</b> . |
|------------------------|---|

Class: Select up to five Classes of concrete.

|                        |   |
|------------------------|---|
| <b>EXAMPLE PROBLEM</b> | Because this mix will be used for a continuously reinforced portland cement concrete pavement, the appropriate Class to select is <b>PV</b> . |
|------------------------|---|

Responsible Location: District responsible for mix design's use; for example, "91" for District 1.

|                        |   |
|------------------------|---|
| <b>EXAMPLE PROBLEM</b> | Select one of the nine IDOT Districts with which you typically work; for example, select <b>91</b> if you often work with District 1 in the Chicago area. |
|------------------------|---|

Lab: Laboratory associated with the creation and/or testing of the design. For example: DI for district mix designs, or PP for producer mix designs. Contractors and Producers are to use "Producer" Lab codes. Consultants are to use "Independent" Lab codes.

Company Name: Name of laboratory responsible for creation and/or testing of mix design.

Location: Nearest municipality to Lab/Company.

Designer: Name, phone number, and email of person that created the design.

Mix Design Producer: MISTIC producer number and name of producer.

IDOT Engineer: This is the IDOT District representative to whom this mix design should be submitted for approval. Consult your District's Mixtures Control Engineer for more information. Use the yellow table to the right of the main input area to add names to the drop-down list.

Contract No.: (Optional) Either the five digit contract number, or if it is a local agency contract without a five digit number, then enter the MFT (Motor Fuel Tax) contract number.

**Step 2. Design Variables**

The *Design Variables* page is where the designer first begins to determine the mix design's parameters that factor into the mix design calculations.

FIT TO SCREEN

**2. Design Variables**

|                           |      |                               |
|---------------------------|------|-------------------------------|
| <b>Batch Size</b>         | 1.00 | cubic yard                    |
| <b>Cement Factor</b>      | 5.65 | cwt / cu yd                   |
| <b>Mortar Factor</b>      | 0.83 | Typically between 0.70 - 1.00 |
| <b>Target Air Content</b> | 6.5  | %                             |
| <b>Target Slump</b>       | 1.50 | in.                           |

|   |                   |  |
|---|-------------------|--|
| <b>Determine Water Content:</b>   |                   |  |
| <input checked="" type="radio"/> A. Standard Method <input type="radio"/> B. w/c Ratio Method |                   |  |
| FA Type: "B" Combination of rounded and angular particles                                     |                   |  |
| FA Water Req.   | 5.3               | gal/cwt  |
| CA Water Req.   | 0                 | gal/cwt  |
| Water Reduction   | 6.0               | % <span style="font-size: small;">Water Adjustment Help</span> |
| Fineness Mod  |                   | (optional)   |
| Admixture   | W - Water Reducer | ▼  |
| Fly Ash Class   | C                 | ▼  |

| Cement Factor Adjustment     |      |             |
|------------------------------|------|-------------|
| Initial:                     | 5.65 | cwt / cu yd |
| Reduction for Admixture Use: | 0.30 | cwt / cu yd |
| Addition for Underwater Use: |      | cwt / cu yd |
| Final:                       | 5.35 | cwt / cu yd |

| Typical FA Water Requirements |     |         |
|-------------------------------|-----|---------|
| Type A                        | 5.1 | gal/cwt |
| Type B                        | 5.3 | gal/cwt |
| Type C                        | 5.5 | gal/cwt |
| Typical CA Water Requirements |     |         |
| Cr. Stone                     | 0.2 | gal/cwt |
| Slag                          | 0.4 | gal/cwt |
| Gravel                        | 0.0 | gal/cwt |

Return to Start.  
 Design Information

Step 3.  
 Enter Aggregate Information

Step 4.  
 Enter Finely Divided Minerals & Admixtures

View Design Report  
 (English units)

View Design Report  
 (metric units)

View MISTIC Report

Batch Size: Batch size in cubic yards (cubic meters). All mix designs are created per 1 yd<sup>3</sup> (1 m<sup>3</sup>).

Cement Factor: Cement quantity in hundredweight per cubic yard (kilograms per cubic meter). Adjustments based on admixture use or underwater placement can be applied using the *Cement Factor Adjustment* table.

|                        |   |
|------------------------|---|
| <b>EXAMPLE PROBLEM</b> | From Table 2.2.1 in the Course Manual, the cement factor for Class PV concrete from a central mixed plant is <b>5.65 cwt/yd<sup>3</sup></b> .<br><br>Also, from Section 2.2.2, a cement factor reduction of <b>0.30 cwt/yd<sup>3</sup></b> can be applied because a water-reducing admixture will be used. Enter <b>0.30</b> in the appropriate box of the <i>Cement Factor Adjustment</i> table.<br><br>Thus, the final, adjusted cement factor is reduced to <b>5.35 cwt/yd<sup>3</sup></b> . |
|------------------------|---|

Mortar Factor: Refer to Table 2.8.2.3 *Design Mortar Factor* in the Course Manual.

|                        |  |
|------------------------|--|
| <b>EXAMPLE PROBLEM</b> | From Table 2.8.2.3 in the Course Manual, a mortar factor can be selected for Class PV concrete.<br><br>Enter <b>0.83</b> as a reasonable starting point. |
|------------------------|--|

Target Air Content: Percentage of entrained air in the concrete to improve durability. Refer to Table 2.7.1 *Air Content* in the Course Manual.

|                        |   |
|------------------------|---|
| <b>EXAMPLE PROBLEM</b> | From Table 2.7.1 in the Course Manual, the midpoint of the air content range for Class PV concrete is <b>6.5%</b> . |
|------------------------|---|

Target Slump: Enter the target slump in inches (mm). Refer to Table 6.1 *Slump* in the Course Manual.

|                        |   |
|------------------------|---|
| <b>EXAMPLE PROBLEM</b> | From Table 6.1 in the Course Manual, the slump range for Class PV concrete is 2 to 4 inches, except when slipformed, it is 1/2 to 2 1/2 inches (Table 6.1, Note 1). As noted in Section 6.1, experience has shown that a slump of 1/2 to 1-1/2 inches at the paver is typical for slipformed pavement construction, but many Contractors desire 1-1/2 inches to obtain a smooth pavement. Enter <b>1.5 inches</b> . |
|------------------------|---|

**Step 2. Design Variables** (continued)

**Determine Water Content**

First, using the toggle switch, select either the *Standard Method* or the *w/c Ratio Method*.

The *Standard* method requires the designer to enter fine and coarse aggregate water requirements, as well as percent water reduction. Refer to Section 2.5.1 *Water Requirement* in the Course Manual for more information.

Alternatively, the *w/c Ratio Method* will determine mix water based on the water/cement ratio (w/c) entered and the total content of cement and finely divided minerals. No water adjustment needs to be entered as it will be back-calculated based on the w/c ratio and aggregate water requirement inputs.

**If the Standard Method has been selected, refer to the following inputs:**

|                                 |  |   |   |                                      |             |
|---------------------------------|--|---|---|--------------------------------------|-------------|
| <b>Determine Water Content:</b> |  | <input checked="" type="radio"/> A. Standard Method | <input type="radio"/> B. w/c Ratio Method | <b>Typical FA Water Requirements</b> |             |
| <b>FA Type</b>                  | "B" Combination of rounded and angular particles ▼ |   |   | Type A                               | 5.1 gal/cwt |
| <b>FA Water Req.</b>            | 5.3  | gal/cwt   |   | Type B                               | 5.3 gal/cwt |
| <b>CA Water Req.</b>            | 0  | gal/cwt   |   | Type C                               | 5.5 gal/cwt |
| <b>Water Reduction</b>          | 6.0  | %   | <b>Water Adjustment Help</b>              | <b>Typical CA Water Requirements</b> |             |
| <b>Fineness Mod</b>             |  | (optional)  |   | Cr. Stone                            | 0.2 gal/cwt |
| <b>Admixture</b>                | W - Water Reducer                                  | ▼   |   | Slag                                 | 0.4 gal/cwt |
| <b>Fly Ash Class</b>            | C  | ▼   |   | Gravel                               | 0.0 gal/cwt |

**FA Type:** Select fine aggregate type.

|                        |   |
|------------------------|---|
| <b>EXAMPLE PROBLEM</b> | Because this mix will utilize a Type "B" fine aggregate, select <b>B</b> from the drop-down list. |
|------------------------|---|

**FA Water Req.:** Water requirement for fine aggregate in gallons per hundredweight (liters per kilogram) of cement and finely divided minerals. This value is based on the type of fine aggregate. For example, 5.1 gal/cwt (0.426 L/kg) is typical for Type "A" fine aggregate, as shown in the table, *Typical FA Water Requirements*.

|                        |  |
|------------------------|--|
| <b>EXAMPLE PROBLEM</b> | Because this mix will utilize a Type "B" fine aggregate, the typical water requirement is <b>5.3 gal/cwt</b> . |
|------------------------|--|

**CA Water Req.:** Water requirement for coarse aggregate in gallons per hundredweight (liters per kilogram) of cement and finely divided minerals material. This value is based on the type of coarse aggregate. Typical values are provided in the table, *Typical CA Water Requirements*.

|                        |  |
|------------------------|--|
| <b>EXAMPLE PROBLEM</b> | Because this mix will utilize a non-crushed gravel coarse aggregate, the typical water requirement is <b>0.0 gal/cwt</b> . |
|------------------------|--|

**Water Reduction:** Percentage of water adjustment (typically a reduction) taking into account various factors, such as admixture use, cement and finely divided mineral content, air content, etc. Note that because this input is referred to as a "reduction," the value entered may seem counter-intuitive; that is, a water reduction should be entered as a positive value, while a water addition should be entered as a negative value. For example, enter "10.0" for a 10 percent water reduction, and enter "-10.0" for a 10 percent water addition.

For help determining a reasonable water adjustment, click on the button, **Water Adjustment Help**. The Water Adjustment Help tab is modeled after Table 2.5.2 *Adjustment to Basic Water Requirement* in the Course Manual.

|                        |   |
|------------------------|---|
| <b>EXAMPLE PROBLEM</b> | Because this mix will utilize a water-reducing admixture to provide a target water reduction of 6%, enter <b>6.0</b> .<br><br>Note: If for some reason this mix needed a 6 percent water <u>addition</u> , you would have entered -6.0. |
|------------------------|---|

**Step 2. Design Variables** (continued)

*If the W/C Ratio Method has been selected:*

|                                 |  |  |  |
|---------------------------------|--|--|--|
| <b>Determine Water Content:</b> |  | <input type="radio"/> A. Standard Method | <input checked="" type="radio"/> B. w/c Ratio Method |
| Select FA Type >                | "B" Combination of rounded and angular particles ▼ |  |  |
| Enter W/C Ratio >               | 0.42   |  |  |
| CA Water Req. >                 | 0  |  |  |
| ignore >>>                      |  | Water Adjustment Help                    |  |

Enter W/C Ratio: When *w/c Ratio Method* is toggled, this field appears. Enter the target water/cement ratio that the design water will be based on; for example, 0.42.

It is still important to select the appropriate FA Type, as well enter the CA Water Requirement, so as to allow the spreadsheet to back-calculate the water reduction on the final mix design reports.

|                        |  |
|------------------------|--|
| <b>EXAMPLE PROBLEM</b> | <p>Another way to determine mix water is based on inputting a target water/cement ratio (w/c):</p> <p>In this example, per <b>Table 2.6.1</b> in the Course Manual, the maximum w/c for Class PV concrete is <b>0.42</b>.</p> <p>Also, by selecting the appropriate fine aggregate type ("B") and entering a reasonable water requirement for the coarse aggregate, the water reduction will be back-calculated on the final mix design reports.</p> |
|------------------------|--|

Fineness Mod: (Optional) Fineness modulus of the fine aggregate used in the mix design; for example, 2.36. Fineness modulus is for informational purposes only; fineness modulus does not factor into proportioning calculations.

Admixture: Choose an admixture type: "W – water reducer", "S – superplasticizer", or "R – retarder".

|                        |   |
|------------------------|---|
| <b>EXAMPLE PROBLEM</b> | Because this mix will utilize a water-reducing admixture to meet the water/cement ratio requirement, select <b>W – Water Reducer</b> from the drop-down list. |
|------------------------|---|

Fly Ash Class: Choose the class of fly ash used in the mix design, if applicable.

|                        |  |
|------------------------|--|
| <b>EXAMPLE PROBLEM</b> | Because this mix will utilize Class C fly ash, select <b>C</b> from the drop-down list. If this example did not utilize any fly ash, you would select "n/a". |
|------------------------|--|

**Step 3. Aggregate Information**

The Aggregate Information worksheet is where the designer enters all fine and coarse aggregate information. Note that although up to six aggregate materials can be accommodated by this spreadsheet, the Department's MISTIC database only allows a total of six materials, including cement and finely divided minerals. For example, four aggregates, one cement, and one finely divided mineral (e.g., fly ash); or three aggregates, one cement, and two finely divided minerals (e.g., fly ash and microsilica).

FIT TO SCREEN

**3. Aggregate Information**

|   | Material Code | Producer Number | Ledge Number | Producer Name    | SSD Sp. Gravity | % Blend | Moisture (%) |
|---|---------------|-----------------|--------------|------------------|-----------------|---------|--------------|
| 1 | 027fa01       | 54321-01        |              | Little Rocks Co. | 2.660           | 100.0   |              |
| 2 | 020ca07       | 12345-05        |              | Big Rock Co.     | 2.680           | 100.0   |              |
| 3 |               |                 |              |                  |                 |         |              |
| 4 |               |                 |              |                  |                 |         |              |
| 5 |               |                 |              |                  |                 |         |              |
| 6 |               |                 |              |                  |                 |         |              |

Return to **Start**.  
Design Information

Return to **Step 2**.  
Design Variables

**Step 4**.  
Enter Finely Divided Minerals  
&  
Admixtures Info

View Report (English)

View Report (metric)

View MISTIC Report

**3a. Voids in Coarse Aggregate**  
*Refer to Illinois Test Procedure 306*

Calculated
  User-Defined

| Coarse Aggregate | % Absorption | Oven-Dry Sp. Gravity |
|------------------|--------------|----------------------|
|                  |              |                      |
|                  |              |                      |
|                  |              |                      |
|                  |              |                      |
|                  |              |                      |
|                  |              |                      |

|                         |  |           |
|-------------------------|--|-----------|
| Net Weight of Aggregate |  | lb.       |
| Volume of Measure       |  | cu. ft    |
| SSD Sp. G               |  |           |
| % Absorption            |  | %         |
| Oven-Dry Sp. G          |  |           |
| Unit Weight             |  | lb/cu. ft |

**User-defined:** Enter voids, V =  <<<

**Calculated:** Volume of Voids per Unit Volume of Oven-Dry Rodded Coarse Aggregate V = **see above**

**Calibration of Measure:**

|                                 |  |        |
|---------------------------------|--|--------|
| Weight of Water to fill Measure |  | lb.    |
| Temperature of Water            |  | F      |
| Calibrated Volume of Measure    |  | cu. ft |

Material:

Aggregate material codes. Coarse and fine aggregates may be entered in any order, except as required by your District. For more information regarding aggregate material codes, refer to form BMPR MI504 "Field/Lab Gradations".

|                        |  |
|------------------------|--|
| <b>EXAMPLE PROBLEM</b> | <ul style="list-style-type: none"> <li>Fine aggregate: Enter <b>027FA01</b> as given in the Course Manual. This material code is for an "A" quality natural sand meeting the gradation criteria for FA 1 per Article 1003.01(c).</li> <li>Coarse aggregate: Enter <b>020CA07</b> as given in the Course Manual. This material code is for an "A" quality non-crushed gravel meeting the gradation criteria for CA 7 per Article 1004.01(c).</li> </ul> |
|------------------------|--|

Producer Number:

Aggregate producer number. This field is required for all aggregate components.

Producer Name:

Aggregate producer name.

Specific Gravity:

Saturated Surface Dry (SSD) specific gravity of each aggregate.

|                        |  |
|------------------------|--|
| <b>EXAMPLE PROBLEM</b> | The example problem as given in the Course Manual indicates that the saturated surface-dry specific gravities for the fine and coarse aggregate components are <b>2.66</b> and <b>2.68</b> , respectively. |
|------------------------|--|

**Step 3. Aggregate Information** (continued)

Agg. Moisture (%): Moisture of aggregates relative to SSD condition. If the percentage moisture is drier than SSD, it must be entered using a negative value (e.g., -1.00).

**EXAMPLE PROBLEM** No aggregate moisture is indicated in the example problem as given in the Course Manual. Thus, it can be left blank.

% Blend: Percent blend for aggregate components. If only using one coarse aggregate and one fine aggregate material, enter “100” for each. On the other hand, if blending coarse aggregate materials, say, CA 11 and CA 16 at 75 and 25 percent, respectively, enter a “75” for the CA 11 and a “25” for the CA 16. Similarly, if blending fine aggregate materials. Do not blend coarse and fine aggregate, except as noted below for CAM II:

**Note for CAM II designs only**—Recommended % Blend of coarse-to-fine aggregate: 50-50 when using CA 7, CA 9, or CA 11; 75-25 when using CA 6; and 100-0 (i.e., no fine aggregate) when using CA 10. For example, when using CA 6 and FA 1, enter “75” for the CA 6 and “25” for the FA 1.

**EXAMPLE PROBLEM** Because this mix is utilizing one coarse aggregate component and one fine aggregate component (and the mix is not CAM II), enter **100** for coarse aggregate and **100** for fine aggregate, as well.

**Step 3a. Voids in Coarse Aggregate**

The Designer has the option to either enter the Voids directly or calculate Voids by performing ITP 306, Voids Test of Coarse Aggregate for Concrete Mixtures, which can be found in the Manual of Test Procedures for Materials. However, some Districts may provide a value for general aggregate types, such as “0.36” for gravels.

If calculating the Voids, enter the “% Absorption”, “Net Weight of Aggregate”, and “Volume of Measure” as determined while performing ITP 306. Consult your District for “% Absorption” values. (The Calibration of Measure is not required for every mix design, but is included for convenience.)

**3a. Voids in Coarse Aggregate**  
Refer to Illinois Test Procedure 306

| Coarse Aggregate | % Absorption | Oven-Dry Sp. Gravity |
|------------------|--------------|----------------------|
| 020CA07          | -0.5         | 2.69                 |
|                  |              |                      |
|                  |              |                      |
|                  |              |                      |
|                  |              |                      |

Calculated     User-Defined

Net Weight of Aggregate: 53.00 lb.  
 Volume of Measure: 0.500 cu. ft.  
 SSD Sp. G: 2.68  
 % Absorption: -0.5 %  
 Oven-Dry Sp. G: 2.69  
 Unit Weight: 106.00 lb/cu. ft

**Calculated:**  
 Volume of Voids per Unit Volume of Oven-Dry Rodded Coarse Aggregate  $V = 0.37$

**Calibration of Measure:**  
 Weight of Water to fill Measure: 31 lb.  
 Temperature of Water: 72 F  
 Calibrated Volume of Measure: 0.5 cu. ft

If entering the Voids directly, toggle the “Enter Directly” button and input the appropriate value in the “User-defined” box. **Important:** Enter “1.00” for any mix design that does not contain coarse aggregate.

**User-defined:** Enter voids, V =  <<<

**Calculated:**  
 Volume of Voids per Unit Volume of Oven-Dry Rodded Coarse Aggregate  $V =$  **see above**

**Calibration of Measure:**  
 Weight of Water to fill Measure:  lb.  
 Temperature of Water:  F  
 Calibrated Volume of Measure:  cu. ft

**EXAMPLE PROBLEM** The example problem as given in the Course Manual notes that the Voids for the coarse aggregate is **0.37**.



**Step 4. Finely Divided Minerals & Admixtures Information**

This worksheet is where the designer enters all information pertaining to cement and finely divided minerals, as well as chemical admixtures (e.g., air-entraining water-reducing admixtures, etc.).

| FIT TO SCREEN  |                               |  |                      |   |                      |                          |
|--|-------------------------------|--|----------------------|---|----------------------|--------------------------|
| <b>4. Cement and Finely Divided Minerals Information</b> |                               |  |                      |   |                      |                          |
|  | <b>Material Code</b>          | <b>Producer Number</b>                               | <b>Producer Name</b> | <b>Specific Gravity</b>                             | <b>Percent Blend</b> | <b>Replacement Ratio</b> |
| 1  | 37601 Type I, Portland        |  |                      | 3.150   | 75.0                 |                          |
| 2  | 37801 Fly Ash Class C         | 555-05   | City Electric Co.    | 2.610   | 25.0                 |                          |
| 3  | Select Slag...                |  |                      |   |                      |                          |
| 4  | Select Other FDM...           |  |                      |   |                      |                          |
|  |                               |  |                      |   | <b>100%</b>          |                          |
| <b>5. Admixture Information</b>                          |                               |  |                      |   |                      |                          |
|  | <b>Material Code</b>          | <b>Admixture Type</b><br><small>(ASTM C 494)</small> | <b>Product Name</b>  | <b>Remarks</b><br><small>(e.g. dosage rate)</small> |                      |                          |
| 1  | 42000                         | AEA - Air Entraining                                 | Air Plus X           |   |                      |                          |
| 2  | 43000                         | A - Water Reducer                                    | Water Reducto 2000   |   |                      |                          |
| 3  |                               | n/a  |                      |   |                      |                          |
| 4  |                               | n/a  |                      |   |                      |                          |
|  |                               |  |                      | <b>Latex Admixture Information</b>                  |                      |                          |
|  |                               |  |                      | Batch Dosage  |                      | gal/cu yd                |
|  |                               |  |                      | Specific Gravity                                    |                      |                          |
|  |                               |  |                      | % Solids  |                      | %                        |
| <b>6. General Remarks</b>                                |                               |  |                      |   |                      |                          |
| 1  | ASR Mix Option 2, 25% fly ash |  |                      |   |                      |                          |
| 2  |                               |  |                      |   |                      |                          |

Return to **Start**.  
Design Information

Return to **Step 2**.  
Design Variables

Return to **Step 3**.  
Aggregate Information

Report (English)

Report (metric)

MISTIC Report

Material: Cement and finely divided mineral (FDM) material codes. Each line is dedicated to a specific material: Line 1 for cement, Line 2 for fly ash, Line 3 for GGBF slag, and Line 4 for miscellaneous (e.g., microsilica, high-reactivity metakaolin, etc.).

|                 |  |
|-----------------|--|
| EXAMPLE PROBLEM | <p>Because this mix will utilize a Type I cement and Class C fly ash, Lines 1 and 2 will be used.</p> <ul style="list-style-type: none"> <li>Cement: Because this mix is utilizing a Type I cement, select <b>37601 Type I, Portland</b> from the drop-down list.</li> <li>Fly ash: Because this mix is utilizing a Class C fly ash, select <b>37801 Fly Ash Class C</b> from the drop-down list.</li> </ul> |
|-----------------|--|

Producer Number: Material producer number. This field is required for all finely divided minerals.

Producer Name: Material producer name.

Specific Gravity: Specific gravity of each material. The specific gravity of cement is normally assumed to be 3.15. However, for a blended cement, this value should be verified with the District. Specific gravity values for finely divided minerals can be obtained from the Approved/Qualified Producer List of Finely Divided Minerals.

|                 |  |
|-----------------|--|
| EXAMPLE PROBLEM | <p>The example problem as given in the Course Manual notes that the specific gravity for the fly ash component is <b>2.61</b>.</p> <p>Although no specific gravity is given for the cement component, from Section 2.3 in the Course Manual, the specific gravity of cement is normally assumed to be <b>3.15</b>.</p> |
|-----------------|--|

**Step 4. Finely Divided Minerals & Admixtures Information** (continued)

Percent Blend: The blend percentage must be entered for each material, totaling 100. For example, when blending fly ash and cement at 20 and 80 percent, respectively, enter a "20" for the fly ash and an "80" for the cement.

|                        |   |
|------------------------|---|
| <b>EXAMPLE PROBLEM</b> | <p>First, we have to determine if we need to mitigate for alkali-silica reaction (ASR):</p> <p>From Section 2.4.3 in the Course Manual, it is determined that the component aggregates are <b>Group II</b> (fine aggregate expansion in the <b>&gt;0.16% - 0.27%</b> range and coarse aggregate expansion <b>≤0.16%</b>). Thus, we are required to use Mix Option 1, 2, 3, 4, or 5.</p> <p>Because the example problem as given notes that the mix will utilize a cement with alkali content &gt;0.60% and a Class C fly ash, we will use <b>Mix Option 2</b>.</p> <p>Mix Option 2 requires a minimum 25.0 percent Class C fly ash.</p> <p>Furthermore, from Section 2.4.1.1 in the Course Manual, the Class C fly ash component can replace up to 30 percent of the cement.</p> <p>Thus, it is decided to use <b>30 percent</b> fly ash since fly ash is cheaper than cement, and will provide the most economical mix.</p> <p>Because the total Percent Blend must equal 100, enter <b>70.0</b> for the cement and <b>30.0</b> for the fly ash.</p> |
|------------------------|---|

Replacement Ratio: (Optional) Enter the replacement ratio for each finely divided mineral, if applicable. If left blank, the default value of "1.00" will be used.

**Step 5. Admixtures Information**

Material Code: Enter admixture material codes here. The 5-digit material code for admixtures can be found on the Approved/Qualified Product List of Concrete Admixtures.

Admixture Type: Choose admixture type.

Admixture Name: Enter admixture product name here.

Remarks: Enter key information regarding proposed dosage rates, dosing procedures, etc.

**Step 6. General Mixture Remarks**

Remarks: Enter any pertinent information not already covered. When required to mitigate for alkali-silica reaction (ASR), indicate the mixture option selected.

|                        |   |
|------------------------|---|
| <b>EXAMPLE PROBLEM</b> | <p>Because we are required to mitigate for alkali-silica reaction, we must indicate the mixture option selected.</p> <p>Enter <b>ASR Mix Option 2, 30% fly ash</b>.</p> |
|------------------------|---|

**Latex Admixture Information** (only required for mix designs using a latex admixture)

Batch Dosage: Enter latex admixture dosage in terms of gallons per cubic yard (liters per cubic meter).

Specific Gravity: Enter manufacturer's specific gravity for the latex admixture.

% Solids: Enter manufacturer's percent solids for the latex admixture.

**Design Report**

Given the inputs, the mix design proportions are calculated and reported. Three design reports are generated: one in English units of measure, one in metric (SI), and one formatted per the Department's MISTIC database requirements. Please consult your District for which report(s) to submit for approval.

**ENGLISH UNITS DESIGN REPORT**

| DTT03110 PCC MIX DESIGN <span style="float: right;">Version 2.4</span>   |                                 |                        |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
|--|---------------------------------|------------------------|--------------------|---------------------|---------|---------------|------------------|--------------------|-------------|----|------|------|---------------|---------|-------|-----|------------|--|-------|---|--------------------|--|
| <b>Print English Report</b>  | IDOT MIX #: <b>Not Assigned</b> | MATERIAL: <b>21605</b> | CONCRETE PC FLYASH |                     |         |               | EFFECTIVE: _____ |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
|  | CONTR MIX #: <b>PMC0001PV</b>   | CLASS: <b>PV</b>       |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
|  | RESP: <b>91</b>                 | DISTRICT 1             | LAB: <b>PP</b>     | Producer Plant Site |         |               |                  | REVIEWED BY: _____ |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| <b>View metric Report</b>  | BATCH                           | H2O% FINE              | %                  | (Z)                 | MORTAR  | {TYPE}        | {GAL/CWT}        | {ABS. VOL}         |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| <b>View MISTIC Report</b>  | CU YD                           | ADX                    | RED                | MOD                 | AIR     | VOIDS         | CEMENT           | FACTOR             | ASH         | FA | CA   | CA,B | FA,A          |         |       |     |            |  |       |   |                    |  |
|  | 1.00                            | W                      | 6.0                |                     | 6.5     | .37           | 5.35             | 0.83               | C           | B  | 5.30 | 0.00 | 0.4315 0.2630 |         |       |     |            |  |       |   |                    |  |
| <b>Design Information</b>  | MATERIAL                        | PROD NO                | PROD NAME          | SP G                | % BLEND | %MOIST / REPL | [LBS / CU YD]    |                    | [KG / CU M] |    |      |      |               |         |       |     |            |  |       |   |                    |  |
|  |                                 |                        |                    |                     |         |               | SSD              | ADJ                | ADJ         |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| <b>Design Variables</b>  | 027FA01                         | 54321-01               | LITTLE ROCKS CO.   | 2.660               | 100.0   | 0.00          | 1178             | 1178               | 700         |    |      |      |               |         |       |     |            |  |       |   |                    |  |
|  | 020CA07                         | 12345-05               | BIG ROCK CO.       | 2.680               | 100.0   | 0.00          | 1947             | 1947               | 1156        |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| <b>Aggregate Information</b>   | 37601                           |                        |                    | 3.150               | 75.0    | 1.00          | 405              | 405                | 240         |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| <b>Finely Divided Minerals &amp; Admixtures</b>  | 37801                           | 555-05                 | CITY ELECTRIC CO.  | 2.610               | 25.0    | 1.00          | 135              | 135                | 80          |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| {FA + CA} MIX-H2O: <input type="text" value="5.30"/> W/C RATIO: <input type="text" value="0.42"/>  |                                 |                        |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| ADJ. H2O (gal : lbs) <input type="text" value="26.9"/> <input type="text" value="133"/>  |                                 |                        |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| TOTAL BATCH WT (lbs) <input type="text" value="3889"/> <input type="text" value="2309"/>   |                                 |                        |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| THEO. H2O (gal : lbs) <input type="text" value="26.9"/> <input type="text" value="224"/>   |                                 |                        |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| PRODUCER: <b>1234-05</b> PROD NAME: <b>EVERYMAN REDI-MIX CO.</b>   |                                 |                        |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| REMARKS: <b>ASR Mix Option 2, 25% fly ash</b> CONTRACT _____   |                                 |                        |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| <b>ADDITIONAL INFORMATION:</b> Lab: <b>PAVE MASTERS CO.</b> Location: <b>CHICAGO</b> Target _____  |                                 |                        |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| Designer: <b>SMITH</b> Created: _____ Slump (in.) <b>1.5</b>   |                                 |                        |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| Adx(s): <table border="1" style="display: inline-table; border-collapse: collapse;"> <tr> <th>Code</th> <th>Type</th> <th>Product</th> <th>Remarks</th> </tr> <tr> <td>42000</td> <td>AEA</td> <td>AIR PLUS X</td> <td></td> </tr> <tr> <td>43000</td> <td>A</td> <td>WATER REDUCTO 2000</td> <td></td> </tr> </table> |                                 |                        |                    |                     |         |               |                  |                    |             |    | Code | Type | Product       | Remarks | 42000 | AEA | AIR PLUS X |  | 43000 | A | WATER REDUCTO 2000 |  |
| Code   | Type                            | Product                | Remarks            |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| 42000  | AEA                             | AIR PLUS X             |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| 43000  | A                               | WATER REDUCTO 2000     |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| Designer Phone: 555-555-5555<br>Designer email: jsmith@email.com   |                                 |                        |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |
| Printed 12/6/2013<br>Cc: ENOCKSON  |                                 |                        |                    |                     |         |               |                  |                    |             |    |      |      |               |         |       |     |            |  |       |   |                    |  |

**METRIC UNITS DESIGN REPORT**

| DTT03110 PCC MIX DESIGN <span style="float: right;">Version 2.4</span>   |                                 |                         |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
|--|---------------------------------|-------------------------|--------------------|---------------------|---------|---------------|------------------|--------------------|---------------|----|--------|--------|---------------|---------|-------|-----|------------|--|-------|---|--------------------|--|
| <b>Print metric Report</b>   | IDOT MIX #: <b>Not Assigned</b> | MATERIAL: <b>21605M</b> | CONCRETE PC FLYASH |                     |         |               | EFFECTIVE: _____ |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
|  | CONTR MIX #: <b>PMC0001PV</b>   | CLASS: <b>PV</b>        |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
|  | RESP: <b>91</b>                 | DISTRICT 1              | LAB: <b>PP</b>     | Producer Plant Site |         |               |                  | REVIEWED BY: _____ |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| <b>View English Report</b>   | BATCH                           | H2O% FINE               | %                  | (Z)                 | MORTAR  | {TYPE}        | {L / KG}         | {ABS. VOL}         |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| <b>View MISTIC Report</b>  | CU M                            | ADX                     | RED                | MOD                 | AIR     | VOIDS         | CEMENT           | FACTOR             | ASH           | FA | CA     | CA,B   | FA,A          |         |       |     |            |  |       |   |                    |  |
|  | 1.00                            | W                       | 6.0                |                     | 6.5     | .37           | 320              | 0.83               | C             | B  | 0.4420 | 0.0000 | 0.4315 0.2630 |         |       |     |            |  |       |   |                    |  |
| <b>Design Information</b>  | MATERIAL                        | PROD NO                 | PROD NAME          | SP G                | % BLEND | %MOIST / REPL | [KG / CU M]      |                    | [LBS / CU YD] |    |        |        |               |         |       |     |            |  |       |   |                    |  |
|  |                                 |                         |                    |                     |         |               | SSD              | ADJ                | ADJ           |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| <b>Design Variables</b>  | 027FAM01                        | 54321-01                | LITTLE ROCKS CO.   | 2.660               | 100.0   | 0.00          | 700              | 700                | 1178          |    |        |        |               |         |       |     |            |  |       |   |                    |  |
|  | 020CAM07                        | 12345-05                | BIG ROCK CO.       | 2.680               | 100.0   | 0.00          | 1156             | 1156               | 1947          |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| <b>Aggregate Information</b>   | 37601M                          |                         |                    | 3.150               | 75.0    | 1.00          | 240              | 240                | 405           |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| <b>Finely Divided Minerals &amp; Admixtures</b>  | 37801M                          | 555-05                  | CITY ELECTRIC CO.  | 2.610               | 25.0    | 1.00          | 80               | 80                 | 135           |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| {FA + CA} MIX-H2O: <input type="text" value="0.4420"/> W/C RATIO: <input type="text" value="0.42"/>  |                                 |                         |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| ADJ. H2O (L : kg) <input type="text" value="133.0"/> <input type="text" value="133"/>  |                                 |                         |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| TOTAL BATCH WT (kg) <input type="text" value="2309"/> <input type="text" value="3890"/>  |                                 |                         |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| THEO. H2O (kg : lbs) <input type="text" value="133.0"/> <input type="text" value="224"/>   |                                 |                         |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| PRODUCER: <b>1234-05</b> PROD NAME: <b>EVERYMAN REDI-MIX CO.</b>   |                                 |                         |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| REMARKS: <b>ASR Mix Option 2, 25% fly ash</b> CONTRACT _____   |                                 |                         |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| <b>ADDITIONAL INFORMATION:</b> Lab: <b>PAVE MASTERS CO.</b> Location: <b>CHICAGO</b> Target _____  |                                 |                         |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| Designer: <b>SMITH</b> Created: _____ Slump (mm) <b>38.1</b>   |                                 |                         |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| Adx(s): <table border="1" style="display: inline-table; border-collapse: collapse;"> <tr> <th>Code</th> <th>Type</th> <th>Product</th> <th>Remarks</th> </tr> <tr> <td>42000</td> <td>AEA</td> <td>AIR PLUS X</td> <td></td> </tr> <tr> <td>43000</td> <td>A</td> <td>WATER REDUCTO 2000</td> <td></td> </tr> </table> |                                 |                         |                    |                     |         |               |                  |                    |               |    | Code   | Type   | Product       | Remarks | 42000 | AEA | AIR PLUS X |  | 43000 | A | WATER REDUCTO 2000 |  |
| Code   | Type                            | Product                 | Remarks            |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| 42000  | AEA                             | AIR PLUS X              |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| 43000  | A                               | WATER REDUCTO 2000      |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| Designer Phone: 555-555-5555<br>Designer email: jsmith@email.com   |                                 |                         |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |
| Printed 12/6/2013<br>Cc: ENOCKSON  |                                 |                         |                    |                     |         |               |                  |                    |               |    |        |        |               |         |       |     |            |  |       |   |                    |  |

**MISTIC DESIGN REPORT**

|   |  | PCC DESIGN MIX     |                              |                         |                         |                 |        |               |              |         |            | DATE      |        |             |                     |      |  |  |  |
|---|--|--------------------|------------------------------|-------------------------|-------------------------|-----------------|--------|---------------|--------------|---------|------------|-----------|--------|-------------|---------------------|------|--|--|--|
| <b>Print MISTIC Report</b>                      | PCC MIX #:                             | [REDACTED]         |                              |                         |                         |                 |        |               |              |         |            | MATERIAL: | 21605M | EFFECT:     | [REDACTED] (mmddyy) |      |  |  |  |
|   | REF DESIGN #:                          | PMC0001PV          |                              | CLASS:                  |                         | PV              |        | LAST YR USED: |              |         |            | TERM:     |        |             |                     |      |  |  |  |
| <b>View English Report</b>                      | RESP:                                  | 91                 | DISTRICT 1                   |                         | LAB:                    |                 | PP     |               | REVIEWED BY: |         | [REDACTED] |           | DFLAG: |             |                     |      |  |  |  |
|   | MIX PROD:                              | 1234-05            |                              | EVERYMAN REDI-MIX CO.   |                         | CONTRACT:       |        |               |              |         |            |           |        |             |                     |      |  |  |  |
| <b>View metric Report</b>                       | BATCH                                  | H2O%               | FINE                         | %                       | (Z)                     | MORTAR          | {TYPE} | {H2O L/kg}    | {ABS. VOL}   |         |            |           |        |             |                     |      |  |  |  |
|   | CU m                                   | ADX                | RED                          | MOD                     | AIR                     | VOIDS           | CEMENT | FACTOR        | ASH          | FA      | FA         | CA        | CA, B  | FA, B       |                     |      |  |  |  |
|   |  | 1.0                | W                            | 6.0                     | 6.5                     | .37             | 320    | 0.83          | C            | B       | 0.4420     | 0.0000    | 0.4315 | 0.2630      |                     |      |  |  |  |
|   |  |                    |                              |                         |                         |                 |        |               |              | %BLEND/ |            | %MOIST    |        | {kg / CU m} |                     | LBS/ |  |  |  |
| <b>Design Information</b>                       | MATERIAL                               | PROD NO            |                              | PROD NAME               |                         | SP G            |        | Z             | RATIO        | REPL    | SSD        | ADJ       | CU     | YD          |                     |      |  |  |  |
|   | 027FAM01                               | 54321-01           |                              | LITTLE ROCKS CO.        |                         | 2.660           |        | 100.0         | 0.00         | 700     | 700        | 1178      |        |             |                     |      |  |  |  |
|   |  | 020CAM07           | 12345-05                     |                         | BIG ROCK CO.            |                 | 2.680  |               | 100.0        | 0.00    | 1156       | 1156      | 1947   |             |                     |      |  |  |  |
| <b>Design Variables</b>                         | 37801M                                 | 555-05             |                              | CITY ELECTRIC CO.       |                         | 2.610           |        | 25.0          | 1.00         | 80      | 80         | 135       |        |             |                     |      |  |  |  |
|   | 37601M                                 |                    |                              |                         |                         | 3.150           |        | 75.0          | 1.00         | 240     | 240        | 405       |        |             |                     |      |  |  |  |
| <b>Aggregate Information</b>                    | {CA + FA}                              |                    | {RATIOS}                     |                         | ADJ H2O (kg:LBS)        |                 | 133    |               | 224          |         |            |           |        |             |                     |      |  |  |  |
|   | MIX-H2O: 0.4420                        |                    | ASH/CMT WT: 33.3             |                         | TOTAL BATCH WT (kg:LBS) |                 | 2309   |               | 3890         |         |            |           |        |             |                     |      |  |  |  |
| <b>Finely Divided Minerals &amp; Admixtures</b> | RED MIX H2O: 0.4155                    |                    | TOTAL CEMENTITIOUS MATL: 320 |                         | THEO. WATER (kg:LBS)    |                 | 133    |               | 224          |         |            |           |        |             |                     |      |  |  |  |
|   | REMARKS: ASR Mix Option 2, 25% fly ash |                    |                              |                         | THEO H2O (GAL)          |                 | 26.9   |               |              |         |            |           |        |             |                     |      |  |  |  |
| REMARKS:  |  |                    |                              | ADJ H2O (GAL)           |                         | 26.9            |        |               |              |         |            |           |        |             |                     |      |  |  |  |
| Cc: ENOCKSON                                    |  | Designed By: SMITH |                              | Phone: 555-555-5555     |                         | W/C Ratio: 0.42 |        |               |              |         |            |           |        |             |                     |      |  |  |  |
|   |  |                    |                              | email: jsmith@email.com |                         |                 |        |               |              |         |            |           |        |             |                     |      |  |  |  |

**Note:** The MISTIC Report has three input fields *to be completed upon receiving approval from the District.*


Additionally, there is a tab for help determining the percent water adjustment taking into account various factors. However, this table is for informational purposes only. The water adjustment calculated using this table is not referenced by any of the spreadsheet's mix design calculations. To use the water adjustment calculated using this table, **the value must be entered on the Design Variable tab.**

| FIT TO SCREEN  |                      |                       | Return to Design Variables   |
|--|----------------------|-----------------------|--|
| <p>There are many factors that can be taken into account when determining a mix's water requirement. The table below allows you to estimate the percentage of water adjustment (typically a reduction) based on the mix's constituent materials. <b>IMPORTANT:</b> This table is for informational purposes only. The water adjustment calculated here is not referenced by any mix design calculations. To use the water adjustment calculated here, it must be entered on the <b>Design Variables</b> tab.</p> |                      |                       |  |
| Water Adjustment   | Suggested Range      | Adjustment Percentage |  |
| <b>Aggregate shape and texture:</b> (Note 1)   |                      |                       | <p><b>Note 1:</b> It is recommended to adjust for aggregate shape and texture as described in Section 2.5.1.2* "Coarse Aggregate Water Requirement" and Section 2.5.1.3* "Basic Water Requirement."</p> <p><b>Note 2:</b> A polycarboxylate superplasticizer may reduce the water content up to 40%.</p> <p><b>Note 3:</b> For each 10% of fly ash, it is recommended to allow a water reduction of at least 3%.</p> |
| Baseline (cubical crushed stone)   | (0%)                 |                       |  |
| Rounded, smooth  | (-5 to 0%)           |                       |  |
| Flat, elongated, rough   | (0 to +5%)           |                       |  |
| <b>Combined aggregate grading:</b>   |                      |                       |  |
| Well-graded  | (-10 to 0%)          |                       |  |
| Gap-graded   | (0 to +10%)          |                       |  |
| <b>Admixture(s):</b>   |                      |                       |  |
| Air entraining admixture   | 1 to 3% air content  | (0%)                  |  |
| Minimum air content specified:   | 4 to 5% air content  | (-5%)                 |  |
|  | 6 to 10% air content | (-10%)                |  |
| Normal water-reducing admixture  |                      | (-10 to -5%)          |  |
| Mid-range water-reducing admixture   |                      | (-15 to -8%)          |  |
| High range water-reducing admixture (Note 2)   |                      | (-30 to -12%)         |  |
| <b>Finely Divided Minerals:</b>  |                      |                       |  |
| Fly Ash (Note 3)   |                      | (-10 to 0%)           |  |
| Microsilica  |                      | (0 to +15%)           |  |
| High-Reactivity Metakaolin (HRM)   |                      | (-5 to +5%)           |  |
| Ground Granulated Blast Furnace (GGBF) Slag  |                      | (0%)                  |  |
| <b>Other factors:</b>  |                      |                       |  |
| Coarse cement, water/cement ratio > 0.45, and concrete temperature < 60 °F (27 °C)   |                      | (-10 to 0%)           |  |
| Fine cement, water/cement ratio < 0.40, and concrete temperature > 80 °F (27 °C)   |                      | (0 to +10%)           |  |
| Cumulative Adjustment (%)  |                      | 0                     |  |
| Reference: Table 2.5.2 "Adjustment to Basic Water Requirement"   |                      | 0 %                   |  |
| * <a href="#">PCC Level III Technician Course Manual</a>   |                      |                       |  |

### Changing Macro Security Settings in Microsoft Excel

**Note:** Any macro settings changes you make in Excel apply only to Excel and do not affect any other Office program.

**To change the macro security settings in Excel 2007/2010:**

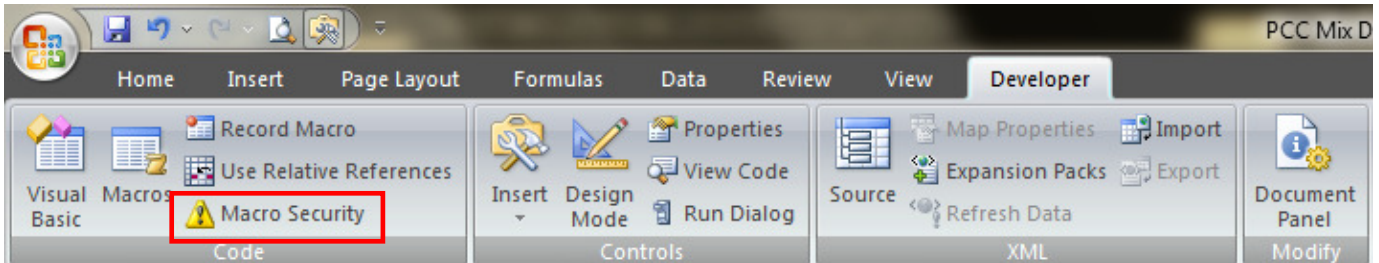


1. On the **Developer** tab\*, in the **Code** group, click **Macro Security**.
2. In the **Macro Settings** category, under **Macro Settings**, click the 2<sup>nd</sup> option to **Disable all macros with notification**.

This option initially disables macros, but alerts you if macros are present. This way, you can choose when to enable the macros on a case by case basis.


3. Now, close Excel, and re-open the PCC Mix Design spreadsheet.

You should now get a **Security Warning** (below), click the **Options** button, then click to **Enable this content**, and finally click **OK** to close the window.

**Office 2007**

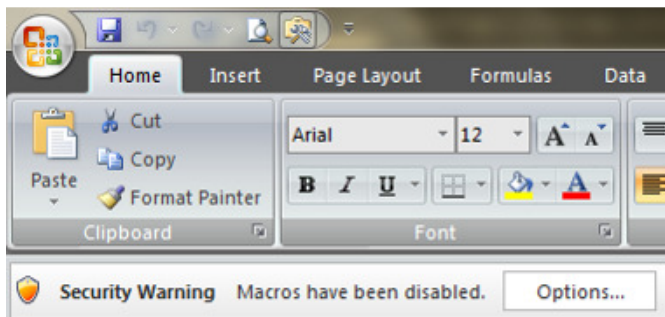

**Office 2010**

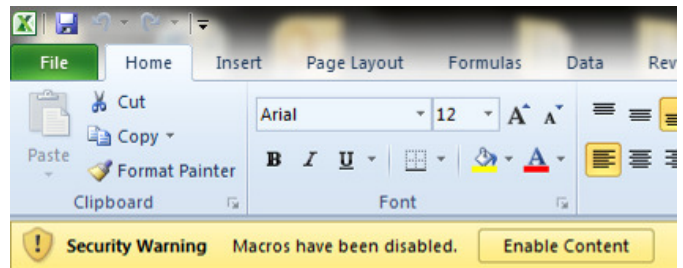

\* If the **Developer** tab is not displayed...

**For Excel 2007:**

1. Click the **Microsoft Office Button**
2. Click **Excel Options** (bottom right corner)
3. In the **Popular** category, under **Top options for working with Excel**, click **Show Developer tab in the Ribbon**.

**For Excel 2010:**

1. Click the **File** tab, click **Options**, and then click the **Customize Ribbon** category.
2. In the **Main Tabs** list, check the **Developer**, and then click **OK**.
3. Click any other tab to return to your file.

**To change the macro security settings in Excel 2013:**




When you open a file that has macros, a yellow **Security Warning** (above) appears with a shield icon and an **Enable Content** button: click **Enable Content**. The file opens and is a trusted document.


## Changing Macro Security Settings in Microsoft Excel (continued)

### Older versions of Excel:

1. To access the macro security settings in older version of Excel, go to the **Tools** menu, **Options**, **Security** tab, and click on the **Macro Security** button. The **Security** window will open as shown:

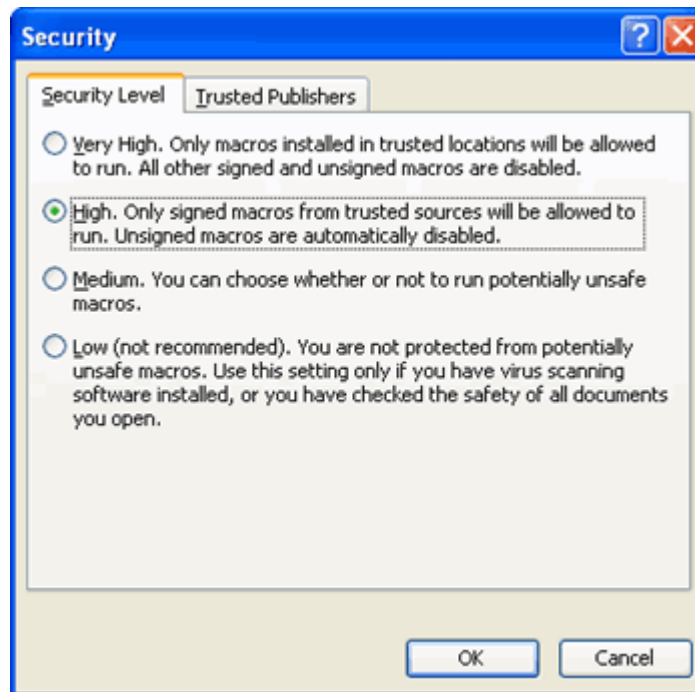

2. Click on **Medium**, then click **OK**, and close Excel.
3. Re-open the PCC Mix Design spreadsheet. At **Medium**, whenever you open a file that has macros, a **Security Warning** (below) appears: click **Enable Macros**. The file opens and is a trusted document.

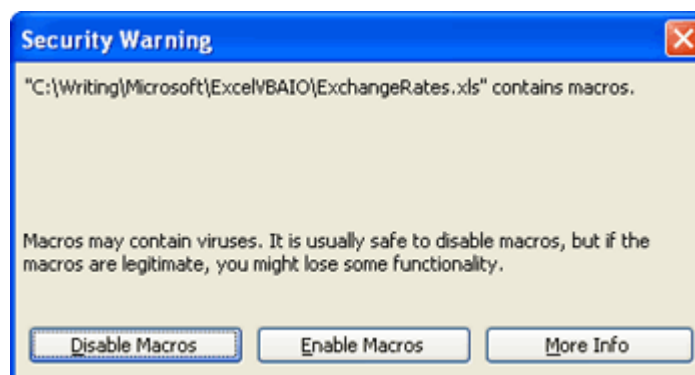

# APPENDIX C

## Illinois Test Procedure 306

Effective Date: April 1, 2008

### VOIDS TEST OF COARSE AGGREGATE FOR CONCRETE MIXTURES

Reference Test Procedure(s):

1. Illinois Specification 101, Minimum Requirements for Electronic Balances
2. AASHTO M 231, Weighing Devices Used in the Testing of Materials
3. AASHTO T 255 (Illinois Modified), Total Moisture Content of Aggregate by Drying
4. ASTM E 29 (Illinois Modified), Standard Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications

To maintain brevity in the text, the following will apply:

**Example:** AASHTO T 255 (Illinois Modified) will be designated as "T 255."  
ASTM E 29 (Illinois Modified) will be designated as "ASTM E 29."

#### 1. GENERAL

The volume of voids per unit volume of dry rodded coarse aggregate relates experimental data to the theory of proportioning, which produces the amount of coarse aggregate needed in a concrete mixture. Voids may also be defined as the ratio of the volume of empty spaces in a unit volume of dry rodded coarse aggregate to the unit volume of dry rodded coarse aggregate.

All rounding shall be according to ASTM E 29.

#### 2. EQUIPMENT

- a. The measure shall be metal, cylindrical, watertight, and of sufficient rigidity to retain its form under rough usage. The top and bottom of the measure shall be true and even, and its sides should be provided with handles. The measure shall have a capacity of 0.014 or 0.028 m<sup>3</sup> (0.5 or 1.0 ft<sup>3</sup>).
- b. Tamping Rod—A round, straight steel rod 16 mm (5/8 in.) in diameter and at least 584 mm (23 in.) in length, having the tamping end or both ends rounded to a hemispherical tip the diameter of which is 16 mm (5/8 in.).
- c. The balance or scale shall conform to M 231 and Illinois Specification 101. Refer to the requirements for unit weight.

### 3. PROCEDURE

- a. Fill the measure with water at room temperature and cover with a piece of plate glass in such a way as to eliminate bubbles and excess water. The measure shall be calibrated by accurately determining the mass (weight) of water, to the nearest 0.05 kg (0.1 lb.), required to fill it. Calculate the Measure Volume according to Section 5.0.
- b. The sample of aggregate shall be obtained and dried according to T 255, and shall be thoroughly mixed. When more than one size coarse aggregate is to be used in a mixture, the test shall be performed on the combination.
- c. The measure shall be filled in three equal lifts. Level each lift with the fingers. Each layer shall be rodded 25 times when the measure's capacity is 0.014 m<sup>3</sup> (0.5 ft<sup>3</sup>) or 50 times when the measure's capacity is 0.028 m<sup>3</sup> (1.0 ft<sup>3</sup>).

Rodding shall be evenly distributed over the surface of the aggregate. The rodding should knead the layers together by the tamping rod extending slightly into the previous layer. Care shall be taken to rod immediately above the bottom of the measure without striking it.

- d. With the final layer, the measure shall be filled to overflowing, rodded, and the surplus aggregate struck off, using the tamping rod as a straightedge.
- e. The Net Mass (Weight) of the aggregate in the measure shall then be determined to the nearest 0.05 kg (0.1 lb.).

### 4. CALCULATIONS

- a. The Unit Weight of the coarse aggregate is the Net Mass (Weight) of the coarse aggregate in the measure divided by the Measure Volume. Determine the Unit Weight to the nearest 0.01 kg/m<sup>3</sup> (0.01 lb/ft<sup>3</sup>).
- b. The volume of voids per unit volume of oven-dry rodded coarse aggregate is calculated to the nearest 0.01 as follows:

*Metric:*

$$\text{Voids, } V = \frac{(G_a \times 1000.00) - \text{Unit Wt.}}{G_a \times 1000.00}$$

*English:*

$$\text{Voids, } V = \frac{(G_a \times 62.37) - \text{Unit Wt.}}{G_a \times 62.37}$$

$$G_a = \frac{G_s}{\left(1 + \frac{A}{100}\right)}$$



Where: *Unit Wt.* is the unit weight of the coarse aggregate

$G_a$  is the oven-dry specific gravity calculated to the nearest 0.01

$G_s$  is the saturated surface-dry specific gravity of the coarse aggregate to the nearest 0.01, which is obtained from the Department's District office.

$A$  is the percent absorption of the coarse aggregate to the nearest 0.1, which is obtained from the Department's District office.

When more than one size coarse aggregate is used in a mixture, calculate the oven-dry specific gravity for each aggregate. Then obtain a weighted average of the oven-dry specific gravity using the following formula.

$$WAG_a = \left(\frac{a}{100} \times A\right) + \left(\frac{b}{100} \times B\right) + \left(\frac{c}{100} \times C\right) + \dots$$

Where:  $WAG_a$  = Weighted Average of Oven-dry Specific Gravity

$a, b, c, \dots$  = Percent of Total Coarse Aggregate

$A, B, C, \dots$  = Oven-dry Specific Gravity

The weighted average of the oven-dry specific gravity shall then be used in the Voids formula.

- c. The test shall be performed at least twice. Test results with the same measure should check within 0.01.

## 5. CALIBRATION OF MEASURE

The Measure Volume is calculated to the nearest 0.01 m<sup>3</sup> (0.001 ft<sup>3</sup>) as follows:

$$\text{Measure Volume} = \frac{M}{W}$$

Where:  $M$  = mass (weight) of water required to fill measure, kg (lb.)

$W$  = unit weight of water (refer to Table 1), kg/m<sup>3</sup> (lb/ft<sup>3</sup>)

**Table 1. Unit Weight of Water**

| Temperature of Water |      | kg / m <sup>3</sup> | lb / ft <sup>3</sup> |
|----------------------|------|---------------------|----------------------|
| °C                   | °F   |                     |                      |
| 15.6                 | 60   | 999.01              | 62.366               |
| 18.3                 | 65   | 998.54              | 62.336               |
| 21.1                 | 70   | 997.97              | 62.301               |
| 23.0                 | 73.4 | 997.54              | 62.274               |
| 23.9                 | 75   | 997.32              | 62.261               |
| 26.7                 | 80   | 996.59              | 62.216               |
| 29.4                 | 85   | 995.83              | 62.166               |


This Page Reserved

# APPENDIX D

## WORKABILITY

### 1.0 PRINCIPLE FACTORS OF WORKABILITY

Workability is related to the ease of motion of one coarse aggregate particle relative to adjacent particles. The lubricating ability of the mortar depends on the thickness of the mortar layer and the viscosity of the mortar. Refer Figure 1.0.

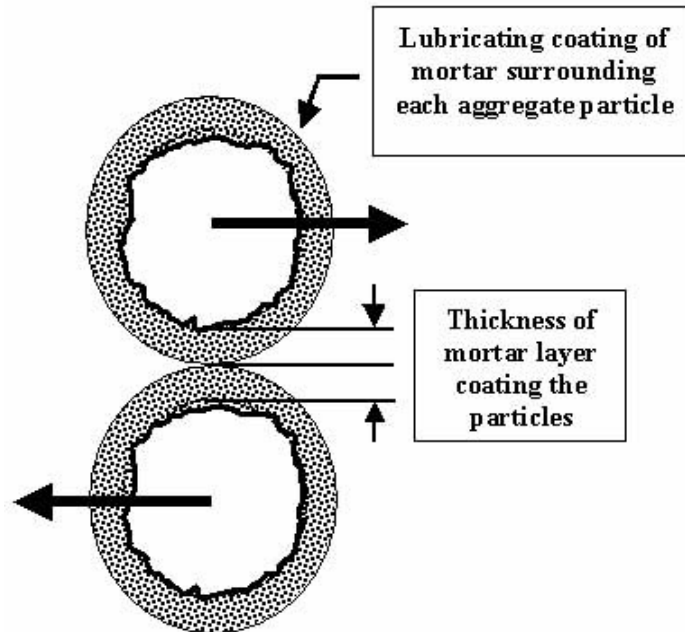

**Figure 1.0 Mortar Layer Around Coarse Aggregate Particles**

The thickness of the mortar layer depends on:

- Volume of coarse aggregate.
- Size and surface area of coarse aggregate.
- Shape and surface texture of aggregate particles.
- Volume of mortar.

The mortar volume depends on:

- Water content.
- Volume of cement and finely divided minerals.
- Volume of air.
- Volume of fine aggregate.


The viscosity of the mortar depends on:

- Water content.
- Volume of cement and finely divided minerals.
- Particle shape and fineness of cement and finely divided minerals.
- Shape and fineness of fine aggregate.
- Air content.
- Water-reducing admixtures.
- Rate of hydration (accelerating and retarding admixtures, concrete temperature, cement type and type of finely divided minerals).


## 2.0 MORTAR AND WORKABILITY

The following sections illustrate the role of mortar and its influence on workability.

### 2.1 Mortar Illustration

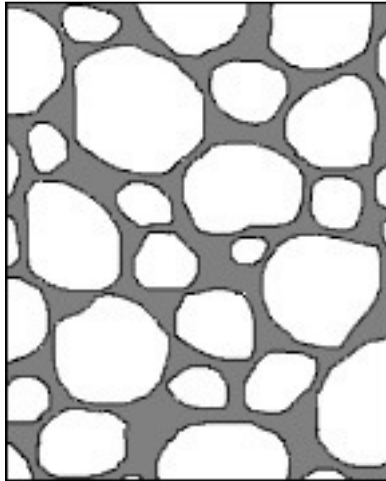


Concrete with low mortar content. This results in increased contact between coarse aggregate particles and decreases workability.

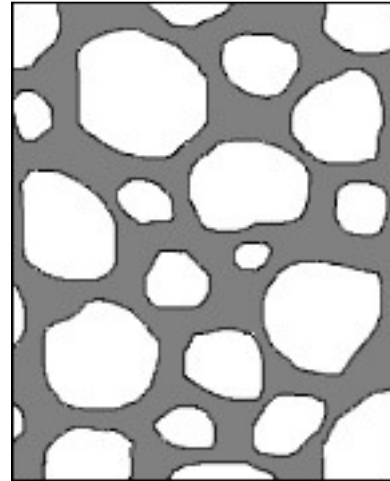

Concrete with high mortar content. This results in decreased contact between coarse aggregate particles and increases workability.


### 2.2 Mortar and Wall Effect

A higher mortar content is required at rigid boundaries, where the “wall effect” occurs. Examples of boundaries include structural members and pipe walls for pumping.

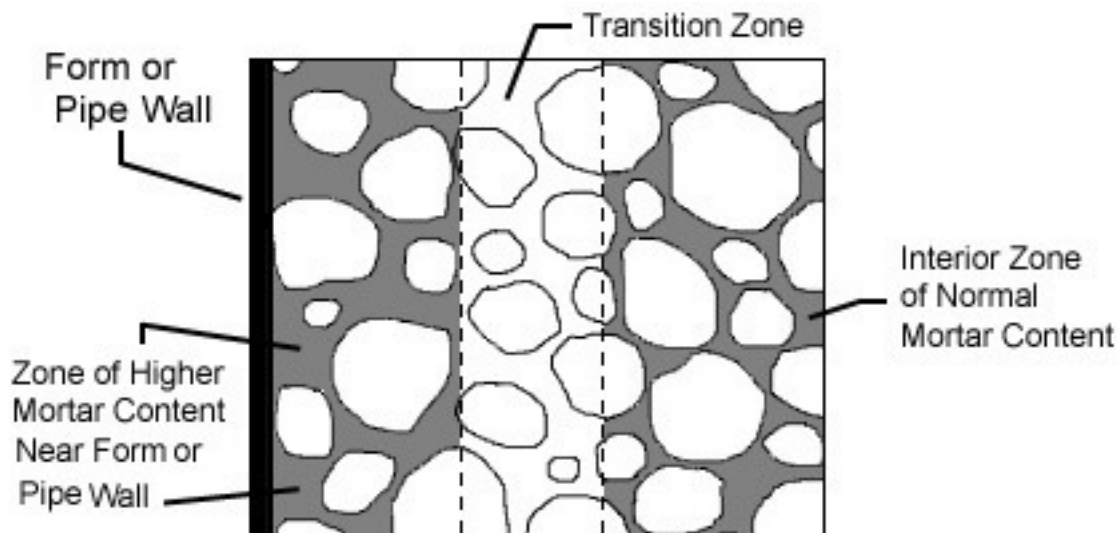


### 2.2.1 Mortar and Structural Member

The volume of mortar required for a smooth finish against formed surfaces (i.e., without honeycombing or “bug” holes) depends on the surface area to concrete volume ratio. For example, the volume of concrete decreases as the width of the structural member decreases (assuming all other dimensions are unchanged). However, the wall surface area remains the same. Thus, the reduced concrete volume has less mortar available to ensure a smooth finish. Therefore, a thinner structural member will require a higher mortar content.

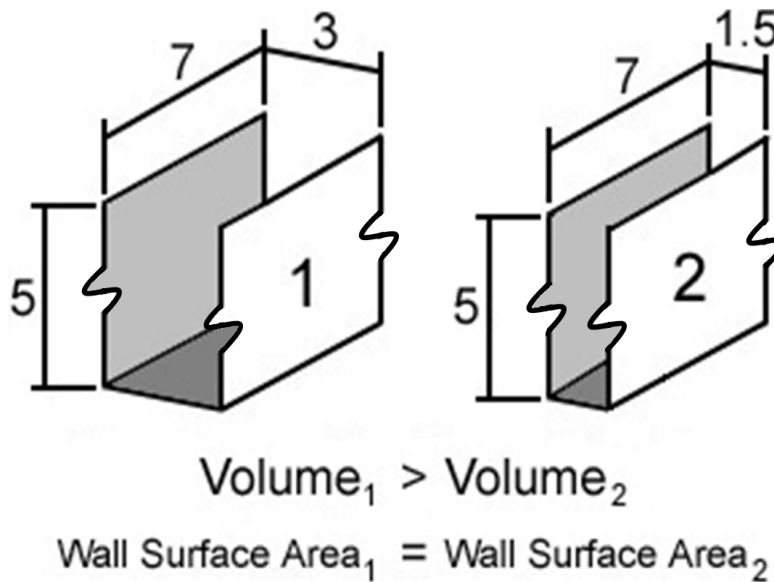

As another example, two different structural members may have different dimensions, but require the same volume of concrete. A higher mortar content is required for the structural member with the higher surface area.

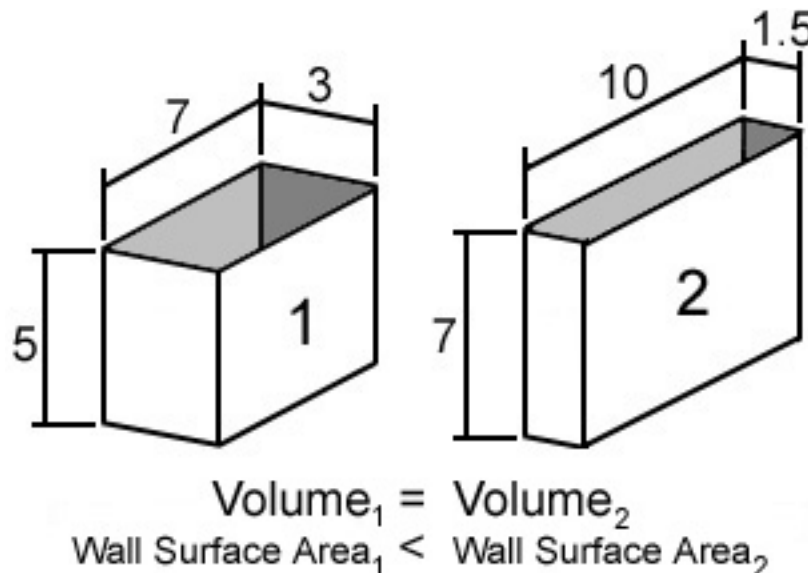

### 2.2.2 Mortar and Pipe Wall

A higher mortar content is required for smaller diameter concrete pump pipelines. For example, a 4 inch (102 mm) diameter pipe has a higher surface area to concrete volume ratio than a 5 in. (127 mm) diameter pipe.

This Page Reserved

# APPENDIX E

## AGGREGATE BLENDING

### 1.0 AGGREGATE BLENDING

The grading, or particle size distribution, of an aggregate can have a significant influence on a concrete mixture. The two types of grading are as follows:

- Uniformly Graded – Aggregates which do not have a large deficiency or excess of any particle size. Also known as Well Graded or Continuously Graded.
- Gap Graded – Aggregates which have specific particle sizes omitted or are minimal.

Many Illinois coarse aggregates are gap graded, typically having a small amount of material passing the 1/2 in. (12.5 mm) sieve. Experience has shown that when the percent finer than 1/2 in. (12.5 mm) is below 40 percent, placement problems (such as when pumping) may occur. In order to improve workability and minimize potential problems, a second coarse aggregate is blended in to fill the gap.

Furthermore, the combined gradation of the coarse and fine aggregate has a significant impact on several mix characteristics: ease of placing, pumping, consolidating, and finishing, as well as water demand of the mix.

Blending aggregates may be specified as per Article 1004.02(d), or alternate combinations of gradation sizes may be used with the approval of the Engineer according to Article 1020.04, Table 1, Note 14.

### 1.1 Aggregate Blending Characterization

Over the years, a number of analytical methods have been developed to characterize the combined aggregate gradation, or blend. Three such methods will be discussed further in this section: the “8-18” Rule, the “Tarantula” Curve, and the 0.45 Power Curve.

First, it is necessary to know how to calculate the aggregate blend when combining aggregates. The formula for determining the total blend on a particular sieve is as follows:

$$TB = \left(\frac{a}{100} \times A\right) + \left(\frac{b}{100} \times B\right) + \left(\frac{c}{100} \times C\right) + \dots$$

Where: TB = Total Blend of Aggregate either Passing or Retained on the Sieve,  
 a, b, c... = Percent of Total Aggregate, and  
 A, B, C... = Percent of Aggregate either Passing or Retained on the Sieve

For example, the percent passing the 3/8 in. (9.5 mm) sieve of the aggregate blend described in Table 1.1.1 is calculated as follows:

$$\begin{aligned} TB &= \left(\frac{60}{100} \times 11\%\right) + \left(\frac{40}{100} \times 100\%\right) \\ TB &= 6.6 + 40 \\ TB &= 46.6, \text{ or } 47 \text{ percent after rounding} \end{aligned}$$

Table 1.1.1 is an illustration of a single coarse aggregate (gap graded) with a single fine aggregate. As described in Table 1.1.2, a second coarse aggregate (in this case, CA 16) is used to improve the aggregate blend. This data will be used to illustrate the “8-18” Rule, the “Tarantula” Curve, and 0.45 Power Curve.

**Table 1.1.1 Gap Graded Aggregate Mix Design**

| Sieve Size<br>(English) | Sieve Size<br>(metric) | CA 07, a = 60%    |                    | FA 01, b = 40%    |                    | Aggregate Blend |                 |
|-------------------------|------------------------|-------------------|--------------------|-------------------|--------------------|-----------------|-----------------|
|                         |                        | %<br>Passing<br>A | %<br>Retained<br>A | %<br>Passing<br>B | %<br>Retained<br>B | %Passing<br>TB  | %Retained<br>TB |
| 1                       | 25 mm                  | 100               | 0                  | 100               | 0                  | 100             | 0               |
| 3/4                     | 19 mm                  | 86                | 14                 | 100               | 0                  | 92              | 8               |
| 1/2                     | 12.5 mm                | 37                | 49                 | 100               | 0                  | 62              | 30              |
| 3/8                     | 9.5 mm                 | 11                | 26                 | 100               | 0                  | 47              | 15              |
| No. 4                   | 4.75 mm                | 2                 | 9                  | 97                | 3                  | 40              | 7               |
| No. 8                   | 2.36 mm                | 2                 | 0                  | 89                | 8                  | 37              | 3               |
| No. 16                  | 1.18 mm                | 2                 | 0                  | 77                | 12                 | 32              | 5               |
| No. 30                  | 600 µm                 | 2                 | 0                  | 53                | 24                 | 22              | 10              |
| No. 50                  | 300 µm                 | 2                 | 0                  | 12                | 41                 | 6               | 16              |
| No. 100                 | 150 µm                 | 2                 | 0                  | 2                 | 10                 | 2               | 4               |
| No. 200                 | 75 µm                  | 1.4               | 0.6                | 0.5               | 1.5                | 1.0             | 1               |

**Table 1.1.2 Blended Aggregate Mix Design**

| Sieve Size<br>(English) | Sieve Size<br>(metric) | CA 07,<br>a = 45% |                | CA 16,<br>b = 15% |                | FA 01,<br>c = 40% |                | Aggregate Blend    |                     |
|-------------------------|------------------------|-------------------|----------------|-------------------|----------------|-------------------|----------------|--------------------|---------------------|
|                         |                        | %<br>Pass.<br>A   | %<br>Ret.<br>A | %<br>Pass.<br>B   | %<br>Ret.<br>B | %<br>Pass.<br>C   | %<br>Ret.<br>C | %<br>Passing<br>TB | %<br>Retained<br>TB |
| 1                       | 25 mm                  | 100               | 0              | 100               | 0              | 100               | 0              | 100                | 0                   |
| 3/4                     | 19 mm                  | 86                | 14             | 100               | 0              | 100               | 0              | 94                 | 6                   |
| 1/2                     | 12.5 mm                | 37                | 49             | 100               | 0              | 100               | 0              | 72                 | 22                  |
| 3/8                     | 9.5 mm                 | 11                | 26             | 96                | 4              | 100               | 0              | 59                 | 13                  |
| No. 4                   | 4.75 mm                | 2                 | 9              | 28                | 68             | 97                | 3              | 44                 | 15                  |
| No. 8                   | 2.36 mm                | 2                 | 0              | 5                 | 23             | 89                | 8              | 37                 | 7                   |
| No. 16                  | 1.18 mm                | 2                 | 0              | 3                 | 2              | 77                | 12             | 32                 | 5                   |
| No. 30                  | 600 µm                 | 2                 | 0              | 3                 | 0              | 53                | 24             | 23                 | 9                   |
| No. 50                  | 300 µm                 | 2                 | 0              | 2                 | 1              | 12                | 41             | 6                  | 17                  |
| No. 100                 | 150 µm                 | 2                 | 0              | 2                 | 0              | 2                 | 10             | 2                  | 4                   |
| No. 200                 | 75 µm                  | 1.4               | 0.6            | 1.9               | 0.1            | 0.5               | 1.5            | 1.1                | 0.9                 |



**1.1.1 The “8-18” Rule**

The “8-18” Rule is one method to characterize an aggregate blend. In this rule, the percent retained on every sieve (except the top two and bottom two sieves) should be between 8 and 18 percent. This ensures that the peaks and valleys are not too severe. Figure 1.1.1.2 illustrates a typical gap graded aggregate mix design based on the data in Table 1.1.1. On the other hand, using the improved aggregate blend in Table 1.1.2, Figure 1.1.1.3 illustrates the benefits of blending another aggregate to normalize the peaks and valleys.

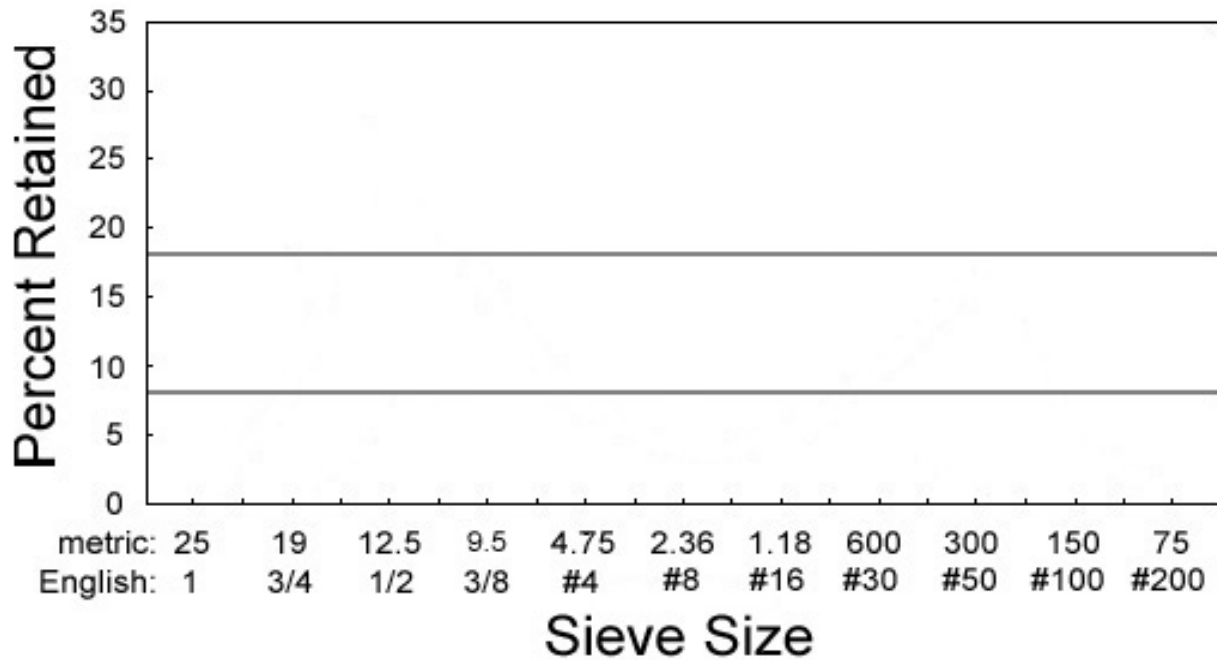


Figure 1.1.1.1 The “8-18” Rule


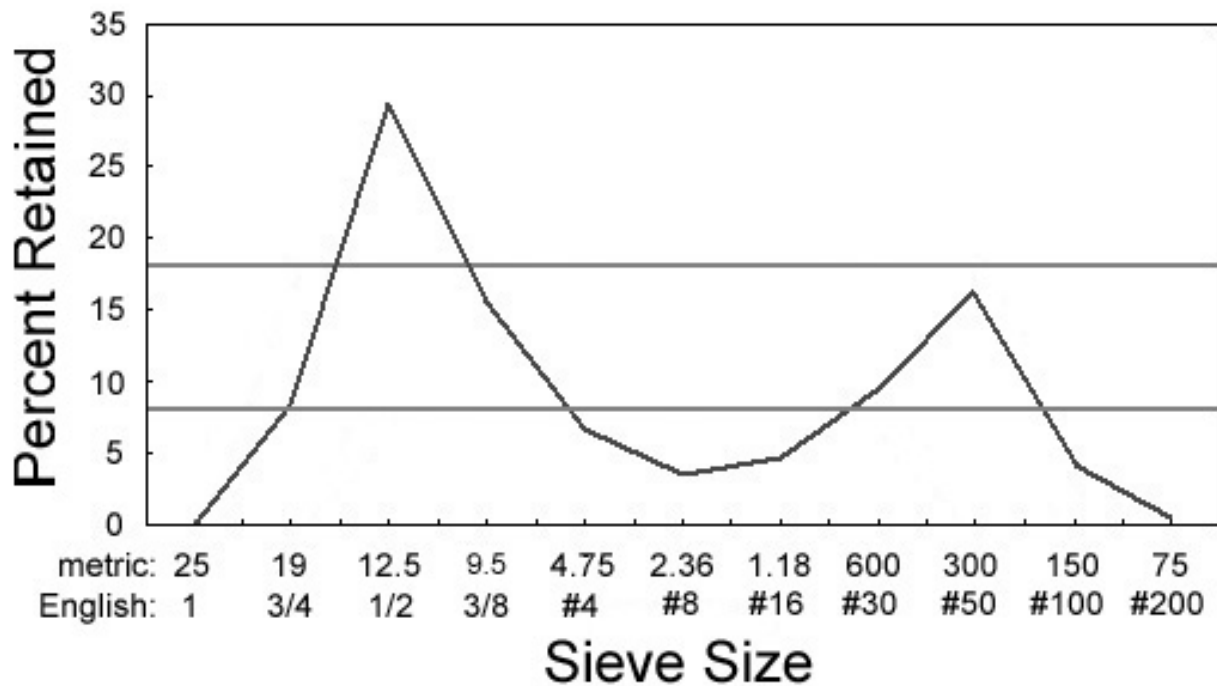


Figure 1.1.1.2 Gap Graded Aggregate Mix Design (referencing Table 1.1.1)

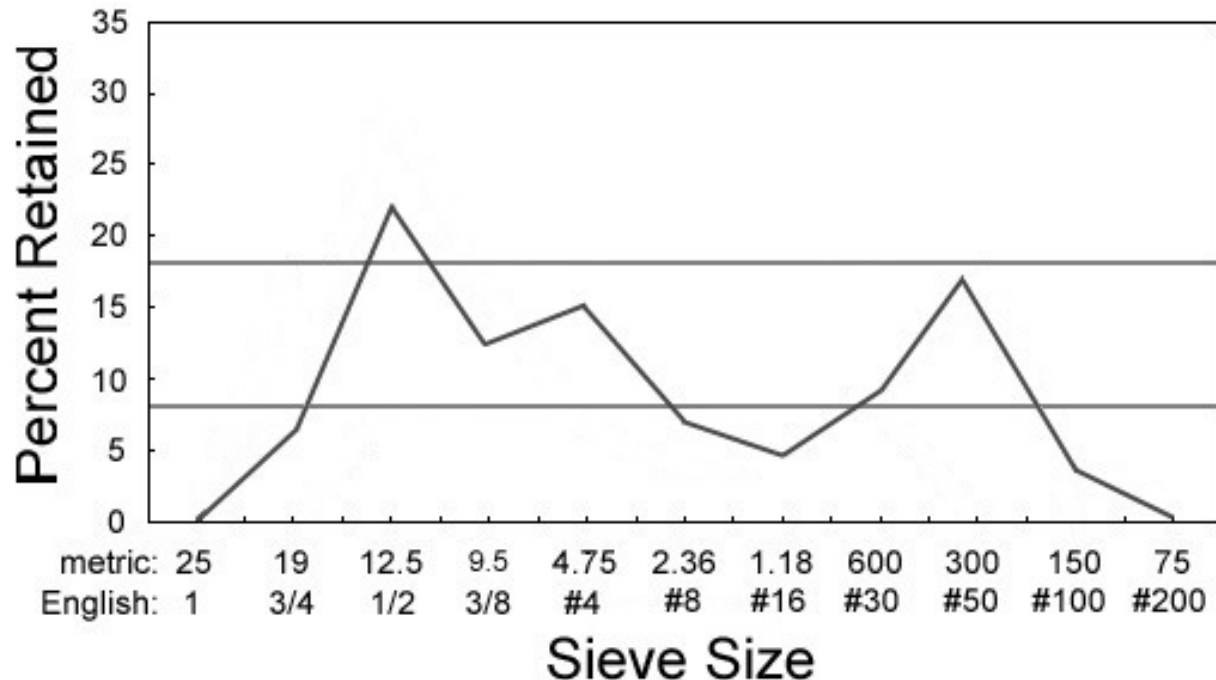

**Figure 1.1.1.3 Blended Aggregate Mix Design (referencing Table 1.1.2)**

Illinois aggregates cannot normally be combined to stay within the “8-18” rule, but they can be blended to lower the peak typically present on the 1/2 in. (12.5 mm) sieve. For example, as demonstrated in the figures, a CA 16 aggregate can be blended with a gap graded CA 07 or CA 11 to reduce the amount of material retained on the 1/2 in. (12.5 mm) sieve. As a rule of thumb, it is recommended to keep the difference between two sieves at 13 percent or less.

With most FA 01 and FA 02 aggregates, there will be a peak at the No. 50 (300 μm) sieve and a valley just before this peak, between the No. 8 (2.36 mm) and No. 16 (1.18 mm) sieves. Knowing this, it is important to remember that the amount of material passing the No. 30 (0.6 mm) sieve, but retained on the No. 50 (0.3 mm) sieve, is critical for holding entrained air bubbles in the mix. In addition, material between the No. 30 (0.6 mm) and No. 100 (0.15 mm) sieves is the most effective for entraining air.

As a final comment on the “8-18” rule, the 8 percent and 18 percent limits should be used only as a guide. Aggregate angularity (round vs. angular) and aggregate particle shape (flat and elongated) are not reflected in the “8-18” rule. For example, if the 3/8 in. (9.5 mm) to No. 16 (1.18 mm) sieve range contains 18 percent angular material, the concrete mixture would be gritty and difficult to finish. If the aggregate is flat and elongated, it may be more appropriate to have 4 to 8 percent retained on a given sieve.

### 1.1.2 The “Tarantula” Curve

Similar in concept to the “8-18” Rule, the “Tarantula” Curve is the result of research at Oklahoma State University for the Oklahoma DOT, and has been corroborated by data provided by the Iowa and Minnesota DOTs. Essentially, it provides a series of limits on percent retained for a combined gradation suited specifically to slipform construction.

The research suggests a minimum 15 percent cumulatively retained on the No. 8 (2.36 mm), No. 16 (1.18 mm), and No. 30 (0.6 mm) sieves; however, the amount retained on the No. 8 (2.36 mm) and No. 16 (1.18 mm) sieves individually should not exceed 12 percent.

Furthermore, it is recommended to have 24 to 34 percent of the total aggregate volume between the No. 30 (0.6 mm) and No. 200 (0.3 mm) sieves. Refer to Figure 1.1.2.

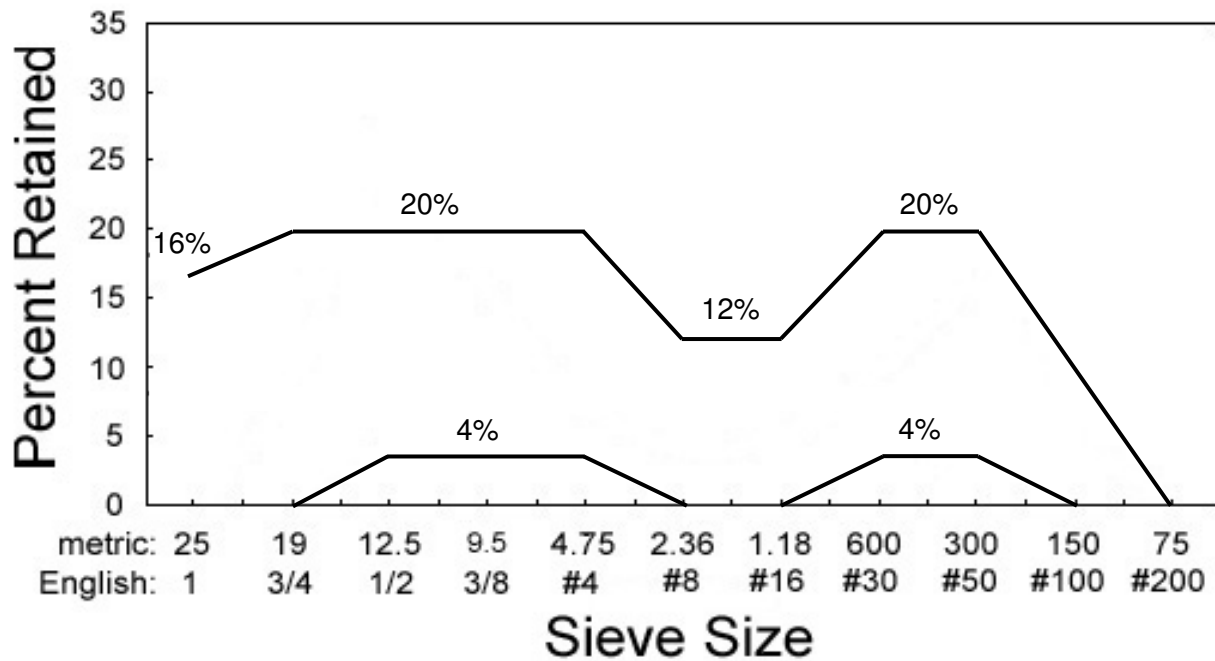


Figure 1.1.2 The “Tarantula” Curve (Oklahoma State University)


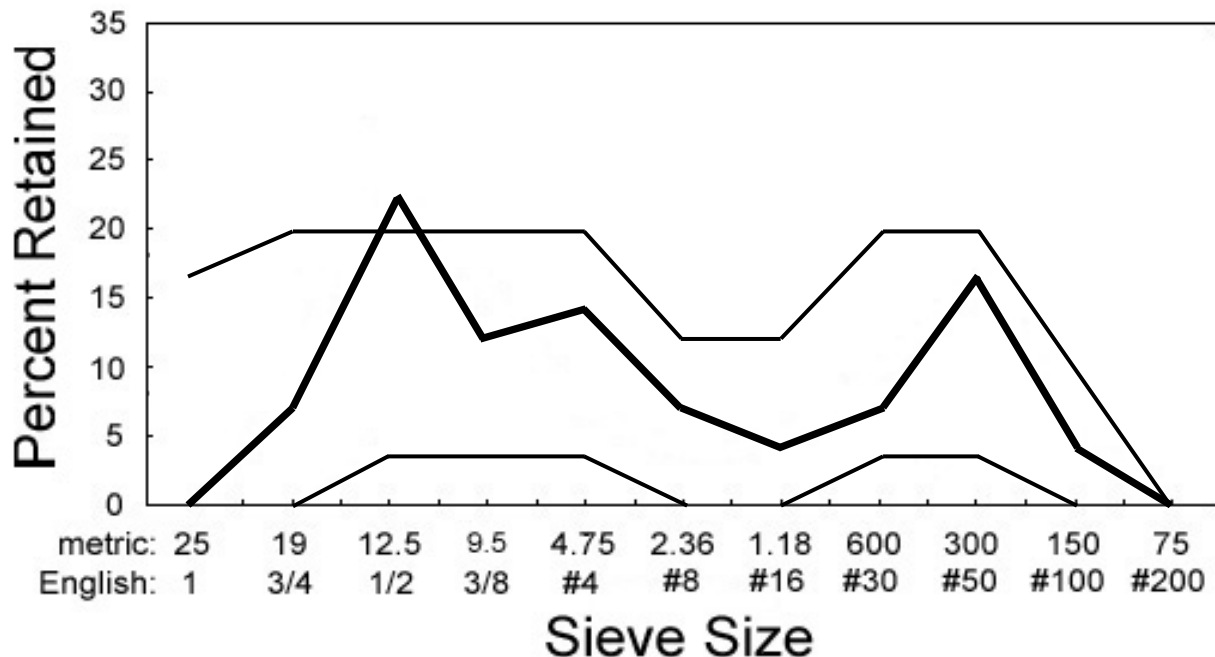


Figure 1.1.3 Blended Aggregate Mix Design (referencing Table 1.1.2)

**1.1.3 The 0.45 Power Curve**

The 0.45 Power Curve is another method to characterize an aggregate blend. Gap graded aggregate and blended aggregate gradation mix designs are plotted together on the 0.45 power curve in Figure 1.1.2, using Tables 1.1.1 and 1.1.2. When a second coarse aggregate material

(CA 16) is blended with the gap graded aggregate, the plotted line shifts closer to the theoretical optimum, indicating a more uniform combined gradation. The theoretical optimum gradation line originates at the bottom left corner and extends upward to the nominal maximum size. If the plotted line is located to the left of the theoretical optimum gradation line, this indicates a finer gradation. If the plotted line is located to the right of the theoretical optimum gradation line, this indicates a coarser gradation.

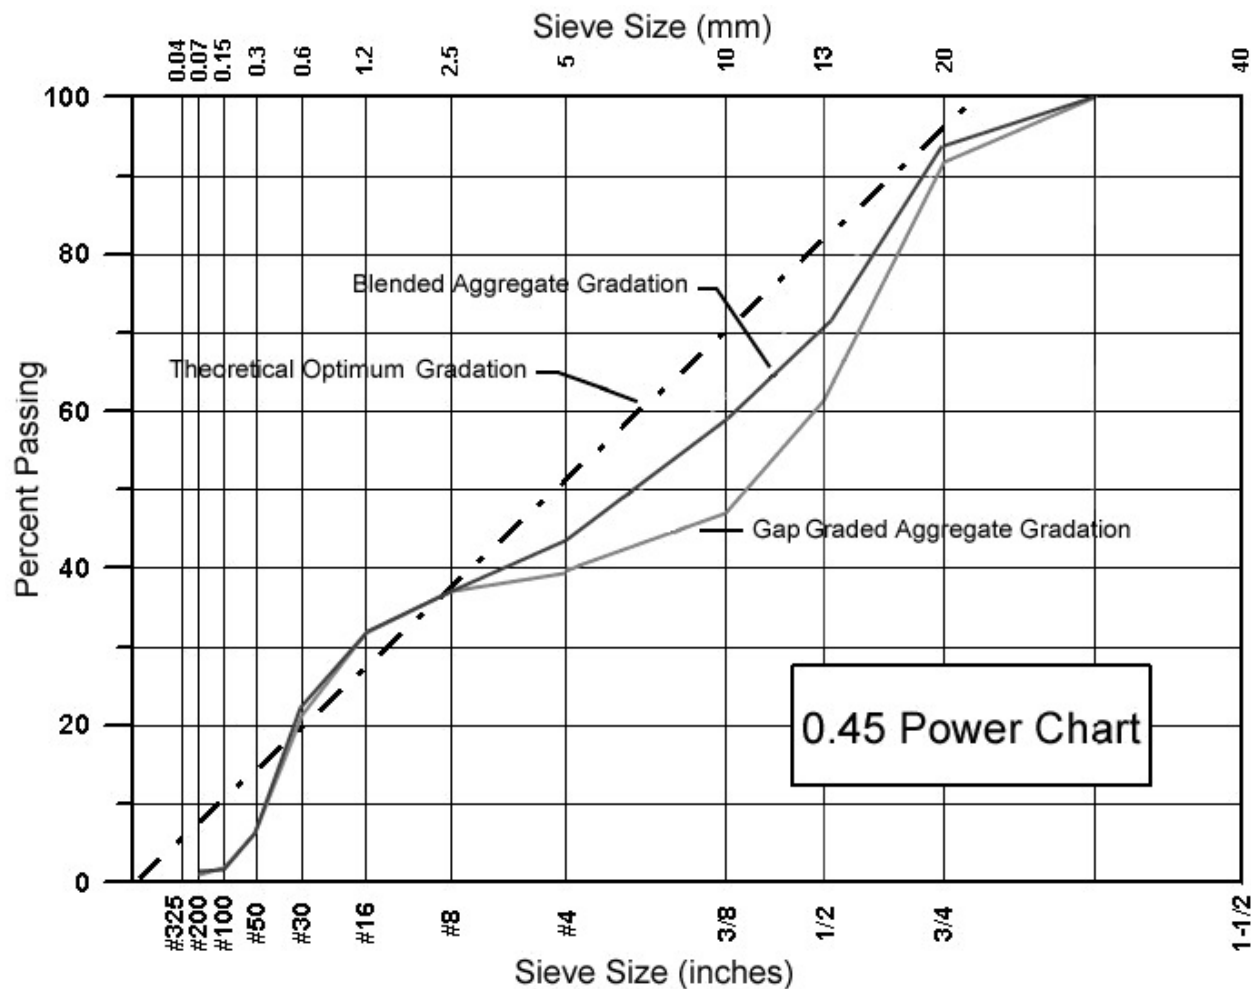

**Figure 1.1.3 Gap Graded Aggregate Mix Design (Table 1.1.1) and Blended Aggregate Mix Design (Table 1.1.2) Example on 0.45 Power Curve**

## 1.2 Fineness Modulus

Though not strictly related to aggregate blending, fineness modulus is a potentially useful method for characterizing aggregate gradation, particularly for fine aggregate. Fineness modulus is defined in ASTM C 125 as “a factor obtained by adding the percentages of material in the sample that is coarser than each of the following sieves (cumulative percentages retained), and dividing the sum by 100: No. 100 (0.15 mm), No. 50 (0.3 mm), No. 30 (0.6 mm), No. 16 (1.18 mm), No. 8 (2.36 mm), No. 4 (4.75 mm), 3/8 in. (9.5 mm), 3/4 in. (19.0 mm), 1 1/2 in. (37.5 mm), 3 in. (75 mm), 6 in. (150 mm)” (see also ASTM C 136). Thus, for fine aggregate, the fineness modulus is calculated by dividing by 100 the sum of the cumulative percents retained on the sieves listed in Table 1.2.1 (refer also to Table 1.2.2 for an example calculation).

The fineness modulus is typically used in conjunction with the nominal maximum coarse aggregate size to determine the volume of dry rodded coarse aggregate per unit volume of

concrete according to the ACI method for mix design (ACI 211.1). That is, it can be used to determine the initial aggregate proportions of a concrete mixture.

**Table 1.2.1 Sieves Required to Calculate Fineness Modulus for Fine Aggregate**

| Sieve Size (English) | Sieve Size (metric) |
|----------------------|---------------------|
| 3/8 inch             | 9.5 mm              |
| No. 4                | 4.75 mm             |
| No. 8*               | 2.36 mm*            |
| No. 16               | 1.18 mm             |
| No. 30*              | 600 $\mu\text{m}$ * |
| No. 50               | 300 $\mu\text{m}$   |
| No. 100              | 150 $\mu\text{m}$   |

\* The sieve is not required by the "Required Sampling and Testing Equipment for Concrete" document, and would have to be acquired.

**Table 1.2.2 Calculating Fineness Modulus for Fine Aggregate**

| Sieve Size (English) | Sieve Size (metric) | Percent Passing | Percent Retained | Cumulative Percent Retained |
|----------------------|---------------------|-----------------|------------------|-----------------------------|
| 3/8 inch             | 9.5 mm              | 100             | 0                | 0                           |
| No. 4                | 4.75 mm             | 98              | 2                | 2                           |
| No. 8                | 2.36 mm             | 85              | 13               | 15                          |
| No. 16               | 1.18 mm             | 65              | 20               | 35                          |
| No. 30               | 600 $\mu\text{m}$   | 45              | 20               | 55                          |
| No. 50               | 300 $\mu\text{m}$   | 21              | 24               | 79                          |
| No. 100              | 150 $\mu\text{m}$   | 3               | 18               | 97                          |
|                      |                     |                 | Sum =            | 283                         |
|                      |                     |                 | Calculation      | 283/100                     |
|                      |                     |                 | FM =             | 2.83                        |

The fineness modulus allows an individual to quickly identify a change in fine aggregate gradation, such as when it increases, the gradation becomes coarser. In addition, a fine aggregate with a high fineness modulus may result in a tendency for the concrete mixture to lose air. If the fine aggregate fineness modulus changes more than 0.2, changes in the mix proportions are probably needed to provide the same workability.


A good application for monitoring fineness modulus occurs when concrete is pumped. For example, ACI Committee 304 recommends the fine aggregate fineness modulus to be between 2.40 and 3.00 with at least 15 to 30 percent passing the No. 50 (300  $\mu\text{m}$ ) sieve and 5 to 10 percent passing the No. 100 (150 $\mu\text{m}$ ).

1.3 Aggregate Blending Worksheet


| AGGREGATE BLENDING WORKSHEET |         |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
|------------------------------|---------|------------------|-----------|--------------------|------------------------|-----------|-----------|--------------------|------|-----------|-----------------|--------------------|------|
| Sieves                       |         | Coarse Aggregate |           |                    | Intermediate Aggregate |           |           | Fine Aggregate     |      |           | Aggregate Blend |                    |      |
| English                      | metric  | % Pass, A        | % Pass, B | % of Total (a = %) |                        | % Pass, A | % Pass, B | % of Total (b = %) |      | % Pass, A | % Pass, B       | % of Total (c = %) |      |
|                              |         |                  |           | Pass               | Ret.                   |           |           | Pass               | Ret. |           |                 |                    | Pass |
| 2 1/2 in.                    | 63 mm   |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| 2 in.                        | 50 mm   |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| 1 3/4 in.                    | 45 mm   |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| 1 1/2 in.                    | 37.5 mm |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| 1 in.                        | 25 mm   |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| 3/4 in.                      | 19 mm   |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| 5/8 in.                      | 16 mm   |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| 1/2 in.                      | 12.5 mm |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| 3/8 in.                      | 9.5 mm  |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| 1/4 in.                      | 6.3 mm  |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| No. 4                        | 4.75 mm |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| No. 8                        | 2.36 mm |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| No. 16                       | 1.18 mm |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| No. 30                       | 600 µm  |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| No. 40                       | 425 µm  |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| No. 50                       | 300 µm  |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| No. 100                      | 150 µm  |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| No. 200                      | 75 µm   |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |
| PAN                          |         |                  |           |                    |                        |           |           |                    |      |           |                 |                    |      |

$$*TB = \left(\frac{a}{100} \times A\right) + \left(\frac{b}{100} \times B\right) + \left(\frac{c}{100} \times C\right) + \dots$$

1.4 "8-18" Rule Worksheet

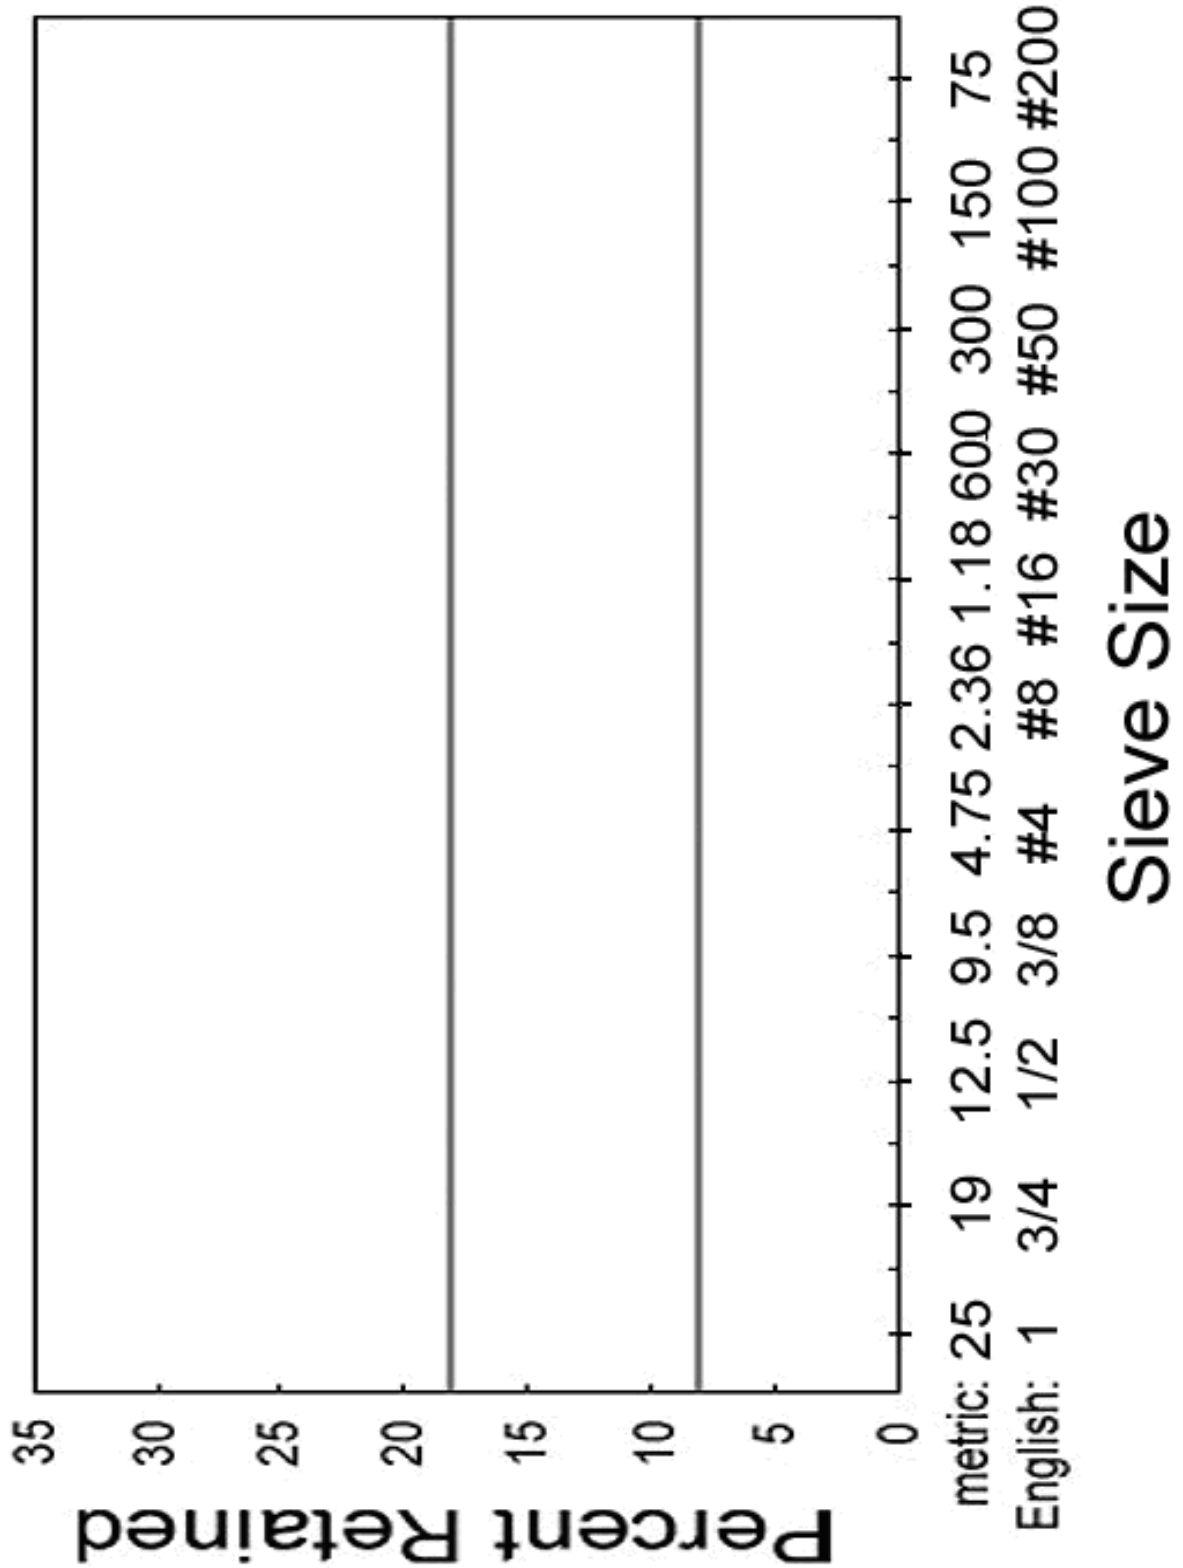


1.5 "Tarantula" Curve Worksheet

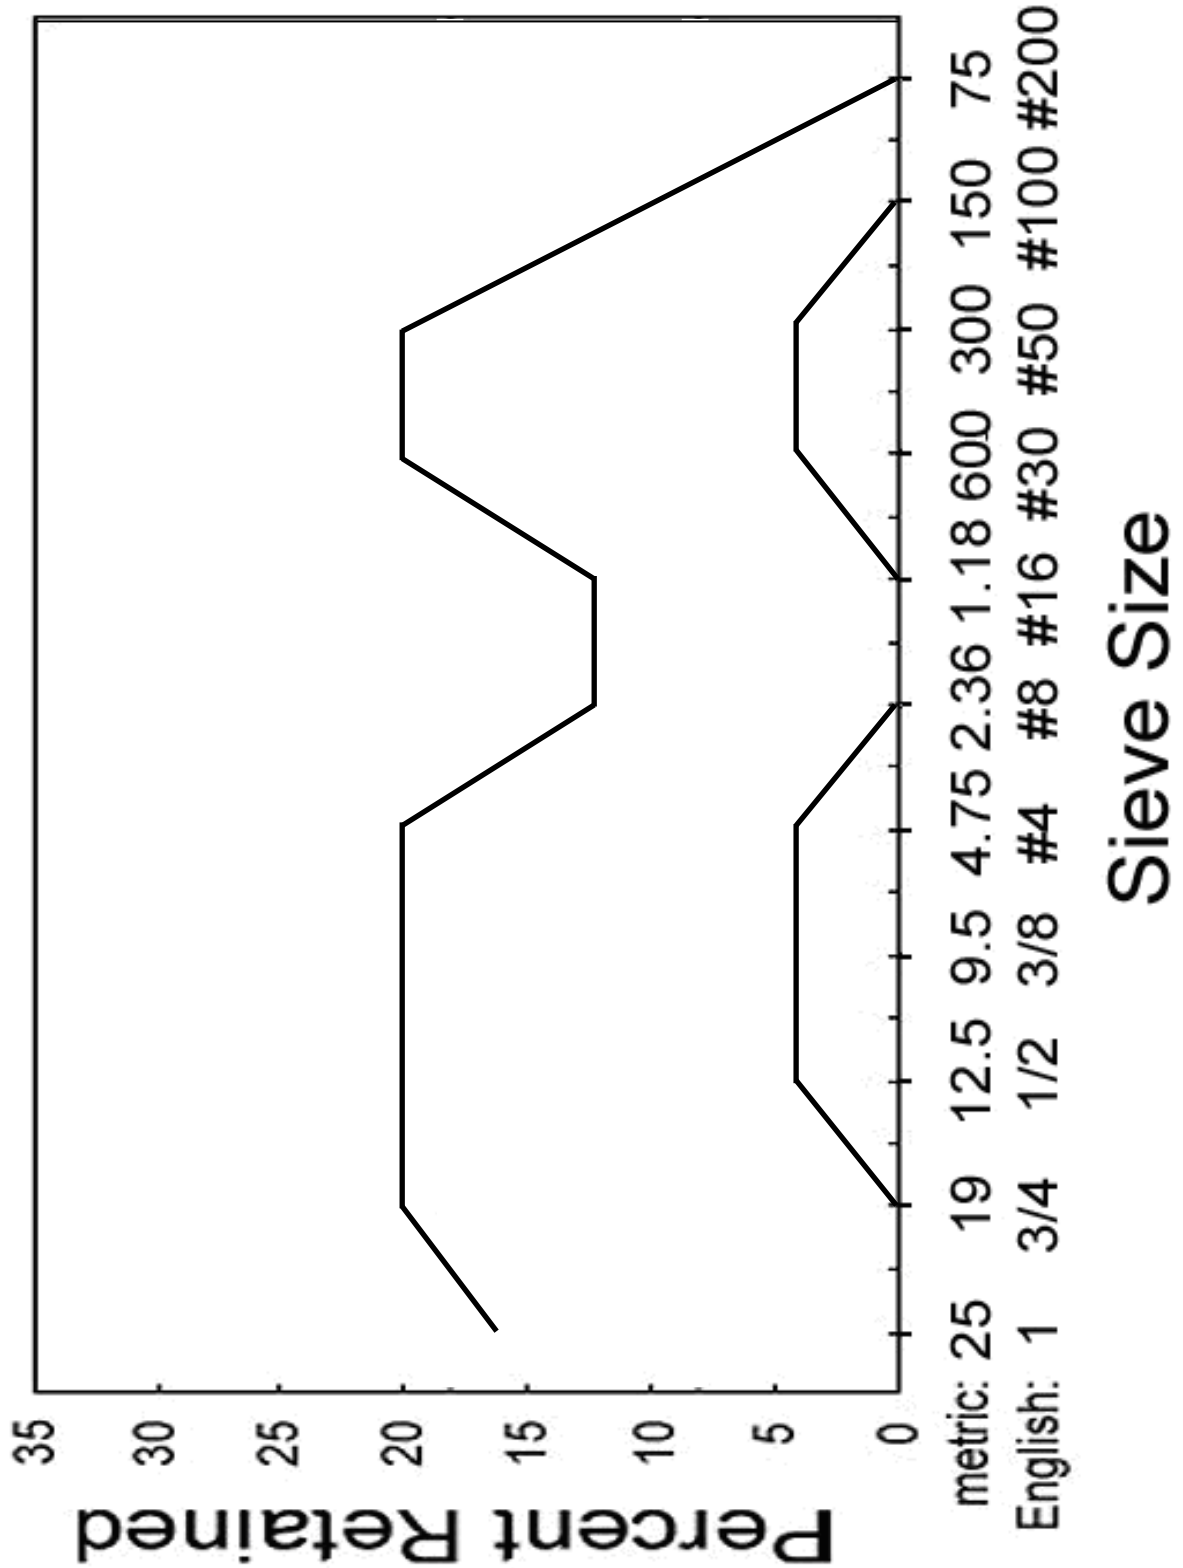



1.6 0.45 Power Curve Worksheet

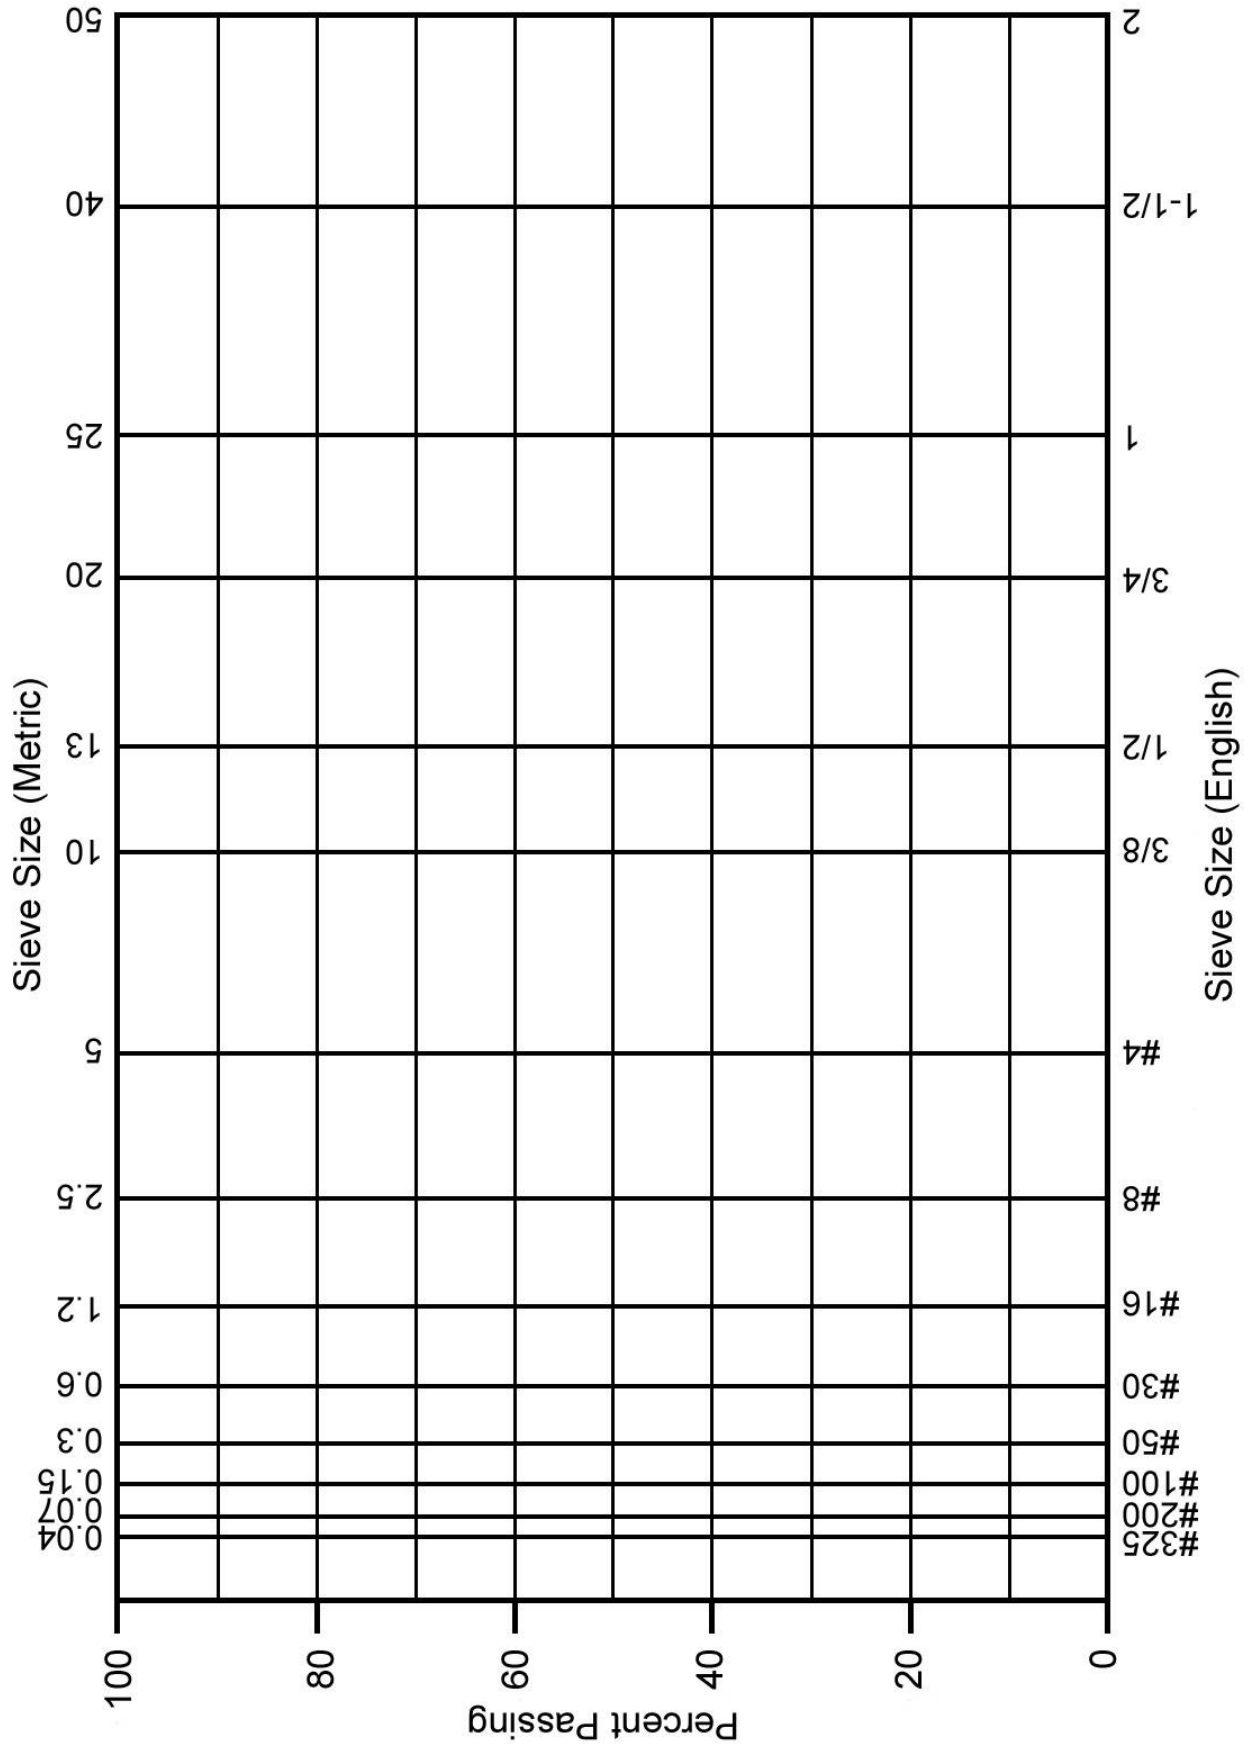

This Page Reserved

# APPENDIX F

## CEMENT AGGREGATE MIXTURE (CAM) II

### 1.0 CEMENT AGGREGATE MIXTURE (CAM) II MIX DESIGN DEVELOPMENT

The development of a CAM II mix design is similar to that of the Department's conventional concrete mix design. However, a fine aggregate water requirement, a coarse aggregate water requirement, and a mortar factor are not used.

Per Article 312.09, the Engineer will determine the proportions of materials for the mixture, or the Contractor may propose their own mix design. The Department recommends developing three mix designs for a cement-only mixture, or three mix designs for a cement and fly ash mixture, as follows:

| Mixture Type               | Mix Design Option | English Units, lb/yd <sup>3</sup> | Metric Units, kg/m <sup>3</sup> | W/C Ratio   |          |
|----------------------------|-------------------|-----------------------------------|---------------------------------|-------------|----------|
|                            |                   |                                   |                                 | CA 6, 9, 10 | CA 7, 11 |
| Cement Only Mixture        | 1                 | 200                               | 120                             | 1.2         | 1.1      |
|                            | 2                 | 250                               | 150                             | 1.1         | 1.0      |
|                            | 3                 | 300                               | 180                             | 1.0         | 0.9      |
| Cement and Fly Ash Mixture | 1                 | 170, 60                           | 101, 36                         | 1.2         | 1.1      |
|                            | 2                 | 205, 70                           | 122, 42                         | 1.1         | 1.0      |
|                            | 3                 | 245, 85                           | 145, 50                         | 1.0         | 0.9      |

The procedure for developing a CAM II mix design is as follows:

1. Calculate the absolute volume of the cement and fly ash ( $V_{\text{Cement}}$  and  $V_{\text{Ash}}$ ). The mixture shall have a portland cement content minimum of 200 lb/yd<sup>3</sup> (120 kg/m<sup>3</sup>), except a maximum 25 percent Class F ash or 30 percent Class C ash may replace the portland cement. However, per Article 312.26, the replacement shall not result in a mixture with a cement content less than 170 lb/yd<sup>3</sup> (101 kg/m<sup>3</sup>). Furthermore, based on laboratory experience, the Department recommends a maximum cement content of 300 lb/yd<sup>3</sup> (136 kg/m<sup>3</sup>), or maximum 330 lb/yd<sup>3</sup> (195 kg/m<sup>3</sup>) of cement and fly ash combined.
2. Calculate the absolute volume of water ( $V_{\text{Water}}$ ). The water/cement ratio indicated in the table in step 1 is only a starting point. Department experience has shown the water/cement ratio to range from 0.60 to 1.60. No matter what water/cement ratio is selected, a water-reducing admixture shall be used.
3. Calculate the absolute volume of air ( $V_{\text{Air}}$ ). An air-entraining admixture shall be used to produce an air content of 7.0 to 10.0 percent. Design using the midpoint of this range (i.e., 8.5 percent).
4. Calculate the absolute volume of combined aggregate ( $V_{\text{Agg}}$ ). Article 312.26 indicates the volume of fine aggregate shall not exceed the volume of coarse aggregate.

$$V_{\text{Agg}} = 1 - [V_{\text{Cement}} + V_{\text{Ash}} + V_{\text{Water}} + V_{\text{Air}}]$$

5. Calculate the absolute volume of the constituent aggregates ( $V_{CA}$  and  $V_{FA}$ ). The absolute volume of combined aggregate is multiplied by the percentage of each aggregate to obtain their respective absolute volumes.

$$\text{Absolute volume of coarse aggregate: } V_{CA} = V_{Agg} \times \frac{\%CA}{100}$$

$$\text{Absolute volume of fine aggregate: } V_{FA} = V_{Agg} \times \frac{\%FA}{100}$$

Department lab experience has shown a 50-50 percent blend of coarse aggregate to fine aggregate is a reasonable starting point when the coarse aggregate is CA 7, CA 9, or CA 11. For CA 6, the Department recommends 75 percent coarse aggregate and 25 percent fine aggregate. For CA 10, the Department recommends starting with 100 percent coarse aggregate and no fine aggregate. As an alternative to these starting points, refer to Appendix E for developing a uniformly graded mixture.

As a word of caution, the coarse aggregate may be Class D quality or better. The risk is more clay material in Class B, C, or D quality aggregate as compared to Class A quality aggregate. Clay can make it more difficult to entrain air, which is why Class A quality aggregate is normally specified for concrete.

6. Convert the absolute volumes of fine aggregate and coarse aggregate to pounds (kilograms).

$$\text{Weight of Aggregate (lb/yd}^3\text{)} = V \times G_{SSD} \times 1,683.99 \quad (\text{English})$$

$$\text{Mass of Aggregate (kg/m}^3\text{)} = V \times G_{SSD} \times 1,000.00 \quad (\text{Metric})$$

Where  $V$  = Absolute volume of coarse aggregate ( $V_{CA}$ ) or fine aggregate ( $V_{FA}$ )  
 $G_{SSD}$  = Specific gravity of coarse aggregate or fine aggregate

7. A trial batch should be performed for each mix design. The slump shall range from 1 in. (25 mm) to 3 in. (75 mm), and the air content shall range from 7.0 to 10.0 percent. If the slump and air content cannot be batched within the specified range, revise the mix design. It should also be noted that CAM II has no strength requirements. However, it is recommended to make three 4 in. x 8 in. (100 mm x 200 mm) cylinders for strength testing at 14 days. A value from 750-1500 psi (5,170-10,340 kPa) is desired, but a mix outside this range is perfectly acceptable.
8. Submit the mix design to the Department for freeze/thaw testing according ITP 161.

### 1.1 EXAMPLE PROBLEM FOR CEMENT AGGREGATE MIXTURE (CAM) II MIX DESIGN

#### Given:

- Type I portland cement with > 0.60 alkalies will be used.
- Class C fly ash with calcium oxide of 26.0 percent and specific gravity of 2.70 will be used.
- A fine aggregate (FA 1) with a saturated surface-dry specific gravity of 2.65 will be used. The alkali-silica reaction expansion for the fine aggregate is in the >0.16% – 0.27% range.
- A crushed stone coarse aggregate (CA 6) with a saturated surface-dry specific gravity of 2.69 will be used. The alkali-silica reaction expansion for the coarse aggregate limestone is an assigned value of 0.05 percent per Article 1004.02(g)(1).

### 1.1.1 Example for English Units

Step 1 Determine the absolute volume of cement and finely divided minerals.

- The minimum required cement is 170 lb/yd<sup>3</sup> if the portland cement is replaced with fly ash.
- The Class C fly ash can replace up to 30 percent of the cement.
- From 2.4.3 “Mitigation of Alkali-Silica Reaction with Finely Divided Minerals,” it is determined that the aggregate is in Group II. Thus, a minimum 25.0 percent Class C fly ash is required to reduce the risk of a deleterious alkali-silica reaction.

Thus, the Department’s default cement and fly ash mix design option 1 is selected. This mix design has 170 lb/yd<sup>3</sup> of cement and 60 lb/yd<sup>3</sup> of fly ash, and satisfies the minimum fly ash needed for the reactive aggregate without exceeding the maximum replacement as follows.

The calculation to determine the percent replacement  
 $= 60 \text{ lb/yd}^3 \div (170 \text{ lb/yd}^3 + 60 \text{ lb/yd}^3) = 26\% \text{ Class C fly ash.}$

The absolute volume of cement per cubic yard  
 $= 170 \text{ lb/yd}^3 \div (3.15 \times 1,683.99 \text{ lb/yd}^3) = 0.032$

The absolute volume of fly ash per cubic yard  
 $= 60 \text{ lb/yd}^3 \div (2.70 \times 1,683.99 \text{ lb/yd}^3) = 0.013$

Step 2 Determine the absolute volume of water.

Assume a water/cement ratio of 1.10 which takes into account that a water-reducing admixture will be used.

The calculation is  $1.10 \times (170 \text{ lb/yd}^3 + 60 \text{ lb/yd}^3) = 253 \text{ lb/yd}^3$

The absolute volume of water per cubic yard  
 $= 253 \text{ lb/yd}^3 \div (1.0 \times 1,683.99 \text{ lb/yd}^3) = 0.150$

Step 3 Determine the absolute volume of air.

The midpoint of the air content range for CAM II is 8.5 percent.

The absolute volume of air per cubic yard =  $8.5 \text{ percent} \div 100 = 0.085$

Step 4 Determine the absolute volume of the combined fine and coarse aggregates.

The absolute volume of combined fine and coarse aggregates per cubic yard  
 $= 1 - (0.032 + 0.013 + 0.150 + 0.085) = 0.720$

Step 5 Determine the absolute volumes of the constituent aggregates.

For a CA 6, use the Department’s recommendation of a 75-25 percent blend of coarse aggregate to fine aggregate.

The absolute volume of coarse aggregate per cubic yard  
 $= 0.720 \times (75 \text{ percent} \div 100) = 0.540$

The absolute volume of fine aggregate per cubic yard  
 $= 0.720 \times (25 \text{ percent} \div 100) = 0.180$

Step 6 Convert the absolute volumes of the coarse and fine aggregate to pounds.

$$\text{Coarse aggregate} = 0.540 \text{ yd}^3 \times 2.69 \times 1,683.99 \text{ lb/yd}^3 = 2,446 \text{ lb/yd}^3$$

$$\text{Fine aggregate} = 0.180 \text{ yd}^3 \times 2.65 \times 1,683.99 \text{ lb/yd}^3 = 803 \text{ lb/yd}^3$$

Step 7 Summarize the mix design.

|                          |  |
|--------------------------|--|
| Cement (3.15*)           | = 170 lb/yd <sup>3</sup>   |
| Fly Ash (2.70*)          | = 60 lb/yd <sup>3</sup>  |
| Water                    | = 253 lb/yd <sup>3</sup>   |
|                          | or   |
|                          | = 253 lb/yd <sup>3</sup> ÷ 8.33 lb/gallon = 30 gallons/yd <sup>3</sup> |
| Air Content (Target)     | = 8.5 percent  |
| Coarse Aggregate (2.69*) | = 2,446 lb/yd <sup>3</sup>   |
| Fine Aggregate (2.65*)   | = 803 lb/yd <sup>3</sup>   |
| Admixture                | = water-reducing admixture   |
| Slump (Target)           | = 2 inches   |
| Water/Cement Ratio       | = 1.10   |

\*Specific Gravity

### 1.1.2 Example for Metric Units

Step 1 Determine the absolute volume of cement.

- The minimum required cement is 101 kg/m<sup>3</sup> if the portland cement is replaced with fly ash.
- The Class C fly ash can replace up to 30 percent of the cement.
- From 2.4.3 “Mitigation of Alkali-Silica Reaction with Finely Divided Minerals,” it is determined that the aggregate is in Group II. Thus, a minimum 25.0 percent Class C fly ash is required to reduce the risk of a deleterious alkali-silica reaction.

Thus, the Department’s default cement and fly ash mix design option 1 is selected. This mix design has 101 kg/m<sup>3</sup> of cement and 36 kg/m<sup>3</sup> of fly ash, and satisfies the minimum fly ash needed for the reactive aggregate without exceeding the maximum replacement as follows.

$$\begin{aligned} &\text{The calculation to determine the percent replacement} \\ &= 36 \text{ kg/m}^3 \div (101 \text{ kg/m}^3 + 36 \text{ kg/m}^3) = 26\% \text{ Class C fly ash.} \end{aligned}$$

$$\begin{aligned} &\text{The absolute volume of cement per cubic meter} \\ &= 101 \text{ kg/m}^3 \div (3.15 \times 1000.00 \text{ kg/m}^3) = 0.032 \end{aligned}$$

$$\begin{aligned} &\text{The absolute volume of fly ash per cubic meter} \\ &= 36 \text{ kg/m}^3 \div (2.70 \times 1000.00 \text{ kg/m}^3) = 0.013 \end{aligned}$$

Step 2 Determine the absolute volume of water.

Assume a water/cement ratio of 1.10, which takes into account that a water-reducing admixture will be used.

$$\text{The calculation is } 1.10 \times (101 \text{ kg/m}^3 + 36 \text{ kg/m}^3) = 151 \text{ kg/m}^3$$

$$\begin{aligned} &\text{The absolute volume of water per cubic meter} \\ &= 151 \text{ kg/m}^3 \div (1.00 \times 1,000.00 \text{ kg/m}^3) = 0.151 \end{aligned}$$

Step 3 Determine the absolute volume of air.

The midpoint of the air content range for CAM II is 8.5 percent.

The absolute volume of air per cubic meter = 8.5 percent  $\div$  100 = 0.085.

Step 4 Determine the absolute volume of the combined fine and coarse aggregates.

The absolute volume of combined fine and coarse aggregates per cubic meter  
 = 1 - (0.032 + 0.013 + 0.151 + 0.085) = 0.719

Step 5 Determine the absolute volumes of the constituent aggregates.

For a CA 6, use the Department's recommendation of a 75-25 percent blend of coarse aggregate to fine aggregate.

The absolute volume of coarse aggregate per cubic meter  
 = 0.719  $\times$  (75 percent  $\div$  100) = 0.539

The absolute volume of fine aggregate per cubic yard  
 = 0.719  $\times$  (25 percent  $\div$  100) = 0.180

Step 6 Convert the absolute volumes of the fine and coarse aggregates to kilograms.

Coarse aggregate = 0.539 m<sup>3</sup>  $\times$  2.69  $\times$  1000.00 kg/m<sup>3</sup> = 1,450 kg/m<sup>3</sup>

Fine aggregate = 0.180 m<sup>3</sup>  $\times$  2.65  $\times$  1000.00 kg/m<sup>3</sup> = 477 kg/m<sup>3</sup>

Step 7 Summarize the mix design.

|                          |   |
|--------------------------|---|
| Cement (3.15*)           | = 101 kg/m <sup>3</sup>   |
| Fly Ash (2.70*)          | = 36 kg/m <sup>3</sup>  |
| Water                    | = 151 kg/m <sup>3</sup>   |
|                          | or  |
|                          | = 151 kg/m <sup>3</sup> $\div$ 1 liter/m <sup>3</sup> = 151 liters/m <sup>3</sup> |
| Air Content (Target)     | = 8.5 percent   |
| Coarse Aggregate (2.69*) | = 1,450 kg/m <sup>3</sup>   |
| Fine Aggregate (2.65*)   | = 477 kg/m <sup>3</sup>   |
| Admixture                | = water-reducing admixture  |
| Slump (Target)           | = 50 mm   |
| Water/Cement Ratio       | = 1.10  |

\*Specific Gravity

## 2.0 DEPARTMENT CEMENT AGGREGATE MIXTURE (CAM) II MIX DESIGN VERIFICATION

### 2.1 Verification by the Engineer

A new cement aggregate mixture (CAM) II mix design will be verified by the Engineer from test information provided by the Contractor (optional), testing performed by the Engineer, applicable Department historical test data, and previous Department experience.

For a CAM II mix design previously developed by the Engineer or Contractor, the Engineer will verify the mix design if the Department's historical test data shows compliance with specification requirements.

## **2.2 Testing Performed by the Engineer**

Per Article 312.26, constituent materials for CAM II mixtures are submitted to the Department for testing. The Department will verify all materials meet specification requirements.

Additionally, because CA 6, CA 9, and CA 10 gravel aggregates are not normally screened by the Department for alkali reaction per Article 1004.02(g), CA 6, CA 9, and CA 10 gravel aggregates submitted will need to be tested according to ASTM C 1260, and the mixture will be evaluated to meet the requirements of Article 1020.05(d).

The CAM II mixture shall meet the test requirements in Article 312.26 for relative durability (freeze/thaw resistance), air-entrainment, and slump. The mix design with the lowest cement content or cement and fly ash contents that meets the requirements will be reported to the District. Once one mix design is approved for a contract, no additional mixtures will be tested for that contract.

### **2.2.1 Testing Proportions Determined by the Engineer**

The Engineer will test either a cement only mixture or a cement and fly ash mixture. For the selected mixture type, the Engineer will develop proportions for three mix design options. Refer to 1.0 "Cement Aggregate Mixture (CAM) II Mix Design Development." In the event all three mix designs fail to meet specification requirements, one additional round of testing may be performed by the Engineer.

### **2.2.2 Testing Proportions Determined by the Contractor**

The Engineer will test either a cement only mixture or a cement and fly ash mixture. For the selected mixture type, the Contractor can develop the proportions for up to three mix design options. The mix designs may be different from those suggested in 1.0 "Cement Aggregate Mixture (CAM) II Mix Design Development." In the event all three mix designs fail to meet specification requirements, one additional round of testing (comprised of three mix design options) may be performed by the Engineer using proportions determined by the Engineer.

### **2.2.3 Unacceptable Materials**

In some cases, all three mix design options fail due to material deficiencies that can be identified after the first round of testing. For example, high fines in an aggregate can make it impossible to properly entrain air, or very poor freeze/thaw durable aggregate can make it impossible to meet relative durability requirements. The Engineer may discontinue further testing of some or all materials determined to be of questionable quality after evaluating a minimum of three mix design options (one round of testing).



# **APPENDIX G**

## **CONTROLLED LOW-STRENGTH MATERIAL (CLSM)**

### **1.0 CONTROLLED LOW-STRENGTH MATERIAL (CLSM) MIX DESIGN DEVELOPMENT**

For CLSM, there is no formal mix design procedure. However, the principle of volumetric mix design, designing in terms of a standard unit volume, still applies. The absolute volumes of cement, fly ash, water, air, and aggregate shall equal one. In addition, the mix shall comply with the mix design criteria. For more details concerning the mix design criteria and submittal of the mix design, refer to Section 1019 of the Standard Specifications.

The Contractor is advised that CLSM does not normally pump well.

### **2.0 DEPARTMENT CONTROLLED LOW-STRENGTH MATERIAL (CLSM) MIX DESIGN VERIFICATION**

#### **2.1 Verification by the Engineer**

A new controlled low-strength material (CLSM) mix design will be verified by the Engineer according to Article 1019.06 of the Standard Specifications.

For a CLSM mix design previously developed by the Engineer or Contractor, the Engineer will verify the mix design if the Department's historical test data shows compliance with specification requirements.

This Page Reserved

# APPENDIX H

## STAMPED OR INTEGRALLY COLORED CONCRETE

Stamped or integrally colored concrete shall be done according to contract specifications. The following is for informational purposes when stamped or integrally colored concrete is used.

### Stamped Concrete

A minimum cement factor of 6.05 cwt/yd<sup>3</sup> (360 kg/m<sup>3</sup>) for central-mixed, truck-mixed or shrink-mixed concrete is recommended.

A slump range of 3 in. (75 mm) to 5 in. (125 mm) is recommended.

A coarse aggregate gradation of CA 11, CA 13, CA 14, or CA 16 is recommended.

A mortar factor of 0.88 to 0.90 is recommended.

### Integrally Colored Concrete

The pigment for colored concrete has no influence on the mix design.

The following guidance may help prevent color variations.

- Maintaining a water/cement ratio within  $\pm 0.02$  of the target value is recommended.
- A calcium chloride accelerating admixture shall not be used.

This Page Reserved

# Appendix I

## CONCRETE REVETMENT MATS

### 1.0 CONCRETE REVETMENT MAT MIX DESIGN DEVELOPMENT

For concrete revetment mats, there is no formal mix design procedure, and Section 285 of the Standard Specifications provides very few mix design parameters. However, the principle of volumetric mix design, designing in terms of a standard unit volume, still applies. The absolute volumes of cement, fly ash, water, air, and fine aggregate (there is no coarse aggregate) shall equal one.

For an air content between 6.0 and 9.0 percent, the following mix design parameters should be used to meet the required 28-day compressive strength of 2500 psi (17,000 kPa).

#### Cement Only Mix Design

- |  |  |
|--|--|
| • Cement   | 650 – 800 lb/yd <sup>3</sup> (385 – 475 kg/m <sup>3</sup> )                |
| • Water/Cement Ratio                               | Maximum 0.60   |
| • Fine Aggregate (saturated surface dry condition) | Adjust for $V_{\text{Cement}}$ , $V_{\text{Water}}$ , and $V_{\text{Air}}$ |
| • Air Content (Target)                             | 7.5 percent  |
| • Water-Reducing or HRWR Admixture                 | Optional   |

#### Cement and Fly Ash Mix Design

- |  |  |
|--|--|
| • Cement   | 470 – 610 lb/yd <sup>3</sup> (279 – 362 kg/m <sup>3</sup> )                |
| • Total Cement Plus Fly Ash*                       | 725 – 825 lb/yd <sup>3</sup> (430 – 489 kg/m <sup>3</sup> )                |
| • Water/Cement Ratio                               | Maximum 0.60   |
| • Fine Aggregate (saturated surface dry condition) | Adjust for $V_{\text{Cement}}$ , $V_{\text{Water}}$ , and $V_{\text{Air}}$ |
| • Air Content (Target)                             | 7.5 percent  |
| • Water-Reducing or HRWR Admixture                 | Optional   |

\*It is recommended to keep the fly ash at a maximum 35 percent of the total cement plus fly ash.

Section 285 states the mixture shall be proportioned to provide a pumpable slurry. A flow cone test according to ASTM D 6449 is a good method to determine pumpability. It is recommended the efflux time range from 9 to 12 seconds.

### 2.0 DEPARTMENT CONCRETE REVETMENT MAT MIX DESIGN VERIFICATION

#### 2.1 Verification by the Engineer

A new concrete revetment mat mix design will be verified by the Engineer from test information provided by the Contractor (optional), testing performed by the Engineer, applicable Department historical test data, target strength calculations, and previous Department experience.

For a concrete revetment mat mix design previously developed by the Engineer or Contractor, the Engineer will verify the mix design if the Department's historical test data shows compliance with specification requirements.

## **2.2 Testing Performed by the Engineer**

The Engineer may require the Contractor to provide a batch of concrete revetment mat mixture at no cost to the Department.

### **2.2.1 Procedure for Trial Batch**

The procedure that follows shall be used to perform a trial batch unless specified otherwise in the contract plans.

The trial batch shall be performed in the presence of the Engineer, and the Engineer will perform all tests. The Contractor has the option to perform their own tests. The volume of the trial batch shall be a minimum of 2.0 yd<sup>3</sup> (1.5 m<sup>3</sup>), but 4.0 yd<sup>3</sup> (3.0 m<sup>3</sup>) is strongly recommended to more accurately evaluate the influence of mixing. Batch at or near the maximum water/cement ratio as requested by the Engineer. The air content should be within 0.5 percent of the maximum allowable specification value or as requested by the Engineer. Strength will be determined for the test of record, or at other ages as determined by the Engineer. The test of record shall be the day indicated in Section 285. In all cases, strength will be based on the average of a minimum two 6- by 12-in. (150- by 300-mm) cylinder breaks or three 4- by 8-in. (100- by 200-mm) cylinder breaks. In addition to air and strength testing, concrete temperature will be determined by the Engineer. Testing will be performed according to Illinois Modified AASHTO R 60, T 22, T 23, T 152 or T 196, and Illinois Modified ASTM C 1064. As an option for additional information, Illinois Modified AASHTO T 121 and ASTM D 6449 may be performed.

#### **2.2.2.1 Verification of Trial Batch**

The trial batch will be verified by the Engineer if Department test results meet specification requirements and the mixture is pumpable.

# **APPENDIX J**

## **INSERTION LINING OF PIPE CULVERTS (GROUT)**

### **1.0 GROUT MIXTURE MIX DESIGN DEVELOPMENT FOR INSERTION LINING OF PIPE CULVERTS**

For the grout mixture used in insertion lining of pipe culverts, there is no formal mix design procedure. However, the principle of volumetric mix design, designing in terms of a standard unit volume, still applies. The absolute volumes of cement, fly ash, water, air, and fine aggregate (there is no coarse aggregate) shall equal one. According to Section 543 of the Standard Specifications, the mix design parameters are as follows:

The grout mixture shall be 6.50 cwt/yd<sup>3</sup> (385 kg/m<sup>3</sup>) of portland cement plus fine aggregate and water. Fly ash may replace a maximum of 5.25 cwt/yd<sup>3</sup> (310 kg/m<sup>3</sup>) of the portland cement. The water/cement ratio, according to Article 1020.06, shall not exceed 0.60. An air-entraining admixture shall be used to produce an air content, according to Article 1020.08, of not less than 6.0 percent nor more than 9.0 percent of the volume of the grout. The Contractor shall have the option to use a water-reducing or high range water-reducing admixture.

As indicated by the mix design parameters, there are few variables for developing the mix design. The Contractor shall use a target air content of 7.5 percent, and vary the cement, fly ash, and water proportions to obtain a flowable mix. In addition, the grout mixture shall have a minimum 28 day compressive strength of 150 psi (1035 kPa).

### **2.0 DEPARTMENT GROUT MIXTURE FOR INSERTION LINING OF PIPE CULVERTS MIX DESIGN VERIFICATION**

The mix design is normally be done by the Department, but the Contractor has the option to submit a mix design for a Quality Control/Quality Assurance project.

#### **2.1 Verification by the Engineer**

A new insertion lining of pipe culverts mix design will be verified by the Engineer from test information provided by the Contractor (optional), testing performed by the Engineer, applicable Department historical test data, target strength calculations, and previous Department experience.

For a insertion lining of pipe culverts mix design previously developed by the Engineer or Contractor, the Engineer will verify the mix design if the Department's historical test data shows compliance with specification requirements.

#### **2.2 Testing Performed by the Engineer**

The Engineer may require the Contractor to provide a batch of insertion lining of pipe culverts mixture at no cost to the Department.

##### **2.2.1 Procedure for Trial Batch**

The procedure that follows shall be used to perform a trial batch unless specified otherwise in the contract plans.

The trial batch shall be performed in the presence of the Engineer, and the Engineer will perform all tests. The Contractor has the option to perform their own tests. The volume of the trial batch shall be a minimum of 2.0 yd<sup>3</sup> (1.5 m<sup>3</sup>), but 4.0 yd<sup>3</sup> (3.0 m<sup>3</sup>) is strongly recommended to more accurately evaluate the influence of mixing. Batch at or near the maximum water/cement ratio as requested by the Engineer. The air content should be within 0.5 percent of the maximum allowable specification value or as requested by the Engineer. Strength will be determined for the test of record, or at other ages as determined by the Engineer. The test of record shall be the day indicated in Section 543. In all cases, strength will be based on the average of a minimum of two breaks. In addition to air and strength testing, concrete temperature will be determined by the Engineer. Air and concrete temperature testing will be performed according to Illinois Modified AASHTO R 60, T 152 or T 196, and Illinois Modified ASTM C1064. Strength testing will be performed according to ASTM C 1107 and C 109. As an option for additional information, Illinois Modified AASHTO T 121 may be performed.

#### **2.2.2.1 Verification of Trial Batch**

The trial batch will be verified by the Engineer if Department test results meet specification requirements and the mixture is flowable.



# Appendix K

## INSERTION LINING OF PIPE CULVERTS (CELLULAR CONCRETE)

### 1.0 CELLULAR CONCRETE MIX DESIGN DEVELOPMENT FOR INSERTION LINING OF PIPE CULVERTS

Cellular concrete (sometimes called engineered fill) is a special mix which relies on foam to make the concrete low strength or light weight.

The mix designs are proprietary in nature, and therefore, their development will not be discussed within this manual. However, the principle of volumetric design, designing in terms of a standard unit volume, still applies. The absolute volume of materials shall equal one.

#### **Cement Only Mix Design for Strength Range of 30 – 350 psi (207 – 2,413 kPa)**

- |   |   |
|---|---|
| • Cement                                | 400 – 650 lb/yd <sup>3</sup> (237 – 386 kg/m <sup>3</sup> ) |
| • Water/Cement Ratio                    | 0.50 – 0.60   |
| • Foam Admixture                        | Consult Manufacturer for Dosage                             |
| • Homogenous Void or Air Cell Structure | 20 – 70 percent   |

#### **Comments:**

- Cement replacement with fly ash may reach as high as 65 percent.
- The use of fine aggregate is optional, but is not normally utilized when low strength or light weight is desired.

### 2.0 DEPARTMENT CELLULAR CONCRETE FOR INSERTION LINING OF PIPE CULVERTS MIX DESIGN VERIFICATION

#### 2.1 Verification by the Engineer

The mix design will be verified by the Engineer from test information provided by the Contractor showing that the mix is flowable and meets compressive strength requirements.

This Page Reserved

# **APPENDIX L**

## **CLASS SI CONCRETE BETWEEN PRECAST CONCRETE BOX CULVERTS**

### **1.0 CLASS SI CONCRETE MIX DESIGN DEVELOPMENT (WHEN MIXTURE IS USED BETWEEN PRECAST CONCRETE BOX CULVERT SECTIONS)**

For the Class SI concrete used between precast concrete box culvert sections, Article 540.06 states "The Class SI concrete shall be according to Section 1020, except the maximum size coarse aggregate shall be  $\frac{3}{8}$  in. (10 mm)." This requirement is also in the Bridge Guide Special Provision "Three Sided Precast Concrete Structure." Thus, the principle of volumetric mix design discussed in this manual applies. The key point is that the specification essentially states to use a fine aggregate only. According to Article 1003.01, fine aggregate has a maximum size of  $\frac{3}{8}$  in. (10 mm). To develop the mix design, the absolute volumes of cement, finely divided minerals, water, and air are calculated and added together. The resultant value is subtracted from one to get the volume of aggregate. Since the coarse aggregate proportion has been replaced with fine aggregate, the water demand will be higher. It is suggested to use a coarse aggregate basic water requirement of 0.4 gal/cwt (0.33 L/kg) as a starting point in developing the mix design.

### **2.0 DEPARTMENT CLASS SI CONCRETE MIX DESIGN VERIFICATION (WHEN MIXTURE IS USED BETWEEN PRECAST CONCRETE BOX CULVERT SECTIONS)**

#### **2.1 Verification by the Engineer**

A new Class SI concrete (used between precast concrete sections) mix design will be verified by the Engineer from test information provided by the Contractor (optional), testing performed by the Engineer, applicable Department historical test data, target strength calculations, and previous Department experience.

For a Class SI concrete (used between precast concrete sections) mix design previously developed by the Engineer or Contractor, the Engineer will verify the mix design if the Department's historical test data shows compliance with specification requirements.

#### **2.2 Testing Performed by the Engineer**

The Engineer may require the Contractor to provide a batch of Class SI concrete (used between precast concrete sections) mixture at no cost to the Department.

##### **2.2.1 Procedure for Trial Batch**

The procedure that follows shall be used to perform a trial batch unless specified otherwise in the contract plans.

The trial batch shall be performed in the presence of the Engineer, and the Engineer will perform all tests. The Contractor has the option to perform their own tests. The volume of the trial batch shall be a minimum of 2 yd<sup>3</sup> (1.5 m<sup>3</sup>), but 4 yd<sup>3</sup> (3.0 m<sup>3</sup>) is strongly recommended to more accurately evaluate the influence of mixing. Batch at or near the maximum water/cement ratio or as requested by the Engineer. The air content should be within 0.5 percent of the maximum allowable specification value or as requested by the Engineer. The slump should be within the allowable specification range. Strength will be determined for the test of record, or at other ages determined by the Engineer. The test of record shall be the day indicated in Article 1020.04 or as specified. In all cases, strength will be based on the average of a minimum

two 6- by 12-in. (150- by 300-mm) cylinder breaks, three 4- by 8-in. (100- by 200-mm) cylinder breaks, or two beam breaks. In addition to slump, air, and strength testing, concrete temperature will be determined by the Engineer. Testing will be performed according to Illinois Modified AASHTO R60, T 23, T 119, T 152 or T 196, T 22 or T 177, and Illinois Modified ASTM C 1064. As an option for additional information, Illinois Modified AASHTO T 121 may be performed.

#### **2.2.1.1 Verification of Trial Batch, Voids Test, and Durability Test Data**

The trial batch will be verified by the Engineer if Department test results meet specification requirements.

# **APPENDIX M**

## **PERVIOUS CONCRETE**

Pervious concrete shall be done according to contract specifications, and there is no formal mix design procedure. However, the principle of volumetric mix design, designing in terms of a standard unit volume, still applies. The absolute volumes of cement, finely divided minerals, water, air, and aggregate shall equal one.

When the contract specifications specify freeze/thaw durability, improved durability may be achieved by entraining air in the cement paste.

This Page Reserved

# APPENDIX N

## AVERAGE AND STANDARD DEVIATION

### 1.0 AVERAGE STRENGTH


“Average” strength implies that half of the samples tested are **stronger than average** and half are **weaker than average**. Thus, the average strength of a concrete mix must be **greater** than the minimum required strength.

The quantitative difference between the average, or mix design target strength and the minimum required strength, depends on the accuracy and precision of the test results. The accuracy and precision of the test results must be calculated before the mix design target strength can be determined.

### 1.1 Accuracy and Precision

Accuracy refers to the average of the performance with reference to the target: a measure of how near the results are to the target.

Precision refers to the consistency of the performance itself: a measure of how near the results are to each other regardless of the target. That is, though the results may not be near the target, amongst themselves they are tightly grouped.

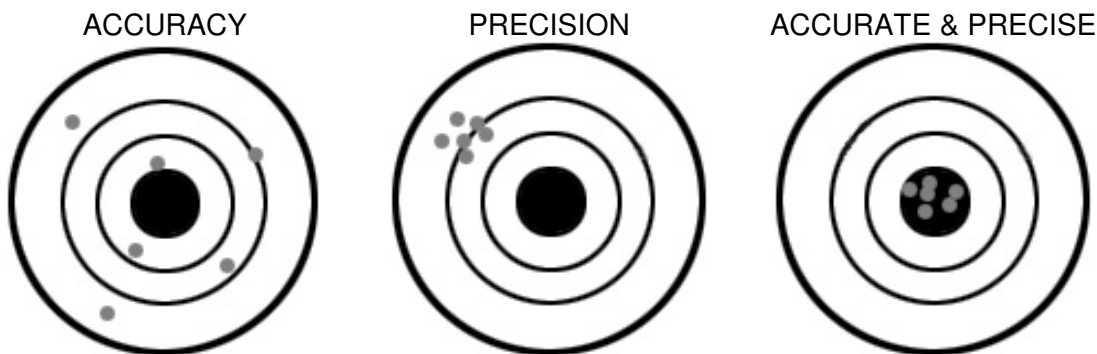

**Figure 1. Illustration of Accuracy and Precision**

Accuracy is typically measured by the mean, or average, of the test results as follows:

$$\text{Average, } \bar{X} = \frac{X_1 + X_2 + X_3 + \cdots + X_n}{n}$$

Where  $x_i$  is an individual test result, and  
 $n$  is the total number of test results

Precision, or “measure of dispersion,” is measured by the standard deviation, which indicates width, spread, clustering, and consistency, and is defined as follows:

$$\text{Standard Deviation, } S = \sqrt{\frac{\sum (\bar{X} - x_i)^2}{(n-1)}}$$

**Example Using English Units:**

| Test Record (psi)   |      | Deviation<br>$\bar{X} - x_i$ | Square of Deviation<br>$(\bar{X} - x_i)^2$                                     |
|---|------|------------------------------|--|
| 1   | 3000 | 4058 - 3000 = 1058           | 1,119,364  |
| 2   | 3450 | 4058 - 3450 = 608            | 369,664  |
| 3   | 3600 | 4058 - 3600 = 458            | 209,764  |
| 4   | 4650 | 4058 - 4650 = -592           | 350,464  |
| 5   | 4750 | 4058 - 4750 = -692           | 478,864  |
| 6   | 4900 | 4058 - 4900 = -842           | 708,964  |
| $\text{sum} = \sum_{i \rightarrow n}^{n=6} x_i = 24,350$        |      |                              | $\text{sum} = \sum_{i \rightarrow n}^{n=6} (\bar{X} - x_i)^2 = 3,237,084$      |
| average,<br>$\bar{X} = \frac{\text{sum}}{n} = 4058 \text{ psi}$ |      |                              | standard deviation,<br>$S = \sqrt{\frac{\text{sum}}{(n-1)}} = 805 \text{ psi}$ |


**Example Using Metric Units:**

| Test Record (kPa)   |        | Deviation<br>$\bar{X} - x_i$ | Square of Deviation<br>$(\bar{X} - x_i)^2$                                      |
|---|--------|------------------------------|---|
| 1   | 20,690 | 27,980 - 20,690 = 7290       | 53,144,100  |
| 2   | 23,790 | 27,980 - 23,790 = 4190       | 17,556,100  |
| 3   | 24,820 | 27,980 - 24,820 = 3160       | 9,985,600   |
| 4   | 32,060 | 27,980 - 32,060 = -4080      | 16,646,400  |
| 5   | 32,750 | 27,980 - 32,750 = -4770      | 22,752,900  |
| 6   | 33,790 | 27,980 - 33,790 = -5810      | 33,756,100  |
| $\text{sum} = \sum_{i \rightarrow n}^{n=6} x_i = 167,900$         |        |                              | $\text{sum} = \sum_{i \rightarrow n}^{n=6} (\bar{X} - x_i)^2 = 153,841,200$     |
| average,<br>$\bar{X} = \frac{\text{sum}}{n} = 27,980 \text{ kPa}$ |        |                              | standard deviation,<br>$S = \sqrt{\frac{\text{sum}}{(n-1)}} = 5547 \text{ kPa}$ |



## 2.0 THE NORMAL DISTRIBUTION—The Bell Curve

Characteristics in any statistical sample population, such as compressive strength test results, can be grouped around some central tendency, or average, as illustrated in Figure 2.

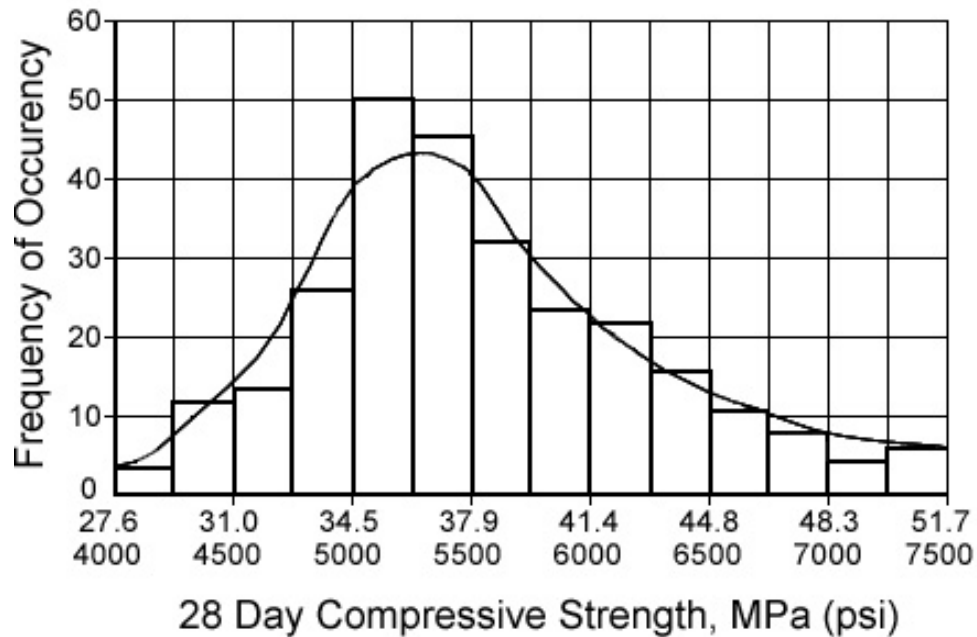

**Figure 2. Example of Normal Distribution Histogram**

Figure 2. is an example of a histogram, a graph of the frequency of occurrences per subdivision of the complete range of test results. For example, there were 50 occurrences of test results within 5000 and 5250 psi (34.5 and 36.2 MPa).

Now, a smooth bell-shaped curve can be drawn through the histogram. This “Bell Curve” is known as the Normal Distribution, characterized by a distinct central tendency toward the center, which is the average. The Bell Curve quantitatively illustrates how test results have an equal chance to be above or below the average.

The characteristics of the Normal Distribution are as follows:

- 68 percent of all results fall within 1 standard deviation from either side of the average
- 95 percent of all results fall within 2 standard deviations from either side of the average
- 99.7 percent of all results fall within 3 standard deviations from either side of the average
- 99 percent of all results fall above the value that is 2.33 standard deviations below the average

The figures on the next page illustrate an example of how greater precision can help production. Figure 3 shows three mixes with the same target strength but different standard deviations (i.e., precision). Even with the different levels of precision, all three mixes can be expected to meet the minimum specified strength of 4000 psi (27.6 MPa). However, as illustrated in Figure 4, increased precision allows the target strengths for two of the mixes to be reduced (e.g., via reduced total cement) without fear of violating the minimum specified strength.

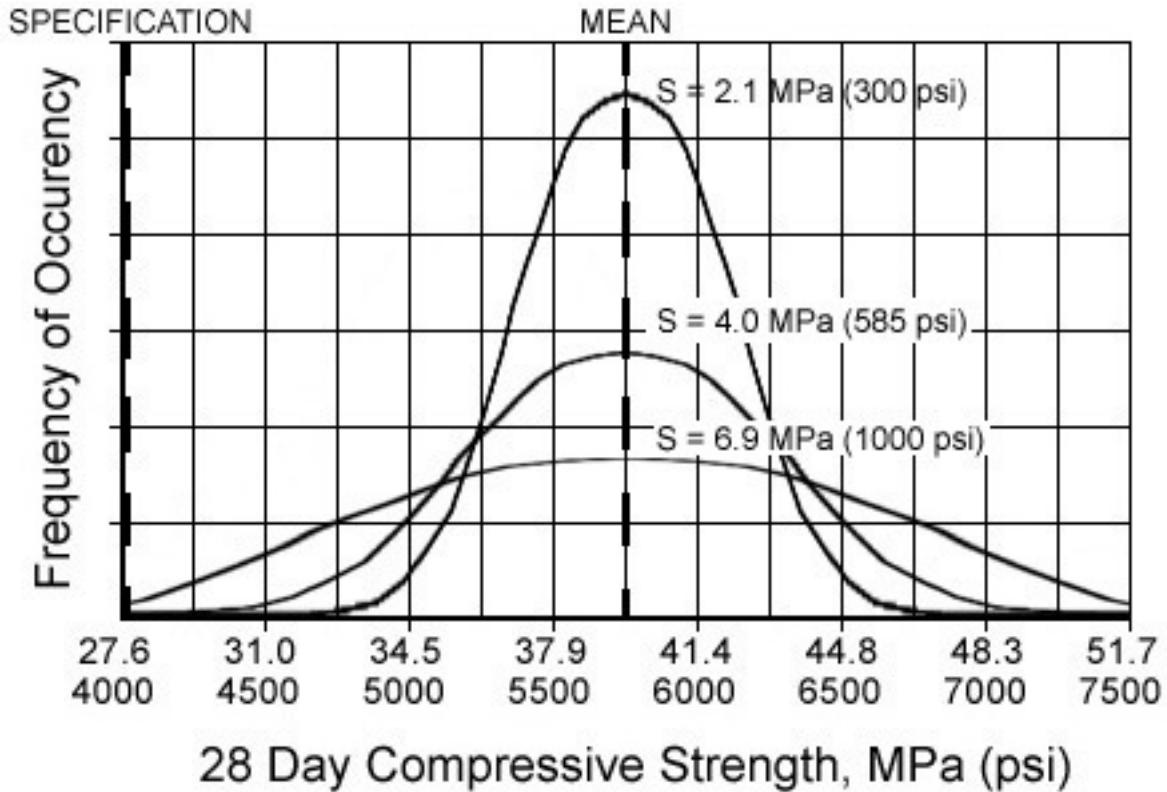


Figure 3 Example of Normal Distribution Plots for Mixes with the Same Target Strength but Differing Standard Deviations



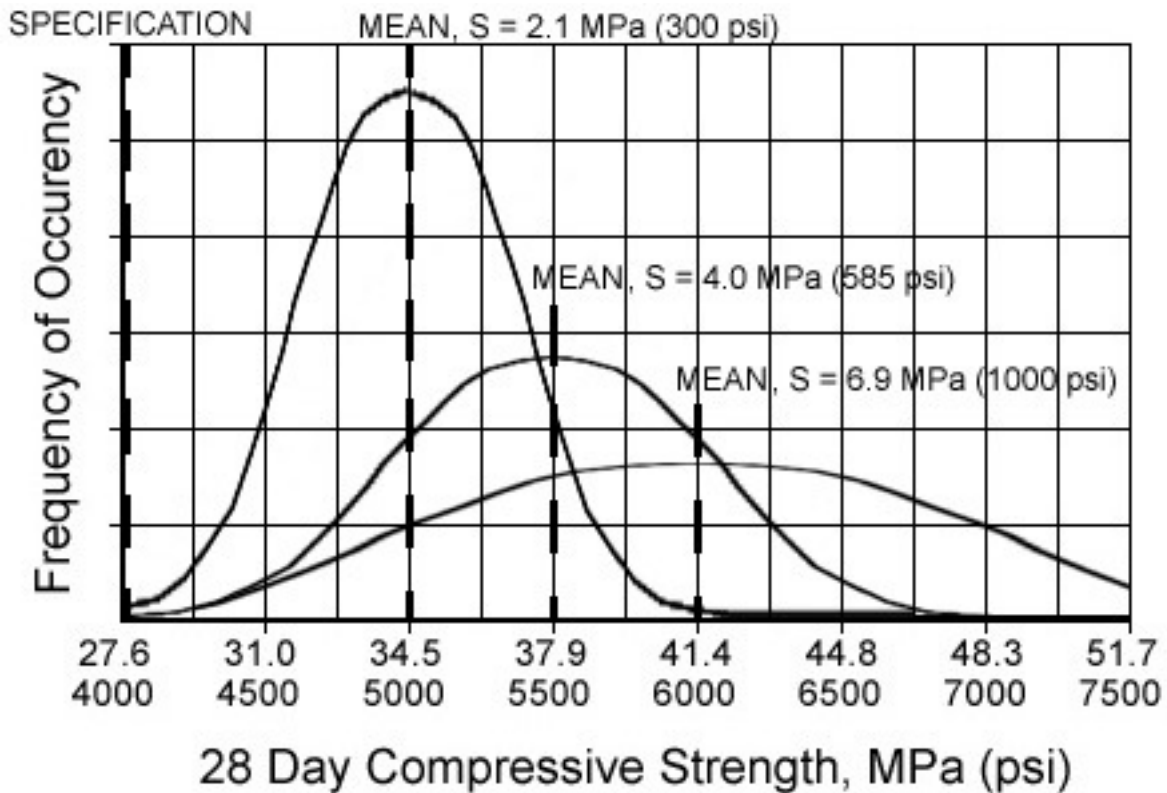


Figure 4 Example of Normal Distribution Plots for Mixes with Adjusted Target Strengths to Account for the Differing Standard Deviations

# APPENDIX O

## ALKALI-SILICA REACTION MITIGATION FLOW CHART

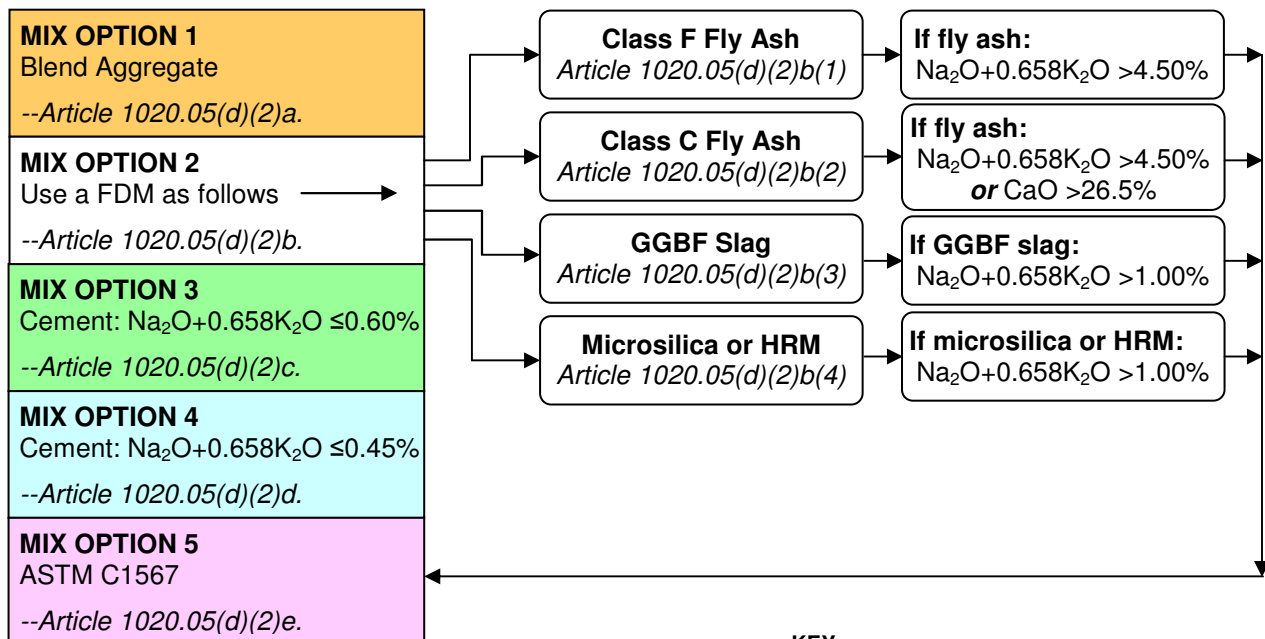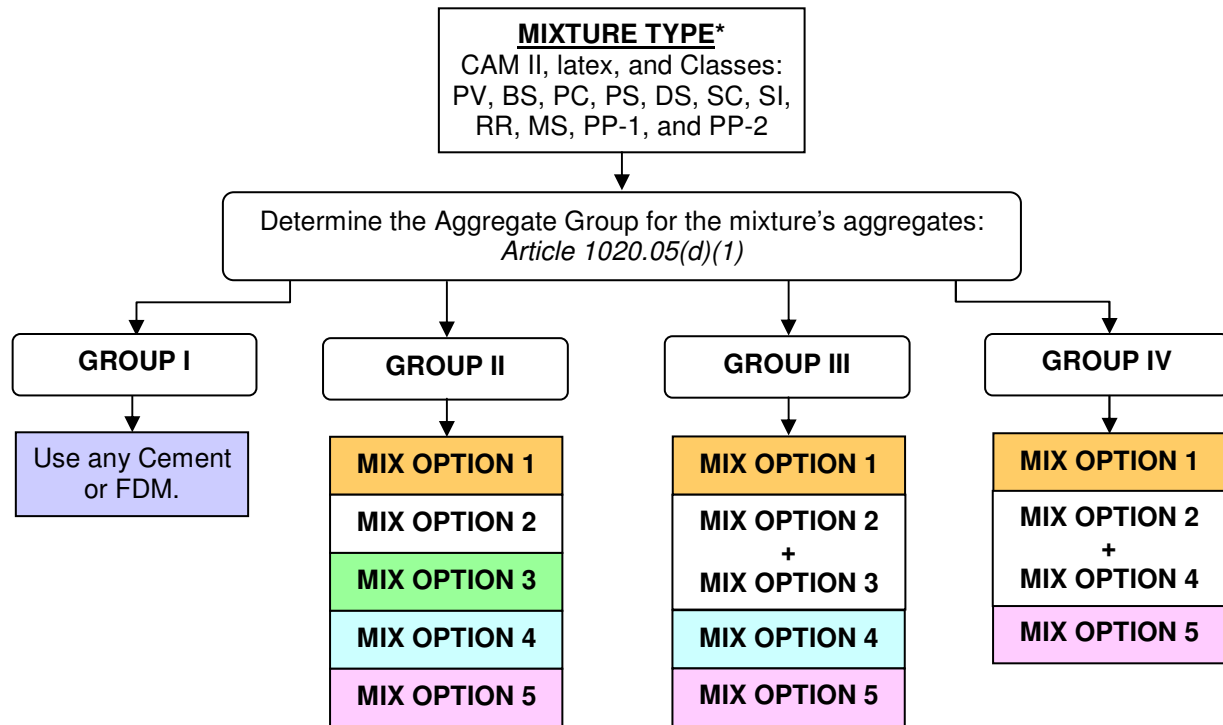

\* Not applicable: concrete revetment mat, insertion lining of pipe culvert, portland cement mortar fairing course, CLSM, miscellaneous grouts that are not prepackaged, and Classes PP-3, PP-4, PP-5.

**KEY**  
 CAM: Cement Aggregate Mixture (e.g., CAM II)  
 CLSM: Controlled Low Strength Material  
 FDM: Finely Divided Mineral  
 GGBF: Ground Granulated Blast Furnace (slag)  
 HRM: High Reactivity Metakaolin

This Page Reserved

# APPENDIX P

## BRIDGE DECK LATEX CONCRETE OVERLAY MIX DESIGN

Latex concrete shall be done according to the Guide Bridge Special Provision for Bridge Deck Latex Concrete Overlay, which provides approximate mix design criteria. The principle of volumetric mix design, designing in terms of a standard unit volume, still applies. Thus, it is important to note that the solids and nonsolids contained in the latex admixture may contribute significantly to the volume of the mix design. To account for the volumetric contribution made by the latex admixture, the absolute volumes of coarse aggregate and water can be reduced to accommodate the volumes of solids and nonsolids, respectively, of the latex admixture.

First, the mix design is calculated as though there is no latex admixture included; this will help ensure the intended 42 to 50 percent coarse aggregate content (by weight) is established. Then, the volume of solids in the latex admixture is calculated and subtracted from the volume of coarse aggregate. Similarly, the volume of nonsolids in the latex admixture is subtracted from the volume of water in the mix. Finally, the weights of all components can be re-calculated based on their specific gravities as usual.

For example, calculate the adjusted batch weights for a latex concrete mixture using a latex admixture with specific gravity 1.01 and percent solids 46%:

**Given:** Latex – 24.5 gal/cu yd  
Fine and Coarse Aggregate Specific Gravity – 2.65

|                  | Initial Batch<br>(without latex admixture) |                                     | Adjusted Batch<br>(with latex admixture) |                                     |
|------------------|--|-------------------------------------|--|-------------------------------------|
|                  | Absolute<br>Volume<br>(cu yd)              | Batch<br>Weight, SSD<br>(lbs/cu yd) | Absolute<br>Volume<br>(cu yd)            | Batch<br>Weight, SSD<br>(lbs/cu yd) |
| Fine Aggregate   | 0.346                                      | 1544                                | 0.346                                    | 1544                                |
| Coarse Aggregate | 0.339                                      | 1513                                | 0.284                                    | 1267                                |
| Cement           | 0.124                                      | 658                                 | 0.124                                    | 658                                 |
| Air (5%)         | 0.050                                      | 0                                   | 0.050                                    | 0                                   |
| Water            | 0.143                                      | 240                                 | 0.078                                    | 131                                 |
| Latex            | ---  | ---                                 | 0.120                                    | 204                                 |
| Total            | 1.00                                       |                                     | 1.00                                     |                                     |

### Adjustment Calculations:

Batch Weight of Latex Admixture =  $24.5 \text{ gal/cu yd} \times 8.33 \text{ lbs/gal} = 204 \text{ lbs/cu yd}$

Absolute Volume of Latex Admixture =  $204 \div (1.01 \times 1683.99) = 0.120 \text{ cu yd}$

Absolute Volume of Latex Solids =  $0.120 \times (46/100) = 0.055 \text{ cu yd}$

Absolute Volume of Latex Nonsolids =  $0.120 - 0.055 = 0.065 \text{ cu yd}$

Adjusted CA Absolute Volume =  $0.339 - 0.055 = 0.284 \text{ cu yd}$

Adjusted CA Batch Weight =  $0.284 \times 2.65 \times 1683.99 = 1267 \text{ lbs/cu yd}$

Adjusted Water Absolute Volume =  $0.143 - 0.065 = 0.078 \text{ cu yd}$

Adjusted Water Batch Weight =  $0.078 \times 1.00 \times 1683.99 = 131 \text{ lbs/cu yd}$

The Department's Excel PCC Mix Design program accounts for the latex admixture contribution in this way based on the following required design inputs:

- Batch Dosage: latex admixture dosage in terms of gallons per cubic yard (L/m<sup>3</sup>).
- Specific Gravity: manufacturer's specific gravity for the latex admixture.
- % Solids: manufacturer's percent solids for the latex admixture.

This Page Reserved

**PCC Level III  
PowerPoint  
Handout  
Main Presentation**

**2015-2016**





## CONCRETE MIX DESIGN CET 039



2016

1

## INSTRUCTORS

- Greg Rohlf
- Derek White
- Joe Pitlik



2

## LLC Enrollment Form and Photo i.d.

Lake Land College Intent to Enroll

Name: \_\_\_\_\_

Law First Middle \_\_\_\_\_

Address: \_\_\_\_\_  
Street address or PO Box \_\_\_\_\_

City State Zip Code County \_\_\_\_\_

Telephone Home \_\_\_\_\_

Telephone Cell \_\_\_\_\_

E-Mail \_\_\_\_\_

Social Security Number \_\_\_\_\_

Birthdate / / Gender \_\_\_\_\_

Last high school attended (attending) \_\_\_\_\_

School City State \_\_\_\_\_

Year graduated or expected to graduate \_\_\_\_\_

Your previous ID# \_\_\_\_\_

List ALL other institutions attended or now attending:

Name City State \_\_\_\_\_

Name City State \_\_\_\_\_

Are you in the United States as a Visa Nonimmigrant alien?  
 Yes in the United States as a Visa Nonimmigrant alien (country and # of days)  
 No in the United States as a Visa  
 No in the United States as a Visitor

Are you Hispanic or Latino (do not use of Spanish Origin)?  
 Yes Hispanic or Latino \_\_\_\_\_ Not Hispanic or Latino

Are you from one of the following racial groups? (Select ALL that apply)  
 American Indian or Alaska Native  
 Black  
 Black or African American  
 Native Hawaiian or Other Pacific Islander  
 White  
 Other race (do not respond)

Please identify your primary racial/ethnic group. (Select One)  
 American Indian or Alaska Native  
 Black or African American  
 Hispanic or Latino  
 White  
 Other race (do not respond)

Select highest degree earned:  
 Less than High School  
 High School Graduate  
 Associate  
 Bachelor  
 Master  
 Doctorate  
 Certificate  
 Unknown



Applicant Certification: I understand that withholding information reported on this application or giving false information may make me ineligible for admission to the College or subject to dismissal. With this in mind, I certify that the above information is true.



3

## Follow the PowerPoint Notes

Last tabbed divider Course Manual



4

## OBJECTIVES

- Be able to perform mix design per IDOT Mortar Factor method
- Identify and understand IDOT PCC specifications
- Improve understanding of how ingredient materials affect PCC mix design and performance
- Introduce IDOT mix design spreadsheet

5

## Administration

- Two Day Class
- Test – 2 ½ hours, open book
- You will be notified of results by mail
- Re-test by August 31
- 12 Professional Development Hours (PDH)

6

## COURSE MANUAL PREVIEW



7

## Table of Contents – Reference

- Course Evaluation Forms – **Please fill out before you leave.**
- Definitions
- Applicable Specifications
- Classes of Concrete
- Units of Measure
- Significant Digits and Rounding

8

## Table of Contents (Page vii) Main Content (Page 1 of 46)

- 1.0 Mix Design Overview
- 2.0 Mix Design
  - Walk thru specifications and design steps
  - Example problems
- 3.0 Specialty Mixes (2<sup>nd</sup> day)
- 4.0 Ternary Mix Designs
- 5.0 Mass Concrete
- 6.0 Trial Mix
- 7.0 Target Strength

9

## Table of Contents (more)

- 8.0 Durability Testing
  - 9.0 Verification – Trial Batch
- Appendices TOC (Page ix)**





### Last tabs

- Worksheets for Homework and Problems
- PowerPoint Handout


10

## Applicable Specifications

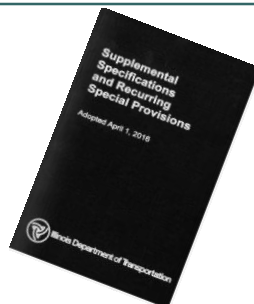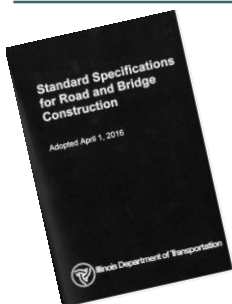

11

## Resources: [www.idot.illinois.gov](http://www.idot.illinois.gov)

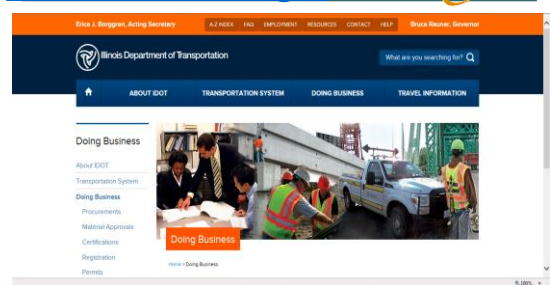

12

[www.idot.illinois.gov](http://www.idot.illinois.gov)  
**“Contractor Resources”**



- Standard Specifications for Road and Bridge Construction - Every 5 years
- Supplemental Specifications and Recurring Special Provisions - Annually
- BDE (Bureau of Design & Environment) Special Provisions – Per letting
  - Remember Errata
- GBSP – Guide Bridge Special Provisions

13

[www.idot.illinois.gov](http://www.idot.illinois.gov)  
**“Contractor Resources”**



14

[www.idot.illinois.gov](http://www.idot.illinois.gov)  
**“Material Approvals”**



15

[www.idot.illinois.gov](http://www.idot.illinois.gov)  
**“Material Approvals”**



- Cement
- Finely Divided Minerals (Fly ash, etc.)
- Admixtures
- Aggregate ASR and Freeze Thaw Rating
- Proprietary repair and specialty mixes

Updated weekly – Subscribe to Email Updates!

16

[www.idot.illinois.gov](http://www.idot.illinois.gov)  
**Search function**



17

**Hierarchy of Contract Documents (Article 105.05)**



1. Special Provisions:
  - Project-Specific
  - Inserted BDE/GBSP
2. Plans (Detail Plans over Hwy. Standards)
3. Recurring Special Provisions (Check Sheet)
4. Supplemental Specifications
5. Standard Specifications

18

## Hierarchy of Contract Documents Art. 105.05



Art. 105.06 Control of Work

| Hierarchy of the Contract Documents |            |   |
|-------------------------------------|------------|---|
| Special Provisions                  | Hold over: | Plans, Recurring Special Provisions, Supplemental Specifications, and Standard Specifications |
| Plans <sup>1, 2, 3</sup>            | Hold over: | Recurring Special Provisions, Supplemental Specifications, and Standard Specifications        |
| Recurring Special Provisions        | Hold over: | Supplemental Specifications, and Standard Specifications                                      |
| Supplemental Specifications         | Hold over: | Standard Specifications   |

- 1/ Detail plans hold over Highway Standards.
- 2/ Calculated dimensions hold over scaled dimensions.
- 3/ The Highway Standards indicated by the revision number listed in the Index of Highway Standards on the plans shall hold over Highway Standards listed anywhere else.

19

## GBSP Guide Bridge Special Provisions

Issued by the Bureau of Bridges and Structures  
Inserted into Project Manual

- Deck Slab Repair
- Bridge Deck Overlays - Microsilica, Latex, High-Reactivity Metakaolin, Fly Ash, GGBF Slag
- Concrete Wearing Surface
- Structural Repair of Concrete

20

## BDE Special Provisions (Bureau of Design and Environment)

- Dept. Mix Design BDE Special Provision 80277 (Appendix A)
- QC/QA BDE (4x8 cylinders allowed)
- Placing and Consolidating 80316 (Moved to Standard Specs, Article 503.07)

Inserted in Project Manual.  
Look for Updates on IDOT website  
Revised alternate lettings.

21

## Concrete Mix Design – Department Provided (BDE 80277) Appendix A

- Contractor has the option to request the Engineer determine mix design material proportions for all classes of concrete (except PS)
- A single mix design for each class of concrete will be provided.
- Contractor must still meet specification requirements.
- District Option to include in contracts

22

## Supplemental Specification for PCC

Supplemental Specification amends Section 1020 of Standard Specifications for Road & Bridge Construction (Except when Standard Specifications are newly issued)

- Rules for Fly Ash/GGBFS replacement & ternary mixes
- Alkali-Silica (ASR) mitigation (See Appendix O)
- Use of concrete admixtures
- Mix time, use of multiple plants, curing, temperature restrictions

23

## Recurring Special Provisions (Check Sheets)

Included in *Supplemental Specifications* book  
District option to include - Must be "checked" in project manual to apply.

- #23 Calcium Chloride Accelerator for PP-2
- #24 QC/QA for PCC at the plant
- #25 QC/QA Special Provision (QC Plan, required tests & frequencies, procedures)

24

## IDOT District QC/QA and Mix Design Status

**OUTDATED**


### SUBJECT TO CHANGE



- Districts 1, 2, 3, 4, 8 - QC/QA; Contractor Mix Design.
- District 6 - Moving from QC at Plant to QC/QA.
- Districts 5, 7, 9 - Not QC/QA, District will provide mix designs.

25

## DEFINITIONS and MATH REVIEW

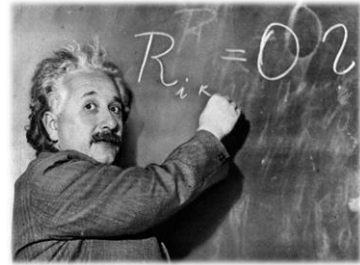

26

p. xviii

### Abbreviations

BDE.....Bureau of Design and Environment  
 FDM.....Finely Divided Mineral  
 GBSP.....Guide Bridge Special Provision  
 MF.....Mortar Factor  
 CWT.....Hundredweight  
 SSD.....Saturated Surface Dry  
 SG.....Specific Gravity  
 GGBFS...Ground Granulated Blast Furnace Slag  
 HRM.....High-Reactivity Metakaolin

27

### Abbreviations, continued

ASR.....Alkali Silica Reaction  
 FCA.....Fraction of Coarse Aggregate  
 FM.....Fineness Modulus  
 SCC.....Self Consolidating Concrete  
 CAM II....Cement Aggregate Mixture II  
 CLSM.....Controlled Low-Strength Material  
 VCA.....Voids in Coarse Aggregate  
 ITP.....IDOT Test Procedure  
 MISTIC...Materials Integrated System for Test Information and Communication

28

### Concrete Math


- Concrete is batched by weight, sold by volume (Level II)
- Designed by volume, batched by weight (Level III)



29

### Numerical Equivalents

Fraction **1/3**  
 = Decimal Fraction **0.333**  
 = Percentage **33.3%**

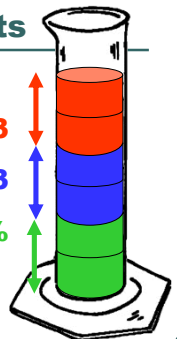

30

## IMPORTANT CONCEPT #1


### IDOT DESIGN VOLUME

The sum of volume of all ingredients is **ONE CUBIC YARD!**



1 Cubic Yard "box"

31

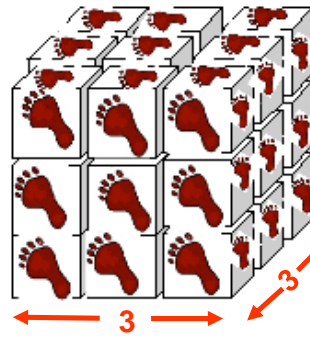

### Remember?

1 YD<sup>3</sup>

3 x 3 x 3  
= 27 FT<sup>3</sup>

32

## IDOT Design Volume = 1 Cubic Yard

- + Aggregate
- + Cement
- + Other cementitious materials (FDM's)
- + Water
- + Air
- + Admixtures



1 Cubic Yard

33

## Volume vs. Weight Typical PCC Mix

|              | <u>VOLUME</u> | <u>WEIGHT</u> |
|--------------|---------------|---------------|
| AIR          | 6%            | 0%            |
| WATER        | 13%           | 6%            |
| CEMENTITIOUS | 11%           | 14%           |
| AGGREGATE    | 70%           | 80%           |
|              | <u>100%</u>   | <u>100%</u>   |

34

## Unit Weight (Density): Requires 2 Measurements



Mass (or Weight)  
Volume

e.g.

Pounds  
Cubic Foot

35

## Volumetric Testing – Weight and Volume



Weigh it  
(mass)

Wet it  
(volume)



Volume of Displaced Water

36

### Unit Weight Formula 3 Configurations

examples

$$\text{Unit Wt.} = \frac{\text{Weight}}{\text{Volume}} \quad \text{PCF} = \frac{\text{Pounds}}{\text{Cu. Ft.}}$$

$$\text{Volume} = \frac{\text{Weight}}{\text{Unit Wt.}} \quad \text{Cu. Ft.} = \frac{\text{Pounds}}{\text{PCF}}$$

$$\text{Weight} = \text{Vol.} \times \text{Unit Wt.} \quad \text{Pounds} = \text{CF} \times \text{PCF}$$


37

### Unit Weight of Water

Unit Weight = 62.37 LB/FT<sup>3</sup>

$$62.37 \text{ LB/FT}^3 \times 27 \text{ FT}^3/\text{YD}^3 = 1,683.99 \text{ LB/YD}^3$$

**For this class**  
**= 1,684 LB/YD<sup>3</sup>**

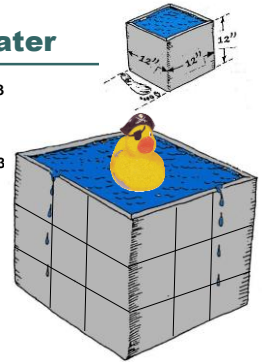

38

### Specific Gravity "The Other Unit Weight"



Unit weight relative to the unit weight of water:

$$\frac{\text{Weight of Material}}{\text{Wt. of Equal Vol. of Water}}$$


39

### Specific Gravity

Example:  
Unit Wt. = 1,000 pcf

$$\text{Specific Gravity} = \frac{1,000}{62.4} = 16$$

(SG has no "units")

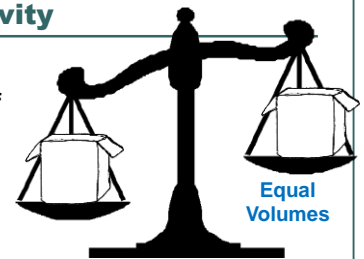


25 pounds  
Rocks SG = 2.5

10 pounds  
Water SG = 1

Equal Volumes

40

### Specific Gravity of Water



1,684 LB/YD<sup>3</sup>

$$\text{SG} = \frac{1,684 \text{ LB/YD}^3}{1,684 \text{ LB/YD}^3}$$



41

### Bulk vs. Solid



- Bulk includes air
- Solid means solid.



42

## Aggregate – Bulk and Solid

Bulk



Solid



43

## Specific Gravity of Solid Rock



4,500 LB

e.g.

Wt of 1 FT<sup>3</sup> solid rock  
= 4,500 LB/YD<sup>3</sup>

$$SG = \frac{4,500 \text{ LB/YD}^3}{1,684 \text{ LB/YD}^3} = 2.672$$

44

## Specific Gravity of Bulk Cement

94 Pound Sacks  
1 cubic foot each




$$\text{Unit Wt.} = \frac{\text{Weight}}{\text{Volume}} = \frac{94 \text{ LB}}{1 \text{ FT}^3} = 94 \text{ pcf}$$

$$\text{Bulk SG} = \frac{\text{Unit Wt}}{\text{Unit Wt Water}} = \frac{94 \text{ pcf}}{62.4 \text{ pcf}} = 1.52$$

45

## Specific Gravity of Solid Cement



5,305 LB/YD<sup>3</sup>


$$SG = \frac{5,305 \text{ LB/YD}^3}{1,684 \text{ LB/YD}^3}$$

= 3.15

Given for Type 1 Cement

46

## Cement Factor – History



Bagged cement  
94 LBS

e.g. “Six Bag Mix”  
= 94 X 6  
= 564 LB/YD<sup>3</sup>

IDOT PV spec = 5.65 cwt

47

## Cement Factor: Weight of Cement per Cubic Yard

Expressed as **cwt per cubic yard** or **cwt**

**cwt** = 100 pounds of cement

e.g. 5.65 cwt/yd<sup>3</sup>

or (shortcut) 5.65 cwt

x 100 to get “Cement Content” of mix

cwt x 100 = 565 LB/YD<sup>3</sup>.

48



## Important Concept #2



### Absolute Volume (2.1)

- The **solid** volume of each ingredient material in the design volume
- Percent expressed as a decimal fraction (**0.XXX**)
- Total = 1.000

49

## Absolute Volume example



$$\frac{22 \text{ FT}^3 \text{ Material}}{27 \text{ FT}^3 \text{ Box}} = 0.815$$

Absolute Volume

50

## Absolute Volume = Another way to express percent

| Typical PCC Mix | Percent | Absolute |
|-----------------|---------|----------|
| AIR             | 6.5%    | .065     |
| WATER           | 12.5%   | .125     |
| CEMENTITIOUS    | 11.0%   | .110     |
| AGGREGATE       | 70.0%   | .700     |
|                 | 100%    | 1.000    |

51

## Absolute volume concept works for any container

As long as you know the proportions of the contents.



52

## Absolute Volume of Liquid



- Container 40% Full
- Absolute Volume Liquid = 0.400
- Absolute Volume Air = 0.600

53

## Bulk candy absolute volume



Bulk Volume 50%  
Half is air.

54

### Solid candy absolute volume



**Absolute Volume Candy = 0.250 (25%)**

**Absolute Volume of Air = 0.750.**

55

### Particle size



56

### Absolute Volume Formula



**Weight of Material**  
**(s.g. of Material) x (Unit Wt. Of Water)**

**(Weight) LB**  
**(Specific Gravity) x 1,684 LB/YD<sup>3</sup>**

**= 0.XXX YD<sup>3</sup>**

57

### What is paste?

- + Cement
- + Finely Divided Minerals (Fly ash, GGBFS, etc.)
- + Water
- + Air



- Ø Fine Aggregate
- Ø Coarse Aggregate

58

### What is mortar?

- + Paste
- + Fine Aggregate

**Everything except coarse aggregate!**



59

### Finely Divided Minerals "FDMs"

#### "Cementitious Material"

- Fly Ash
- Ground Granulated Blast Furnace Slag
- Microsilica
- High-Reactivity Metakaolin

Used for cement replacement and mix enhancement

60

## Supplementary Cementitious Material

Another term for FDM

IDOT uses "FDM"



61

## "Consistency"



"Ability to flow"

Usually measured by the slump test

62

## "Workability"



Characteristic that describes ability to:

- Place
- Consolidate
- Finish

63

## "Initial and Final Set"

**INITIAL SET** – The point of time where the concrete begins to become firm. This will typically occur 2 to 4 hours after batching the concrete.

**FINAL SET** – The point of time where the concrete is no longer plastic and finishing no longer can take place. This will typically occur 5 to 8 hours after batching the concrete.

64

## Shrink Mix

- PCC is mixed in plant mixer before discharge into truck mixer
- Short mixing period in the plant reduces the bulk volume Typically, 1.3 yd<sup>3</sup> fully mixed PCC requires about 2.07 yd<sup>3</sup> of individual (ACPA)
- Thus, more PCC can be loaded into each truck mixer
- The amount of mixing should be determined via mixer uniformity tests

65

## Properties of Concrete Aggregates



- Nominal size
- Gradation
- Specific gravity
- Absorption
- Voids in coarse aggregate (VCA)

66

## PCC Aggregate Nomenclature

### Maximum Aggregate Size

1<sup>st</sup> sieve w/ 100% passing

### Nominal Maximum Aggregate Size

Next Sieve - 1<sup>st</sup> to retain any aggregate.



67

NMAS for PCC and HMA may not be the same.

## Nom Max Agg Size CA11

| Sieve | Spec % Pass | Blend |      |
|-------|-------------|-------|------|
|       |             | A     | B    |
| 1"    | 100%        | 100%  | 100% |
| 3/4"  | 84-100%     | 100%  | 89%  |
| 1/2"  | 30-60%      | 45%   | 30%  |

|     | Blend |      |
|-----|-------|------|
|     | A     | B    |
|     | HMA   | 3/4" |
| PCC | 1/2"  | 3/4" |

68

## Aggregate Specific Gravity

### 1. Oven Dry ( $G_a$ )

- Specific Gravity of Dry Aggregate
- Used to determine Voids in Coarse Aggregate (coming up later)

### 2. Saturated Surface Dry ( $G_{SSD}$ )


- Specific gravity, including absorbed and damp-surface water
- Used in PCC design and production

69

## Oven-Dry Bulk Specific Gravity

$$G_a =$$

$$\frac{\text{Mass (Dry Agg)}}{\text{Vol (Agg + Surf Voids)}}$$



Vol. of water-perm. voids


Surface Voids (empty)

70

## SSD Bulk Specific Gravity

$$G_{SSD} =$$

$$\frac{\text{Mass (Dry Agg + H}_2\text{O)}}{\text{Vol (Agg + Surf Voids)}}$$



Vol. of water-perm. voids

Surface Voids (filled)

71

## Aggregate Specific Gravity Calculations – 3 Measurements

### 3 Measurements

A = Oven Dried Wt.

B = SSD Weight

C = Submerged Wt.

### 3 Calculations

$$G_a = \frac{A}{B-C}$$

$$G_{SSD} = \frac{B}{B-C}$$

$$\text{Absorption} = \frac{B-A}{A}$$



72

## Water/Cement Ratio

W/C ratio =

All liquids, including water in admixtures  
All cement and cementitious materials

73

## Yield

Volume of concrete batch expressed  
in volume (FT<sup>3</sup>)

Sum of Batched Material Weight (LB)  
Unit Weight of Concrete Mix (LB/FT<sup>3</sup>)

74

p. xvii

## Significant Digits / Rounding

**Retain 0.XXX until end.**

### Whole Number

- Cement, Finely Divided Minerals (550 LB)  
(round up to next 5 LB)
- Coarse and Fine Aggregate (1,986 LB)

### One Digit to Right of Decimal

- Water, Air Content, Basic Water (5.3  
gal/cwt 44.1 lbs. 6.5%) >>>

75

## Significant Digits / Rounding

### Two Digits to Right of Decimal

- Specific Gravity, Unit Weight (2.68, 146.35  
pcf)
- Water/Cement Ratio, Mortar Factor, VCA  
(0.44, 0.80, 0.41)

### Three Digits to Right of Decimal:

- Absolute Volume (0.116)

76

## Concrete Materials

- Cement
- Finely Divided Minerals (FDM's)
- Aggregate
  - Fine
  - Coarse
- Admixtures
- Fibers
- Water



77

## Cement (2.2)



78

## Types of Cements

- Type I – Normal
- Type II – Sulfate Resistant
- Type III – High Early Strength
- Type IV – Low Heat
- Type V – High Sulfate Resistant
- Type IA – Air Entraining

79

## Blended Cements

- Type IP (Portland-Pozzolan)
- Type IS (Portland blast-furnace slag cement)
- Type IT – Ternary blended cement
  - e.g. Type IT(S25)(P15) contains 25% slag and 15% pozzolans (fly ash)
- Type IL (Limestone cement)

80

## Approved Cements

Illinois Department of Transportation  
Bureau of Materials and Physical Research  
APPROVED LIST OF QUALIFIED CEMENT PLANTS  
October 25, 2013

Page 1

This list supersedes the March 15, 2013 list.  
Standard Specifications for Road and Bridge Construction, Section 1001 (Adopted January 1, 2012)  
Current Policy Memorandum, "Portland Blended Cement Acceptance Procedure for Qualified and Non-Qualified Plants"

Material Code No.

Type I 37601, Type II 37603, Type III 37605, Type IP 37703, Type IS 37701, Type V 37608, Type II (MH) 37609

For information regarding new product submittals, click the "New Submittal" bookmark to the left.

| Producer     | Location            | Producer Number | Ty I | Ty II | Ty I / Ty II Alkalies | Ty III | Ty III Alkalies    | Other Types and their Alkalies               |
|--------------|---------------------|-----------------|------|-------|-----------------------|--------|--------------------|--|
|              |                     |                 |      |       | < 45   < 50   > 60    |        | < 45   < 50   > 60 | (Na <sub>2</sub> O + 0.658 K <sub>2</sub> O) |
| Buzzi Unicem | Greencastle, IN*    | 6097-02         | x    |       | x                     | x      |                    | x  |
|              | Cape Girardeau, MO* | 6097-03         | x    | x     | x                     |        |                    | Ty II (MH) s.60                              |

↑ Alkalies

81

## Finely Divided Minerals (2.4)

GROUND GRANULATED BLAST-FURNACE SLAG  
FLY ASH  
HIGH REACTIVITY METAKAOLIN (HRM)  
MICROSILICA

82

## Fly Ash

Coal plant by-product

- Increases workability
- Lowers heat of hydration
- Delays set
- Reduces permeability
- Decreases air content
- Lower early strength – Higher long term strength



83

## Fly Ash Classes

**Class C** / - from Lignite/Subbituminous (brown) coal – Cementitious and Pozzolanic properties

- More commonly used in IL
- Usually allowed

**Class F** – from Anthracite/Bituminous (black) coal - Pozzolanic properties

- Burned from harder, older coal
- More restrictions on use

84

Illinois Department of Transportation  
Bureau of Materials and Physical Research  
**APPROVED LIST OF SUPPLIERS FOR FINELY DIVIDED MINERALS**  
October 14, 2011

| Source  | Unit No. | Producer/<br>Supplier No. |
|---|----------|---------------------------|
| Alliant Power <sup>A</sup><br>Columbia Station<br>Portage, WI | 1, 2     | 52403-03                  |

| Class | Material<br>Code No. | R<br>Factor <sup>C</sup> | Average<br>Specific<br>Gravity |
|-------|----------------------|--------------------------|--------------------------------|
| C     | 37801                | 3.61                     | 2.68                           |

85

| Source   | Unit No. | Producer/<br>Supplier No. |
|--|----------|---------------------------|
| Alliant Utilities <sup>B</sup><br>Burlington Station<br>Burlington, IA | 1        | 52203-05                  |

*A/ ... the average calcium oxide (CaO) of the Class C fly ash from this source is  $\geq 18\%$  to  $< 26.5\%$ , and the loss on ignition (LOI) is less than 2.0%.*

*B/ ... the average calcium oxide (CaO) of the Class C fly ash from this source is  $\geq 26.5\%$ , and the loss on ignition (LOI) is less than 2.0%.*

86

### Fly Ash as Cement Replacement Supplemental Spec (Section 1020)

| Fly Ash | Concrete Class                             | Max. Cement Replacement by weight (mass) |
|---------|--|--|
| Class F | PV, BS, PC, PS, DS, SC, SI                 | 25 percent                               |
| Class C | PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, SI | 30 percent                               |

87

### Ground Granulated Blast Furnace Slag

- Increases workability
- Lowers heat of hydration
- Delays set
- Reduces permeability
- Lower early strength – Higher long term strength.

88

### GGBF Slag as Cement Replacement

|           | Concrete Class                                | Max. Cement Replacement by weight (mass) |
|-----------|---|--|
| GGBF Slag | PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC and SI | 35 percent                               |

89

### Microsilica (Silica Fume)

- Electric arc furnace by-product
- Reduces Permeability of Bridge Decks
  - Decreases air content
  - Reduces workability
    - Requires Super
  - Higher early and long term strength
  - Dense, Brittle

90

### High-Reactivity Metakaolin (HRM)

Processed by calcining (heating) purified kaolinite (a clay).

- Increases PCC strength, durability
- Reduces permeability, mitigates ASR
- Enhances workability and finishing
- Reduces shrinkage, due to "particle packing" making concrete denser
- Can be used in HPC and lightweight concrete
- Finer than cement, not as fine as microsilica

91

### Microsilica and HRM as Cement Replacement

|             | Concrete Class        | Max. Cement Replacement by weight |
|-------------|-----------------------|-----------------------------------|
| Microsilica | All *                 | 5.0 percent                       |
|             | * Class PP-3 concrete | Per Art. 1020.04                  |
| HRM         | All                   | 5.0 percent                       |

92

### TERNARY CONCRETE MIXTURES

A mix that includes Portland cement and two FDM's.



Chicago Wacker Drive

93

### Ternary concrete mixtures can be designed for:

- Higher strength
- Lowered permeability
- Corrosion resistance
- Sulfate resistance
- ASR mitigation
- Elimination/reduction of thermal cracking

94

### Use of FDMs in Ternary Mixes Supplemental Spec (Section 1020)

| Class PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, and SI |                            |
|--|----------------------------|
|  | Maximum Cement Replacement |
| Combined FDMs <sup>1/</sup>                          | 35% of total cementitious  |
| Class C Fly Ash                                      | 30%                        |
| Class F Fly Ash                                      | 25%                        |
| Class C + F Fly Ash                                  | 30%                        |
| GGBF Slag  | 35%                        |
| Microsilica or HRM                                   | 10% individual or combined |

<sup>1/</sup> FDM in Blended cements count toward 35% total.

95

### Ternary Mix Example

- Portland cement: 400#
- Fly ash: 100#
- GGBFS: 75#

96



### Ternary Mix Example

| Mix Design         | 3*        | 4*        |
|--------------------|-----------|-----------|
| Cement             | 445 (264) | 445 (264) |
| GGBF Slag***       | 90 (53)   | 90 (53)   |
| Microsilica Solids | 25 (15)   | --        |
| HRM                | --        | 27 (16)   |

97

### Options: IDOT Cement / FDM Selection

1. Straight cement, per Table 2.2.1
2. Use 1 FDM
3. Use Ternary Mix



**NOTE:** Mix Design must comply with ASR mitigation requirements (SS Section 1020).

98

### Fibers (Page 33)

- Req'd for whitetopping
- Optional for slipformed curb, paved ditch, etc. (per Special Provision)
- IDOT Approved List
- Not a mix design component
- Report in "comments" in mix design submittal



99

### Concrete Aggregate

- Quality – "A"
- Gradation
- Durability - Resistant to:
  - D-Cracking
  - Alkali-Silica Reaction



100

### PCC AGGREGATE DURABILITY



ASR



"D" Cracking

101

### D Cracking – "Destructive"

#### 3 Conditions:


1. Moisture
2. Susceptible Coarse Aggregate
3. Freeze-Thaw Cycling



102

## Bottom-up

## D Cracking

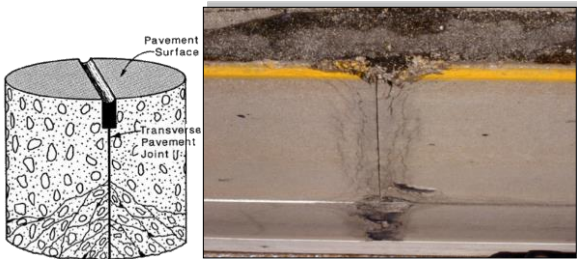

103

## Freeze-Thaw Rated Coarse Aggregate – On Grade

- Pavement
- Base course
- Base course widening
- Shoulders
- & repair
- Driveway
- Sidewalk
- Curb, Gutter,
- Combination curb and gutter
- Median
- Paved ditch

104

## “D” Cracking Mitigation

Use Coarse Aggregate per IDOT Freeze-Thaw Rating Approved list:

- 20-Year – All on-grade PCC
  - 30-Year – Extended Life Pavement\*
  - 40-Year – Extended Life Pavement\*
- \*via Special Provision

105

## Coarse Aggregate Quality


(b) Quality. The coarse aggregate shall be according to the quality standards listed in the following table.

| COARSE AGGREGATE QUALITY  |                   |                  |                    |                  |
|---|-------------------|------------------|--------------------|------------------|
| QUALITY TEST  | CLASS             |                  |                    |                  |
|   | A                 | B                | C                  | D                |
| Na <sub>2</sub> SO <sub>4</sub> Soundness 5 Cycle, Illinois Modified AASHTO T 104 <sup>1/</sup> , % Loss max. | 15                | 15               | 20                 | 25 <sup>2/</sup> |
| Los Angeles Abrasion, Illinois Modified AASHTO T 96, % Loss max.  | 40 <sup>3/</sup>  | 40 <sup>4/</sup> | 40 <sup>5/</sup>   | 45               |
| Minus No. 200 (75 µm) Sieve Material, Illinois Modified AASHTO T 11   | 1.0 <sup>6/</sup> | ---              | 2.5 <sup>7/</sup>  | ---              |
| Deleterious Materials <sup>10/</sup>  |                   |                  |                    |                  |
| Shale, % max.   | 1.0               | 2.0              | 4.0 <sup>8/</sup>  | ---              |
| Clay Lumps, % max.  | 0.25              | 0.5              | 0.5 <sup>8/</sup>  | ---              |
| Coal & Lignite, % max.  | 0.25              | ---              | ---                | ---              |
| Soft & Unsound Fragments, % max.  | 4.0               | 6.0              | 8.0 <sup>8/</sup>  | ---              |
| Other Deleterious, % max.   | 4.0 <sup>8/</sup> | 2.0              | 2.0 <sup>8/</sup>  | ---              |
| Total Deleterious, % max.   | 5.0               | 6.0              | 10.0 <sup>8/</sup> | ---              |

<sup>1/</sup> Does not apply to crushed concrete.


106

## Alkali-Silica Reaction

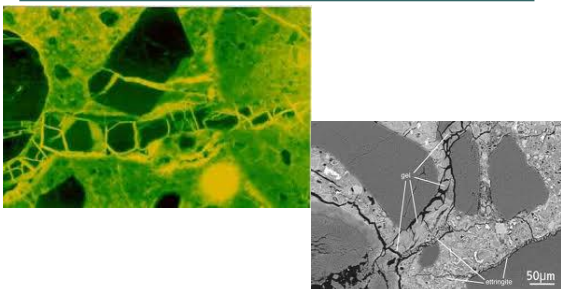

107

## Alkali Silica Reaction



- Reaction of alkalis in cement with siliceous material in some aggregate
- Requires water
- Gel forms – expands and cracks concrete
- Affects strength, stiffness, serviceability, safety, and stability
- Difficult to recognize, identify and monitor
- Not universal or completely predictable

108

### Alkali-Silica Reaction

- First discovered by Thomas Stanton in 1930's
- Cases documented in 1950's
- 1957 – 1<sup>st</sup> case in Canada reported



109

### Alkali-Silica Reaction



110

### Alkali-Silica Reaction Mitigation (SS Section 1020/Appendix O)


Applies to all projects

- Department tests coarse and fine aggregates for "Aggregate Expansion Value" ASTM C 1260, ASTM C 1293
- Ranges posted on IDOT web page
- Fine aggregate: Limestone and Dolomite = 0.03
- Coarse aggregate: Limestone and Dolomite = 0.05
- Combined values determines "Group"
- ~~May~~ Will shape material selection

111

### ASR Mitigation (Supplemental Specs Section 1020)

1. Identify Aggregate Groups
2. Evaluate Mitigation Options
3. Apply Options

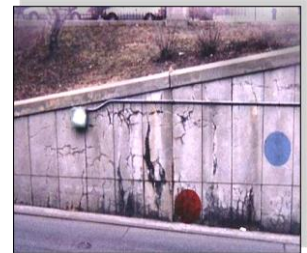

112

### IDOT ASR Rating List Gives Ranges

Illinois Department of Transportation  
Bureau of Materials and Physical Research  
ALKALI-SILICA POTENTIAL REACTIVITY RATING LIST  
October 11, 2013

This list supersedes the August 9, 2013 list. Note: Changes are not high-lighted on this list.

| P/S No.  | Ledge Description | Material Code | ASR Rating* |
|----------|-------------------|---------------|-------------|
| 52600-07 | ABOVE WATER       | 027FA02       | B           |

A = < 0.16    B = 0.17 - 0.27    C = > 0.28

Contact individual sources for ASR Expansion Value

113

### ASR Rating List

Illinois Department of Transportation  
Bureau of Materials and Physical Research  
ALKALI-SILICA POTENTIAL REACTIVITY RATING LIST  
May 22, 2015

Page 18 of 23

This list supersedes the April 10, 2015 list. Note: Changes are not high-lighted on this list.

The following values are based on Illinois Modified ASTM C 1260 test results.

\*Please Note: Each coarse aggregate limestone or dolomite shall have an assigned expansion value of 0.05% and each fine aggregate limestone or dolomite (manufactured stone sand) shall have an assigned expansion value of 0.03%, unless otherwise noted below.

| Dist. | Producer Name       | Location       | P/S No.  | Ledge Description             | Material Code | ASR Rating* | Testing <sup>†</sup> Frequency | Number of Tests | Number C 1293 Test** |
|-------|---------------------|----------------|----------|-------------------------------|---------------|-------------|--------------------------------|-----------------|----------------------|
| 94    | RIVERSIDE MATERIALS | CHILLOCOHE, IL | 51430-09 | BELOW WATER - ROUNDED         | 027FA01       | B           | 3                              | 3               |                      |
| 94    | SAND HILL MATERIALS | ELLISVILLE, IL | 59570-10 | ABOVE & BELOW WATER - ROUNDED | 027FA01       | B           | 2                              | 5               |                      |
| 94    | SPOON RIVER S & G   | SEVILLE, IL    | 50570-07 | ABOVE WATER - ROUNDED         | 027FA01       | B           | 1                              | 2               |                      |
| 94    | DEPAUL DOLCE & C.   | SEDUCI, IL     | 60670-07 | ABOVE & BELOW WATER - ROUNDED | 027FA01       | D           | 4                              | 1               |                      |


114

### ASR Evaluate Mitigation Options

1. Blend Aggregates to improve "group"
2. Mitigate with FDM's
3. Use low alkali cement ( $\leq 0.60\%$ )
4. Use Lower alkali cement ( $\leq 0.45\%$ )
5. Verify mitigation: Test highest expansive aggregate with ASTM C 1567

115

### ASTM C 1260 / 16 Day Test

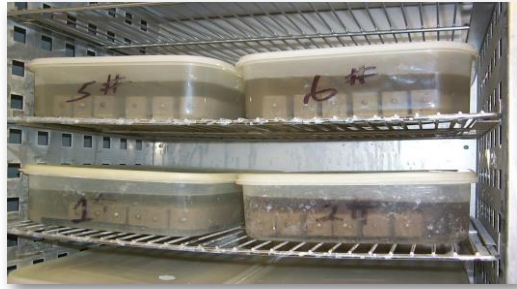

116

### ASTM C 1293 / 1 Year Test



117

### ASR Identify Aggregate Groups

| COARSE AGGREGATE or Blend<br>ASTM C 1260 Expansion | Fine Aggregate Or Fine Aggregate Blend<br>ASTM C 1260 Expansion |                    |           |
|--|---|--------------------|-----------|
|  | $\leq 0.16\%$   | $>0.16\% - 0.27\%$ | $>0.27\%$ |
| $\leq 0.16\%$                                      | Group I   | Group II           | Group III |
| $>0.16\% - 0.27\%$                                 | Group II  | Group II           | Group III |
| $>0.27\%$  | Group III   | Group III          | Group IV  |

118

### ASR Valid Options (X)

| AGG GROUP | Mitigation Option                         |                                |                |                        |   |
|-----------|---|--------------------------------|----------------|------------------------|---|
|           | 1   | 2                              | 3              | 4                      | 5 |
| I         | Use any cement or finely divided mineral. |                                |                |                        |   |
| II        | X   | X                              | X              | X                      | X |
| III       | X   | Combine Option 2 plus Option 3 |                | X                      | X |
| IV        | X   | Option 2 plus Option 4         | Invalid Option | Option 2 plus Option 4 | X |

119

### ASR Option 1 Blend Aggregates

$$\text{Weighted Expansion Value} = (a/100 \times A) + (b/100 \times B) + (c/100 \times C) + \dots$$

Where:

a, b, c... = percentage of aggregate in the blend;  
A, B, C... = expansion value for that aggregate

Look at CA and FA separately.

120


### ASR Expansion Value Blending

| Gradation       | CA 07 | CA 16 | Total |
|-----------------|-------|-------|-------|
| % total mix     | 45%   | 15%   | 60%   |
| (a) % of CA     | 75%   | 25%   | 100%  |
| (A) Exp Value   | 0.05  | 0.19  |       |
| (a/100) x (A) = | 0.04  | 0.05  | 0.09  |



121

### ASR Option 2 Mitigate with FDM



122

### Mitigation with Class F Fly Ash

|                 | CAM II, Class PV, BS, PC, PS, MS, DS, SC, SI |
|-----------------|--|
| Class F Fly Ash | Replace 25% Cement                           |

Class F Fly Ash maximum total equivalent available alkali content ( $\text{Na}_2\text{O} + 0.658\text{K}_2\text{O}$ )  $\leq 4.50\%$

123

### Mitigation with Class C Fly Ash Low Alkali

|                 | CAM II, Class PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, SI |
|-----------------|--|
| Class C Fly Ash | Replace 25% Cement                                       |

Class Fly Ash maximum total equivalent available alkali content ( $\text{Na}_2\text{O} + 0.658\text{K}_2\text{O}$ )  $\leq 4.50\%$  and the calcium oxide  $\leq 26.50\%$ .

124

### Mitigation with GGBF Slag

|           | PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, and SI |
|-----------|--|
| GGBF Slag | Replace 25% Cement                             |

GGBF Class F Fly Ash maximum total equivalent available alkali content ( $\text{Na}_2\text{O} + 0.658\text{K}_2\text{O}$ )  $\leq 1.00\%$

125

### Mitigation with Microsilica or High Reactivity Metakaolin

|   | All Concrete Classes |
|---|----------------------|
| Microsilica or High Reactivity Metakaolin | Replace 5% Cement    |

Maximum total equivalent available alkali content ( $\text{Na}_2\text{O} + 0.658\text{K}_2\text{O}$ )  $\leq 1.00\%$

126

### ASR Option 3 and 4 FDM + Low Alkali Cement

The cement used shall have a maximum total equivalent alkali content of

Option 3: 0.60%

Option 4: 0.45%

FDM alkali content per Option 2.

127

### ASR Option 5 Test the Combination of Materials

The proposed cement or FDM may be used if the ASTM C 1567 expansion value is  $\leq 0.16$  percent when performed on the aggregate in the concrete mixture with the highest ASTM C 1260 test result.

128

### ASR - Don't ignore this!

• Know your material:

- Aggregate - Expansion values
- Cement - Alkali %
- FDM - Alkali %



129


### Concrete Admixtures (2.5.3 - Pg. 12)



130

### Admixtures - Function

- Reduce cost
- Modify concrete properties
- Maintain quality during mixing, transporting, placing, and curing
- Mitigate some production emergencies



131

### Major Admixture Types

- Air-entraining
- Water-reducing
- High range water-reducing (superplasticizers)
- Retarding
- Accelerating

132

### Specialty Admixtures

- Corrosion Inhibitor
- Shrinkage Reduction
- Workability Enhancement
- Bonding
- Damp Proofing
- Coloring

133

### 2.5.3 Required/Optional Use of Admixtures (Section 1020.05)

- Air-Entraining
- Retarding
- Water-Reducing
- Superplasticizer
- Accelerating
- Latex
- Corrosion inhibiting

134

### Admixture Approval and Use

- Admixtures approved based on manufacturer's certified tests
- The admixture technical representative shall be consulted when determining an admixture dosage from this list
- The dosage shall be within the range indicated on the approved list (unless other circumstances warrant otherwise)

135

### Approved Admixture List

Illinois Department of Transportation  
 Bureau of Materials and Physical Research  
**APPROVED LIST OF CONCRETE ADMIXTURES**  
 October 4, 2013  
This list supersedes the July 12, 2013 list.  
 Standard Specifications for Road and Bridge Construction, Section 1021 (Adopted January 1, 2012)

**AIR ENTRAINING ADMIXTURES**  
 TYPE A: WATER REDUCING ADMIXTURES  
 TYPE B: RETARDING ADMIXTURES  
 TYPE C: ACCELERATING ADMIXTURES  
 TYPE D: WATER REDUCING AND RETARDING ADMIXTURES  
 TYPE E: WATER REDUCING AND ACCELERATING ADMIXTURES  
 TYPE F: HIGH RANGE WR ADMIXTURES (SUPERPLASTICIZERS)  
 TYPE G: HIGH RANGE WR & RETARDING ADMIXTURES (SUPER)  
 TYPE F: ONE COMPONENT SELF-CONSOLIDATING (FOR SCC)  
 TYPE S: RHEOLOGY-CONTROLLING ADMIXTURE

136

### DOSAGE RATE – (Approved List)

#### AIR ENTRAINING ADMIXTURES

| Producer / Supplier Number | Brand Name        | Admixture Dosage Range Based on Cementitious mL/100 kg (oz/cwt.) ** |
|----------------------------|-------------------|---|
| 4695-01                    | Catexol AE 260    | 6.5-391 (0.1-6)   |
| 4695-01                    | Catexol AE 360    | 32.6-391.2 (0.5-6.0)  |
| 4179-04                    | MB AE 90          | 16.3-260.8 (0.25-4.0)   |
| 4179-04                    | MBVR Concentrate* | 16.3-260.8 (0.25-4.0)   |
| 4179-04                    | MBVR Standard *   | 16.3-260.8 (0.25-4.0)   |

137

### Air Entrainment

All PCC shall contain entrained air

- Except SC, Seal coat (optional) and Latex-Modified

138

### Cement Reduction with Water-Reducing Admixtures

For class PV, PP-1, RR, SC, SI concrete:  
Cement factor may be reduced by a maximum of 0.30 cwt (except under water)

PCC III Manual, Pg. 3

**(This is Step 1 in Mix Design)**

139

### Class BS Concrete Admixtures

Class BS and bridge deck overlays

1. Retarder at  $\geq 65^{\circ}\text{F}$  (air or concrete)
2. Water-reducer (Optional)

140

### Accelerating Admixtures

- Non-chloride accelerator required for PP-2, PP-3, and PP-5
- Optional for PP-1 or RR concrete.
- PP-1, PP-2, RR – calcium nitrite when air  $<55^{\circ}\text{F}$
- PP-3 - calcium nitrite only.
- Calcium chloride allowed only by special provision in the contract; normally for PP-2.

141

### Water Content of Admixtures

When determining water in admixtures for water/cement ratio, the Contractor shall calculate **70 percent** of the admixture dosage as water, except a value of **50 percent** shall be used for a **latex** admixture used in bridge deck latex concrete overlays. (Section 1020.05)

**See: Appendix P – Check with manufacturer**

142

### Materials Economics



143

### Typical Unit Costs

|                 |                     |
|-----------------|---------------------|
| Type I Cement   | \$ 85-100 / Ton     |
| Type III Cement | \$ 95-120 / Ton     |
| C Fly Ash:      | \$ 65-85 / Ton      |
| GGBF Slag       | \$ 75-85 / Ton      |
| Microsilica     | \$ 0.50-0.60 per lb |
| CA:             | \$ 15 / Ton         |
| FA:             | \$ 12 / Ton         |

144




### FDM Replacement Calculation

|                                     | \$/T | \$/lb     | lb/cy | \$/cy   |
|-------------------------------------|------|-----------|-------|---------|
| 100% Cement                         | \$90 | \$0.045 x | 575 = | \$25.88 |
| <b>30% Fly Ash Ty C Replacement</b> |      |           |       |         |
| 70% Cement                          | \$90 | \$0.045 x | 405 = | \$18.23 |
| 30% Fly Ash                         | \$75 | \$0.038 x | 175 = | \$6.65  |
|                                     |      |           | 580   | \$24.88 |

(\$/lb = \$/T ÷ 2000 lb/T)

145

### Voids in Coarse Aggregate VCA




Percent Voids in a compacted sample of Coarse Aggregate. Expressed as a decimal (0.XX) Determined via test

146


### Voids in Coarse Aggregate

- VCA is an AGGREGATE PROPERTY!
- Same for all users of same aggregate
- District Option to provide VCA for design



147

### Voids in Coarse Aggregate

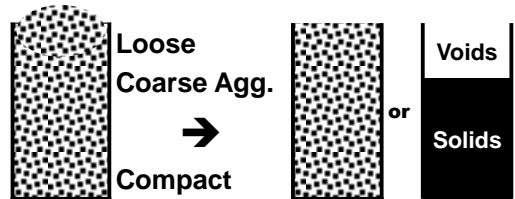

$$VCA = \text{Vol. Voids} / \text{Vol. Bucket}$$

148

### Voids in Coarse Aggregate

- AASHTO T 19
- ASTM C 29
- ITP 306 (Appendix C)



149

### 1<sup>st</sup> - Check your gradations!!!



150

## Procedure

**STEP 1:  
START WITH  
ONE BUCKET  
OF ROCKS**



151

## Equipment Needed

- Bucket ( $\frac{1}{2}$  ft<sup>3</sup> min.)
- Scale
- $\frac{1}{2}$ " Thick Glass Plate
- Thermometer
- Tamping Rod
- Scoop
- Rubber Syringe.



152

## 4 Measurements Needed


Weigh and Record:

1. Bucket
2. Bucket + Glass Plate
3. Bucket + Glass + Water
4. Bucket + Coarse Aggregate.

153

## Take Water Temperature

- Unit weight of water is dependent on temperature.
- Use chart Appendix C.

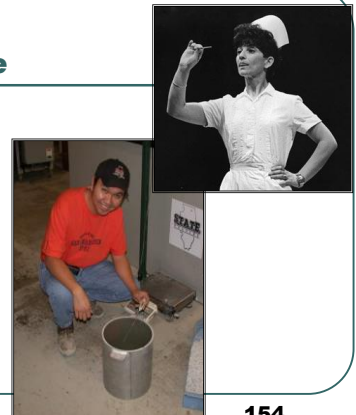

154

## Weigh Bucket + Water + Glass



155

## Dry Aggregate to Constant Weight




156

### Fill 1/3 with Aggregate



157

### Level and Rod 25 Times

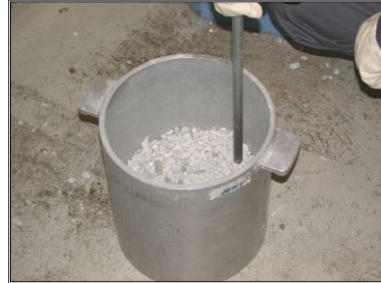

158

### Repeat 3 Layers - Bucket Should be Overflowing



159

### Strike Off, Level Surface



160

### Weigh Bucket and Coarse Aggregate



161

### Repeat

- Perform test twice
- Results should be within 0.01

162

### Calibration of Measure (Bucket)

$$V \text{ (Volume of Measure)} = \frac{M \text{ (Mass Water)}}{W \text{ (Water Unit WT)}}$$

$$V = (X.XXX \text{ FT}^3)$$

M = Mass (Wt.) of water to fill (X.XXX LB)

W = Unit weight of water- (X.XXX LB/FT<sup>3</sup>).

163

### Bucket Calibration

|                                  |             |
|----------------------------------|-------------|
| Weight of Bucket + Glass + Water | 48.763 LB   |
| (-) Weight of Bucket + Glass     | - 17.613 LB |
| = Weight of Water                | 31.150 LB   |

$$\text{Volume of Bucket} = \frac{\text{Weight of water}}{\text{Unit wt. of water}} = \frac{31.150}{62.301} = 0.500 \text{ FT}^3$$

164

### Calculate Voids in Coarse Aggregate

#### Three Calculations

- 1) Coarse aggregate bulk unit weight
- 2) Conversion between  $G_a$  and  $G_{SSD}$
- 3) Voids in coarse aggregate

165

### Coarse Aggregate Bulk Unit Weight

|                            |           |
|----------------------------|-----------|
| Weight of Full Bucket      | 68.200 LB |
| (-) Weight of Empty Bucket | - 15.550  |
| Weight of Bulk Aggregate   | 52.650 LB |

|                          |                       |
|--------------------------|-----------------------|
| Weight of Bulk Aggregate | 52.650 LB             |
| Volume of Bucket         | 0.500 FT <sup>3</sup> |

$$= 105.3 \text{ LB/FT}^3$$

166

### Oven Dry Specific Gravity ( $G_a$ )

A = Oven Dry Wt.

B = SSD Weight

C = Submerged Wt.



$$G_a = \frac{A}{B - C}$$

$$G_{SSD} = \frac{B}{B - C}$$

$$\text{Absorption} = \frac{B - A}{A}$$

167

### Oven Dry to SSD Conversion

$$G_a = \frac{G_{SSD}}{1 + \frac{\text{Abs.}}{100}} = \frac{2.66}{1 + \frac{2.0}{100}} = 2.61$$

168

## Specific Gravity – IDOT website

Illinois Department of Transportation  
 Bureau of Materials and Physical Research  
**Specific Gravity (G<sub>s</sub>) List**  
 December 20, 2013

This list supersedes the December 6, 2013 list. Note: Changes are not high-lighted on this list.  
 Standard Specifications for Road and Bridge Construction, Articles 1023 and 1030 (Adopted January 1, 2012)

| Dist | Producer Name | Location      | PIS No.  | Material | Remarks                     | HMA Use |      | Absorp. |
|------|---------------|---------------|----------|----------|-----------------------------|---------|------|---------|
|      |               |               |          |          |                             | Bulk    | SSD  |         |
| 91   | PAYNE & DOLAN | EAST TROY, WI | 52489-58 | 03IFM01  | ABOVE WATER, CRUSHED GRAVEL | 2.897   | 2.72 | 0.7     |
| 91   | PAYNE & DOLAN | FOX LAKE, IL  | 51119-58 | 020CM18  | ABOVE WATER, ROUNDED GRAVEL | 2.623   | 2.66 | 2.1     |
| 91   | PAYNE & DOLAN | FOX LAKE, IL  | 51119-58 | 021CM101 | ABOVE WATER, CRUSHED GRAVEL | 2.695   | 2.73 | 1.4     |
| 91   | PAYNE & DOLAN | FOX LAKE, IL  | 51119-58 | 021CM101 | ABOVE WATER, CRUSHED GRAVEL | 2.688   | 2.73 | 1.6     |
| 91   | PAYNE & DOLAN | FOX LAKE, IL  | 51119-58 | 021FM02  | ABOVE WATER                 | 2.629   | 2.66 | 1.3     |
| 91   | PAYNE & DOLAN | FOX LAKE, IL  | 51119-58 | 03IFM03  | ABOVE WATER                 | 2.676   | 2.71 | 1.5     |
| 91   | PAYNE & DOLAN | RACINE, WI    | 52482-01 | 03IFM03  | ALL LEDGES                  | 2.857   | 2.70 | 1.8     |
| 91   | PAYNE & DOLAN | RACINE, WI    | 52482-01 | 032CM16  | ALL LEDGES                  | 2.896   | 2.74 | 1.7     |
| 91   | PAYNE & DOLAN | RACINE, WI    | 52482-01 | 042CM11  | ALL LEDGES                  | 2.713   | 2.75 | 1.3     |

169

## Voids in Coarse Aggregate

$$V_{CA} = \frac{(G_a \times 62.37) - \text{Bulk Unit Weight}}{G_a \times 62.37}$$

0.370

or  $\frac{\text{Solid Unit Wt.} - \text{Bulk Unit Weight}}{\text{Solid Unit Weight}}$

0.630

e.g.  $\frac{(2.68 \times 62.37) - 105.3}{(2.68 \times 62.37)}$

= 0.37

170

## Coarse Aggregate Voids Affected by:

- Crushing
- Shape
- Gradation
- Texture



171

## CA Voids – Typical Values

- Crushed: 0.39 – 0.45
- Uncrushed: 0.36 - 0.41
- Rodding consolidates 4 to 8%
- NMAS is not a big factor
- Similar for CM-07, -11, -13, -16

District may provide CA voids 2.8.1 (p. 17)

172

## Run Test Carefully

Change of ± 0.02 in coarse aggregate voids requires new mix design

173

## Fraction Coarse Aggregate (F<sub>CA</sub>)

$$F_{CA} + V_{CA} = 1.000$$

$$V_{CA} = 0.37$$

$$F_{CA} = 1.00 - 0.37 = 0.63$$

0.37 ← V<sub>CA</sub>

0.63 ← F<sub>CA</sub>



174

## Summary Voids in Coarse Aggregate

### Department provides:

1. Absorption
2.  $G_A$  &  $G_{SSD}$  (Specific gravities)

### Mix Designer Calculates:

1. Bulk Unit Weight
2. Coarse Aggregate Voids

175

## Mortar Factor



**IDOT** specification to assure minimum mortar for:

- Workability
- Durability
- Finished Surface

**Method unique to IDOT**

176

## Mortar Factor Defined



“Volume of mortar per volume of dry rodded coarse aggregate”

177

## Mortar Factor Defined




Or,  
“Mortar added to VCA bucket of Coarse Aggregate”

Bucket volume = 1.00


178

## Mortar Factor Illustrated

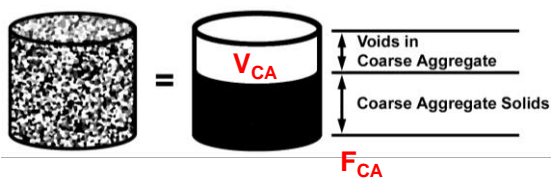

179

## Mortar Factor Illustrated

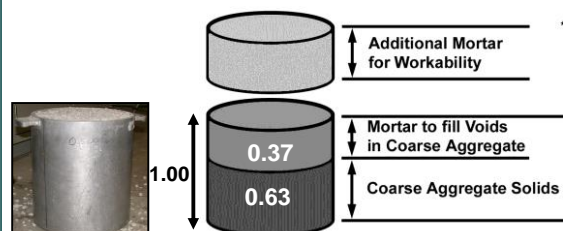

180

### Mortar Factor Illustrated



$$\frac{A \text{ (Volume Mortar)}}{B \text{ (Volume Bucket - 1.00)}}$$

“Volume of mortar per volume of dry-rodded coarse aggregate”

181

### Mortar Factor Illustrated



1 - Bucket of Rodded Aggregate

182

### Mortar Factor Illustrated



2 - Fill the Coarse Aggregate Voids with Mortar

183


### Mortar Factor Illustrated



3 - Add “Workability” Mortar

184

### Mortar Factor ( $M_o$ ) Back-Calculated for Illustration, only



$$M_o = A/B = \text{Mortar}/1.00$$


$$= \frac{0.37 + \text{Workability Mortar}}{1.00}$$

$$= \frac{0.37 + 0.46}{1.00}$$

$$= 0.83$$

185

### Mortar Factor is a Design Criteria



| Class of Concrete   | Coarse Agg. Gradation                     | Mortar Factor Range        |
|---------------------|---|----------------------------|
| BS <sup>2,3,7</sup> | CA 7,11, or 14                            | 0.70 - 0.86 <sup>5,6</sup> |
| PV                  | CA 5 & 7;<br>CA 5 & 11;<br>CA 7,11, or 14 | 0.70 - 0.90 <sup>5</sup>   |

Not in Spec Book

186


**Table 2.8.2.2  
Typical Mortar Factor Values**

| CLASS     | Spec       | Typical                        |
|-----------|------------|--------------------------------|
| BS        | 0.70-0.86* | 0.83                           |
| PV        | 0.70-0.90  | 0.86 Formed<br>0.88 Slipformed |
| PP (CA11) | 0.70-0.93  | 0.83                           |
| PP (CA13) | 0.79-0.99  | 0.90                           |
| SI        | 0.70-0.90  | 0.85-0.90                      |

\* except for structural lightweight

187


**Mortar Factor vs. Percent Mortar**



- **Mortar Factor** is a design criteria (Specification)
- **Percent Mortar (or Mortar Fraction)** is a volumetric property

188


**Percent Mortar**



$$\frac{A \text{ (Volume Mortar)}}{C \text{ (Total Volume)}}$$

189

**Mortar Factor vs. Percent Mortar**

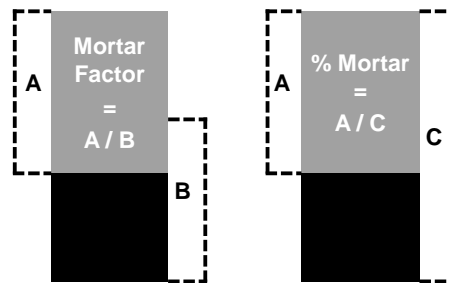

190

**Volume Fraction of Mortar (p. 21)**

$$\text{Mortar Fraction} = \frac{M_O}{M_O + F_{CA}} \quad \begin{matrix} M_O = \text{Mortar Factor} \\ F_{CA} = \text{CA Solids} \end{matrix}$$

Given:  
 $M_O = 0.83$   
 $V_{CA} = 0.37$

$$F_{CA} = 1 - V_{CA} = 1.00 - 0.37 = 0.63$$



$$\text{Mortar} = \frac{0.83}{0.83 + 0.63} = 0.568$$

191

**Volume Fraction (Percent) Coarse Aggregate**



$$\frac{\begin{matrix} + \text{Mortar Fraction} \\ + \text{Coarse Aggregate Fraction} \end{matrix}}{= 100\% \text{ Total Volume}}$$

$$\begin{matrix} 1.000 \text{ Total Volume} \\ - 0.568 \text{ Mortar Fraction} \\ = 0.432 \text{ Coarse Aggregate.} \end{matrix}$$

192



## Workability

Appendix D



Characteristic that describes ability to:

- Place
- Consolidate
- Finish.

193


## Workability

Appendix D

### Lubrication of Mortar Layer

#### FACTORS

- Thickness of Mortar
- Volume of Mortar
- Viscosity of Mortar



194

## Viscosity of Mortar

Appendix D


#### Factors:

- H<sub>2</sub>O Content
- Air
- Aggregate NMAS
- Aggregate Gradation
- Aggregate Shape and Texture
- Cementitious fineness
- Etc.



195


## Workability - Wall Effect

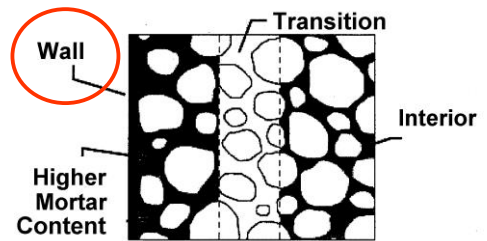

Walls, Pipes, Forms

196

## Wall Effect - Surface Area

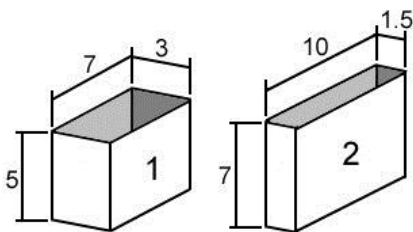


$$\text{Volume}_1 = \text{Volume}_2$$

$$\text{Wall Surface Area}_1 < \text{Wall Surface Area}_2$$

197

## Wall Effect - Volume

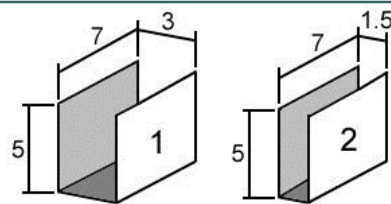

$$\text{Volume}_1 > \text{Volume}_2$$

$$\text{Wall Surface Area}_1 = \text{Wall Surface Area}_2$$

198

## Placement Method Affects Mortar Factor

|                |      |
|----------------|------|
| Paving Machine | 0.83 |
| Chute          | 0.85 |
| 5 inch pump    | 0.86 |
| 4 inch pump    | 0.90 |

199

## MIX DESIGN



200

PAGE 1

## 1.0 VOLUMETRIC MIX DESIGN

- IDOT Mortar Factor method
- Volumetric method more accurate than design by weight.
- Based on:
  - Decades of IDOT experience
  - Established material properties

201

## Mix Design Steps

1. PCC III Manual and course
2. "PCC Mix Design" EXCEL spreadsheet
3. Mix design on paper, calculations
4. Trial mix, submittals
5. Verification, Trial batch

202

## Mix Design and Submittals



203

## Understanding the Mix Specification – Job #1

- Class of concrete
- Type of cement
- Component material specs
- Cement factor
- Water/Cement ratio
- ASR mitigation
- Mortar factor
- Air content
- Slump
- Required admixtures
- Aggregate allowed
- Minimum strength

204

### Concrete Mix Design (2.0)

- + Aggregate
- + Cement
- + FDM's
- + Water
- + Air
- + Admixtures.



205

### Section 2.0 of Manual

- Combines PCC material specifications from 1020 and the GBSP's
- In effect February 2016
- ~~May~~ Will be modified by future Special Provisions or course manuals.

206

### Absolute Volume Concept

- Solid volume, excluding voids between the particles
- Serves as the basis of concrete proportioning
- ALWAYS expressed as a decimal; eg, 14.1% = absolute volume 0.141

$$\frac{\text{Weight of Material}}{\text{S.G. of Material} \times \text{Unit Wt. Of Water}}$$

207

### Absolute Volume Concept

- Absolute volume is percent expressed as a decimal
- X.XXX format – always carry decimal 3 places
- Example: 56.1% = 0.561 absolute volume

208

### Design Worksheet (see Appendix)

**8. MIX DESIGN SUMMARY**

|           |              |                     |
|-----------|--------------|---------------------|
| Cement    | _____        | <b>Batch weight</b> |
| Fly Ash   | _____        |                     |
| Water     | _____        |                     |
| Air       | _____        | <b>Volume</b>       |
| Coarse Ag | _____        |                     |
| Fine Ag   | _____        |                     |
|           | <b>1.000</b> | <b>LB</b>           |

209

### Workbook and Class Illustration Problem

| 8. MIX DESIGN SUMMARY |                      |               |
|-----------------------|----------------------|---------------|
|                       | <u>Absolute Vol.</u> | <u>WEIGHT</u> |
| Cement                | 0.076                | 405           |
| FDM1                  | 0.031                | 135           |
| FDM2                  |                      |               |
| Water                 | 0.134                | 225           |
| Air                   | 0.065                | 0             |
| Coarse Ag             | 0.432                | 1,950         |
| Fine Ag               | 0.262                | 1,174         |
|                       | <b>1.000</b>         | <b>3,889</b>  |

MF= 0.83 VCA= 0.37

210

## Mix Design - Order of Operations

- 1) Cement factor from Table 2.2.1
- 2) Cement **reduction** with water-reducing admixtures
- 3) Cement **replacement** with FDM's
- 4) Water requirement and W/C ratio
- 5) Air content
- 6) Aggregate proportions

211

## 2.2 Cement Factor

### Step 1 – Check the Spec!

Specification ~~usually~~ always governs:

- Minimum – Strength and durability
- Maximum – Minimize shrinkage cracking

212

## Important note: Minimum Portland Cement (p. 3)

“...the **Portland Cement** content in the mixture shall be a minimum of **400 lbs/cu yd.**”

Unless the mix is freeze-thaw durable according to AASHTO T 161 (14 day test)



213

Table 2.2.1

| Class or Type of Concrete | Minimum Cement Factor (cwt/yd <sup>3</sup> ) | Maximum Cement Factor (cwt/yd <sup>3</sup> ) |
|---------------------------|--|--|
| BS                        | 6.05   | 7.05   |
| PV                        | 5.65 <sup>/2</sup><br>6.05 <sup>/3</sup>     | 7.05   |

<sup>/1</sup> Central-mixed <sup>/2</sup> Truck mixed or shrink-mixed

214

## Note re: Manual Tables

Look like Table 1 in Section 1020 (Standard Specs) and Special Provisions

- GBSP mixes added to Manual
- Contains info not in Supplemental Specs
- Always read the fine print and **footnotes!**



215

## Allowable Cement Factor Reduction with W-R Admixture 2.2.2 (Pg. 3)

Available for most mixes – PV, PP-1, RR, SC, SI:

- Using water reducing or high-range WR admixture may reduce minimum cement factor by **0.30 cwt/yd<sup>3</sup>**
- Since most mixes contain water reducer...usually take the reduction when offered

216

### Cement Factor Reduction

e.g.

- Cement Factor for PV = 6.05
- 0.30 Reduction for Water-Reducer

Revised Cement Factor:  
=  $6.05 - 0.30 = 5.75$

217

### 2.3 Cement Absolute Volume

$$\frac{\text{Weight of Material}}{\text{S.G. of Material} \times \text{Unit Wt. Of Water}}$$

$$\frac{5.75 \text{ (Cement Factor)} \times 100 \text{ (LB/cwt)}}{3.15 \text{ (S.G.)} \times 1,684 \text{ (LB/YD}^3\text{)}} = 0.108 \text{ (YD}^3\text{)}$$

218

### Cement Replacement with FDM 2.4.1 (Page 6)



219

### Cement Replacement with FDMs

Replacement Rate;

- Varies by mix class
- Varies for different FDM's

Replacement Factors:

1. Cement replacement percentage
2. FDM Replacement ratio/rate is always 1:1 (since 2012)

220

### 2.4.1 Type C Fly Ash

Max. 30% Cement Replacement

- For Class PV and most other classes

221

### e.g. FDM Replacement

- Revised Cement Factor = 5.75
  - S.G. = 2.61
- 30% allowable replacement
- $5.75 \text{ cwt/YD}^3 \times 30\% = 1.71 \text{ cwt/YD}^3$
- Round UP to next 5 LB ---- 175 LB/YD<sup>3</sup>

222

### Fly Ash Absolute Volume

$$\frac{\text{Weight of FDM}}{\text{s.g. of FDM} \times \text{Unit Wt. Of Water}}$$

e.g. 
$$\frac{175 \text{ LB}}{2.61 \times 1,684 \text{ LB/YD}^3}$$
  
 = 0.040 YD<sup>3</sup>.

223

### 2.3 Cement Absolute Volume, revisited

- Using our example:
- Cement factor = 5.75
- 30% replaced with fly ash
- 70% x 5.75 = 4.03 (Round up to 4.05)

$$\frac{4.05 \text{ (Cement Factor)} \times 100 \text{ (LB/cwt)}}{3.15 \text{ (S.G.)} \times 1,684 \text{ (LB/YD}^3\text{)}}$$

Absolute volume = 0.076 (YD<sup>3</sup>)

224

### 2.5 Water

Since cement content is generally controlled by the specifications, the amount of water is the most important variable of the design. Includes:

- Batch water
- Free moisture
- Admixture water

225

### 2.5 Water



Fine aggregate H<sub>2</sub>O demand  
 + Coarse aggregate H<sub>2</sub>O demand  
 = Total concrete water demand

226

### Fine Aggregate Water Demand 2.5.1 (Pg. 8)

| Fine Aggregate Type | Shape                       | Basic Water |
|---------------------|-----------------------------|-------------|
| Type A              | Round – natural sand        | 5.1 gal/cwt |
| Type B              | Mixed                       | 5.3 gal/cwt |
| Type C              | Angular – manufactured sand | 5.5 gal/cwt |

227

### Coarse Aggregate Water Demand (Pg. 9)

| Coarse Agg. Shape               | Additional Water |
|---------------------------------|------------------|
| Rounded Gravel (Uncrushed)      | None             |
| Crushed Stone or Crushed Gravel | +0.2 gal/cwt     |
| Lightweight Slag                | +0.4 gal/cwt     |

228

### Calculation – Basic Water

Example: FA is Type B  
CA is Uncrushed gravel

Basic Water Requirement:  
5.3 gal/cwt (Fine aggregate)  
+ 0 gal/cwt (Coarse aggregate)  
5.3 gal per cwt of Total Cementitious

229

PAGE 11 - NOT A SPEC!

### Table 2.5.2 Water Adjustment

| Aggregate   | Range                                |
|---|--------------------------------------|
| <b>Shape &amp; texture:</b><br>Baseline = cubical crushed stone | (0%)                                 |
| Rounded, smooth   | (-5 to 0%)                           |
| Flat, elongated, rough  | (0 to +5%)                           |
| <b>Combined grading:</b><br>Well-graded                         | (-10 to 0%)                          |
| Gap-graded  | (0 to +10%) <a href="#">more&gt;</a> |

230

### Table 2.5.2 Water Adjustment

| ADMIXTURES  | Range  |
|---|--|
| <b>Air-entraining</b> 1 to 3% air   | (0%)   |
| 4 to 5% air   | (-5%)  |
| 6 to 10% air  | (-10%)   |
| <b>Water-reducing</b> Normal range  | (-10 to -5%)   |
| Mid-range   | (-15 to -8%)   |
| High range (superplasticizer), minimum of 14% when used to reduce cement factor | (-30 to -12%)<br><span style="color: red;">Note 2</span> |
| <a href="#">more&gt;</a>  |  |

231

### Table 2.5.2 Water Adjustment

| Finely Divided Minerals | Range                                  |
|-------------------------|--|
| Fly Ash                 | (-10 to 0%)<br>3% for each 10% Fly Ash |
| Microsilica             | (0 to +15%)                            |
| HRM                     | (-5 to +5)                             |
| GGBF Slag               | (0%)                                   |

[more>](#)

232

### Table 2.5.2 Water Adjustment

| Other factors   | Range       |
|---|-------------|
| •Coarse cement<br>•Water/Cement ratio > 0.45<br>•Concrete temperature < 60° F | (-10 to 0%) |
| •Fine cement<br>•water/Cement ratio < 0.40<br>•Concrete temperature > 80° F   | (0 to +10%) |

[more>](#)

233

### Table 2.5.2 Water Adjustment Notes:

- Suggested max water reduction recognizing overlapping effects is -30%.
- Minimum water/cement ratio applies.
- A high range W-R admixture may be able to reduce the water content up to 40%.
- For each 10% of fly ash, it is recommended to allow a water reduction of at least 3%.

234

## 2.6 Water/Cement Ratio

$$\frac{\text{Weight of Water}}{\text{Weight of Cementitious Material}}$$

- Water includes **ALL FREE** water
- "Cementitious" includes FDM's

See Table 2.6 (Pg. 15)

235

## 2.6 Water/Cement Ratio



### Minimum


- Need adequate water to hydrate cement ( $\approx 0.32$ )
- Extra water is needed for workability
- Excess water creates pore space, reducing strength and durability

### Maximum

- Normal maximum spec: 0.40 - 0.44
- If not specified, min. = 0.32; max. = 0.45


236

## W/C and Performance

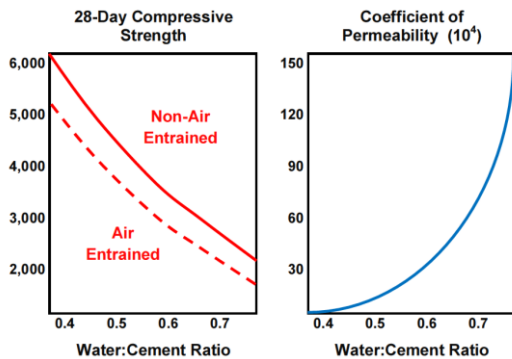

237

## W/C and Performance

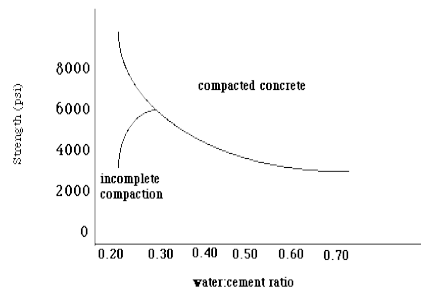

238

## Water Adjustment example:

|                   |             |          |
|-------------------|-------------|----------|
| Basic Water:      | 5.3 gal/cwt |          |
| Reduction for W-R | -6%         | (Option) |
| Revised Water     | 5.0 gal/cwt |          |

### Cementitious

|                    |          |
|--------------------|----------|
| Cement = 405 lbs.  | 4.05 cwt |
| Fly Ash = 175 lbs. | 1.75 cwt |
|                    | 5.80 cwt |

Water = 5.0 x 5.80 x 8.33 (lbs/gal) = 242 lbs. of water

239

## Water Absolute Volume

$$\frac{\text{Weight of Water}}{\text{S.G. of Water} \times \text{Unit Wt. Of Water}}$$

e.g.

$$\frac{242 \text{ LB}}{1.00 \times 1,684 \text{ LB/YD}^3} = 0.144 \text{ (YD}^3\text{)}$$

240



## 2.6 Water/Cement Ratio Calculation (Method #1)

e.g. Adjusted Basic Water = 5.0 gal/cwt

$$\begin{aligned} \text{W/C} &= \frac{\text{Water (gal/cwt)} \times 8.33 \text{ (LB/gal)}}{100 \text{ LB/cwt}} \\ &= \frac{5.0 \text{ gal/cwt} \times 8.33 \text{ LB/gal}}{100 \text{ LB/cwt}} \\ &= 0.42 \end{aligned}$$

241

## 2.6 Water/Cement Ratio Calculation (Method #2)

$$\begin{aligned} \text{W/C} &= \frac{\text{Weight of water}}{\text{Weight of cement + FDM's}} \\ &= \frac{242 \text{ \# water}}{405 \text{ \# cement} + 175 \text{ \# fly ash}} \\ &= 0.42 \end{aligned}$$

242

## 2.6 W/C Ratio Verification

Verify Minimum Spec:

(Table 2.6 – Pg. 15)

Class PV

Range: 0.32 – 0.42

Our result = 0.42

OK ✓

243

## Where are we?

We know:

1. Cement Factor
2. W-R Reduction
3. FDM Replacement
4. Water
5. W/C Verification


Next: **Entrained Air**

244

## 2.7 Air Content

PAGE 16

| Class or Type of Concrete | Air Content Percent |
|---------------------------|---------------------|
| BS <sup>1</sup>           | 5.0-8.0             |
| PV <sup>1</sup>           | 5.0-8.0             |
| SI <sup>1</sup>           | 5.0-8.0             |



Design to midpoint of spec range

<sup>1</sup> For slipform construction, the minimum air content is 5.5 percent. (Still design @ 6.5% air)

245

## 2.7 Air Content Absolute Volume

Absolute Volume of Air

$$= \text{Percent Air} \div 100$$

e.g. 6.5% Air

$$\begin{aligned} \text{Absolute Volume} &= 6.5 \div 100 \\ &= 0.065 \text{ YD}^3 \end{aligned}$$

246

**2.7.1**  
**Minimum Air Content**

Page 16

Necessary for freeze-thaw resistance

If not otherwise specified,  
Design to minimum 18% (volume) of:  
H<sub>2</sub>O + Cement + FDM

247

**Minimum Air Content example**

$$\text{Air}_{\text{MIN}} = [0.18 \times (V_{\text{H}_2\text{O}} + V_{\text{cement}} + V_{\text{FDM}})] \times 100$$

e.g.  $V_{\text{H}_2\text{O}} = 0.134$

$V_{\text{cement}} = 0.071$

$V_{\text{FDM}} = 0.038$

$$\text{Air}\% = [0.18 \times (0.134 + 0.071 + 0.038)] \times 100 = 4.3\%$$

248

**Adjustment of Air (Art. 503.07)**  
**BDE 80316 Concrete Placement**

- Maximum air loss caused by pumping operation shall be 3.0%
- Minimum air at the point of discharge shall be per Article 1020.04.



249

**Where are we?**

We know all about the Paste:

1. Cement Factor
2. Water
3. FDM
4. W/C Verification


Next:

- Add the Paste to the aggregate
- Using  $V_{\text{CA}}$  and Mortar Factor

250


**Refresher**

- **Mortar Factor** is related to the VCA bucket
- **Mortar Fraction** is related to the Design Box



251

$V_{\text{CA}}$

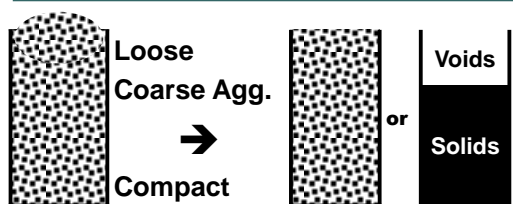

$$V_{\text{CA}} = \text{Vol. Voids} / \text{Vol. Bucket}$$

252

## **$V_{CA}$ - Voids in Coarse Aggregate (ITP 306)**

From Department, obtain:

- Absorption
- $G_A$  (Oven Dry Specific Gravity) &
- $G_S$  (SSD Specific Gravity)

Calculate

1. Unit Weight
2.  $V_{CA}$  - Coarse Aggregate Voids

253

## **Design Mortar Factor**

Select Mortar Factor based on Table 2.8.2 and experience with local materials and construction applications.

**A new mix design is required if MF changes by  $\pm 0.05$  from original value.**

254

Page 21

## **2.8.2.2 Design Mortar Factor**

| Class or Type of Concrete | Coarse Aggregate Gradation                       | Mortar Factor Range        |
|---------------------------|--|----------------------------|
| BS <sup>2,3,7</sup>       | CA-7, CA-11, or CA-14                            | 0.70 - 0.86 <sup>5,6</sup> |
| PV                        | CA-5 & CA-7, CA-5 & CA-11, CA-7, CA-11, or CA-14 | 0.70 - 0.90 <sup>5</sup>   |

<sup>3</sup> CA minimum 45% passing 1/2" when pumped  
<sup>5</sup> Max = 0.85 if FA is Stone Sand

255

## **Exceptions to the Rule**

- MF > 1.00 for structural lightweight (90-115 lb/ft<sup>3</sup>) using lightweight coarse aggregate (2.8.2.2)
- MF > 1.00 for SCC or latex
- MF > 0.86 for BS concrete using lightweight coarse aggregate (Pg. 43)

256

## **Volume Fraction (%) of Mortar**

We know:

- Mortar Factor  $M_O$  (0.83 given)
- $V_{CA}$  (0.37 from VCA test)

Calculate:

1. Mortar Fraction (% Mortar)
2. Coarse Aggregate Fraction.



257

## **Mortar Volume Fraction**

$$\% \text{ Mortar} = \frac{M_O}{M_O + F_{CA}}$$

**Example:**  $M_O$  Mortar Factor = 0.83  
 $V_{CA} = 0.37$  ( $F_{CA} = 0.63$ )

$$\% \text{ Mortar} = \frac{0.83}{0.83 + 0.63} = 0.568 \text{ (56.8\%)}$$

258

### Mortar Absolute Volume

Mortar Fraction = 0.568

This is also the **Absolute Volume** of the mortar.

Mortar is everything but coarse aggregate.: **Cementitious + Water + Air + Fine Aggregate**



259

### Absolute Volume of Aggregate



260

### Coarse Aggregate Absolute Volume (2.8.3)

PAGE 22

Mortar + Coarse Aggregate = Concrete

For our example:

$$0.568 + \text{Coarse Aggregate} = 1.000$$

$$\text{Coarse Aggregate} = 1.000 - 0.268$$

$$= 0.432 = \text{Absolute Volume of Coarse Aggregate}$$

261

### Coarse Aggregate Absolute Vol.

|                  |       |                |
|------------------|-------|----------------|
| Cement           | 0.CEM | 0.568          |
| Fly Ash          | 0.FLY |                |
| Water            | 0.H2O |                |
| Air              | 0.AIR | Mortar         |
| Fine Aggregate   | 0.FA2 |                |
| Coarse Aggregate | 0.CA7 | 0.432          |
|                  |       | <b>= 1.000</b> |

262

### Fine Aggregate Absolute Volume (2.8.4)

PAGE 22

This is the last unknown:

Subtract everything else from 1.000

$$= 1.000 - (\text{Cement} + \text{FDM} + \text{H}_2\text{O} + \text{Air} + \text{CA})$$

e.g.

$$= 1.000 - (0.076 + 0.040 + 0.144 + 0.065 + 0.432)$$

$$= 0.243$$

263

### Converting Aggregate Volume to Weight (2.8.5)

PAGE 23

Given:

- $G_{SSD}$
- Absolute volume of aggregate



Calculate Weight:

$$\text{Wt.} = \text{Absolute Vol.} \times SG_{SSD} \times \text{Unit Wt.}_{H_2O}$$

264

### Converting Coarse Aggregate Volume to Weight (2.8.5)

$$\text{Weight} = \text{Abs. Vol.} \times \text{SG}_{\text{SSD}} \times \text{Unit Wt}_{\text{H}_2\text{O}}$$

e.g.

- CA Absolute Volume = 0.432
- $\text{SG}_{\text{SSD}} = 2.68$

$$\begin{aligned} \text{Wt.} &= 0.432 \text{ (YD}^3\text{)} \times 2.68 \times 1,684 \text{ (LB/YD}^3\text{)} \\ &= 1,950 \text{ LB} \end{aligned}$$

265

### Converting Fine Aggregate Volume to Weight (2.8.5)

$$\text{Weight} = \text{Abs. Vol.} \times \text{SG}_{\text{SSD}} \times \text{Unit Wt}_{\text{H}_2\text{O}}$$

e.g.

- FA Absolute Volume = 0.243
- $\text{SG}_{\text{SSD}} = 2.65$

$$\begin{aligned} \text{Wt.} &= 0.243 \text{ (YD}^3\text{)} \times 2.65 \times 1,684 \text{ (LB/YD}^3\text{)} \\ &= 1,084 \text{ LB} \end{aligned}$$

266

### PV Example Problem 2.9 Page 23 (Solution App. HW-1)

#### Example Problem Solution - PCC Level III

|                                      |            |                    |       |
|--------------------------------------|------------|--------------------|-------|
| <b>Given or Calculate:</b>           |            |                    |       |
| Mix Plant Type:                      | Central    |                    |       |
| Mix Class:                           | PV (Slip)  |                    |       |
| Coarse Agg:                          | 020CA07    | G <sub>ssd</sub> : | 2.68  |
| Fine Agg:                            | 027FA01    | G <sub>ssd</sub> : | 2.65  |
| Cement:                              | Type I     | SC:                | 3.15  |
| FDM1:                                | Fly C      | SG:                | 2.61  |
| FDM2:                                |            | SG:                |       |
| CA Voids:                            | 0.37       |                    |       |
| Mortar Factor:                       | 0.83       |                    |       |
| <b>ASR INFO</b>                      |            |                    |       |
| CA Type:                             | Gravel     | Exp. Group:        | 0.05  |
| FA Type:                             | B          | Exp. Group:        | >0.16 |
| Use % water adjustment:              |            | Alkali:            | >0.60 |
|                                      |            | Alkali:            |       |
|                                      |            | Alkali:            |       |
|                                      |            | Aggr. Group:       | II    |
| <b>Specification look-up:</b>        |            |                    |       |
| Cement Factor                        | 5.65       | ow/YD <sup>3</sup> |       |
| Allowed CF Reduction (W-R)           | 0.30       | ow/YD <sup>3</sup> |       |
| FDM Replacement %                    | 25         | %                  |       |
| FDM Replacement Ratio                | 1.0 (1:1)  |                    |       |
| W/C Ratio                            | 0.42       | Max                |       |
| 25% FDM replacement required for ASR |            |                    |       |
| Mitigation Option                    | 2          |                    |       |
| Target Air Content                   | 6.6        | %                  |       |
| Target Slump                         | 0.5-2.5    | in.                |       |
| Min. Comp. Strength                  | 3,500 @ 14 | PSI @ days         |       |

267

### 2.9 EXAMPLE PROBLEM (Pg. 23)

Given:

- Continuous reinforced slipformed concrete pavement (CRCP)
- Central mix plant using dumps
- Type I cement with >0.60 alkalies (S.G. 3.15)

268

### Example Problem – Fly Ash

- Class C
- S.G. = 2.61
- CaO = 25.1%
- Ignition loss = 1.0%

269

### Example – Aggregates

- Fine Aggregate Type B
- 027FA01  $\text{SG}_{\text{SSD}} = 2.66$
- ASR expansion range >0.16%-0.27%
- Coarse Aggregate – 020CA07 (gravel)
- $\text{SG}_{\text{SSD}} = 2.68$
- $V_{\text{CA}}$  Coarse Aggregate Voids = 0.37
- ASR value = 0.05%

270

## ASR Identify Aggregate Groups

| COARSE<br>AGGREGATE<br>or<br>Blend<br><br>ASTM C 1260<br>Expansion | Fine Aggregate<br>Or<br>Fine Aggregate Blend<br><br>ASTM C 1260 Expansion |                |            |
|--|---|----------------|------------|
|  | ≤0.16%  | >0.16% - 0.27% | >0.27%     |
|  | → ≤0.16%  | Group I        | Group II ← |
| >0.16% - 0.27%   | Group II  | Group II       | Group III  |
| >0.27%   | Group III   | Group III      | Group IV   |

271

## ASR Group II - Valid Options (Will mitigate with FDM's)

| AGG<br>GROUP | Mitigation Option                         |                                   |                   |                              |   |
|--------------|---|-----------------------------------|-------------------|------------------------------|---|
|              | 1   | 2                                 | 3                 | 4                            | 5 |
| I            | Use any cement or finely divided mineral. |                                   |                   |                              |   |
| II           | X   | → X                               | X                 | X                            | X |
| III          | X   | Combine Option 2<br>plus Option 3 |                   | X                            | X |
| IV           | X   | Option 2<br>plus<br>Option 4      | Invalid<br>Option | Option 2<br>plus<br>Option 4 | X |

272

### Step 1.1 – Choose Cement Factor

#### Standard Cement Factor

(Table 2.2.1 – Pg. 4)

- PV (paving) mix
- Cement Factor = 5.65<sup>2</sup>

Footnote: <sup>2</sup> Central-mixed

273

### Step 1.2 Reduce Cement Factor

#### Allowable reduction for W-R admixture

(from 2.2.2 0 Pg. 3)

0.30 cwt./YD<sup>3</sup> reduction allowed

The use of water reducer is a designer option, based on spec, guidelines, and experience

Revised cement factor:

$$5.65 - 0.30 = 5.35 \text{ cwt/YD}^3$$

274

### Step 1.3 – Cement Replacement 2.4.1 (Pg. 6)

#### Allowable Cement Replacement with Fly Ash

Up to 30% replacement allowed for Class C fly ash, 400 cwt cement per yard minimum

$$5.35 \times 0.25 = 1.34 \text{ cwt/YD}^3$$

Revised Cement:

$$5.35 - 1.34 = 4.01 \text{ cwt/YD}_3$$

Rounds up to 4.05 cwt/YD<sub>3</sub> (405 lbs)

275

### Step 1.4 – Cement Absolute Volume

Absolute Volume =

$$\text{Weight} \div (\text{SG} \times 1,684)$$

Weight = 405 pounds

SG = 3.15

$$= \frac{405 \text{ LB}}{3.15 \times 1,684}$$

$$= 0.076$$

276

### Step 2.0 – Fly Ash

#### Absolute Volume

1.34 cwt/YD<sup>3</sup> or 134 lbs (Rounds up to 135)

SG = 2.61

$$= \text{Weight} / \text{S.G.} \times 1,684$$

$$= \frac{135}{2.61 \times 1,684}$$

$$= 0.031$$

277

### Step 3.0 – Basic Water Requirement

#### Basic Water for Aggregate

From 2.5.1.1

Water for Type B fine agg. = 5.3 gal/cwt.

From 2.5.1.2

Additional water for uncrushed gravel = 0 gal/cwt

$$\text{Basic Water} = 5.3 + 0 = 5.3 \text{ gal/cwt}$$

278

### Step 3.1 – Adjustment to Water Requirement

From 2.5.2 (Pg. 11)

6% Target reduction (Given)

Basic Water = 5.3 gal/cwt

6% Water reduction = 0.3 gal/cwt

Revised Water = 5.3 – 0.3

$$= 5.0 \text{ gal/cwt}$$

279

### Step 3.2 – Water Calculation

#### Revised Water

Revised Water = 5.0 gal/cwt

5.0 gal/cwt x 8.33 LB/gal = 41.65 LB/cwt

$$41.65 \times (4.05 + 1.35) = 225 \text{ LB}$$

Order of calculations makes slight difference

280

### Step 3.3 – Water Absolute Volume

#### Absolute Volume

$$= \frac{\text{Weight}}{\text{SG} \times 1,684}$$

$$= \frac{225 \text{ LB}}{1.00 \times 1,684 \text{ LB/YD}^3}$$

$$= 0.134$$

281

### Step 3.4 – Verify Water/Cement Ratio

#### Water/Cement Ratio

Water = 41.65 LB/cwt

(From 2.6)

W/C = Weight of Water / Weight of Cement

$$= 41.65 / 100$$

$$= 0.4165 \text{ (Rounds up to 0.42)}$$

Max. W/C = 0.42 OK (Table 2.6)

282

### Step 3.4 - Water/Cement Ratio

#### Alternate calculation:

Total Water = 225 lbs.

Total Cementitious = 405 + 135 = 540

W/C =  $225 \div 540 = 41.66$

Max. W/C = 0.42

Still OK

283

### Step 4.0 - Air

(From Table 2.7 - Pg. 16)

Spec = 5.0-8.0%

Midpoint = 6.5%

Absolute Volume =  $\% \text{ air} / 100$   
 $= 0.065$

284

### Step 5.0 - Percent Mortar

M<sub>O</sub>: Mortar Factor = 0.83

VCA = 0.37

F<sub>CA</sub> =  $1.00 - 0.37 = 0.63$

$$\begin{aligned} \% \text{ Mortar} &= \frac{100 \times M_O}{M_O + F_{CA}} \\ &= \frac{100 \times 0.83}{0.83 + 0.63} \end{aligned}$$

= 56.8 % (Absolute Volume = 0.568 YD<sup>3</sup>)

285

### Step 5.1 - Coarse Aggregate Absolute Volume

#### CA Absolute Volume

= 1 - (Mortar Absolute Volume)

= 1 - 0.568

= 0.432 YD<sup>3</sup> Absolute Volume

286

### Step 6.0 - Fine Aggregate Absolute Volume

= 1

- V<sub>Cement</sub> (0.076)

- V<sub>FDM</sub> (0.031)

- V<sub>Water</sub> (0.134)

- V<sub>Air</sub> (0.065)

- V<sub>CA</sub> (0.432)

= 0.262 YD<sup>3</sup>

287

### Step 7.0 - Determine Aggregate Weights

Weight = Abs Vol x S.G. x 1,684

#### Coarse Aggregate

= 0.432 YD<sup>3</sup> x 2.68 x 1,684 LB/YD<sup>3</sup>

= 1,950 LB

#### Fine Aggregate

= 0.262 YD<sup>3</sup> x 2.66 x 1,684 LB/YD<sup>3</sup>

= 1,174 LB

288



### Step 8.0 – Mix Design Summary

- Cement – 405 lbs.
- Fly Ash – 135 lbs.
- Water – 225 lbs.
- Air – 6.5%
- CA – 1,950 lbs.
- FA – 1,174 lbs.
- Mortar Factor – 0.83
- CA Voids – 0.37
- W/C Ratio – 0.42
- **Later - Slump & Strength**

289

### Where are we?

- VCA test
- Mix Design Proportions
- Trial Mix
- Trial Batch

290


### 6.0 Trial Mixture (Pg. 36)

#### Contractor's verification of:

- Slump (6.1 – Pg. 36)
  - Air (2.7 – Pg. 15)
  - Minimum strength (6.2 – Pg. 38)
- Minimum 2 cubic yards (4 recommended)  
 Recommended near-max. W/C ratio for trial  
 Recommended strength curves at 3, 7, 14, 28, and 56 days.

291


### Strength Curves Recommended (Pg. 41)

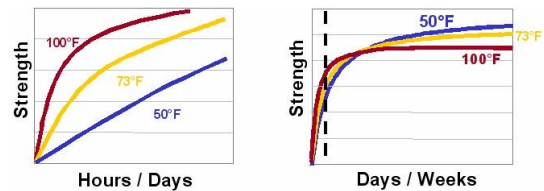

- Learn about your mixes
- Set time/strength gain
  - Temperature


292

### PV – Example

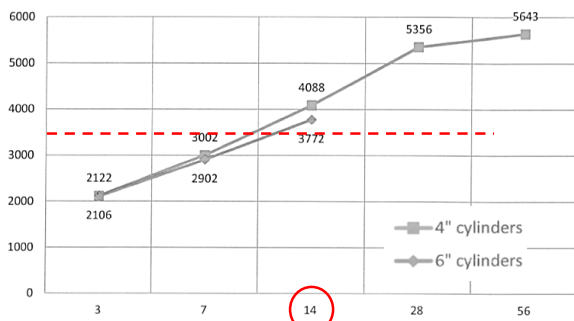

293

### Trial Mix Slump



Slump measures batch-to-batch  
 Read the Footnotes:

- Slipform PV slump spec: 0.5 – 2.5 inches\*
- Others may be modified with water reducer
- **\*Check the Special Provision!**

294

## Slipform Slump Specification

SLIPFORM PAVING (D-1)  
Effective: November 1, 2014

Revise Article 1020.04 Table 1, Note (5) of Standard Specifications to read:

"The slump range for slipform construction shall be 1/2 to 1 1/2 in."

Revise Article 1020.04 Table 1 (metric), Note (5) of Standard Specifications to read:

"The slump range for slipform construction shall be 13 to 40 mm."



295

## Trial Mix Air



Trial results within 0.5% of spec max.

296

## Trial Mix Strength

Must meet minimum strength on day of record for trial mix

However, in the field, IDOT has discretion to wait for strength



297

## 6.3 Laboratory p. 39

- Approved for QC per BMRP Policy Memo and District
- (AASHTO Accreditation is **not** required)
- QC/QA Trained Technicians

298

## Design Lab Steps

1. Batch
2. Evaluate / Adjust for air, slump
3. Evaluate for consistency, plasticity, and workability
4. Evaluate for yield
5. Make strength specimens – beams or cylinders
6. Document test of record.

299

## 8.0 Durability Testing (Pg. 43)

Not required for most mixes because IDOT policy provides:

- Specified Procedures
- Specified Mix Parameters
  - Cement, FDM, W/C, Air
- Specified Material Quality
  - Aggregate

300

### Durability Testing

Required for unique mix designs if **Mortar Factor** is not within spec limits. **Only spec change that will be considered.**

- For Class BS concrete, MF ≤ 0.86
- FA portion ≤ 50% of total aggregate

Employ Accredited Lab; Perform:

- 300 Cycle Freeze-Thaw – IL Method
- Salt Scaling – IL Method.

301

### Where are we?

- VCA test
- Mix Design Proportions
- Trial Mix
- Department Verification/Trial Batch

302

### 9.0 Department Verification (Pg. 44)

#### Considerations:

- Proportions / calculations
- Strength test results
- Historical test data for similar mixes
- Target strength calculations
- Department experience
- **Trial batch**

303

### Trial Batch (Pg. 45)

#### Department Option

- Contractor's mix expense
- Department testing expense



304

### Trial Batch Procedure

- 2 yd<sup>3</sup> Minimum (4 yd<sup>3</sup> Preferred)
- Air within 0.5% of upper spec limit
- Air for slipform trial batch TBA
- Temperature per IDOT specs
- Strength on specified day (Usu. 14 days)
- All Tests per Manual of Test Procedures

305

### IDOT Verification Tests

- Air
- Slump
- Strength (cylinders or beams)
- Temperature
- Yield (optional)
- CA voids

306

## Trial Batch Verification

Batch verified if test results meet specification requirements.

CA voids (VCA) verified if Department test results are within 0.02 of Contractor's value.

307

## Materials Control

New mix design required when...

- Cement s.g. change > 0.04 (Pg. 5)
- FDM s.g. change > 0.04 (Pg. 6)

308

| PCC Level II Technician Course Manual                 |   |        |   |
|---|---|--------|---|
| 2.10 SUMMARY OF MIX DESIGN EQUATIONS                  |   |        |   |
| <b>Volume of Cement &amp; Finely Divided Minerals</b> |   |        |   |
| English   | Absolute Volume, $V_{CA} = \frac{W_{CA}}{G_{CA}}$   | Weight | Absolute Volume of Cement, Finely Divided Minerals, and LVA |
| Metric  | Absolute Volume, $V_{CA} = \frac{M_{CA}}{G_{CA}}$   | Mass   | Weight of Material (kg)                                     |
| <b>Basic Water Requirement—IDOT Method</b>            |   |        |   |
| English   | Basic Water Requirement, $W_{Basic} = W_{FA} + W_{CA}$  | Weight | Basic Water Requirement, $W_{Basic}$ (gal)                  |
| Metric  | Basic Water Requirement, $W_{Basic} = W_{FA} + W_{CA}$  | Mass   | Basic Water Requirement, $W_{Basic}$ (kg)                   |
| <b>Adjusted Basic Water Requirement</b>               |   |        |   |
| English   | Adjusted Basic Water Requirement, $W_{Adj} = W_{Basic} - (W_{Basic} \times \frac{\%Adjustment}{100})$ | Weight | Adjusted Basic Water Requirement, $W_{Adj}$ (gal)           |
| Metric  | Adjusted Basic Water Requirement, $W_{Adj} = W_{Basic} - (W_{Basic} \times \frac{\%Adjustment}{100})$ | Mass   | Adjusted Basic Water Requirement, $W_{Adj}$ (kg)            |
| <b>Water/Cement Ratio</b>                             |   |        |   |
| English   | Water/Cement Ratio, $W/C = \frac{W_{Adj}}{W_{CA}}$  | Ratio  | Water/Cement Ratio  |
| Metric  | Water/Cement Ratio, $W/C = \frac{W_{Adj}}{W_{CA}}$  | Ratio  | Water/Cement Ratio  |
| <b>Volume of Water</b>                                |   |        |   |
| English   | Absolute Volume, $V_{Water} = \frac{W_{Water}}{G_{Water}}$  | Weight | Volume of Water (gal)                                       |
| Metric  | Absolute Volume, $V_{Water} = \frac{M_{Water}}{G_{Water}}$  | Mass   | Volume of Water (kg)  |
| <b>Volume of Estimated Air</b>                        |   |        |   |
| English   | Absolute Volume, $V_{Air} = \frac{W_{Air}}{G_{Air}}$  | Weight | Absolute Volume of Air (gal)                                |
| Metric  | Absolute Volume, $V_{Air} = \frac{M_{Air}}{G_{Air}}$  | Mass   | Absolute Volume of Air (kg)                                 |

## 2.10 Summary Mix Design Equations

Page 30

309

## Basic Water – IDOT Method

### Basic Water Requirement—IDOT Method

English & Metric Basic Water Requirement,  $W_{Basic} = W_{FA} + W_{CA}$

Unit = X.X gal/cwt

310

## Adjusted Basic Water

### Adjusted Basic Water Requirement

English & Metric Adjusted Basic Water Requirement,  $W_{Adj} = W_{Basic} - (W_{Basic} \times \frac{\%Adjustment}{100})$

Unit = X.X gal/cwt

311

## Water/Cement Ratio

### Water/Cement Ratio

English Water/Cement Ratio,  $W/C = \frac{W_{Adj} \times 8.33}{100}$

Unit = 0.XX

312

### Water/Cement Ratio Alternate Method

$$= \frac{\text{Total Weight Water}}{\text{Total Weight Cementitious}}$$

Unit = 0.XX

313

### Absolute Volume

#### Volume of Cement & Finely Divided Minerals

|         |   |
|---------|---|
| English | Absolute Volume, $V_{Cement} = \frac{Weight}{G_{sp} \times 1,683.99}$ |
|         | $V_{FDM} = \frac{Weight}{G_{sp} \times 1,683.99}$                     |

Unit = 0.XXX

314

### Water Absolute Volume

#### Volume of Water

|         |  |
|---------|--|
| English | Absolute Volume, $V_{Water} = \frac{Weight}{1,683.99}$ |
|---------|--|

Unit = 0.XXX YD<sup>3</sup>

315

### Entrained Air Absolute Volume

#### Volume of Entrained Air

|                        |  |
|------------------------|--|
| English<br>&<br>Metric | Absolute Volume, $V_{Air} = \frac{\%Air}{100}$ |
|------------------------|--|

Unit = 0.XXX YD<sup>3</sup>

316

### Minimum % Air Content

#### Minimum Percent Air Content

|                        |   |
|------------------------|---|
| English<br>&<br>Metric | Minimum Percent Air<br>= $[0.18 \times (V_{Water} + V_{Cement} + \Sigma V_{FDM})] \times 100$ |
|------------------------|---|

Unit = X.X %

317

### Volume CA Solids and Mortar

#### Volume Fraction of Coarse Aggregate & Mortar

|                        |  |
|------------------------|--|
| English<br>&<br>Metric | Fraction of Coarse Aggregate Solids,<br>= 1 - V        |
|                        | Volume Fraction of Mortar = $\frac{M_O}{M_O + F_{CA}}$ |

$$V = V_{CA}$$

Unit = 0.XXX

318

### Coarse Aggregate Absolute Volume

#### Volume of Coarse Aggregate

|                                     |   |
|-------------------------------------|---|
| <i>English<br/>&amp;<br/>Metric</i> | Absolute Volume,<br>$V_{CA} = 1 - \text{Volume Fraction of Mortar}$ |
|                                     | OR<br>$V_{CA} = \frac{1}{1 + \left(\frac{M_o}{1-V}\right)}$         |

**Unit = 0.XXX YD<sup>3</sup>**

319

### Fine Aggregate Absolute Volume

#### Volume of Fine Aggregate

|                                     |  |
|-------------------------------------|--|
| <i>English<br/>&amp;<br/>Metric</i> | Absolute Volume,<br>$V_{FA} = 1 - (V_{\text{Cement}} + \Sigma V_{\text{FDM}} + V_{\text{Water}} + V_{\text{Air}} + V_{\text{CA}})$ |
|-------------------------------------|--|

**Unit = 0.XXX YD<sup>3</sup>**

320

### Aggregate Weight

#### Aggregate Content

|                |  |
|----------------|--|
| <i>English</i> | Weight of Aggregate (lb./yd <sup>3</sup> )<br>= $V_{CA} \times G_{SSD} \times 1,683.99$<br>= $V_{FA} \times G_{SSD} \times 1,683.99$ |
|----------------|--|

**X,XXX LB**

321

### Aggregate Blending Appendix E


- Aggregate grading
- Fineness Modulus of fine aggregate
- "8-18 Rule"
- 0.45 Power Curve

322

### Types of Aggregate Grading


#### \* Uniformly graded

- Balance of sieve sizes



#### \* Gap graded

- Imbalance of sieve sizes



323

### Aggregate grading (particle size distribution) affects:

- Ease of placing
- Pumping
- Consolidating
- Finishing
- Water demand

324

### Illinois Coarse Aggregates

“Problems occur when % passing 12.5 mm is less than 40%.”

| Product | P 12.5 mm |
|---------|-----------|
| CA-05   | 0-10%     |
| CA-07   | 30-60%    |
| CA-11   | 30-60%    |
| CA-14   | 80-100%   |
| CA-16   | 100%      |

325

### Coarse Aggregate for Bridge Decks

(1) When Class BS concrete is to be pumped, the coarse aggregate gradation shall have a minimum of 45 percent passing the 1/2 in. (12.5 mm) sieve. The Contractor may combine two or more coarse aggregate sizes, consisting of CA 7, CA 11, CA 13, CA 14, and CA 16, provided a CA 7 or CA 11 is included in the blend.

When placing Class BS concrete with a pump, the discharge end of the pump shall have an "S" shaped flexible or rigid conduit, a 90 degree elbow with a minimum of 10 ft (3 m) of flexible conduit placed parallel to the deck, or a similar configuration approved by the Engineer.

326

### Fine Aggregate Gradation

Affects:

- Air retention
- Workability
- Pumping capacity
- Finishing
- Bleeding

327

### Fineness Modulus of Fine Aggregate

Cumulative Sum:

$$\frac{\text{Retained (3/8 through \#100 sieve)}}{100}$$

328

| Sieve | Passing | Retained | Σ Retained | FM    |
|-------|---------|----------|------------|-------|
| 3/8   | 100     | 0        | 0          |       |
| # 4   | 98      | 2        | 2          |       |
| # 8   | 85      | 13       | 15         |       |
| #16   | 65      | _____    | _____      |       |
| #30   | 45      | _____    | _____      |       |
| #50   | 21      | _____    | _____      |       |
| #100  | 3       | _____    | _____      |       |
|       |         | Sum      | _____      | _____ |

329

| Sieve | Passing | Retained | Σ Retained | FM    |
|-------|---------|----------|------------|-------|
| 3/8   | 100     | 0        | 0          |       |
| # 4   | 98      | 2        | 2          |       |
| # 8   | 85      | 13       | 15         |       |
| #16   | - 65    | = 20     |            |       |
| #30   | 45      | _____    | _____      |       |
| #50   | 21      | _____    | _____      |       |
| #100  | 3       | _____    | _____      |       |
|       |         | Sum      | _____      | _____ |

330

| Sieve | Passing | Retained | Σ Retained | FM    |
|-------|---------|----------|------------|-------|
| 3/8   | 100     | 0        | 0          |       |
| # 4   | 98      | 2        | 2          |       |
| # 8   | 85      | 13       | + 15       |       |
| #16   | 65      | + 20     | = 35       |       |
| #30   | 45      | _____    | _____      |       |
| #50   | 21      | _____    | _____      |       |
| #100  | 3       | _____    | _____      |       |
|       |         | Sum      | _____      | _____ |

331

| Sieve | Passing | Retained | Σ Retained | FM    |
|-------|---------|----------|------------|-------|
| 3/8   | 100     | 0        | 0          |       |
| # 4   | 98      | 2        | 2          |       |
| # 8   | 85      | 13       | 15         |       |
| #16   | 65      | 20       | 35         |       |
| #30   | - 45    | 20       | 55         |       |
| #50   | 21      | _____    | _____      |       |
| #100  | 3       | _____    | _____      |       |
|       |         | Sum      | _____      | _____ |

332

| Sieve | Passing | Retained | Σ Retained | FM    |
|-------|---------|----------|------------|-------|
| 3/8   | 100     | 0        | 0          |       |
| # 4   | 98      | 2        | 2          |       |
| # 8   | 85      | 13       | 15         |       |
| #16   | 65      | 20       | 35         |       |
| #30   | 45      | 20       | 55         |       |
| #50   | 21      | 24       | 79         |       |
| #100  | 3       | _____    | _____      |       |
|       |         | Sum      | _____      | _____ |

333

| Sieve | Passing | Retained | Σ Retained | FM   |
|-------|---------|----------|------------|------|
| 3/8   | 100     | 0        | 0          |      |
| # 4   | 98      | 2        | 2          |      |
| # 8   | 85      | 13       | 15         |      |
| #16   | 65      | 20       | 35         |      |
| #30   | 45      | 20       | 55         |      |
| #50   | 21      | 24       | 79         |      |
| #100  | 3       | 18       | 97         |      |
|       |         | Sum      | 283        | 2.83 |

334

### Fineness Modulus

- Larger number = coarser
- FM range typically 2.0 to 4.0
- ACI recommends 2.4 to 3.0
- ACI recommends 2.7 to 3.5 for slipform
- 0.2 change is significant – workability may be affected
- Very high FM may result in lost air
- May need to change FA &/or raise MF

335

### Fineness Modulus Class Exercise

| Sieve | Passing | Retained | Σ Retained | FM |
|-------|---------|----------|------------|----|
| 3/8   | 100     | 0        | 0          |    |
| # 4   | 97      |          |            |    |
| # 8   | 89      |          |            |    |
| #16   | 77      |          |            |    |
| #30   | 53      |          |            |    |
| #50   | 12      |          |            |    |
| #100  | 2       |          |            |    |
|       |         | Sum      | _____      |    |

336



**Fineness Modulus Class Exercise**

| Sieve | Passing | Retained | Σ Retained | FM   |
|-------|---------|----------|------------|------|
| 3/8   | 100     | 0        | 0          |      |
| # 4   | 97      | 3        | 3          |      |
| # 8   | 89      | 8        | 11         |      |
| #16   | 77      | 12       | 23         |      |
| #30   | 53      | 24       | 47         |      |
| #50   | 12      | 41       | 88         |      |
| #100  | 2       | 10       | 98         |      |
|       |         | Sum      | 270        | 2.70 |

337

**How to Blend Numbers (Appendix E)**

For:

1. Gradation
2. Specific Gravity
3. ASR Expansion Value



338

**Blending Aggregate Gradations**

$$TB = (a / 100) \times A + (b/100) \times B + \dots$$

Where:

TB = Total blend on each sieve

a, b... = Percent of aggregate product

A, B ... = Percent on that sieve



Valid for % Passing or Retained.

339

**Gradation Blending**

Calculate for each sieve:

| Gradation       | CA 07 | CA 16 | FA 01 | Total |
|-----------------|-------|-------|-------|-------|
| (a) % mix       | 45%   | 15%   | 40%   | 100%  |
| (A) P 3/8"      | 11%   | 96%   | 100%  |       |
| (a/100) x (A) = | 5%    | 14%   | 40%   | 59%   |

Total P 3/8" in Aggregate Blend =

$$5\% + 14\% + 40\% = 59\%$$



340

**Specific Gravity Blending**

| Gradation       | CA 07 | CA 16 | Total |
|-----------------|-------|-------|-------|
| % total mix     | 45%   | 15%   | 60%   |
| (a) %CA         | 75%   | 25%   | 100%  |
| (A) S.G.        | 2.60  | 2.45  |       |
| (a/100) x (A) = | 1.95  | 0.61  | 2.56  |



341

**ASR Expansion Value Blending**

| Gradation       | CA 07 | CA 16 | Total |
|-----------------|-------|-------|-------|
| % total mix     | 45%   | 15%   | 60%   |
| (a) % of CA     | 75%   | 25%   | 100%  |
| (A) Exp Value   | 0.05  | 0.19  |       |
| (a/100) x (A) = | 0.04  | 0.05  | 0.09  |



342

## Aggregate Blend Gradation Characterization

1. "8-18" Rule
2. 0.45 Power Curve


343

## "8-18" Rule

"Percent retained on all sieves, except top and bottom two, should fall with between 8 and 18"


Rule of Thumb: Keep difference between sieves  $\leq 13\%$  (p. E-5).

344

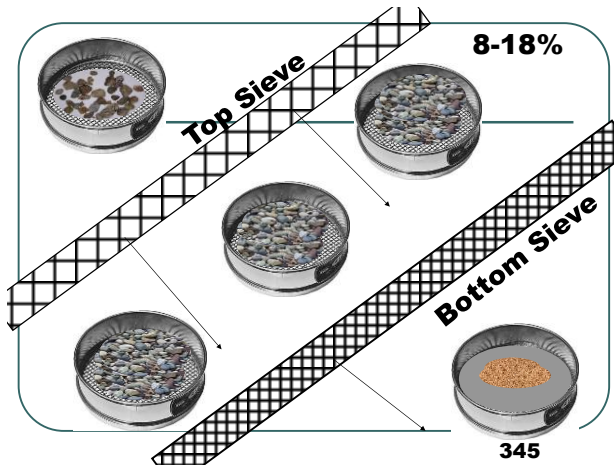

| Sieve    | Pass | Retain | 8-18? |
|----------|------|--------|-------|
| 1 inch   | 100% | 0      | N/A   |
| 3/4 inch | 92%  | 8%     | N/A   |
| 1/2 inch | 62%  | 30%    | N     |
| 3/8 inch | 47%  | 15%    | Y     |
| No. 4    | 40%  | 7%     | N     |
| No. 8    | 37%  | 3%     | N     |
| No. 16   | 32%  | 5%     | N     |
| No. 30   | 22%  | 10%    | Y     |
| No. 50   | 6%   | 16%    | Y     |
| No. 100  | 2%   | 4%     | N/A   |
| No. 200  | 1.0% | 1%     | N/A   |


346

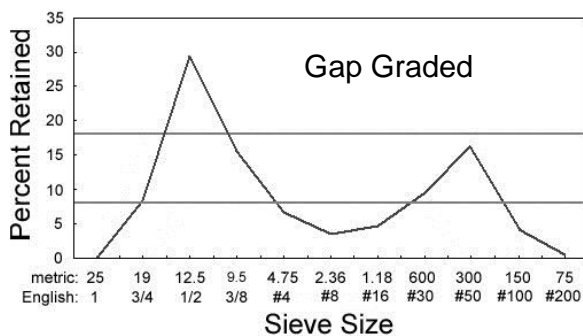


347

| Sieve    | Pass | Retain | 8-18? |
|----------|------|--------|-------|
| 1 inch   | 100% | 0      | N/A   |
| 3/4 inch | 94%  | 6%     | N/A   |
| 1/2 inch | 72%  | 22%    | N     |
| 3/8 inch | 59%  | 13%    | Y     |
| No. 4    | 44%  | 15%    | Y     |
| No. 8    | 37%  | 7%     | N     |
| No. 16   | 32%  | 5%     | N     |
| No. 30   | 23%  | 9%     | Y     |
| No. 50   | 6%   | 17%    | Y     |
| No. 100  | 2%   | 4%     | N/A   |
| No. 200  | 1.0% | 0.9%   | N/A   |

348

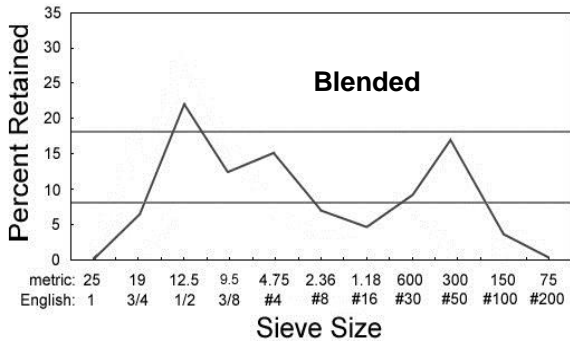

349

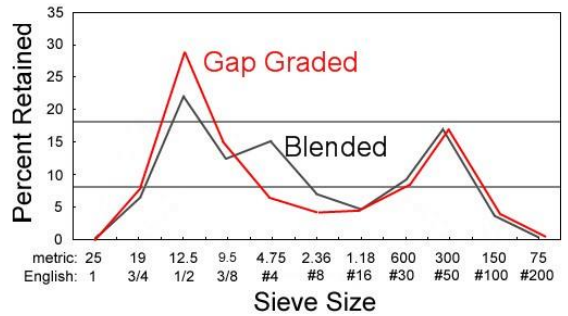

350

### Fine Aggregate and Air

Amount passing #30 and retained on the #50 is critical for holding entrained air.

For this blend:

P#30 = 23%

P#50 = 6%

Retained on #50 = 17%

351

### 0.45 Power Curve

- Y = Percent Passing each Sieve
- X = Sieve Size raised to the 0.45 power
- Maximum density line plotted from origin to Nominal Maximum Aggregate Size (NMAS) for PCC.

352

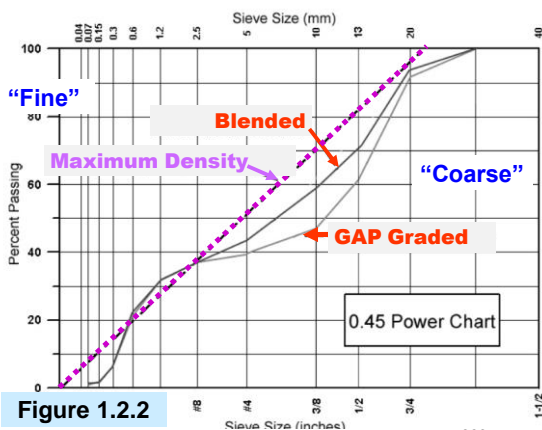


Figure 1.2.2

### 7.0 Design Strength

- Section 7 (Pg. 41)
- Appendix N




354

## Statistics - Appendix N

- Accuracy
- Precision
- Standard deviation
- Averages (Median & Mean)
- Bell curves

355

## What Do Test Results Mean?

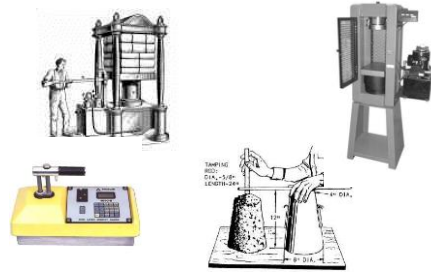


356

## What Time is it?



357


## Normal Distribution

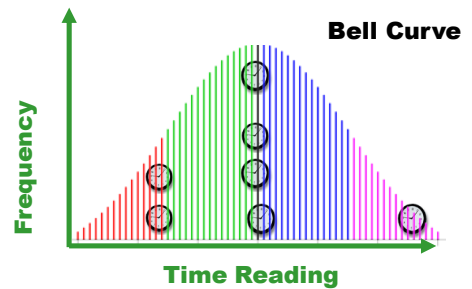

358

## Language of Statistics


- Average
- Precision
- Accuracy
- Standard Deviation.

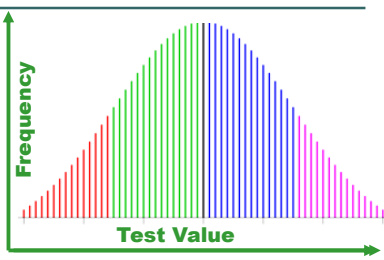

Normal Distribution

359

## Average

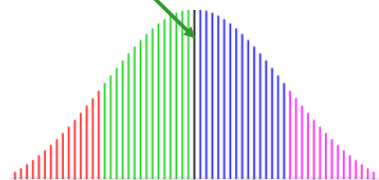


360

## Precision and Accuracy

- Precision - Variability of repeating same measurement
- Accuracy - Conformity to the true value
- Bias - Deviation from the true value


361

## Precise

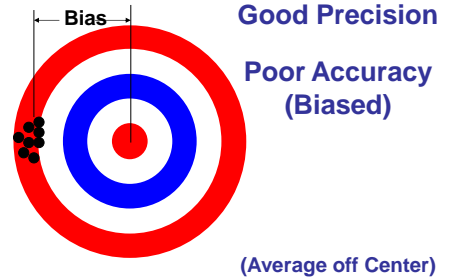

362

## Accurate




(Average on Center)

363

## Precise and Accurate

Good Precision  
Good Accuracy  
(Unbiased)



(Average on Center)

364

## Standard Deviation Appendix N-2


(f) spread of test results from the average.

$$\text{sum} = \sum_{i=1}^{n=6} (\bar{X} - x_i)^2$$

$$\text{standard deviation } S = \sqrt{\frac{\text{sum}}{(n-1)}}$$


365

## Standard Deviation

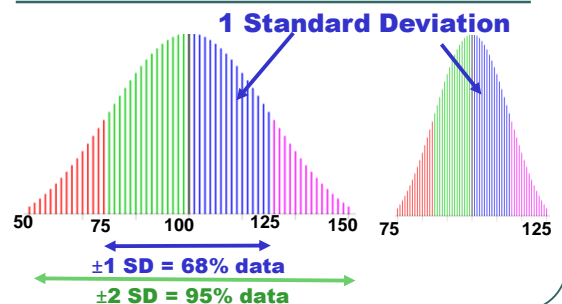


366

### Average Strength and Standard Deviation of 3 mixes

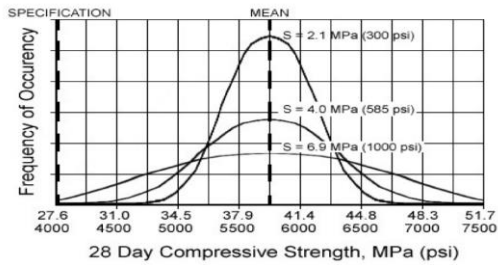


367

### IDOT Strength Specification

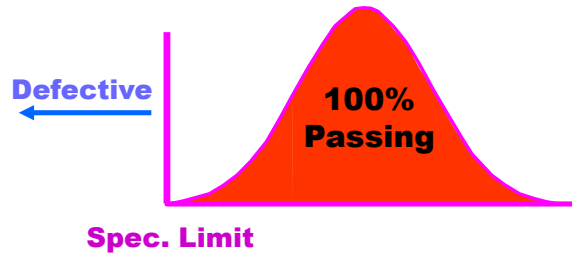

368

### Minimum Strength and Standard Deviation

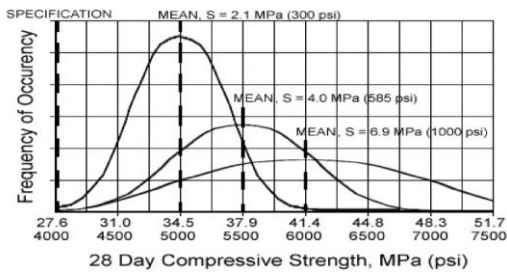

369


### 7.0 Design Target Strength (Pg. 41)

#### ACI 318 (Required for Ternary mix designs)

- Average of 3 tests may not be below minimum spec. (test = 2 cylinders)
- No single test can exceed 500 psi below minimum spec
- @ 14 days for most IDOT mixes
- @ 28 days for > 4,000 psi design

370

### Statistical Approach – ACI 318

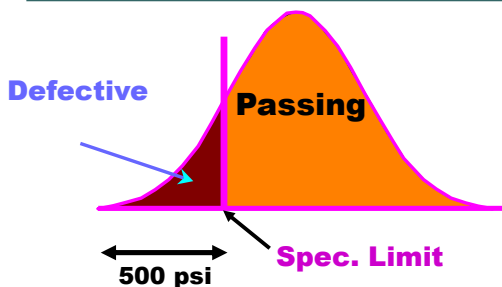

371

### Improving confidence in PCC Strength

1. Increase average strength, or
2. Decrease standard deviation

372

## 7.0 Statistical Analysis of Strength (ACI 318)

- A statistical analysis of strength is strongly recommended when developing a new mix design,

373

## Target Strength (<15 Tests)

| Less Than 15 Tests or No Test Data Available | Mix Design Target Strength      |
|--|---------------------------------|
| If $f'_c < 3,000$ psi                        | $f'_{cr} = f'_c + 1,000$ psi    |
| If $f'_c$ is 3,000 – 5,000 psi               | $f'_{cr} = f'_c + 1,200$ psi    |
| If $f'_c > 5,000$ psi                        | $f'_{cr} = 1.10 f'_c + 700$ psi |

$f'_{cr}$  may be adjusted based on statistical analysis per ACI 318 (>15 batches; 30+ optimum)

374

## The End Part 1



375





**PCC Level III  
PowerPoint  
Handout  
Specialty Mixes**

**2015-2016**




### 3.0 Specialty Mixes (Pg. 32/Appendices)



1

### Specialty Mixes

- High-Early Strength (Section 3.1)
- CAM II (Appendix F)
- CLSM (Appendix G)
- Stamped/Colored Concrete (Appendix H)
- Revetment Mats (Appendix I)
- Pipe Lining Grout (Appendix J)
- Cellular Concrete (Appendix K)
- Class SI Between Precast Boxes (Appendix L)



More >>>>

2

### More.....Specialty Mixes

- Pervious Concrete (Appendix M)
- Latex Concrete (Appendix P)
- Self-Consolidating Concrete (Section 1020)
- Mass Concrete
- Structural Concrete Mixes
- Patching Mixes
- White Topping
- Roller-Compacted Concrete

3

### High-Early Strength Concrete (3.1 – Pg. 32)

Need 48-hr strength?

3 OPTIONS:

1. Use Type III high-early strength cement
2. Use a higher cement content Type I cement mix
  - 7-bag mix (658 Pounds)
  - Less FA Water 4.9 gal/cwt
  - WR admixture or superplasticizer, if permitted)
3. Use approved accelerator



4

### CAM II – Cement Aggregate Mixture (Appendix F)

- Stabilized Subbase, Section 312.09
- No basic water, mortar factor, or strength requirement
- Minimum cement 170 lbs. per yard
- 3 trial mixes recommended – with and without fly ash
- Slump 1-3 inches
- Air 7-10%



5

### CAM II

- Dept. will conduct freeze-thaw tests
- ASR applies
- Dept. will perform one set of mix designs with contractor's three cement ranges.



6

## CLSM – Controlled Low Strength Material (Appendix G)

### “Flowable Fill” - Section 1019

- No design procedure
- 3 proportion options offered
- Design criteria
  - ≥ 7 inch flow (IL Test Method)
  - 0-25% air
  - ≤ 1.5 in./blow dynamic cone penetrometer
  - 30-150 psi strength @ 28 and 180 days.

7

## CLSM – Controlled Low Strength Material (Appendix G)

1019.06 Contractor Mix Design. A Contractor may submit their own mix design and may propose alternate fine aggregate materials, fine aggregate gradations, or material proportions. Article 1020.05(a) shall apply and a Level III PCC Technician shall develop the mix design.

The mix design shall include the following information.

- (a) Source of materials.
- (b) Gradation of fine aggregate.
- (c) Specific gravities, material proportions, and any other parameters used in the mix design process.
- (d) Type and proposed dosage of admixtures.
- (e) Target flow and air content.
- (f) Test data indicating compressive strength at 28 and 180 days.

8

## CLSM Mix Properties



- Self-leveling
- Self-compacting
- Able to readily fill voids
- Minimum bleeding and shrinkage

9

## CLSM Uses

- Backfilling utility trenches.
- Backfilling abandoned vaults and pipes.
- Backfilling underground tanks.
- Structural backfill under/around over-excavated foundations.
- Backfilling washed out or undermined areas.


10

## Workable/Diggable



11

## CLSM Bonus Benefits



- Reduce traffic inconvenience
- Safer working environment
- Easily 'dig-able' or removable
- Fewer pavement failures, fewer future expenses, fewer delays

12

### CLSM Mix Design Options

|         | Mix 1      | Mix 2      | Mix 3      |
|---------|------------|------------|------------|
| Cement  | 50 lb.     | 125 lb.    | 40 lb.     |
| Fly Ash | 125 lb.    |            | 125 lb.    |
| FA      | 2900 lb.   | 2500 lb.   | 2500 lb.   |
| Water   | 50-65 gal. | 35-50 gal. | 35-50 gal. |
| Air     | 0          | 15-25 %    | 15-25 %    |

13

### CLSM-Type Products




- Flowable Fill
- Flash Fill
- FlowFill
- Geofill
- Redi-Fill.



14

### Stamped/Colored Concrete (Appendix H)

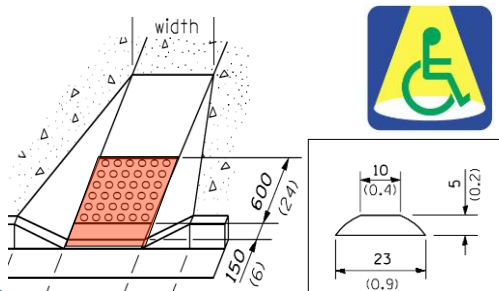

15

### Curb Ramps/ Colored Concrete

- Article 424.08 - concrete no longer required for domed ramps.
- Mix design guidelines Appendix H.
- See District for Special Provision



16

### Fabric Formed Revetment Mats (Appendix I)

- Section 285
- No formal mix design
- 2,500 psi, pumpable "mortar"
- Mix options:
  1. Cement only
  2. Cement + Fly Ash
- 6.0-9.0 % air
- 0.60 max. W/C ratio

17

### Pipe Lining Options BDE 80315

#### "SECTION 543. INSERTION LINING OF CULVERTS

#### 543.02 Materials

- (g) Grout Mixture ..... 1024.01
- (h) Portland Cement Concrete ..... 1020
- (i) Controlled Low-Strength Material ..... 1019
- (j) Cellular Concrete ..... 1029

18

### Pipe Lining - Grout Mixture (Appendix J)

- Article 1024.1
- 150 psi @ 28 days min.
- 6.50 cwt/yd<sup>3</sup>
- 80% fly ash replacement allowed
- 0.60 max. W/C ratio
- 6.0-9.0% air
- Trial Batch Required.

19

### Cellular Concrete (Appendix K)

“Engineered Fill” Lightweight “foam” concrete

- Not Article 1029
- Proprietary mixes
- 4.0-6.5 cwt
- 65% Fly Ash replacement
- 0.50-0.60 W/C ratio
- 20-70% air voids structure
- Fine Aggregate is optional
- Proprietary foam admixture

20

### Class SI PCC Between Precast Concrete Box Culverts (Appendix L)

- Article 540.06 – Multi-Cells (rows)
- “Maximum Agg. Size 3/8-inch”
- CM16 (finer) or 100% FA
- Higher H<sub>2</sub>O demand
- Start with CA basic water 0.4 gal/cwt.



3-inch space between rows

21

### Pervious Concrete (Appendix M)



No IDOT Spec.



22

### Pervious Concrete

**Green Alley**

- No formal design procedure
- Project-specific Special Provision
- Single CA (usu. CM13)
- Typical: 450# Cement/100 # GGBFS + fibers
- Hydration stabilizer
- 2,000 – 3,000 psi
- 18-25% voids structure
- Can use transit mixer, mobile mixer, or dump

23

### Pervious Examples



Center Strip



Full Width



Certification Program

24

## Self-Consolidating Concrete (SCC)



25

## SCC

Can flow around reinforcement and consolidate without additional effort and without segregation



26

## SCC for Cast-in-place Construction

Article 1020.04

Usage –BS, PC, PS, DS, & SI

Reduces:

- Equipment use
- Construction time
- Labor
- Construction noise, vibration
- Segregation, bug holes


27

## Materials & Design

- High range W-R, or
- High range W-R admixture + separate viscosity modifying admixture
- CA 100% <12.5 mm 95% <19 mm
- FA 50% Max. total aggregate
- Maximum cement factor 7.05 cwt/cu yd
- Maximum water/cement ratio 0.44
- Special design and QC tests

28

## Visual Stability Index

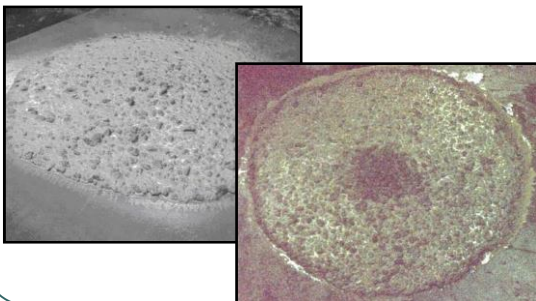

29

## Slump Flow Range 22 to 28 in.



30

## J-Ring

(J-Ring Flow - Slump flow)  $\leq 2''$



31


## L-Box

Blocking Ratio (A/B) min. 80%



32

## Hardened Visual Stability Index



33

## Column Segregation

- Optional Test
- Wash concrete from each section from each section through #4 sieve
- Difference in retained weight of CA cannot exceed 15% Index



34

## Mass Concrete (Pg. 35)

- Class MS concrete replaced with a spec for "massive" pours with least dimension  $>5$  ft.
- Drilled shaft, foundation, footing, substructure, superstructure
- Temperature restrictions
- Pre-cooling & post-cooling measures
- Larger aggregate, uniformly graded
- More FDMs allowed, less total cementitious

35

## Structural Concrete Mixes *Guide Bridge Special Provisions*

- Bridge Deck Microsilica Overlay
- Bridge Deck Latex Concrete Overlay
- Bridge Deck High-Reactivity Metakaolin Overlay
- Bridge Deck Thin Polymer Overlay
- High Performance Concrete Structures
- Deck Slab Repair

36



### Bridge Deck Latex Concrete (Appendix P)


|        |  |             |
|--------|--|-------------|
| CM13   | 1,267 lbs. (42-50% by weight of total aggregate) |             |
| FM02   | 1,544 lbs. (≥ 50% of agg.)                       |             |
| Cement | 658 lbs.   | C.F. = 6.58 |
| Water  | 15.7 gal   |             |
| Latex  | 24.5 gal (c. 54% water)                          | W/C = 0.37  |
| Air    | 0  |             |

CA weights adjusted for solids in latex

37

### Concrete Patches

- PP-1
- PP-2
- PP-3
- PP-4
- PP-5

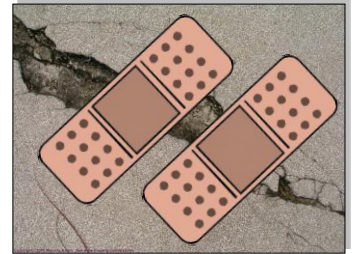

38

### Concrete Patches

- PP-1 Standard patch - Type I cement (7.0 bag) 48 hr. opening/final strength. Type C fly ash or GGBFS allowed. Most economical.
- PP-2 Same-day opening (7.8 bag) 24 hr. final strength Non-chloride accelerator (Chloride accelerator only via S.P.) Lower durability, seldom used

39

### Concrete Patches

- PP-3 Same-day Opening – 16 hr. final Strength Type III – High-early strength cement Slag & microsilica required for strength Non-chloride accelerator required Higher durability, seldom used (requires extra silo)
- PP-4 Rapid-hardening cement- 8 hr. final strength Mobile mixer only Product from “Approved List of Packaged, Dry, Rapid-Hardening Cementitious Materials”

40

### PP-5

- Calcium Aluminate Cement – High strength/ sensitive to admixtures
- 4 Hour strength
- Mobile mixer required
- Suitable for low temperature placement
- Proprietary accelerator and superplasticizer

41

### Patch Opening Strength Specs Section 701.17

| Class of Conc. | Use                       | Specification Section Reference | Cement Factor<br>cw/cu yd<br>(3) | Water / Cement Ratio<br>lb/b<br>in. | S<br>i<br>u<br>m<br>p | Mix Design Compressive Strength (Flexural Strength)<br>psi, minimum<br>Days | Air Content %  | Coarse Aggregate Gradations (14) |
|----------------|---------------------------|---------------------------------|----------------------------------|-------------------------------------|-----------------------|---|--|----------------------------------|
|                |                           |                                 |                                  |                                     |                       |   |  |                                  |
| PP             | Pavement Patching         |                                 |                                  | 22,100                              |                       |   |  |                                  |
|                | Bridge Deck Patching (10) |                                 |                                  | (4150)                              |                       |   |  |                                  |
|                | PP-1                      |                                 |                                  |                                     |                       | at 48 hours   | 3,200 psi open<br>1,600 psi open<br>3,200 psi @ time |                                  |
|                | PP-2                      |                                 |                                  |                                     |                       | at 24 hours   |  |                                  |
|                | PP-3                      |                                 |                                  |                                     |                       | at 16 hours   |  |                                  |
| PP-4           |                           |                                 |                                  |                                     | at 8 hours            |   |  |                                  |
| PP-5           |                           |                                 |                                  |                                     | at 4 hours            |   |  |                                  |

42

## Opening to Traffic (Section 701.17)

- i. **Strength Tests.** For patches constructed with Class PP-1 concrete, the pavement may be opened to traffic when test specimens have obtained a minimum flexural strength of 600 psi (4,150 kPa) or a minimum compressive strength of 3200 psi (22,100 kPa) according to Article 1020.09.

For patches constructed with Class PP-2, PP-3, PP-4, or PP-5 concrete, the pavement may be opened to traffic when test specimens have obtained a minimum flexural strength of 250 psi (1725 kPa) or a minimum compressive strength of 1600 psi (11,000 kPa) according to Article 1020.09. However, the concrete mixture shall obtain a minimum flexural strength of 600 psi (4150 kPa) or a minimum compressive strength of 3200 psi (22,100 kPa) in the time specified in Table 1 of Article 1020.04.

43

## White Topping Special Provision 80353

### PORTLAND CEMENT CONCRETE INLAY OR OVERLAY (BDE)

Effective: January 1, 2015  
Revised: April 1, 2016

44

## White Topping



Illinois Department of Transportation  
Memorandum

To: Regional Engineers  
From: Omar M. Osman *Omar M. Osman*  
Subject: Special Provision for Portland Cement Concrete Inlay or Overlay  
Date: January 8, 2016

This special provision was developed by the Bureau of Materials & Physical Research as an alternative rehabilitation strategy to hot-mix asphalt overlays on pavements or intersections that have experienced excessive riding. Use of this special provision shall be according to the Bureau of Design and Environment (BDE) Manual, Chapter 53, Section 53-4.08 for use of Portland Cement Concrete Inlay or Overlay.

This special provision has been revised to fit with the 2016 Standard Specifications.

This special provision should be inserted in contracts using Portland Cement Concrete Inlay or Overlay.

The districts should include the BDE Check Sheet marked with the applicable special provisions for the April 22, 2016 and subsequent lettings. The Project Development and Implementation Section will include a copy in the contract.

This special provision will be available on the transfer directory January 8, 2016.

80353m

45

## Mix Characteristics

- **Class PV**
- **Variable design thickness (≥ 4 inches)**
- **Cement factor 6.05 cwt (Central-mixed)**
- **Cement factor reduction < 0.30 cwt**
- **NMAS limited by thickness**
- **Minimum 3000 psi @ 14 days.**
- **Synthetic fibers < 5.0 lb/cu yd**

46

## RCC Roller Compacted Concrete

- **No Slump**
- **Blended Coarse Aggregate**
- **Impermeable**



47

## RCC Roller Compacted Concrete

### ROLLER COMPACTED CONCRETE (BMPR)

Effective: January 17, 2014

| Item  | Criteria   |
|---|--|
| Cement Factor, cwt/cu yd (kg/cu m)                  | 5.35 (320) (Note 1)                                    |
| Water/Cement Ratio, lb/lb (kg/kg)                   | 0.25 - 0.40  |
| Slump, in. (mm)                                     | Not Applicable   |
| Air Content, %                                      | Not Applicable   |
| Coarse Aggregate Gradations                         | CA11   |
| Intermediate Aggregate Gradations                   | CA13, CA14, CA16                                       |
| Fine Aggregate Gradations                           | FA01, FA02, FA20                                       |
| Mix Design Compressive Strength, psi (kPa), minimum | 3,500 (24,000) at 7 days;<br>4,500 (31,000) at 28 days |

Notes: (1) The minimum portland cement content in the mixture shall be 400 lbs/cu yd (237 kg/cu m). A cement factor reduction for using a water-reducing admixture or a high range water-reducing admixture will not be allowed, and Articles 1020.05(c)(5)b. and 1020.05(c)(5)c. will not apply.

48

## Roller Compacted Concrete (RCC)

| Material | WT    | Vol   |
|----------|-------|-------|
| CM11     | 830   | 0.183 |
| CM13     | 850   | 0.187 |
| FM20     | 1,820 | 0.406 |
| Ty 1     | 400   | 0.075 |
| Fly      | 125   | 0.029 |
| Air      | 0     | 0.020 |
| Water    | 168   | 0.100 |
|          | 4,193 | 1.000 |

$M_o = 0.95$



49

## Roller-Compacted Concrete



50

*The End*



51



**PCC Level III  
PowerPoint  
Handout  
Mix Design  
Software**

**2015-2016**



# PCC MIX DESIGN Software V2.4 (2016)



1

# Resources & Downloads

1. Tutorial - Appendix B-A
2. See Section 1.2.1 of Course Manual for downloading instructions



2

## References

Below are reference materials to assist in getting materials approved and IDOT guidelines.

### Guides/Spreadsheets

The following documents are provided as a tool to assist with identifying materials and/or ensuring that correct data is supplied to IDOT.

- Model Quality Control Plan for Concrete Production BMPR PCC04 Template
- PCC Mix Design Spreadsheet
  - PCC Mix Design (V2.4)
  - Tutorial (V2.4)
  - PV Example Mix Design
  - Allowable H2O (V2.2)
  - Blending Aggregates (V2.2)
- PCC Mixer Performance Spreadsheet

The following documents are provided as a tool to assist with identifying materials and/or ensuring that correct data is supplied to IDOT.

- QC/QA Package Downloads

Stay Connected and subscribe for updates:

- Subscribe [subscribe-dot-qcqaupdates@lists.illinois.gov](mailto:subscribe-dot-qcqaupdates@lists.illinois.gov)
- Unsubscribe [unsubscribe-dot-qcqaupdates@lists.illinois.gov](mailto:unsubscribe-dot-qcqaupdates@lists.illinois.gov)

3

PCC Level III Technician Course Manual

Revised February 1, 2016

## APPENDIX B-A

### PCC MIX DESIGN SOFTWARE TUTORIAL

(Version 2.4)

For help, comments, and/or suggestions, please contact:

James M. Krstulovich, Jr.  
IDOT Bureau of Materials and Physical Research  
126 East Ash Street  
Springfield, Illinois 62704  
Phone: (217) 782-7200  
email: [DOT.PCCMIX@illinois.gov](mailto:DOT.PCCMIX@illinois.gov)

!!! IMPORTANT !!! This spreadsheet utilizes macros. Depending on Excel's security settings, the macros may not be enabled. To change the macros settings for Excel, refer to the steps found at the end of this tutorial.

4

## Guide for input for PV Example Problem

**EXAMPLE PROBLEM** Because this is the Producer's or Contractor's mix design number, any reasonably succinct and unique identifier can be used here, as long as it is no more than nine characters long. For this example, we will use **PMC0001PV** (i.e., Pave Masters Co. paving mix #1).

5

## Cell Format / Input

Input

Optional

Calculated / Locked

**RED** Tags  
have  
comments

| ISH | METRIC   |
|-----|--|
|     | krstulovichjm:<br>Contractor/Producer designated mix de  |
| N   | This is NOT the IDOT mix design numbe<br>which will be assigned by the District up<br>of the mix design. |
| 02  |  |
|     | 21622 - CONC PC FASH MSIL  |

6

Unit of Measure for Mix Design Inputs: ENGLISH METRIC FIT TO SCREEN Version 2.3.4

**Step 1.** Mix Design No. m0001  
 IDOT Design No. Not yet assigned  
 Date Created 02/17/2012  
 Concrete Code 21622 - CONC PC FASH MSIL  
 Class (optional, enter up to 5) BS  
 PV - Pavement SC - Seal Coat  
 PP - PCC Patching SI - Structures  
 RR - Railroad PC - Precast  
 BS - Bridge Super PS - Prestressed  
 DS - Drilled Shaft  
 Responsible Location 91 - District 1  
 Lab Type PP - Producer Plant Site Lab  
 Company Name Redi-Maker North Lab  
 Main Office Location Schaumburg  
 Designer Name J Smith  
 Phone 708-555-1234  
 email jsmith@redi-maker.com  
 Mix Producer No 1234-05  
 Name Redi-Maker, Inc.  
 IDOT Engineer Houston  
 Contract No. (optional)

**IMPORTANT:** All worksheets are password protected. Cells highlighted BLUE or GREEN can accept data input. BLUE cells are mandatory. GREEN cells are optional.

**Step 2.** Enter Design Variables View Design Report (English units)  
**Step 3.** Enter Aggregate Information View Design Report (metric units)  
**Step 4.** Enter Finely Divided Minerals & Admixtures View MISTIC Report

For help, comments, and/or suggestions, please contact:  
 James Kratulovich, Bureau of Materials & Physical Research  
 Phone: (217) 782-7200  
 email: PCCMIX@dot.il.gov

**Design Info** 7

**IMPORTANT:** All worksheets are password protected. Cells highlighted BLUE or GREEN can accept data input. BLUE cells are mandatory; GREEN cells are optional.

**Step 2.** Enter Design Variables View Design Report (English units)  
**Step 3.** Enter Aggregate Information View Design Report (metric units)  
**Step 4.** Enter Finely Divided Minerals & Admixtures View MISTIC Report

Getting Around

8

**Also, Navigation Tabs**

Design Info Variables H2O Adj. Agg. Info

FDM & Admix Mix Report (English)

Mix Report (metric) MISTIC Report

9

**1.** Mix Design No. m0001  
 IDOT Design No. Not yet assigned  
 Date Created 02/17/2012  
 Concrete Code 21622 - CONC PC FASH MSIL  
 Class (optional, enter up to 5) BS  
 PV - Pavement SC - Seal Coat  
 PP - PCC Patching SI - Structures  
 RR - Railroad PC - Precast  
 BS - Bridge Super PS - Prestressed  
 DS - Drilled Shaft  
 Responsible Location 91 - District 1  
 Lab Type PP - Producer Plant Site Lab  
 Company Name Redi-Maker North Lab  
 Main Office Location Schaumburg  
 Designer Name J Smith  
 Phone 708-555-1234  
 email jsmith@redi-maker.com  
 Mix Producer No 1234-05  
 Name Redi-Maker, Inc.  
 IDOT Engineer Houston  
 Contract No. (optional)

Basic Information

10

**Design Variables**

|                    |      |              |
|--------------------|------|--------------|
| Batch Size         | 1.00 | cubic yard   |
| Cement Factor      | 6.05 | cwt / cu yd  |
| Mortar Factor      | 0.86 | Typically be |
| Target Air Content | 6.5  | %            |
| Target Slump       |      | in.          |

**Variables**

|                              |                  |
|------------------------------|------------------|
| Cement Factor Adjustment     |                  |
| Initial:                     | 6.05 cwt / cu yd |
| Reduction for Admixture Use: | cwt / cu yd      |
| Addition for Underwater Use: | cwt / cu yd      |
| Final:                       | 6.05 cwt / cu yd |

Cement Factor Reductions

Determine Water Content:  A. Standard Method  B. w/c Ratio Method

FA Type "B" Combination of rounded and angular particles

FA Water Req. 5.3 gal/cwt  
 CA Water Req. gal/cwt  
 Water Reduction 8.0 % [Go to Calculate Water Reduction](#)

Fineness Mod (optional)  
 Admixture W - Water Reducer  
 Fly Ash Class C

11

| Default FA Water Requirements |             |
|-------------------------------|-------------|
| Type A                        | 5.1 gal/cwt |
| Type B                        | 5.3 gal/cwt |
| Type C                        | 5.5 gal/cwt |
| Default CA Water Requirements |             |
| Cr. Stone                     | 0.2 gal/cwt |
| Slag                          | 0.4 gal/cwt |
| Gravel                        | 0.0 gal/cwt |

12





**METRIC UNITS DESIGN REPORT**  
PCC MIX DESIGN

Assigned: 01 MATERIAL: 21622M CONC ASH MS  
CLASS: BS  
LAB: PP Producer Plant Site

% FINE % (Z) MORTAR (TYPE) (L / KG)  
MOD AIR VOIDS CEMENT FACTOR ASH FA FA C

(2)

## Allowable Water Worksheet



Allow H2O Print

**MISTIC DESIGN REPORT**  
PCC DESIGN MIX

MATERIAL: 21622M  
CLASS: BS LAST YR USED  
DISTRICT 1 LAB: PP REVIEWED BY:  
234-05 REDI-MAKER, INC. CONTRACT:

(3)

19

20

Select Water Content Calculation Method  
Standard Method w/c Ratio Method

FA Water Requirement 5.5 gal/cwt  
CA Water Requirement 0.2 gal/cwt  
Water Reduction 10.0 %  
Maximum W/C Ratio 0.44

| Matl Code | SSD Weight lbs / cu yd | Moisture % | Water gal / cu yd |
|-----------|------------------------|------------|-------------------|
| 022ca11   | 2396                   | -2.07      | -5.95             |
| 027fa01   | 749                    | -1.96      | -1.76             |

Water in Admixtures  
Total Cement+FDM 6.05 cwt/cu yd

| Type                          | Product | Dosage Rate oz / cwt of cement+FDM | Water oz H2O / oz of admixture |
|-------------------------------|---------|------------------------------------|--------------------------------|
| AEA                           |         | 6.0                                | 0.7                            |
| A                             |         | 8.0                                | 0.7                            |
|                               |         |                                    | 0.0                            |
|                               |         |                                    | 0.0                            |
| <b>Total Admixture Water:</b> |         | <b>59.29</b>                       | <b>oz per cu yd</b>            |

ILLINOIS DEPARTMENT OF TRANSPORTATION  
WATER/CEMENT RATIO WORKSHEET

Date: 09/05 Ticket No:  
Producer No: Contractor No:  
Producer Name: PCC Ready-Mix Co. Contractor Name:  
Mix Design No: 06PCC034 Resident Engineer: J. Smith  
PCC Level II: Level II Employer:  
Department: Inspector:  
Inspector at Plant: Employer:

|  |      |           |
|--|------|-----------|
| 1. Total Cement + Finely Divided Minerals                        | 605  | lb/cu yd  |
| 2. Maximum w/c ratio   | 0.44 |           |
| 3. Maximum Allowable Total Water* (per cubic yard)               | 32.0 | gal/cu yd |
| 4. Batch Size  | 1.00 | cu yd     |
| 5. Water in FA per Batch   | -1.8 | gallons   |
| 6. Water in CA per Batch   | -6.0 | gallons   |
| 7. Water in Admixture(s) per Batch                               | 0.5  | gallons   |
| 8. Plant Water** per Batch                                       | 38.2 | gallons   |
| 9. Wash Water in Truck per Batch                                 | 0.0  | gallons   |
| 10. Total Water in Batch (at Plant Site)                         | 30.9 | gallons   |
| 11. Maximum Water Allowed per Batch                              | 32.0 | gallons   |
| 12. Maximum Additional Water Allowed per Batch                   | 1.1  | gallons   |
| 13. Water Added to Batch at Jobsite                              | 1.2  | gallons   |
| 14. Water in Admixture(s) Added to Batch at Jobsite (at Jobsite) | 1.2  | gallons   |
| 15. Total Water in Batch   | 32.1 | gallons   |

21

Select Water Content Calculation Method  
Standard Method w/c Ratio Method

FA Water Requirement 5.5 gal/cwt  
CA Water Requirement 0.2 gal/cwt  
Water Reduction 10.0 %  
Maximum W/C Ratio 0.44

| Matl Code | SSD Weight lbs / cu yd | Moisture % | Water gal / cu yd |
|-----------|------------------------|------------|-------------------|
| 022ca11   | 2396                   | -2.07      | -5.95             |
| 027fa01   | 749                    | -1.96      | -1.76             |

22

**Water in Admixtures**

Total Cement+FDM 6.05 cwt/cu yd

| Type                          | Product | Dosage Rate oz / cwt of cement+FDM | Water oz H2O / oz of admixture |
|-------------------------------|---------|------------------------------------|--------------------------------|
| AEA                           |         | 6.0                                | 0.7                            |
| A                             |         | 8.0                                | 0.7                            |
|                               |         |                                    | 0.0                            |
|                               |         |                                    | 0.0                            |
| <b>Total Admixture Water:</b> |         | <b>59.29</b>                       | <b>oz per cu yd</b>            |

23

|  |      |           |
|--|------|-----------|
| 1. Total Cement + Finely Divided Minerals                        | 605  | lb/cu yd  |
| 2. Maximum w/c ratio   | 0.44 |           |
| 3. Maximum Allowable Total Water* (per cubic yard)               | 32.0 | gal/cu yd |
| 4. Batch Size  | 1.00 | cu yd     |
| 5. Water in FA per Batch   | -1.8 | gallons   |
| 6. Water in CA per Batch   | -6.0 | gallons   |
| 7. Water in Admixture(s) per Batch                               | 0.5  | gallons   |
| 8. Plant Water** per Batch                                       | 38.2 | gallons   |
| 9. Wash Water in Truck per Batch                                 | 0.0  | gallons   |
| 10. Total Water in Batch (at Plant Site)                         | 30.9 | gallons   |
| 11. Maximum Water Allowed per Batch                              | 32.0 | gallons   |
| 12. Maximum Additional Water Allowed per Batch                   | 1.1  | gallons   |
| 13. Water Added to Batch at Jobsite                              | 1.2  | gallons   |
| 14. Water in Admixture(s) Added to Batch at Jobsite (at Jobsite) | 1.2  | gallons   |
| 15. Total Water in Batch   | 32.1 | gallons   |

24

Date: (mm/dd/yy) 01/01/06  
 Producer No.:  
 Producer Name: PCC Ready-Mixed Co.  
 Mix Design No.: 50PCC1234  
 PCC Level II:  
 Department  
 Inspector at Plant

**Project Information**

Ticket No.:  
 Contract No.:  
 Contractor Name:  
 Resident Engineer: J. Smith  
 Level II Employer:  
 Inspector  
 Employer:

25

**Illinois Department of Transportation**  
**Water/Cement Ratio Worksheet**

Date: (mm/dd/yyyy) 1/1/2006 Ticket No.:  
 Producer No.: Contract No.:  
 Producer Name: PCC Ready-Mixed Co. Contractor Name:  
 Mix Design No.: 50PCC1234 Resident Engineer: J. Smith  
 PCC Level II: Level II Employer:  
 Department Inspector  
 Inspector at Plant: Employer:

- Total Cement plus Finely Divided Minerals\*, lb/yd<sup>3</sup> (kg/m<sup>3</sup>)..... 605.0 lb/yd<sup>3</sup> (kg/m<sup>3</sup>)  
 \* Fly Ash, Ground Granulated Blast-Furnace Slag, Microsilica, High Reactivity Metakaolin
- Maximum water/cement ratio..... 0.44
- Maximum Allowable Water, gal/yd<sup>3</sup> (L/m<sup>3</sup>)..... 32.0 gal/yd<sup>3</sup> (L/m<sup>3</sup>)  
 English (Line 1 × Line 2) ÷ 8.33  
 Metric: Line 1 × Line 2
- Batch Size, yd<sup>3</sup> (m<sup>3</sup>)..... 1.00 yd<sup>3</sup> (m<sup>3</sup>)
- Water in Fine Aggregate per Batch, gal (L)..... -1.8 gal (L)  
 English: (WFA Moisture ÷ 100) × FA (bd'yd) × Line 4) ÷ 8.33

26

**Blending Aggregates Worksheet**

- Maximum Water Allowed per Batch, gal (L).....  
 Line 3 × Line 4
- Maximum Additional Water Allowed per Batch, gal (L).....  
 Line 11 - Line 10
- Water Added to Batch at Job Site, gal (L).....
- Water in Admixture(s) Added to Batch at Job Site, gal (L).....  
 Refer to Line 7 for calculation.
- Total Water in Batch at Job Site, gal (L).....  
 Line 10 + Line 13 + Line 14

27



28

**AGGREGATE GRADATIONS:**

STEP 1. Enter determine the correct MATERIAL CODE(s) using the drop down menus, or enter it directly.  Check Box if using DROP DOWN MENU

STEP 2. Either calculate the aggregate % PASSING of a known gradation test, or enter it directly.  Check Box if CALCULATE is Present

| 1. MATERIAL CODE: 029cm11 |                 |                     |        |           |           | 2. MATERIAL CODE: 029cm11 |                 |                     |        |           |           |
|---------------------------|-----------------|---------------------|--------|-----------|-----------|---------------------------|-----------------|---------------------|--------|-----------|-----------|
| Sieve Designations        | Weight Retained | Cumulative Wt. Ret. | % Ret. | % Passing | % Passing | Sieve Designations        | Weight Retained | Cumulative Wt. Ret. | % Ret. | % Passing | % Passing |
| 63 mm                     | 2.12            |                     |        |           |           | 63 mm                     | 2.12            |                     |        |           |           |
| 50 mm                     | 2.4             |                     |        |           |           | 50 mm                     | 2.4             |                     |        |           |           |
| 45 mm                     | 1.34            |                     |        |           |           | 45 mm                     | 1.34            |                     |        |           |           |
| 37.5 mm                   | 1.12            |                     |        |           |           | 37.5 mm                   | 1.12            |                     |        |           |           |
| 25 mm                     | 0               | 0                   | 0.0    | 100.0     | 100.0     | 25 mm                     | 0               | 0                   | 0.0    | 100.0     | 100.0     |
| 19 mm                     | 34              | 10                  | 10.0   | 90.0      | 90.0      | 19 mm                     | 34              | 10                  | 10.0   | 90.0      | 90.0      |
| 16 mm                     | 58              | 19                  | 29.0   | 71.0      | 71.0      | 16 mm                     | 58              | 19                  | 29.0   | 71.0      | 71.0      |
| 12.5 mm                   | 17              | 49                  | 48.0   | 52.0      | 52.0      | 12.5 mm                   | 17              | 49                  | 48.0   | 52.0      | 52.0      |
| 9.5 mm                    | 30              | 20                  | 66     | 34.0      | 34.0      | 9.5 mm                    | 30              | 20                  | 66     | 34.0      | 34.0      |
| 6.3 mm                    | 14              | 18                  | 84     | 16.0      | 16.0      | 6.3 mm                    | 14              | 18                  | 84     | 16.0      | 16.0      |
| 4.75 mm                   | 4               | 8                   | 92     | 8.0       | 8.0       | 4.75 mm                   | 4               | 8                   | 92     | 8.0       | 8.0       |
| 2.36 mm                   | 0               | 82                  | 98.2   | 1.8       | 1.8       | 2.36 mm                   | 0               | 82                  | 98.2   | 1.8       | 1.8       |
| 1.18 mm                   | 0               | 83                  | 98.5   | 1.5       | 1.5       | 1.18 mm                   | 0               | 83                  | 98.5   | 1.5       | 1.5       |
| 800 µm                    | 0               | 88.5                | 98.5   | 1.5       | 1.5       | 800 µm                    | 0               | 88.5                | 98.5   | 1.5       | 1.5       |
| 425 µm                    | 0               | 88.5                | 98.5   | 1.5       | 1.5       | 425 µm                    | 0               | 88.5                | 98.5   | 1.5       | 1.5       |
| 300 µm                    | 0               | 88.5                | 98.5   | 1.5       | 1.5       | 300 µm                    | 0               | 88.5                | 98.5   | 1.5       | 1.5       |
| 150 µm                    | 0               | 88.5                | 98.5   | 1.5       | 1.5       | 150 µm                    | 0               | 88.5                | 98.5   | 1.5       | 1.5       |
| 75 µm                     | 0               | 88.5                | 98.5   | 1.5       | 1.5       | 75 µm                     | 0               | 88.5                | 98.5   | 1.5       | 1.5       |
| FIN                       | 1.5             | 100                 |        |           |           | FIN                       | 1.5             | 100                 |        |           |           |
| Total Dry Weight          | 100             |                     |        |           |           | Total Dry Weight          | 100             |                     |        |           |           |

29

**AGGREGATE GRADATIONS:**

STEP 1. Either determine the correct MATERIAL CODE(s) using the drop down menus, or enter it directly.  Check Box if using DROP DOWN MENU

Material: 0 - Aggregate  
 Quality Level: 2 - A Quality  
 Material Type: 9 - Special Agg.  
 Aggregate Type: C - Coarse  
 Specification: M - Modified or QC/QA


Units: English  
 Gradation: 11  
 Superstructure or Handrail: n/a

1. MATERIAL CODE: 029cm11 029CM11

| Sieve Designations | Weight Retained | Cumulative Wt. Ret. | % Ret. | % Passing | % Passing |
|--------------------|-----------------|---------------------|--------|-----------|-----------|
| 63 mm              | 2 1/2 in.       |                     |        |           |           |
| 50 mm              | 2 in.           |                     |        |           |           |
| 45 mm              | 1 3/4 in.       |                     |        |           |           |
| 37.5 mm            | 1 1/2 in.       |                     |        |           |           |
| 25 mm              | 1 in.           | 0                   | 0      | 100.0     | 100.0     |
| 19 mm              | 3/4 in.         | 10                  | 10.0   | 90.0      | 90.0      |


30

### 8-18 Rule

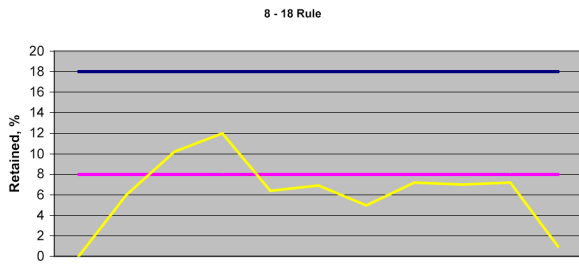

31

### 0.45 Power Curve

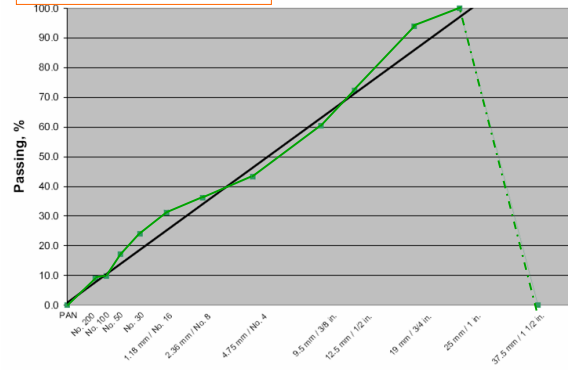

32

## Other Design Software & Information – (see Workbook 2.1)

- **COST** - FHWA and NIST
- **COMPASS** - The Transtec Group, Inc. through funding FHWA.
- **ConcreteWorks** - Concrete Durability Center at the Univ. of Texas

33

# FINISH



34

# Table of Contents

## Homework and Forms

|                                      | Page       |
|--------------------------------------|------------|
| Example Problem Solution.....        | HW-1       |
| BS Mix Homework Problem.....         | HW-2       |
| Ternary Mix Problem.....             | HW-3       |
| Homework Problem 1 – Blending.....   | HW-4       |
| 8-18 Form for Blending homework..... | HW-5       |
| 0.45 Form for Blending homework..... | HW-6       |
| Blank mix design worksheets.....     | HW-7, HW-8 |

## Example Problem Solution - PCC Level III

|                               |                  |   |                              |
|-------------------------------|------------------|---|------------------------------|
| <b>Given or Calculate:</b>    |                  |   |                              |
| Mix Plant Type:               | <b>Central</b>   |   |                              |
| Mix Class:                    | <b>PV (Slip)</b> |   |                              |
| Coarse Agg:                   | <b>020CA07</b>   | G <sub>SSD</sub> :                          | <b>2.68</b>                  |
| Fine Agg:                     | <b>027FA01</b>   | G <sub>SSD</sub> :                          | <b>2.66</b>                  |
| Cement                        | <b>Ty 1</b>      | SG:   | <b>3.15</b>                  |
| FDM1                          | <b>Fly C</b>     | SG:   | <b>2.61</b>                  |
| FDM2                          |                  | SG:   |                              |
| CA Voids:                     | <b>0.37</b>      |   |                              |
| Mortar Factor:                | <b>0.83</b>      |   |                              |
|                               |                  | CA Type:                                    | <b>Gravel</b>                |
|                               |                  | FA Type:                                    | <b>B</b>                     |
|                               |                  | Use 6% water adjustment                     |                              |
|                               |                  | Exp. Group:                                 | <b>0.05</b>                  |
|                               |                  | Exp. Group:                                 | <b>&lt;0.16</b>              |
|                               |                  | Alkali:                                     | <b>&gt;0.60</b>              |
|                               |                  | Alkali:                                     |                              |
|                               |                  | Alkali:                                     |                              |
|                               |                  | Aggr. Group:                                | <b>II</b>                    |
| <b>Specification look-up:</b> |                  |   |                              |
| Cement Factor                 | <b>5.65</b>      | cwt/YD <sup>3</sup>                         |                              |
| Allowed CF Reduction (W-R)    | <b>0.30</b>      | cwt/YD <sup>3</sup>                         |                              |
| FDM Replacement %             | <b>25</b>        | %   |                              |
| FDM Replacement Ratio         | <b>1.0 (1:1)</b> |   |                              |
| W/C Ratio                     | <b>0.42</b>      | Max   |                              |
|                               |                  | <b>25% FDM replacement required for ASR</b> |                              |
|                               |                  | Mitigation Option                           | <b>2</b>                     |
|                               |                  | Target Air Content                          | <b>6.5</b> %                 |
|                               |                  | Target Slump                                | <b>0.5-2.5</b> in.           |
|                               |                  | Min. Comp. Strength                         | <b>3,500 @ 14</b> PSI @ days |

### Calculations:

#### 1.0 Cement

|     |                        |              |                     |                      |
|-----|------------------------|--------------|---------------------|----------------------|
| 1.1 | Starting CF            | <u>5.65</u>  | cwt/YD <sup>3</sup> |                      |
| 1.2 | - Reduction for W-R    | <u>0.30</u>  | cwt/YD <sup>3</sup> |                      |
| 1.3 | = Revised CF           | <u>5.35</u>  | cwt/YD <sup>3</sup> |                      |
| 1.4 | - Replacement w/ FDM1  | <u>1.34</u>  | cwt/YD <sup>3</sup> | ( <u>25</u> % x CF ) |
| 1.4 | - Replacement w/ FDM2  |              | cwt/YD <sup>3</sup> | ( _____ % x CF )     |
| 1.5 | = Final Cement cwt     | <u>4.01</u>  | cwt/YD <sup>3</sup> |                      |
| 1.5 | Wt. Cement             | <u>405</u>   | LB (5#)             | (100 x cwt)          |
| 1.7 | Absolute Volume Cement | <u>0.076</u> | YD <sup>3</sup>     | (Wt ÷ (sg x 1,684))  |

#### 2.0 FDMs

|     |                |              |                 |                             |                           |
|-----|----------------|--------------|-----------------|-----------------------------|---------------------------|
| 2.1 | Wt. FDM1       | <u>135</u>   | LB (5#)         | ( <u>25</u> % x Wt Cement ) | <b>535</b> x Repl. Ratio) |
| 2.2 | Abs. Vol. FDM1 | <u>0.031</u> | YD <sup>3</sup> | Wt. ÷ (sg x 1,684)          |                           |
| 2.3 | Wt. FDM2       |              | LB (5#)         | ( _____ % x Wt Cement )     | _____ x Repl. Ratio)      |
| 2.4 | Abs. Vol. FDM2 |              | YD <sup>3</sup> | Wt. ÷ (sg x 1,684)          |                           |

#### 3.0 Water

|     |                              |              |                 |   |
|-----|------------------------------|--------------|-----------------|---|
| 3.1 | Basic Water                  | <u>5.3</u>   | Gal/cwt         | (FA Water <u>5.3</u> + CA Water <u>0.0</u> )                                    |
| 3.2 | - Water adjustment           | <u>0.3</u>   | <u>6</u> %      |   |
| 3.3 | = Basic Water <sub>REV</sub> | <u>5.0</u>   |                 |   |
| 3.4 | Final Water                  | <u>225</u>   | LB              | (CWT <sub>TOTAL</sub> <u>5.4</u> x W <sub>REV</sub> <u>5.0</u> x 8.33)          |
| 3.5 | Abs. Vol. Water              | <u>0.134</u> | YD <sup>3</sup> | ck/ H <sub>2</sub> O/Cement Ratio (H <sub>2</sub> O ÷ Σ Cement+FDM) <u>0.42</u> |

#### 4.0 Air

|     |                              |              |                 |
|-----|------------------------------|--------------|-----------------|
| 4.1 | Percent <u>6.5</u> Abs. Vol. | <u>0.065</u> | YD <sup>3</sup> |
|-----|------------------------------|--------------|-----------------|

#### 5.0 Mortar

|     |                                      |             |  |
|-----|--------------------------------------|-------------|--|
| 5.1 | CA Voids <u>0.37</u> F <sub>CA</sub> | <u>0.63</u> |  |
|-----|--------------------------------------|-------------|--|

|     |   |             |   |
|-----|---|-------------|---|
| 5.2 | % Mortar (M <sub>O</sub> ÷ (M <sub>O</sub> + F <sub>CA</sub> )) | <u>56.8</u> | % |
|-----|---|-------------|---|

#### 6.0 % Coarse Aggregate

|     |              |              |                 |
|-----|--------------|--------------|-----------------|
| 6.1 | CA Abs. Vol. | <u>0.432</u> | YD <sup>3</sup> |
|-----|--------------|--------------|-----------------|

|     |            |              |    |
|-----|------------|--------------|----|
| 6.2 | CA Weight. | <u>1,950</u> | LB |
|-----|------------|--------------|----|

#### 7.0 FA Abs. Vol.

|     |           |              |    |
|-----|-----------|--------------|----|
| 7.1 | FA Weight | <u>1,174</u> | LB |
|-----|-----------|--------------|----|

### 8. MIX DESIGN SUMMARY

|           | <u>Absolute Vol.</u> | <u>WEIGHT</u> |
|-----------|----------------------|---------------|
| Cement    | <u>0.076</u>         | <u>405</u>    |
| FDM1      | <u>0.031</u>         | <u>135</u>    |
| FDM2      |                      |               |
| Water     | <u>0.134</u>         | <u>225</u>    |
| Air       | <u>0.065</u>         | <u>0</u>      |
| Coarse Ag | <u>0.432</u>         | <u>1,950</u>  |
| Fine Ag   | <u>0.262</u>         | <u>1,174</u>  |
|           | <u>1.000</u>         | <u>3,889</u>  |

## BS Homework Problem - PCC Level III

|                               |                  |   |                 |
|-------------------------------|------------------|---|-----------------|
| <b>Given or Calculate:</b>    |                  |   |                 |
| Mix Plant Type:               | <b>Central</b>   |   |                 |
| Mix Class:                    | <b>BS</b>        |   |                 |
| Coarse Agg:                   | <b>022CA11</b>   | G <sub>SSD</sub> :                          | <b>2.69</b>     |
| Fine Agg:                     | <b>027FA02</b>   | G <sub>SSD</sub> :                          | <b>2.65</b>     |
| Cement                        | <b>Ty 1</b>      | SG:   | <b>3.15</b>     |
| FDM1                          | <b>Fly C</b>     | SG:   | <b>2.66</b>     |
| FDM2                          |                  | SG:   |                 |
| CA Voids:                     | <b>0.41</b>      |   |                 |
| Mortar Factor:                | <b>0.86</b>      |   |                 |
|                               |                  | CA Type:                                    | <b>Crushed</b>  |
|                               |                  | FA Type:                                    | <b>B</b>        |
|                               |                  | Use 8% water adjustment                     |                 |
|                               |                  | Exp. Group:                                 | <b>0.05</b>     |
|                               |                  | Exp. Group:                                 | <b>&lt;0.16</b> |
|                               |                  | Alkali:                                     | <b>&gt;0.60</b> |
|                               |                  | Alkali:                                     |                 |
|                               |                  | Alkali:                                     |                 |
|                               |                  | Aggr. Group:                                | <b>I</b>        |
| <b>Specification look-up:</b> |                  |   |                 |
| Cement Factor                 |                  | cwt/YD <sup>3</sup>                         |                 |
| Allowed CF Reduction (W-R)    |                  | cwt/YD <sup>3</sup>                         |                 |
| FDM Replacement %             | <b>30</b>        | %   |                 |
| FDM Replacement Ratio         | <b>1.0 (1:1)</b> |   |                 |
| W/C Ratio                     |                  | Max   |                 |
|                               |                  | <b>25% FDM replacement required for ASR</b> |                 |
|                               |                  | Mitigation Option                           | <b>n/a</b>      |
|                               |                  | Target Air Content                          | _____ %         |
|                               |                  | Target Slump                                | _____ in.       |
|                               |                  | Min. Comp. Strength                         | PSI @ days      |

**Calculations:**

**1.0 Cement**

- 1.1 Starting CF \_\_\_\_\_ cwt/YD<sup>3</sup>
- 1.2 - Reduction for W-R \_\_\_\_\_ cwt/YD<sup>3</sup>
- 1.3 = Revised CF \_\_\_\_\_ cwt/YD<sup>3</sup>
- 1.4 - Replacement w/ FDM1 \_\_\_\_\_ cwt/YD<sup>3</sup> ( 30 % x CF )
- 1.4 - Replacement w/ FDM2 \_\_\_\_\_ cwt/YD<sup>3</sup> ( \_\_\_\_\_ % x CF )
- 1.5 = Final Cement cwt \_\_\_\_\_ cwt/YD<sup>3</sup>
- 1.5 Wt. Cement \_\_\_\_\_ LB (5#) (100 x cwt)
- 1.7 Absolute Volume Cement \_\_\_\_\_ YD<sup>3</sup> (Wt ÷ (sg x 1,684))

**2.0 FDMs**

- 2.1 Wt. FDM1 \_\_\_\_\_ LB (5#) ( 30 % x Wt Cement \_\_\_\_\_ x Repl. Ratio )
- 2.2 Abs. Vol. FDM1 \_\_\_\_\_ YD<sup>3</sup> (Wt. ÷ (sg x 1,684))
- 2.3 Wt. FDM2 \_\_\_\_\_ LB (5#) ( \_\_\_\_\_ % x Wt Cement \_\_\_\_\_ x Repl. Ratio )
- 2.4 Abs. Vol. FDM2 \_\_\_\_\_ YD<sup>3</sup> (Wt. ÷ (sg x 1,684))

**3.0 Water**

- 3.1 Basic Water \_\_\_\_\_ Gal/cwt (FA Water \_\_\_\_\_ + CA Water \_\_\_\_\_ )
- 3.2 - Water adjustment \_\_\_\_\_ 8 %
- 3.3 = Basic Water<sub>REV</sub> \_\_\_\_\_
- 3.4 Final Water \_\_\_\_\_ LB (CWT<sub>TOTAL</sub> \_\_\_\_\_ x W<sub>REV</sub> \_\_\_\_\_ x 8.33)
- 3.5 Abs. Vol. Water \_\_\_\_\_ YD<sup>3</sup> ck/ H<sub>2</sub>O/Cement Ratio (H<sub>2</sub>O ÷ Σ Cement+FDM)

**4.0 Air**

- 4.1 Percent \_\_\_\_\_ Abs. Vol. \_\_\_\_\_ YD<sup>3</sup>

**5.0 Mortar**

- 5.1 CA Voids 0.40 F<sub>CA</sub> \_\_\_\_\_
- 5.2 % Mortar (M<sub>O</sub> ÷ (M<sub>O</sub> + F<sub>CA</sub>)) \_\_\_\_\_ %

**6.0 % Coarse Aggregate**

- 6.1 CA Abs. Vol. \_\_\_\_\_ YD<sup>3</sup>
- 6.2 CA Weight. \_\_\_\_\_ LB

**7.0 FA Abs. Vol.**

- 7.1 FA Weight \_\_\_\_\_ LB

**8. MIX DESIGN SUMMARY**

|           | <u>Absolute Vol.</u> | <u>WEIGHT</u> |
|-----------|----------------------|---------------|
| Cement    | _____                | _____         |
| FDM1      | _____                | _____         |
| FDM2      | _____                | _____         |
| Water     | _____                | _____         |
| Air       | _____                | _____         |
| Coarse Ag | _____                | _____         |
| Fine Ag   | _____                | _____         |
|           | <b>1.000</b>         |               |

# SI Ternary Mix Problem - PCC Level III

|                               |           |   |             |
|-------------------------------|-----------|---|-------------|
| <b>Given or Calculate:</b>    |           |   |             |
| Mix Plant Type:               | Truck-Mix |   |             |
| Mix Class:                    | SI        |   |             |
| Coarse Agg:                   | 020CA11   | G <sub>SSD</sub> :                          | 2.68        |
| Fine Agg:                     | 027FA02   | G <sub>SSD</sub> :                          | 2.64        |
| Cement                        | Ty 1      | SG:   | 3.15        |
| FDM1                          | Fly C     | SG:   | 2.70        |
| FDM2                          | GGBFS     | SG:   | 2.95        |
| CA Voids:                     | 0.39      |   |             |
| Mortar Factor:                | 0.90      |   |             |
|                               |           | CA Type:                                    | Gravel      |
|                               |           | FA Type:                                    | B           |
|                               |           | Use 8% water adjustment                     |             |
|                               |           | <b>ASR INFO</b>                             |             |
|                               |           | Exp. Group:                                 | >0.16-0.27% |
|                               |           | Exp. Group:                                 | <0.16       |
|                               |           | Alkali:                                     | <0.60       |
|                               |           | Alkali:                                     |             |
|                               |           | Alkali:                                     |             |
|                               |           | Aggr. Group:                                | II          |
| <b>Specification look-up:</b> |           |   |             |
| Cement Factor                 |           | cwt/YD <sup>3</sup>                         |             |
| Allowed CF Reduction (W-R)    |           | cwt/YD <sup>3</sup>                         |             |
| FDM Replacement %             | 30        | %   |             |
| FDM Replacement Ratio         | 1.0 (1:1) |   |             |
| W/C Ratio                     |           | Max   |             |
|                               |           | <b>25% FDM replacement required for ASR</b> |             |
|                               |           | Mitigation Option                           | 2           |
|                               |           | Target Air Content                          | %           |
|                               |           | Target Slump                                | in.         |
|                               |           | Min. Comp. Strength                         | PSI @ days  |

**Calculations:**

**1.0 Cement**

- 1.1 Starting CF \_\_\_\_\_ cwt/YD<sup>3</sup>
- 1.2 - Reduction for W-R \_\_\_\_\_ cwt/YD<sup>3</sup>
- 1.3 = Revised CF \_\_\_\_\_ cwt/YD<sup>3</sup>
- 1.4 - Replacement w/ FDM1 \_\_\_\_\_ cwt/YD<sup>3</sup> ( 20 % x CF )
- 1.4 - Replacement w/ FDM2 \_\_\_\_\_ cwt/YD<sup>3</sup> ( 10 % x CF )
- 1.5 = Final Cement cwt \_\_\_\_\_ cwt/YD<sup>3</sup>
- 1.5 Wt. Cement \_\_\_\_\_ LB (5#) (100 x cwt)
- 1.7 Absolute Volume Cement \_\_\_\_\_ YD<sup>3</sup> (Wt ÷ (sg x 1,684))

**2.0 FDMs**

- 2.1 Wt. FDM1 \_\_\_\_\_ LB (5#) ( 20 % x Wt Cement        x Repl. Ratio )
- 2.2 Abs. Vol. FDM1 \_\_\_\_\_ YD<sup>3</sup> Wt. ÷ (sg x 1,684)
- 2.3 Wt. FDM2 \_\_\_\_\_ LB (5#) ( 10 % x Wt Cement        x Repl. Ratio )
- 2.4 Abs. Vol. FDM2 \_\_\_\_\_ YD<sup>3</sup> Wt. ÷ (sg x 1,684)

**3.0 Water**

- 3.1 Basic Water \_\_\_\_\_ Gal/cwt (FA Water \_\_\_\_\_ + CA Water \_\_\_\_\_ )
- 3.2 - Water adjustment \_\_\_\_\_ 8 %
- 3.3 = Basic Water<sub>REV</sub> \_\_\_\_\_
- 3.4 Final Water \_\_\_\_\_ LB (CWT<sub>TOTAL</sub> \_\_\_\_\_ x W<sub>REV</sub> \_\_\_\_\_ x 8.33)
- 3.5 Abs. Vol. Water \_\_\_\_\_ YD<sup>3</sup> ck/ H<sub>2</sub>O/Cement Ratio (H<sub>2</sub>O ÷ Σ Cement+FDM) \_\_\_\_\_

**4.0 Air**

- 4.1 Percent \_\_\_\_\_ Abs. Vol. \_\_\_\_\_ YD<sup>3</sup>

**5.0 Mortar**

- 5.1 CA Voids 0.39 F<sub>CA</sub>        M<sub>O</sub>
- 5.2 % Mortar (M<sub>O</sub> ÷ (M<sub>O</sub> + F<sub>CA</sub>)) \_\_\_\_\_ %

**6.0 % Coarse Aggregate**

- 6.1 CA Abs. Vol. \_\_\_\_\_ YD<sup>3</sup>
- 6.2 CA Weight. \_\_\_\_\_ LB

**7.0 FA Abs. Vol.**

- 7.1 FA Weight \_\_\_\_\_ LB

**8. MIX DESIGN SUMMARY**

|           | <u>Absolute Vol.</u> | <u>WEIGHT</u> |
|-----------|----------------------|---------------|
| Cement    | _____                | _____         |
| FDM1      | _____                | _____         |
| FDM2      | _____                | _____         |
| Water     | _____                | _____         |
| Air       | _____                | _____         |
| Coarse Ag | _____                | _____         |
| Fine Ag   | _____                | _____         |
|           | <b>1.000</b>         | _____         |



## Homework Problem 1 – Blending PCC Level III

**Instructions:**


- Read Appendix E, “Aggregate Blending”
- Use the blank 8-18 and 0.45 Power Charts in Appendix E
- Plot the above product on the charts

The homework will be discussed on the morning of Day 2.

There may be questions about this exercise on the exam.

| <b>Blending Exercise “8-18” and “0.45”</b> |             |               |
|--|-------------|---------------|
| <b>Sieve</b>                               | <b>Pass</b> | <b>Retain</b> |
| 1 inch                                     | 100%        | 0             |
| 3/4 inch                                   | 94%         | 6%            |
| 1/2 inch                                   | 78%         | 16%           |
| 3/8 inch                                   | 60%         | 18%           |
| No. 4                                      | 44%         | 16%           |
| No. 8                                      | 35%         | 9%            |
| No. 16                                     | 27%         | 8%            |
| No. 30                                     | 20%         | 7%            |
| No. 50                                     | 6%          | 14%           |
| No. 100                                    | 2%          | 4%            |
| No. 200                                    | 1.0%        | 1.0%          |


Rule 8-18 Blank Form

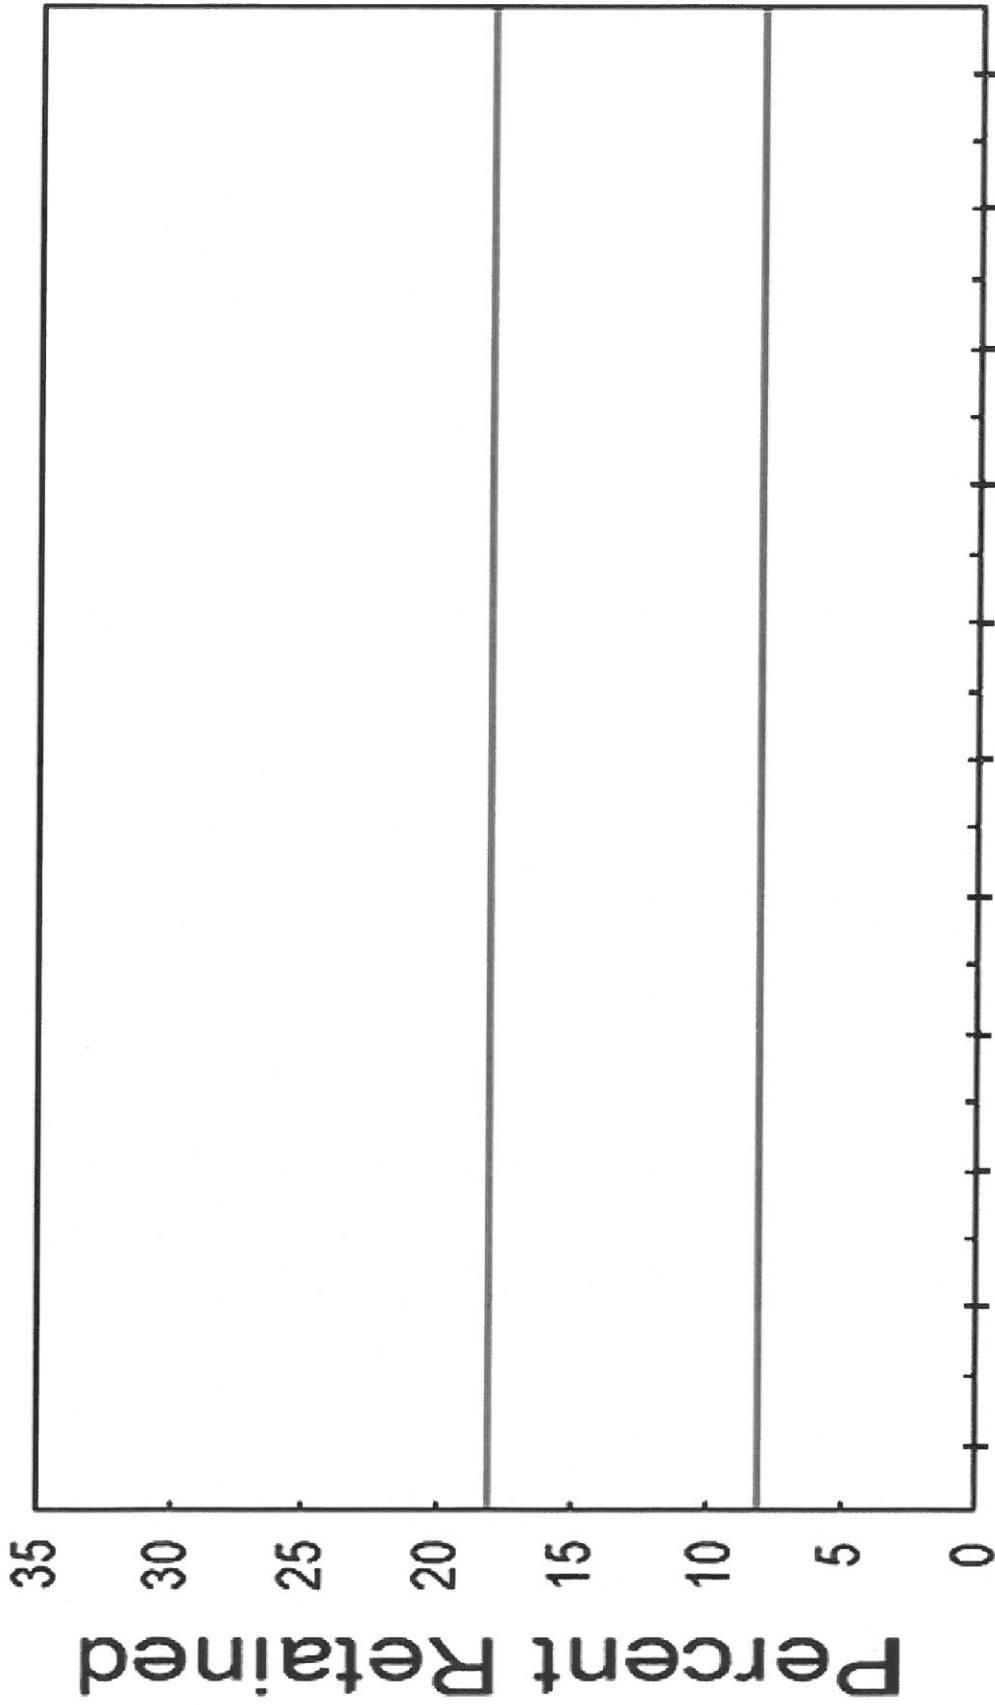

metric: 25 19 12.5 9.5 4.75 2.36 1.18 600 300 150 75  
English: 1 3/4 1/2 3/8 #4 #8 #16 #30 #50 #100 #200

Sieve Size

# 0.45 Power Curve Blank

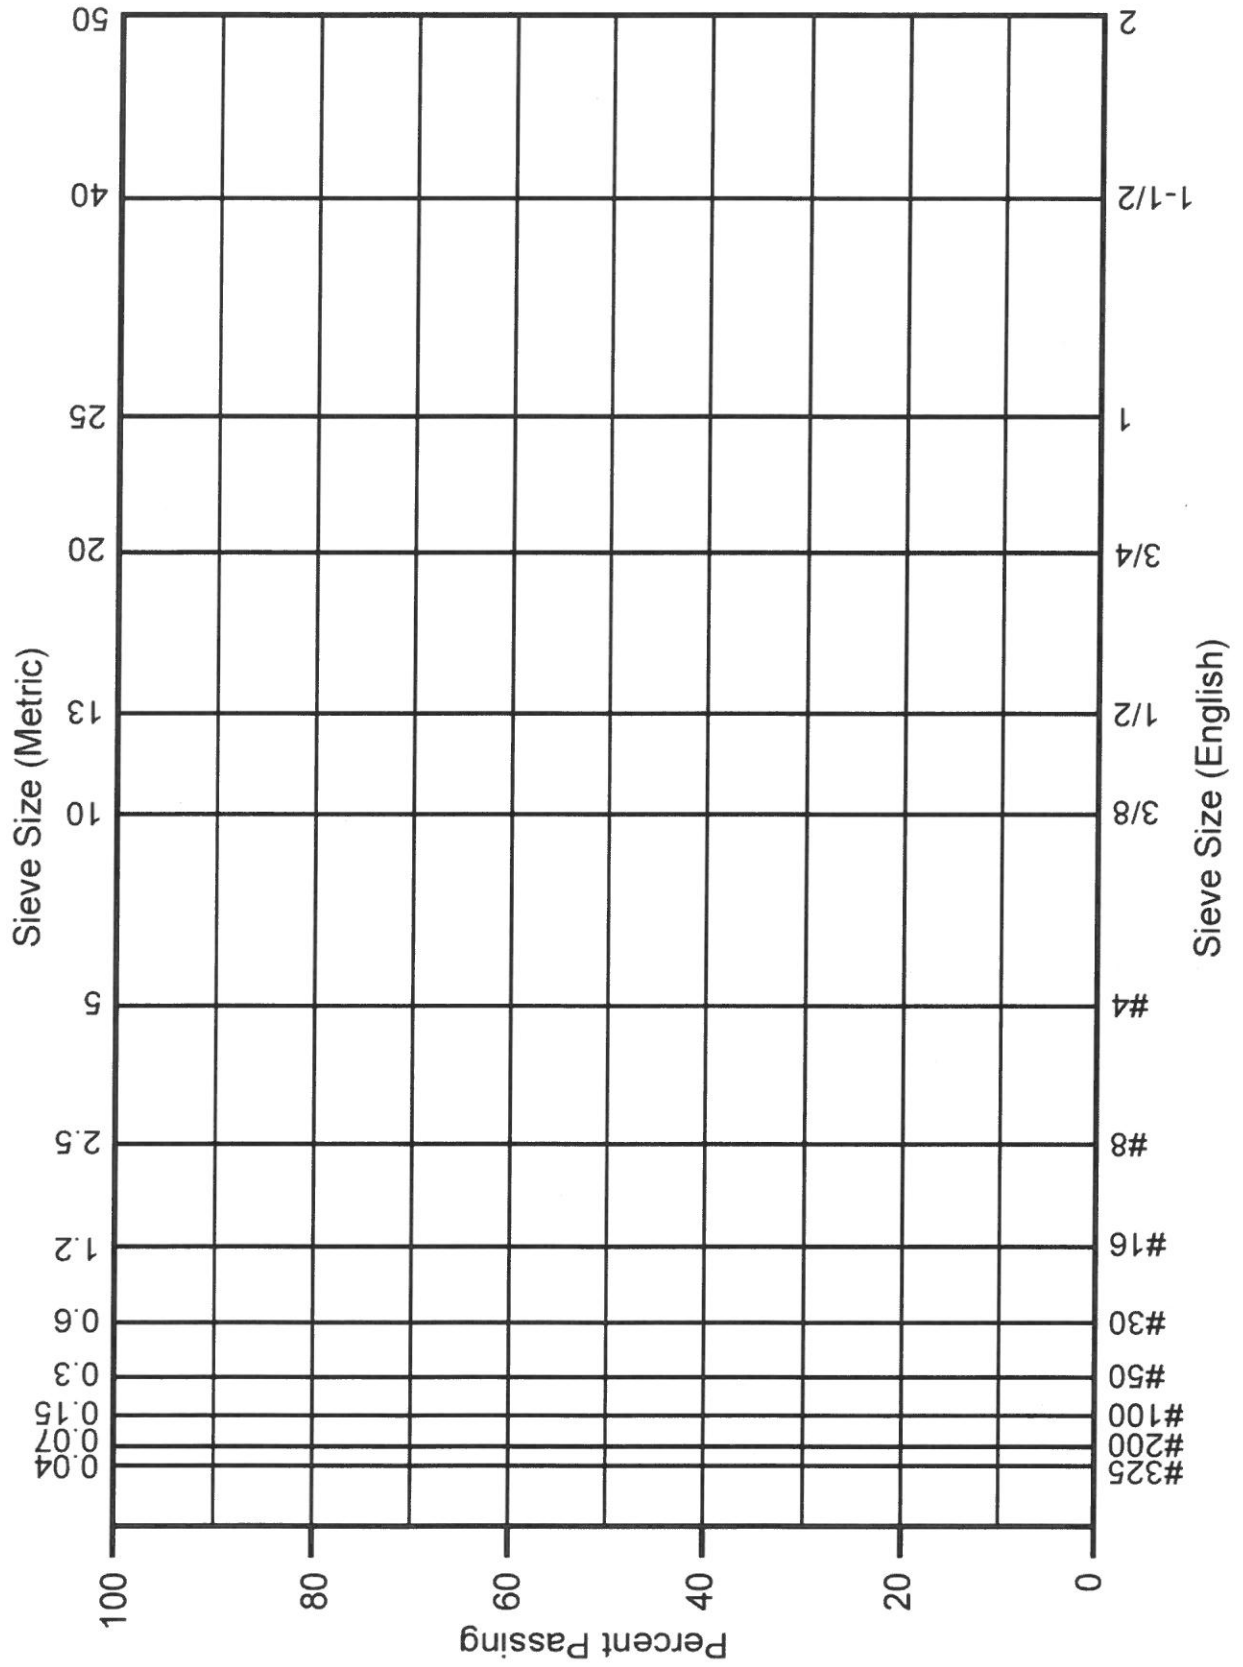

# Mix Design Worksheet - PCC Level III

|                            |                          |                   |                    |
|----------------------------|--------------------------|-------------------|--------------------|
| <b>Given or Calculate:</b> |                          |                   |                    |
| Mix Plant Type: _____      |                          |                   |                    |
| Mix Class: _____           |                          |                   | <b>ASR INFO</b>    |
| Coarse Agg: _____          | G <sub>SSD</sub> : _____ | Water Type: _____ | Exp. Group: _____  |
| Fine Agg: _____            | G <sub>SSD</sub> : _____ | Water Type: _____ | Exp. Group: _____  |
| Cement _____               | SG: _____                |                   | Alkali: _____      |
| FDM1 _____                 | SG: _____                |                   | Alkali: _____      |
| FDM2 _____                 | SG: _____                |                   | Alkali: _____      |
| CA Voids: _____            |                          |                   | Aggr. Group: _____ |
| Mortar Factor: _____       |                          |                   |                    |

|  |                     |                                      |
|--|---------------------|--------------------------------------|
| <b>Specification look-up:</b>          |                     |                                      |
| Cement Factor _____                    | cwt/YD <sup>3</sup> |                                      |
| Allowed CF Reduction (W-R) _____       | cwt/YD <sup>3</sup> |                                      |
| FDM Replacement % _____                | %                   |                                      |
| FDM Replacement Ratio <b>1.0 (1:1)</b> |                     |                                      |
| W/C Ratio _____                        | Max                 |                                      |
|  |                     | Mitigation Option _____              |
|  |                     | Target Air Content _____ %           |
|  |                     | Target Slump _____ in.               |
|  |                     | Min. Comp. Strength _____ PSI @ days |

**Calculations:**

**1.0 Cement**

- 1.1 Starting CF \_\_\_\_\_ cwt/YD<sup>3</sup>
- 1.2 - Reduction for W-R \_\_\_\_\_ cwt/YD<sup>3</sup>
- 1.3 = Revised CF \_\_\_\_\_ cwt/YD<sup>3</sup>
- 1.4 - Replacement w/ FDM1 \_\_\_\_\_ cwt/YD<sup>3</sup> ( \_\_\_\_\_ % x CF)
- 1.4 - Replacement w/ FDM1 \_\_\_\_\_ cwt/YD<sup>3</sup> ( \_\_\_\_\_ % x CF)
- 1.5 = Final Cement cwt \_\_\_\_\_ cwt/YD<sup>3</sup>
- 1.5 Wt. Cement \_\_\_\_\_ LB (5#) (100 x cwt)
- 1.7 Absolute Volume Cement \_\_\_\_\_ YD<sup>3</sup> (Wt ÷ (sg x 1,684))

**2.0 FMDs**

- 2.1 Wt. FDM1 \_\_\_\_\_ LB (5#) ( \_\_\_\_\_ % x Wt Cement \_\_\_\_\_ x Repl. Ratio)
- 2.2 Abs. Vol. FDM1 \_\_\_\_\_ YD<sup>3</sup> (Wt. ÷ (sg x 1,684))
- 2.3 Wt. FDM2 \_\_\_\_\_ LB (5#) ( \_\_\_\_\_ % x Wt Cement \_\_\_\_\_ x Repl. Ratio)
- 2.4 Abs. Vol. FDM2 \_\_\_\_\_ YD<sup>3</sup> (Wt. ÷ (sg x 1,684))

**3.0 Water**

- 3.1 Basic Water \_\_\_\_\_ Gal/cwt (FA Water \_\_\_\_\_ + CA Water \_\_\_\_\_)
  - 3.2 - W-R Reduction \_\_\_\_\_ %
  - 3.3 = Basic Water<sub>REV</sub> \_\_\_\_\_
  - 3.4 Final Water \_\_\_\_\_ LB (CWT<sub>TOTAL</sub> \_\_\_\_\_ x W<sub>REV</sub> \_\_\_\_\_ x 8.33)
- ck/ H<sub>2</sub>O/Cement Ratio (H<sub>2</sub>O ÷ Σ Cement+FDM) \_\_\_\_\_

- 3.5 Abs. Vol. Water \_\_\_\_\_ YD<sup>3</sup>

**4.0 Air**

- 4.1 Percent \_\_\_\_\_ Abs. Vol. \_\_\_\_\_ YD<sup>3</sup>

**5.0 Mortar**

- Mortar Factor \_\_\_\_\_ M<sub>O</sub>
- 5.1 CA Voids \_\_\_\_\_ F<sub>CA</sub>
- 5.2 % Mortar (M<sub>O</sub> ÷ (M<sub>O</sub> + F<sub>CA</sub>)) \_\_\_\_\_ %

**6.0 % Coarse Aggregate**

- 6.1 CA Abs. Vol. \_\_\_\_\_ YD<sup>3</sup>
- 6.2 CA Weight \_\_\_\_\_ LB

**7.0 FA Abs. Vol.**

- 7.1 FA Weight \_\_\_\_\_ LB

**8. MIX DESIGN SUMMARY**

|           | <u>Absolute Vol.</u> | <u>WEIGHT</u> |
|-----------|----------------------|---------------|
| Cement    | _____                | _____         |
| FDM1      | _____                | _____         |
| FDM2      | _____                | _____         |
| Water     | _____                | _____         |
| Air       | _____                | _____         |
| Coarse Ag | _____                | _____         |
| Fine Ag   | _____                | _____         |
|           | <b>1.000</b>         |               |

# Mix Design Worksheet - PCC Level III

**Given or Calculate:**

Mix Plant Type: \_\_\_\_\_  
 Mix Class: \_\_\_\_\_  
 Coarse Agg: \_\_\_\_\_  
 Fine Agg: \_\_\_\_\_  
 Cement \_\_\_\_\_  
 FDM1 \_\_\_\_\_  
 FDM2 \_\_\_\_\_  
 CA Voids: \_\_\_\_\_  
 Mortar Factor: \_\_\_\_\_

G<sub>SSD</sub>: \_\_\_\_\_ Water Type: \_\_\_\_\_  
 G<sub>SSD</sub>: \_\_\_\_\_ Water Type: \_\_\_\_\_  
 SG: \_\_\_\_\_  
 SG: \_\_\_\_\_  
 SG: \_\_\_\_\_

**ASR INFO**

Exp. Group: \_\_\_\_\_  
 Exp. Group: \_\_\_\_\_  
 Alkali: \_\_\_\_\_  
 Alkali: \_\_\_\_\_  
 Alkali: \_\_\_\_\_  
 Aggr. Group: \_\_\_\_\_

**Specification look-up:**

Cement Factor \_\_\_\_\_ cwt/YD<sup>3</sup>  
 Allowed CF Reduction (W-R) \_\_\_\_\_ cwt/YD<sup>3</sup>  
 FDM Replacement % \_\_\_\_\_ %  
 FDM Replacement Ratio **1.0 (1:1)**  
 W/C Ratio \_\_\_\_\_ Max

Mitigation Option \_\_\_\_\_  
 Target Air Content \_\_\_\_\_ %  
 Target Slump \_\_\_\_\_ in.  
 Min. Comp. Strength \_\_\_\_\_ PSI @ days

**Calculations:**

**1.0 Cement**

1.1 Starting CF \_\_\_\_\_ cwt/YD<sup>3</sup>  
 1.2 - Reduction for W-R \_\_\_\_\_ cwt/YD<sup>3</sup>  
 1.3 = Revised CF \_\_\_\_\_ cwt/YD<sup>3</sup>  
 1.4 - Replacement w/ FDM1 \_\_\_\_\_ cwt/YD<sup>3</sup> ( \_\_\_\_\_ % x CF)  
 1.4 - Replacement w/ FDM1 \_\_\_\_\_ cwt/YD<sup>3</sup> ( \_\_\_\_\_ % x CF)  
 1.5 = Final Cement cwt \_\_\_\_\_ cwt/YD<sup>3</sup>  
 1.5 Wt. Cement \_\_\_\_\_ LB (5#) (100 x cwt)  
 1.7 Absolute Volume Cement \_\_\_\_\_ YD<sup>3</sup> (Wt ÷ (sg x 1,684))

**2.0 FMDs**

2.1 Wt. FDM1 \_\_\_\_\_ LB (5#) ( \_\_\_\_\_ % x Wt Cement \_\_\_\_\_ x Repl. Ratio)  
 2.2 Abs. Vol. FDM1 \_\_\_\_\_ YD<sup>3</sup> Wt. ÷ (sg x 1,684)  
 2.3 Wt. FDM2 \_\_\_\_\_ LB (5#) ( \_\_\_\_\_ % x Wt Cement \_\_\_\_\_ x Repl. Ratio)  
 2.4 Abs. Vol. FDM2 \_\_\_\_\_ YD<sup>3</sup> Wt. ÷ (sg x 1,684)

**3.0 Water**

3.1 Basic Water \_\_\_\_\_ Gal/cwt (FA Water \_\_\_\_\_ + CA Water \_\_\_\_\_)  
 3.2 - W-R Reduction \_\_\_\_\_ %  
 3.3 = Basic Water<sub>REV</sub> \_\_\_\_\_  
 3.4 Final Water \_\_\_\_\_ LB (CWT<sub>TOTAL</sub> \_\_\_\_\_ x W<sub>REV</sub> \_\_\_\_\_ x 8.33)  
 ck/ H<sub>2</sub>O/Cement Ratio (H<sub>2</sub>O ÷ Σ<sub>Cement+FDM</sub>) \_\_\_\_\_

**4.0 Air**

4.1 Percent \_\_\_\_\_ Abs. Vol. \_\_\_\_\_ YD<sup>3</sup>

**5.0 Mortar**

Mortar Factor \_\_\_\_\_ M<sub>O</sub>  
 5.1 CA Voids \_\_\_\_\_ F<sub>CA</sub>  
 5.2 % Mortar (M<sub>O</sub> ÷ (M<sub>O</sub> + F<sub>CA</sub>)) \_\_\_\_\_ %

**6.0 % Coarse Aggregate**

6.1 CA Abs. Vol. \_\_\_\_\_ YD<sup>3</sup>  
 6.2 CA Weight \_\_\_\_\_ LB

**7.0 FA Abs. Vol.**

7.1 FA Weight \_\_\_\_\_ LB

**8. MIX DESIGN SUMMARY**

|           | <u>Absolute Vol.</u> | <u>WEIGHT</u> |
|-----------|----------------------|---------------|
| Cement    | _____                | _____         |
| FDM1      | _____                | _____         |
| FDM2      | _____                | _____         |
| Water     | _____                | _____         |
| Air       | _____                | _____         |
| Coarse Ag | _____                | _____         |
| Fine Ag   | _____                | _____         |
|           | <b>1.000</b>         |               |

