
# PCC Level III Technician Course



2024-2025






### Portland Cement Concrete Level III Technician Course "Manual of Instructions for Design of Concrete Mixtures"

# Prepared and Published by Illinois Department of Transportation Bureau of Materials

Springfield, Illinois

January 1, 2025



# LAKE LAND COLLEGE INSTRUCTOR AND COURSE EVALUATION

Course: PCC Level III Technician Course Section:					Date:				
con imp	PURPOSE: The main emphasis at Lake Land College is teaching. In this regard, each instructor must be continuously informed of the quality of his/her teaching and the respects in which that teaching can be mproved. As a student, you are in a position to judge the quality of teaching from direct experience, and in order to help maintain the quality of instruction at Lake Land, you are asked to complete this evaluation.								
DIR	RECTIONS: DO	NOT SIGN YOUR NAME. YO	our frankness and hon	esty are	appre	eciate	d.		
Firs	st, please record	your general impressions and	d/or comments on the	following					
Cou	urse								
Inst	ructor								
inst	ructor and cours	item, circle the number from t e that you are evaluating. Yo ng on the back of this form; pl	ou are strongly encour	aged to m	nake	any c	omme	ents that v	
				WEAL	<b>&lt;</b>		SUPE	RIOR	
<u>OB</u>	JECTIVES AND	APPROPRIATENESS OF T	HE COURSE:						
1.	Clarity of Objectives	The objectives of the course identified. Objectives were		1	2	3	4	5	
2.	Selection content	Content was relevant and method the class.	net the level of	1	2	3	4	5	
<u>OR</u>	GANIZATION A	ND CONTENT OF LESSONS	<u>3</u> :						
3.	Teacher preparation	Instructor was organized an in subject matter and prepar	9	1	2	3	4	5	
4.	Organization of classes	Classroom activities were w clearly related to each other		1	2	3	4	5	
5.	Selection of materials	Instructional materials and r specific, current, and clearly objectives of the course.		1	2	3	4	5	
6.	Clarity of presentation	Content of lessons was pres was understandable to the s		1	2	3	4	5	
7.	Clarity of presentation	Different point of view and/o specific illustrations were us		1	2	3	4	5	

<u>OVER</u>

#### LAKE LAND COLLEGE INSTRUCTOR AND COURSE EVALUATION (PAGE 2)

		WEA	K		SUP	<u>ERIOR</u>
PERSONAL CHARACTERISTICS AND STUDENT RAPPORT:						
8. Vocabu	lary Instructor's vocabulary level was appropriate for the class.	1	2	3	4	5
9. Pupil particip and inte		1	2	3	4	5
10. Persona attribute		1	2	3	4	5
11. Persona attribute		1	2	3	4	5
12. Persona attribute	i i i	1	2	3	4	5
13. Instruct student rapport		1	2	3	4	5
14. Instruct student rapport	1 9	1	2	3	4	5
EXAMINATION	ON:					
15. Exam materia	The exam correlated to the materials being covered in class.	1	2	3	4	5
SUMMARY:						
16. Conside	ring everything, how would you rate this instructor?	1	2	3	4	5
17. Considering everything, how would you rate this course?  1 2 3 4 5					5	
LAPTOP COMPUTER:						
18. If you brought a laptop computer, was the class training 1 2 3 4 5 adequate for learning the PCC Mix Design software?						
<b>COMMENTS</b> : (Please use the area below to add any additional comments regarding the class and exam.)						

# COURSE REQUIREMENTS FOR SUCCESSFUL COMPLETION

#### Student must attend all class sessions.

- PREREQUISITE COURSES Either the Mixture Aggregate Technician Course (3-day) or the Aggregate Technician Course (5-day), and the Portland Cement Concrete Level I & II Technician Courses are required.
- WRITTEN TEST The test is open book. The time limit is 2.5 hours. A minimum grade of 70 is required.

Note: The Department has no out-of-state reciprocity.

- WRITTEN RETEST If the student fails the written test, a retest can be performed. The retest is open book. The time limit is 2.5 hours. A minimum grade of 70 is required. A retest will not be given on the same day as the initial test. A retest must be taken by the end of the academic year that the initial test was taken. The academic year runs from September 1<sup>st</sup> to August 31<sup>st</sup>. Failure of a written retest, or failure to comply with the academic year retest time limit, shall require the student to retake the class and the test. The student shall be required to pay the appropriate fee for the additional class.
- NOTIFICATION The student will be notified by letter of their test score. A certificate
  of completion will be issued if the student passes the course, and 12 professional
  development hours earned will be indicated on the certificate.

This Page Is Reserved

Revised January 1, 2025

## **PREFACE**

This manual has been prepared to train the student to become a Level III Portland Cement Concrete (PCC) Technician. The main focus of the manual is to provide a procedure to design concrete mixes for Illinois Department of Transportation (herein referred to as "IDOT" or the "Department") Quality Control/Quality Assurance (QC/QA) projects. The manual provides basic information and is intended to be a useful reference tool.

The manual summarizes various specifications, but project contract specifications shall govern in all cases. This manual is applicable for the <u>January 1, 2022, Standard Specifications for Road and Bridge Construction</u> (link embedded) and the <u>Supplemental Specifications and Recurring Special Provisions Adopted January 1, 2025</u> (link embedded).

The American Concrete Institute (ACI) procedure for determining the mix design target strength from the minimum specification strength requirement, statistical average/standard deviation, workability and other information was obtained from a course sponsored by the Federal Highway Administration (FHWA) and the Iowa Department of Transportation (DOT). The course "Introduction to Designing and Proportioning Portland Cement Concrete Mixtures" explained the ACI's concrete mix design method. Portions from that manual have been reproduced herein as permitted by the FHWA and Iowa DOT.

Revised January 1, 2025

This Page Is Reserved

#### **Revision History and Document Control**

The Portland Cement Concrete Level III Technician Course Manual will be reviewed annually by the Engineer of Concrete and Soils for adequacy and updated as necessary to reflect current policies and technology changes. Updates are made to the electronic file as needed and hard copies are uncontrolled. Archive versions are available to examine in the Bureau of Materials.

Revision Date
January 1, 2025

Description
Updated Course Requirements to reflect the implementation of recertification requirements.

Approval
Brian Pfeifer

Revised January 1, 2025

This Page Is Reserved

# **TABLE OF CONTENTS**

DEF	INITI	ONS	xi
APP	LICA	BLE SPECIFICATIONS	xiv
CLA	ss o	F CONCRETE	xv
UNI <sup>-</sup>	TS OF	MEASURE CONVERSION	xvi
SIGI	NIFIC	ANT DIGITS AND ROUNDING	.xvii
ABE	BREV	ATIONS	xviii
1.0	MIX D	ESIGN OVERVIEW	1
	1.1	MIX DESIGN SUBMITTAL	1
	1.2	MIX DESIGN SOFTWARE	2
		1.2.1 Department Software	2
		1.2.2 Available Software Applications	2
2.0	CON	NCRETE MIX DESIGN DEVELOPMENT USING IDOT METHOD	3
	2.1	INTRODUCTION – ABSOLUTE VOLUME	
	2.2	CEMENT FACTOR	
	2.2	2.2.1 Cement Factor for Class or Type of Concrete	
		2.2.2 Allowable Cement Factor Reduction – Admixture	
	2.3	CEMENT ABSOLUTE VOLUME CALCULATION	
	2.4	FINELY DIVIDED MINERALS ABSOLUTE VOLUME CALCULATION	
	۷.٦	2.4.1 Cement Replacement with Finely Divided Minerals	
		2.4.1.1 Fly Ash	
		2.4.1.2 Ground Granulated Blast-Furnace Slag	6
		2.4.1.3 Microsilica	
		2.4.1.4 High-Reactivity Metakaolin (HRM)	
		2.4.2 Use of Finely Divided Minerals in Ternary Concrete Mix Designs	
		2.4.3 Mitigation of Alkali-Silica Reaction with Finely Divided Minerals	
	2.5	2.4.4 Use of Finely Divided Minerals in Mass Concrete	
	2.5		
	2.6	AIR CONTENT ABSOLUTE VOLUME CALCULATION	
	0.7	2.6.1 Minimum Air Content	
	2.7	FINE AND COARSE AGGREGATE ABSOLUTE VOLUMES CALCULATIONS	
		2.7.1 Voids in Coarse Aggregate	
		2.7.2.1 General Concept	
		2.7.2.1 General Concept	14
		2.7.3 Coarse Aggregate Absolute Volume Calculation	16
		2.7.4 Fine Aggregate Absolute Volume Calculation	
		2.7.5 Converting Aggregate Absolute Volume to Weight	

	2.8	EXAMPLE PROBLEM	
	0.0	2.8.1 Example Calculations	18
	2.9	SUMMARY OF MIX DESIGN EQUATIONS	20
3.0	SPE	CIALTY MIXTURES	22
	3.1	HIGH-EARLY-STRENGTH CONCRETE MIXTURES	22
	3.2	OTHER MIXTURES	22
	3.3	SYNTHETIC FIBERS	23
4.0	TER	NARY CONCRETE MIX DESIGNS	24
5.0	MAS	SS CONCRETE MIX DESIGNS	25
6.0	CON	ICRETE ADMIXTURES	26
	6.1	REQUIRED USE OF ADMIXTURES	26
	6.2	OPTIONAL USE OF ADMIXTURES	27
7.0	CON	ICRETE MIX DESIGN—TRIAL MIXTURE	29
	7.1	SLUMP	29
	7.2	STRENGTH	29
	7.3	PROCEDURE FOR TRIAL MIXTURE	32
8.0	DET	ERMINING THE CONCRETE MIX DESIGN TARGET STRENGTH	34
9.0	REC	UIREMENTS FOR CONCRETE DURABILITY TEST DATA	36
10.0	DEP	ARTMENT CONCRETE MIX DESIGN VERIFICATION	37
	10.1	VERIFICATION BY THE ENGINEER	37
	10.2	TESTING PERFORMED BY THE ENGINEER	
		10.2.1 Procedure for Trial Batch	
		10.2.1.1 Verification of Trial Batch, Voids Test, and Durability Test Data	38

# TABLE OF CONTENTS (Continued)

# **Appendices**

**Appendix A** Special Provision for Concrete Mix Design – Department Provided (Check Sheet

#31)

**Appendix B** IDOT PCC Mix Design Software Tutorial

**Appendix C** RESERVED

**Appendix D** Workability

**Appendix E** Aggregate Blending

**Appendix F** Cement Aggregate Mixture II (CAM II)

**Appendix G** Controlled Low-Strength Material (CLSM)

**Appendix H** Stamped or Integrally Colored Concrete

**Appendix I** Concrete Revetment Mats

**Appendix J** Insertion Lining of Pipe Culverts (Grout)

**Appendix K** Insertion Lining of Pipe Culverts (Cellular Concrete)

Appendix L Class SI Concrete Between Precast Concrete Box Culverts


**Appendix M** Pervious Concrete

**Appendix N** Average and Standard Deviation

**Appendix O** Alkali-Silica Reaction Mitigation Flow Chart

**Appendix P** Bridge Deck Latex Concrete Overlay Mix Design

**Appendix Q** Basic and Adjusted Water Requirement Method

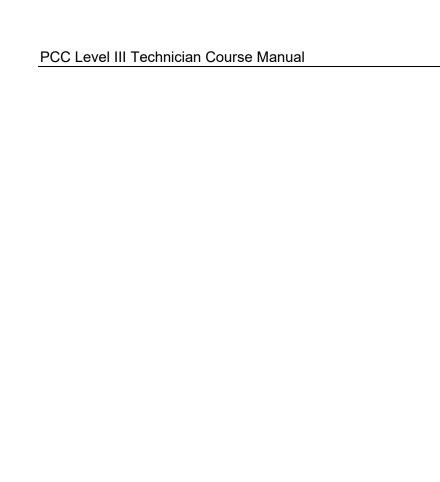

This Page Is Reserved

Revised January 1, 2025

## **DEFINITIONS**

**Absolute Volume** — The solid volume, excluding the voids between particles. It is expressed as the ratio of the loose material's mass (weight) to the material's solid mass (weight) per volume.

**Absorption** — The moisture content at which the saturated surface-dry condition occurs.

**Alkali-Silica Reaction** — The reaction of alkalies in cement with siliceous material in some aggregates. The reaction requires water and produces a gel which expands and cracks the concrete.

**Blended Cement** — A hydraulic cement which meets the requirements of AASHTO M 240 (ASTM C 595). The hydraulic cement consists of portland cement and one or more inorganic constituents.

**Cement Aggregate Mixture II (CAM II)** — A lean (low total cementitious) concrete mixture for stabilized subbase.

**Cement Factor** — The number of pounds of cement per cubic yard (English). Cement factor is the same as cement content or cementitious content if also using finely divided minerals.

**Cementitious Material** — A general term to indicate fly ash, ground granulated blast-furnace slag, microsilica, or high-reactivity metakaolin. However, the term is misleading because none of these materials have cementitious characteristics on their own. The term may be used interchangeably with Finely Divided Mineral or Supplementary Cementitious Material.

**Chips** — The aggregate particle size range between the No.4 and 1/2-in. sieves.

**Coarse Aggregate** — A gradation number CA 1-19 as defined by the Standard Specifications. For an aggregate blend, the coarse aggregate portion is normally considered to be all material retained on or above the No. 4 sieve.

**Concrete** — A mixture consisting of cement, water, and aggregates as a minimum. Admixtures and finely divided minerals may be added.

**Consistency** — The ability of freshly mixed concrete to flow. Consistency is measured by the slump test.

**Controlled Low-Strength Material (CLSM)** — A self-consolidating mortar mixture typically used as a backfill.

**Final Set** – The point of time where the concrete is no longer plastic and finishing can no longer take place. This will typically occur 5 to 8 hours after batching the concrete.

**Fine Aggregate** — A gradation number FA 1-10, 20, and 21 as defined by the Standard Specifications. For an aggregate blend, the fine aggregate portion is normally considered to be all material passing the No. 4 sieve.

**Finely Divided Mineral** — A general term to indicate fly ash, ground granulated blast-furnace slag, microsilica, or high-reactivity metakaolin. The term may be used interchangeably with Cementitious Material or Supplementary Cementitious Material.

**Fineness Modulus** — The Fineness Modulus (FM) is an index of the fineness of an aggregate. The higher the FM, the coarser the aggregate. The Fineness Modulus can be used to estimate proportions of fine and coarse aggregate in concrete mixtures.

**Fly Ash** — The fine residue resulting from the combustion of ground or powdered coal.

**Gap Graded** — Aggregates which have specific particle sizes omitted or the specific particle sizes are minimal.

**Ground Granulated Blast-Furnace (GGBF) Slag** — The glassy granular material formed when molten blast-furnace slag is rapidly chilled and then finely ground. Also known as slag cement.

**High-Reactivity Metakaolin (HRM)** — A manufactured product formed by calcining purified kaolinite at a specific temperature range.

**Hundredweight (cwt)** — A unit of measure equal to 100 pounds.

**Initial Set** — The point of time where the concrete begins to become firm. This will typically occur 2 to 4 hours after batching the concrete.

**Maximum Size** — The smallest sieve on which 100 percent of the aggregate sample particles pass.

**Microsilica** — The extremely fine by-product resulting from the manufacture of silicon or silicon alloys.

**Mix Design Target Strength** — The average strength the concrete mix must attain to ensure the specified strength is met.

**Mortar** — The fine aggregate, cement, finely divided minerals, water, and air in a concrete mixture.

**Mortar Factor** — The volume of mortar per volume of dry rodded coarse aggregate.

**Nominal Maximum Size** — The largest sieve which retains any of the aggregate sample particles.

**Oven-Dry Condition** — The aggregates have been heated until completely dry. There is no free moisture on the surface of the individual aggregate particles. There is no absorbed moisture in the pores of the individual aggregate particles.

**Oven-Dry Specific Gravity** — The ratio of the mass (weight) of a volume of oven dry material, to the mass (weight) of an equal volume of water.

Paste — The cement, finely divided minerals, water, and air in a concrete mixture.

**Plasticity** — The ease of molding the concrete. A plastic concrete mixture will maintain suspension of the aggregates.

**Pervious Concrete** — A permeable concrete that allows water to infiltrate the concrete and drain into the soil beneath it. The zero-slump concrete mixture has little or no fine aggregate.

**Portland Cement** — A hydraulic cement which meets the requirements of AASHTO M 85 (ASTM C 150).

**Saturated Surface-Dry Condition** — There is no free moisture on the surface of the individual aggregate particles. All possible moisture which can be absorbed into the pores of the individual aggregate particles has occurred.

**Saturated Surface-Dry Specific Gravity** — The ratio of the mass (weight) of a volume of saturated surface-dry material, to the mass (weight) of an equal volume of water.

**Standard Specifications** — The Standard Specifications for Road and Bridge Construction.

**Supplementary Cementitious Material** — See definition for Cementitious Material or Finely Divided Mineral.

**Ternary Mix Design** — A mix design consisting of cement and two finely divided minerals. The finely divided mineral in portland-pozzolan cement or portland blast-furnace slag cement shall count as one of the two finely divided minerals allowed.

**Trial Batch** — A batch of concrete tested by the Engineer to verify the Contractor's mix design will meet specification requirements.

**Trial Mixture** — A batch of concrete tested by the Contractor to verify the Contractor's mix design will meet specification requirements.

**Uniformly Graded** — Aggregates which do not have a large deficiency or excess of any particle size.

**Voids** — The volume of voids per unit volume of dry rodded coarse aggregate. In other words, voids is the ratio of the volume of empty spaces in a unit volume of coarse aggregate to the unit volume of coarse aggregate.

**Wash Water** — Residual rinse water in the drum of a truck mixer or truck agitator.

**Water/Cement Ratio** — The weight of water divided by the weight of cement. The water shall include mixing water, water in admixtures, free moisture on the aggregates, and water added at the job site.

When fly ash, ground granulated blast-furnace slag, microsilica, or high-reactivity metakaolin are used in a concrete mix, the water/cement ratio will be based on the total cement and finely divided minerals contained in the mixture.

**Workability** — A measure of how easy or difficult it is to place, consolidate, and finish concrete.

**Yield** — The volume of freshly mixed concrete from a known quantity of materials.

# **APPLICABLE SPECIFICATIONS**

#### Standard Specifications for Road and Bridge Construction

The Level III PCC Technician shall be familiar with the following Sections or Articles of the January 1, 2022, Standard Specifications for Road and Bridge Construction.

Article 285.05	Fabric Formed Concrete Revetment Mat
Article 312.09	Proportioning (Cement Aggregate Mixture II)
Article 540.06	Precast Concrete Box Culverts (Class SI Between Sections)
Section 543	Insertion Lining of Pipe Culverts
Section 1001	Cement
Section 1003	Fine Aggregate
Section 1004	Coarse Aggregate
Section 1010	Finely Divided Minerals
Section 1019	Controlled Low-Strength Material
Section 1020	Portland Cement Concrete
Section 1021	Concrete Admixtures

To view or download the <u>January 1, 2022, Standard Specifications for Road and Bridge Construction</u> (link embedded) on the Internet go to <a href="http://idot.illinois.gov/">http://idot.illinois.gov/</a>; Doing Business; Procurements; Engineering, Architectural & Professional Services; Consultant Resources; Standard Specifications. In addition to the Standard Specifications, it is important for the Level III PCC Technician to be familiar with the <a href="https://supplemental-specifications-and-Recurring-Special-Provisions-Adopted January 1, 2025">https://supplemental-specifications-and-Recurring-Special-Provisions-Adopted January 1, 2025</a> (link embedded) document and the Bureau of Design and Environment (BDE) Special Provisions. They are also found downloadable under Consultant Resources (scroll down to Letting Specific Items to find the BDE Special Provisions). The Supplemental Specifications are a supplement to the Standard Specifications. The Recurring Special Provisions are frequently included by reference, in selected contracts. The BDE Special Provisions are frequently included, by insertion, in selected contracts.

#### Guide Bridge Special Provisions

The Level III PCC Technician shall also be familiar with the following Guide Bridge Special Provisions (GBSP).

Deck Slab Repair

Bridge Deck Microsilica Concrete Overlay

Bridge Deck Latex Concrete Overlay

Bridge Deck High-Reactivity Metakaolin (HRM) Concrete Overlay

Concrete Wearing Surface

Structural Repair of Concrete

Bridge Deck Fly Ash or Ground Granulated Blast-Furnace Slag Overlay

Bridge Deck Construction

**Drilled Shafts** 

To view or download a GBSP, go to <a href="http://idot.illinois.gov/">http://idot.illinois.gov/</a>; Doing Business; Procurements; Engineering, Architectural & Professional Services; Consultant Resources; Bridges & Structures. The GBSPs are frequently included, by insertion, in selected contracts.

# **CLASS OF CONCRETE**

Class Designation	Description
PV	Pavement
PP	PCC Patching
RR	Railroad Crossing
BS	Bridge Superstructure
PC	Precast Concrete
PS	Precast Prestressed
DS	Drilled Shaft
SC	Seal Coat
SI	Structures (except superstructure)

Refer to Article 1020.04 for additional information.

# **UNITS OF MEASURE CONVERSION**

This manual uses English units in most instances. The Department's PCC Mix Design spreadsheet (see Section 1.2.1 "Department Software") does allow a design to be input using either English or metric units of measure. All data inputs will have to be entered in the chosen units of measure; however, the design will be reported in **both** units of measure on the different final reports generated.

Conversion	From English	To Metric	Multiply Quantity by*
LENGTH	inch (in.)	millimeter (mm)	25.4
	foot (ft)	millimeter (mm)	304.8
	foot (ft)	meter (m)	0.3048
	yard (yd)	meter (m)	0.9144
AREA	square inch (in.2)	square mm (mm²)	645.16
	square foot (ft <sup>2</sup> )	square meter (m <sup>2</sup> )	0.092903
	square yard (yd <sup>2</sup> )	square meter (m <sup>2</sup> )	0.836127
VOLUME	cubic inch (in.3)	cubic mm (mm <sup>3</sup> )	16387.06
	cubic foot (ft <sup>3</sup> )	cubic meter (m <sup>3</sup> )	0.028316
	cubic yard (yd <sup>3</sup> )	cubic meter (m <sup>3</sup> )	0.764555
	gallon (gal)	liter (L)	3.78541
MASS	ounces (oz)	grams (g)	28.349523
	pound (lb)	kilogram (kg)	0.453592
50505			4 4 4 0 0 0
FORCE	pound (lb)	Newton (N)	4.44822
MASS/AREA	oz/yd <sup>2</sup>	kg/m <sup>2</sup>	0.0339057
IVIAGGIAILA	lb/ft <sup>2</sup>	kg/m <sup>2</sup>	4.8824
	lb/yd <sup>2</sup>	kg/m <sup>2</sup>	0.5425
MASS/VOLUME	lb/ft <sup>3</sup>	kg/m <sup>3</sup>	16.01894
IVII (OO) V OLOIVIL	lb/yd <sup>3</sup>	kg/m³	0.5933
			10.0000
TEMPERATURE	English to Metric: °C	$C = \frac{(^3F - 32)}{1.8}$ Metric	to English: °F=1.8×°C+32

<sup>\*</sup> To convert from metric to English, *divide* metric quantity by value given in table. For example, 380 mm equals  $15.0 \text{ in.} (380 \div 25.4 = 14.96)$ .

## SIGNIFICANT DIGITS AND ROUNDING

#### **Significant Digits:**

Whole Number: Cement, Finely Divided Minerals, Coarse and Fine Aggregate, Water

One Digit to Right of Decimal: Basic Water Requirement (English), Air Content

Two Digits to Right of Decimal: Specific Gravity, Unit Weight, Water/Cement Ratio,

Basic Water Requirement (Metric), Mortar Factor, Voids

Three Digits to Right of Decimal: Absolute Volume

#### Rounding:

When the digit beyond the last place to be retained (or reported) is equal to or greater than 5, increase by 1 the digit in the last place retained.

# **ABBREVIATIONS**

AASHTO American Association of State Highway and Transportation Officials

ACI American Concrete Institute

ASR Alkali-Silica Reaction

ASTM American Society for Testing and Materials

BDE Bureau of Design and Environment

CA Coarse Aggregate

CAM II Cement Aggregate Mixture II

CCRL Cement and Concrete Reference Laboratory

CLSM Controlled Low-Strength Material

DEF Delayed Ettringite Formation

DOT Department of Transportation

FA Fine Aggregate

FM Fineness Modulus

FDM Finely Divided Mineral

FHWA Federal Highway Administration
GBSP Guide Bridge Special Provision

GGBF Slag Ground Granulated Blast-Furnace Slag

HRM High-Reactivity Metakaolin

ITP Illinois Test Procedure

MISTIC Materials Integrated System for Test Information and Communication

NIST National Institute of Standards and Technology

PCA Portland Cement Association
PCC Portland Cement Concrete

QC/QA Quality Control/Quality Assurance

SSD Saturated Surface-Dry

#### 1.0 MIX DESIGN OVERVIEW

#### 1.1 MIX DESIGN SUBMITTAL

The Department's mix design method is based upon established properties of the materials and the intended use of the concrete. The original design criteria can be found in the University of Illinois Engineering Experiment Station Bulletin No. 137, published in October 1923. The document is entitled "The Strength of Concrete and Its Relation to the Cement Aggregates and Water" by Arthur N. Talbot and Frank E. Richart.

The requirements for providing a mix design are specified in Article 1020.05, which states, "For all Classes of concrete, it shall be the Contractor's responsibility to determine mix design material proportions and to proportion each batch of concrete. A Level III PCC Technician shall develop the mix design for all Classes of concrete, except Classes PC and PS." However, the District may opt to insert a special provision into a contract allowing it to provide mix designs instead of the Contractor (see Appendix A).

Contact your District for mix design submittal procedures and guidelines. Generally, a mix design submittal shall include the following:

- Submittal date
- Class or type of concrete
- Source of materials
- Aggregate gradation designations
- · Coarse aggregate voids
- Specific gravities of materials
- Material proportions (batch weights)
- Water/cement ratio
- Mortar factor
- Type and proposed dosage of admixtures
- Target slump, air content, and strength

For self-consolidating concrete, the submittal is the same except target slump flow (instead of slump) and target J-ring value or L-box blocking ratio are also required.

Once the Engineer verifies the Contractor's mix design according to 10.0 "Department Concrete Mix Design Verification," it will be entered into the Department's Construction and Materials Management System (CMMS) database and provided a Department mix design number.

During construction, changes may occur that will affect the mix design. The following items will require re-submittal and verification of a mix design:

- Voids of the coarse aggregate change more than 0.02.
- Specific gravity of an aggregate changes more than 0.02.
- Specific gravity of the cement or a finely divided mineral changes more than 0.05.
- Mortar factor is changed more than 0.05.
- Water/cement ratio is increased more than 0.04.
- A change in materials.

#### 1.2 MIX DESIGN SOFTWARE

#### 1.2.1 Department Software

An Excel spreadsheet, "PCC Mix Design," is available from the Department's website to facilitate the calculation and submittal of a PCC mix design using the IDOT method. To download the program, go to <a href="http://idot.illinois.gov/">http://idot.illinois.gov/</a>; Doing Business; Material Approvals; Concrete; References; Guides/Spreadsheets.

#### 1.2.2 Available Software Applications

For those individuals who want to expand their mix design knowledge, the following websites have useful information. The following software applications are not to replace the Department's software but may be used to improve/optimize designs created using the Department's method.

 COST, developed by the Federal highway Administration (FHWA) and the National Institute of Standards and Technology (NIST).

The website is <a href="https://www.nist.gov/services-resources/software/concrete-optimization-software-tool">https://www.nist.gov/services-resources/software/concrete-optimization-software-tool</a>.

COST (Concrete Optimization Software Tool) is an online design/analysis system to assist in determining optimal mixture proportions for concrete.

• COMPASS, developed by The Transtec Group, Inc. for the FHWA.

The website is http://www.pccmix.com/.

COMPASS (Concrete Mixture Performance Analysis System Software) grew out of the web-based application tool COST. COMPASS has two key components, a knowledge base and a set of four computer modules. The knowledge base supplies information on concrete properties, testing methods, and material characteristics and compatibilities. The computer modules allow the user to define inputs such as importance of the project, type of pavement, climatic conditions, construction constraints, environmental exposures, and criteria (such as strength, cost, and permeability) that are specific to the project.

 ConcreteWorks developed at the Concrete Durability Center at the University of Texas as part of research for the Texas Department of Transportation.

The website is <a href="http://www.txdot.gov/inside-txdot/division/information-technology/engineering-software.external.html">http://www.txdot.gov/inside-txdot/division/information-technology/engineering-software.external.html</a>.

The ConcreteWorks software includes ConcreteWorks and MixProportions. The ConcreteWorks program can calculate mass concrete temperature development. The MixProportions is a concrete mixture proportioning program based on ACI 211.

#### 2.0 CONCRETE MIX DESIGN DEVELOPMENT USING IDOT METHOD

#### 2.1 INTRODUCTION - ABSOLUTE VOLUME

The basic materials required for concrete are cement, finely divided minerals, fine and coarse aggregates, water, and entrained air (for Illinois' wet freeze-thaw environment). Concrete meeting the requirements of strength and durability will demand accurate proportioning of these basic materials.

Though mix designs are often thought of in terms of "bags of cement," "pounds of rock and sand," and so on, accurate design is achieved based on proportioning each component with respect to a standard unit of volume, most commonly 1 cubic yard. Therefore, the basis of concrete proportioning is determining the volume of the component materials.

With respect to granular materials (e.g., aggregates, cement, etc.), the volume used in mix design calculations is the absolute volume, which is defined as the solid volume of those materials. That is, because granular materials stack, what we normally think of as volume is actually the apparent volume, which is larger than the absolute volume because it includes the spaces between particles. Thus, the absolute volume (volume of solids) is used because the space between particles will be filled by smaller particles (e.g., the space between coarse aggregate particles will be filled by fine aggregate and paste).

The absolute volume of a material is calculated based on its weight and specific gravity.

#### 2.2 CEMENT FACTOR

Through years of laboratory experimentation and field experience, the Department has determined the approximate amount of cement, represented as the cement factor, needed to meet durability requirements after construction. Note that when finely divided minerals are also to be utilized, the cement factor represents the amount of total cementitious material. Also note that the term "cement" will be used throughout this manual, and that unless otherwise noted, generally applies to portland cement, portland-pozzolan cement, portland-slag cement, and portland-limestone cement. Portland-limestone cement (Type IL according to AASHTO M 240) has become the predominant cement type used by industry—replacing conventional portland cements (e.g., Type I, II, I/II, etc.)

#### 2.2.1 Cement Factor for Class or Type of Concrete

Cement is specified in terms of hundredweights per cubic yard. The number of hundredweights of cement used per cubic yard of concrete is the cement factor.

Refer to Table 2.2.1 "Cement Factor for Class or Type of Concrete" for the required cement factor when using portland cement, portland-pozzolan cement, portland blast-furnace slag cement, or portland-limestone cement.

Table 2.2.1 Cement Factor for Class or Type of Concrete

Class or Type of Congrete	Minimum Cement Factor	Maximum Cement Factor		
Class or Type of Concrete	cwt/yd <sup>3</sup>	cwt/yd <sup>3</sup>		
PV	5.65 <sup>1,2</sup>	7.05		
FV	6.05 <sup>1,3</sup>			
PP-1	6.50 <sup>1</sup>	7.50		
	6.20 <sup>1,4</sup>	7.20 4		
PP-2	7.35	8.20		
PP-3	7.35 <sup>5</sup>	7.35 <sup>5</sup>		
PP-4	6.00 <sup>6</sup>	6.25 <sup>6</sup>		
PP-5	6.75 <sup>7</sup>	6.75 <sup>7</sup>		
RR	6.50 <sup>1</sup>	7.50		
	6.20 <sup>1,4</sup>	7.20 4		
BS	6.05	7.05		
PC	Wet Cast: 5.65	Wet Cast: 7.05		
FC	Dry Cast: 5.65 <sup>4</sup>	Dry Cast: 7.05 <sup>4</sup>		
PS	5.65	7.05		
F3	5.65 <sup>4</sup>	7.05 4		
DS	6.65	7.05		
SC <sup>8</sup>	5.65 <sup>1,2</sup>	7.05		
30	6.05 <sup>1,3</sup>	7.03		
SI	5.65 <sup>1,2</sup>	7.05		
	6.05 <sup>1,3</sup>			
Deck Slab Repair	Refer to PP-1, 2, 3, 4, and 5	Refer to PP-1, 2, 3, 4, and 5		
Formed Concrete Repair	6.65	6.65		
Concrete Wearing Surface	Refer to Class BS Concrete	Refer to Class BS Concrete		
Bridge Deck Fly Ash or				
GGBF Slag	Refer to Class BS Concrete	Refer to Class BS Concrete		
Concrete Overlay <sup>9</sup>				
Bridge Deck Microsilica	5.65	5.65		
Concrete Overlay <sup>10</sup>	3.03	3.03		
Bridge Deck High-Reactivity				
Metakaolin Concrete	5.65	5.65		
Overlay <sup>11</sup>				
Bridge Deck Latex Concrete	6.58	6.58		
Overlay <sup>12</sup>	0.50	0.50		

#### Notes:

- 1. Refer to 2.2.2 "Allowable Cement Factor Reduction Admixture" for allowable cement factor reduction.
- 2. Central-mixed.
- 3. Truck-mixed or shrink-mixed.
- 4. Type III cement.
- 5. In addition to the Type III portland cement, 100 lb/yd³ of ground granulated blast-furnace slag and 50 lb/yd³ of microsilica (silica fume) shall be used. For an air temperature greater than 85 °F, the Type III portland cement may be replaced with Type I or II cement.
- 6. The cement shall be a rapid hardening cement from the Department's "Qualified Product List of Rapid Hardening Cement" for PP-4.
- 7. The cement shall be calcium aluminate cement for PP-5.
- 8. For Class SC concrete and any class of concrete that is to be placed under water, except Class DS concrete, the cement factor shall be increased by ten percent.
- 9. The portland cement shall be replaced with 25 percent Class F fly ash, or 25-30 percent Class C fly ash, or 25-35 percent ground granulated blast-furnace slag.
- 10. In addition to the cement, 33 lb/yd3 of microsilica is required in the mix design.
- 11. In addition to the cement, 37 lb/yd³ of high-reactivity metakaolin is required in the mix design.
- 12. In addition to the cement, 24.5 gallons of latex admixture is required in the mix design.

#### 2.2.2 Allowable Cement Factor Reduction – Admixture

For Class PV, PP-1, RR, SC, and SI concrete, the cement factor may be reduced a maximum 0.30 cwt/yd³ when using a water-reducing admixture or a high range water-reducing admixture. However, a cement factor reduction will not be allowed for concrete placed underwater.

#### 2.3 CEMENT ABSOLUTE VOLUME CALCULATION

The absolute volume in cubic yards of cement can be determined as follows:

#### English:

The absolute volume of cement,  $V_{Cement} = \frac{Weight \ of \ Cement}{Specific \ Gravity \ of \ Cement \times Unit \ Weight \ of \ Water}$ 

The "weight of cement" is provided by the cement factor converted to pounds per cubic yard minus the weight of any finely divided minerals also used. The "specific gravity of cement" is normally assumed to be 3.15 for ordinary portland cement and portland-limestone cement, but should be verified with the District when using a portland-pozzolan or portland-slag cement. The "unit weight of water" is 1,683.99 lb/yd³.

If the specific gravity of the cement changes more than 0.05 from the original mix design value, a new mix design will be required.

#### 2.4 FINELY DIVIDED MINERALS ABSOLUTE VOLUME CALCULATION

A portion of cement may be replaced with finely divided minerals. The replacement is commonly done to reduce the unit cost of the concrete, to mitigate for alkali-silica reaction, to lower the heat of hydration, and/or to lower the concrete's permeability, which will slow chloride penetration.

Finely divided minerals (FDMs) are measured in pounds. The absolute volume in cubic yards of a finely divided mineral is determined as follows:

#### English:

The absolute volume of a FDM,  $V_{FDM} = \frac{Weight \ of \ FDM}{Specific \ Gravity \ of \ FDM \times Unit \ Weight \ of \ Water}$ 

The "weight (mass) of FDM" is provided in pounds per cubic yard. The "unit weight of water" is  $1,683.99 \text{ lb/yd}^3$ .

The specific gravity of a finely divided mineral is obtained from the "Qualified Producer List of Finely Divided Minerals" available online at <a href="http://idot.illinois.gov">http://idot.illinois.gov</a>; Doing Business; Materials; Cement; Qualified Product Lists. It is found under the "Average Specific Gravity" column.

If the specific gravity of a finely divided mineral changes more than 0.05 from the original mix design value, a new mix design will be required.

#### 2.4.1 Cement Replacement with Finely Divided Minerals

#### 2.4.1.1 Fly Ash

The following information is according to Article 1020.05(c)(1).

Fly ash may partially replace cement in cement aggregate mixture II (CAM II) and the following Classes PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, and SI.

When Class F fly ash is used in CAM II, Class PV, BS, PC, PS, DS, SC, and SI concrete, the amount of cement replaced shall not exceed 25 percent by weight.

When Class C fly ash is used in CAM II, Class PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, and SI concrete, the amount of cement replaced shall not exceed 30 percent by weight.

Measurements of fly ash shall be rounded up to the nearest 5 lb/yd<sup>3</sup>.

#### 2.4.1.2 Ground Granulated Blast-Furnace Slag

The following information is according to Article 1020.05(c)(2).

Ground granulated blast-furnace (GGBF) slag may partially replace cement in the following Classes: PV, PP-1, PP-2, PP-3, RR, BS, PC, PS, DS, SC, and SI.

When GGBF slag is used in Class PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, and SI concrete, the amount of cement replaced by GGBF slag shall not exceed 35 percent by weight. For Class PP-3 concrete, GGBF slag shall be used according to Article 1020.04, Table 1, Note 8.

Measurements of GGBF slag shall be rounded up to the nearest 5 lb/yd<sup>3</sup>.

#### 2.4.1.3 Microsilica

Per Article 1020.05(c)(3), at the Contractor's option, microsilica may be added at a maximum 5.0 percent by weight of the cement and finely divided minerals summed together.

#### 2.4.1.4 High Reactivity Metakaolin (HRM)

Per Article 1020.05(b)(4), at the Contractor's option, HRM may be added at a maximum 5.0 percent by weight of the cement and finely divided minerals summed together.

#### 2.4.2 Use of Finely Divided Minerals in Ternary Concrete Mix Designs

Refer to Article 1020.(c)(5) for allowable use of finely divided minerals in ternary mix designs.

#### 2.4.3 Mitigation of Alkali-Silica Reaction with Finely Divided Minerals

Alkali-silica reaction (ASR) is the reaction of alkalies in cement with siliceous material in some aggregates. The reaction requires water and produces a gel which expands and cracks the concrete. Refer to Article 1020.05(d) for use of finely divided minerals to mitigate ASR. Also, it may be helpful to refer to the ASR specification flow chart in Appendix P.

#### 2.4.4 Use of Finely Divided Minerals in Mass Concrete

Refer to Article 1020.15 for use of finely divided minerals to reduce heat of hydration in massive structures.

#### 2.5 WATER-TO-CEMENT RATIO AND WATER CONTENT

Since the amount of cement and finely divided minerals used in concrete is basically specified for the various types of construction, the amount of water used is a very important variable of the design.

The Department's original method to determine the amount of water to use is based on the angularity of the aggregates in the mix: as the angularity increases, the amount of water required in the concrete increases. This method determines a "Basic Water Requirement," which can then be adjusted as necessary based on admixtures used, finely divided mineral content, and other factors. Refer to Appendix Q "Basic and Adjusted Water Requirement Method" for more information.

However, because of how important it is to control the water content of a mix, it is more common to design a mix with respect to a target water-to-cement (w/c) ratio. The w/c ratio is defined as the weight of water divided by the total weight of cement and finely divided minerals; thus, it is sometimes called water-to-cementitious or water-to-cementing materials ratio.

**Important:** The Department's "PCC Mix Design" Excel spreadsheet provides both options to determine water content. Furthermore, if the "w/c Ratio Method" is selected, the spreadsheet will provide 'dummy' values in the design reports assuming a Type B fine aggregate with basic water requirement of 5.3 gal/cwt, and a percent water reduction will be back-calculated based on the w/c input and assumed basic water requirement.

Refer to Table 2.5 "Water/Cement Ratio" for specified w/c ratio ranges. Selecting a suitable target w/c ratio is largely based on experience with similar materials and proportions achieving desired strength results in satisfactory timeframes, though other factors may also play a part.

Many mix designs use a w/c ratio in the 0.40 to 0.44 range to ensure complete hydration of the cement, as well as to reduce the dependence on admixtures for workability (as may be the case when the w/c ratio is less than 0.40). If a maximum w/c ratio is not specified, it shall not exceed 0.45 to ensure durability of the concrete.

On the other hand, the water content shall not be reduced to a level which restricts cement hydration; that is, the w/c ratio shall not be lower than 0.32, except as allowed for bridge deck latex concrete overlay and dry cast Class PC items.

A new mix design will be required if the w/c ratio is increased more than 0.04 from the original mix design value. The value shall not exceed specified limits.

Table 2.5 Water/Cement Ratio

Table 2.5 Water/Gement Natio					
Class or Type of Concrete	Water/Cement Ratio				
PV	0.32 - 0.42				
PP-1	0.32 - 0.44				
PP-2	0.32 - 0.38				
PP-3	0.32 - 0.35				
PP-4	0.32 - 0.50				
PP-5	0.32 - 0.40				
RR	0.32 – 0.44				
BS	0.32 - 0.44				
PC	Wet Cast: 0.32 – 0.44				
PO	Dry Cast: 0.25 – 0.40				
PS	0.32 - 0.44				
DS	0.32 - 0.44				
SC	0.32 - 0.44				
SI	0.32 - 0.44				
Deck Slab Repair	Refer to PP-1, 2, 3, 4, and 5				
Formed Concrete Repair	Refer to Class SI Concrete				
Concrete Wearing Surface	Refer to Class BS Concrete				
Bridge Deck Fly Ash or GGBF Slag Concrete Overlay	Refer to Class BS Concrete				
Bridge Deck Microsilica Concrete Overlay	0.37 – 0.41				
Bridge Deck High-Reactivity Metakaolin Concrete Overlay	0.37 – 0.41				
Bridge Deck Latex Concrete Overlay	$0.30 - 0.40^{1}$				
·					

#### Notes:

1. The maximum water content (including free moisture on the fine and coarse aggregates) is 157 lb.

Once a w/c ratio is selected, the total water content is simply the w/c ratio multiplied by the sum of cement and finely divided mineral contents. Keep in mind that the total water content includes not only mixing water but also water in admixtures, free moisture on the aggregates (i.e., water on the surface of the individual particles), and water added at the job site. Refer to the Portland Cement Concrete Level II Technician Course manual for additional information on water-cement control.

Water content is measured in pounds per cubic yard. The absolute volume in cubic yards of water is determined as follows:

#### English:

The absolute volume of water, 
$$V_{Water} = \frac{Weigh \ of \ Water}{Unit \ Weigh \ of \ Water}$$

The "weight of water" is provided in pounds per cubic yard. The "unit weight of water" is 1,683.99 lb/yd³.

#### 2.6 AIR CONTENT ABSOLUTE VOLUME CALCULATION

The next step is calculating the volume of air to be entrained in the mix. Refer to Table 2.6 "Air Content" for specified air content ranges. In general, use the midpoint of the range for calculating volume. However, since it can be more difficult to entrain air when slipforming Class PV, BS, and SI concrete, a value lower than the midpoint may be used in these cases.

The absolute volume in cubic yards of air is determined as follows:

#### English:

The absolute volume of air,  $V_{Air} = \frac{\% Air}{100}$ 

**Table 2.6 Air Content** 

Class or Type of Concrete	Air Content, Percent
PV	$5.0^1 - 8.0$
PP-1	4.0 – 8.0
PP-2	4.0 – 8.0
PP-3	4.0 – 8.0
PP-4	4.0 – 8.0
PP-5	4.0 – 8.0
RR	4.0 – 7.0
BS	$5.0^{1} - 8.0$
PC	5.0 – 8.0
PS	5.0 – 8.0
DS	5.0 – 8.0
SC	Optional <sup>2</sup> (6.0 Maximum)
SI	$5.0^{1} - 8.0$
Deck Slab Repair	Refer to PP-1, 2, 3, 4, and 5
Formed Concrete Repair	Refer to Class SI Concrete
Concrete Wearing Surface	Refer to Class BS Concrete
Bridge Deck Fly Ash or GGBF Slag	Refer to Class BS Concrete
Concrete Overlay	Neiel to Class B3 Coliclete
Bridge Deck Microsilica Concrete Overlay	5.0 – 8.0
Bridge Deck High-Reactivity Metakaolin	5.0 – 8.0
Concrete Overlay	3.0 – 0.0
Bridge Deck Latex Concrete Overlay	7 Maximum

#### Notes:

- 1. For slipform construction, the minimum air content is 5.5 percent.
- 2. When not using an air-entraining admixture, 2.0 percent air content is assumed.

#### 2.6.1 Minimum Air Content

Note that the specified ranges for air content are in terms of the total volume of concrete; however, the volume of air is actually based on what is required to provide adequate air entrainment in the paste (i.e., water, cement, and finely divided minerals). The specified air content is in terms of the total volume because it is a value that is easy to measure using standard test methods.

Thus, if air content is not specified for a concrete mix design, a value can be calculated based on needing a minimum 18 percent air content in the paste for moderate or extreme freeze/thaw exposure conditions, which are typical in Illinois. The calculation to convert 18% air per volume of paste into percent air content per cubic yard of concrete is as follows:

#### English:

Minimum Air Content (%) =  $[0.18 \times (V_{Water} + V_{Cement} + \sum V_{FDM})] \times 100$ 

Where:  $V_{Water}$  = Absolute Volume of Water per yd<sup>3</sup>,

 $V_{Cement}$  = Absolute Volume of Cement per yd<sup>3</sup>, and

 $\sum V_{FDM}$  = Sum of Absolute Volumes of each Finely Divided Mineral


per yd<sup>3</sup>

#### 2.7 FINE AND COARSE AGGREGATE ABSOLUTE VOLUME CALCULATIONS

Knowing the amount of cement, finely divided minerals, water, and air, only the amounts of the fine and coarse aggregates are unknown. In order to determine aggregate content, certain characteristics of the coarse aggregate must first be examined.

#### 2.7.1 Voids in Coarse Aggregate

The first characteristic is the volume of voids in a volume of coarse aggregate. That is, voids (V) is defined as the volume of voids per unit volume of dry rodded coarse aggregate. This is not a measure of voids in a coarse aggregate particle, but instead a measure of the voids between aggregate particles due to stacking. As shown in Figure 2.7.1, voids (V) is the percentage (as a decimal) of the volume of empty spaces between particles in a unit volume of coarse aggregate.

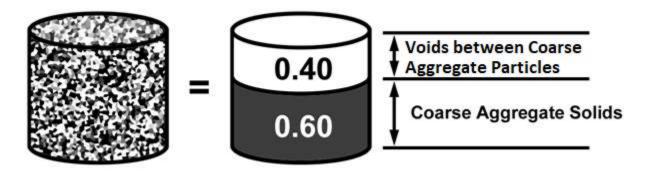

 $1.00_{\text{(Aggregate Volume)}} = 0.40_{\text{(Voids Volume)}} + 0.60_{\text{(Solids Volume)}}$ 

Figure 2.7.1 Voids in Coarse Aggregate

The coarse aggregate voids (*V*) are determined according to Illinois Modified AASHTO T 19.

It is important to know that a change in coarse aggregate particle shape will change the voids as it will change how the particles pack. Refer to the Portland Cement Concrete Level II Technician Course for additional information on aggregate particle shape.

If the voids (*V*) of a coarse aggregate change more than 0.02 from the original mix design value, a new mix design will be required. A change of 0.02 will change the coarse aggregate batch weight approximately 3 times more than a similar change in saturated surface-dry (SSD) specific gravity.

The coarse aggregate voids (V) will typically range from 0.36 to 0.41 for non-crushed gravel and 0.39 to 0.45 for crushed gravel or crushed stone. The overall range for coarse aggregate is normally from 0.30 to 0.50.


Refer to the District office verifying your mix design for guidance on what value to use.

#### 2.7.2 Mortar Factor

#### 2.7.2.1 General Concept


The second coarse aggregate characteristic of concern is the amount of mortar needed to not only fill the volume of voids (*V*) in a volume of coarse aggregate, but also disperse the coarse aggregate particles for workability (refer to Appendix D for additional information regarding workability).

Mortar is the total amount of fine aggregate, cement, finely divided minerals, water, and air in a concrete mixture (i.e., everything but the coarse aggregate). The volume of mortar per volume of dry rodded coarse aggregate in a unit volume of concrete is called the Mortar Factor. In other words, mortar factor is the ratio of total volume of mortar to total apparent volume of coarse aggregate (i.e., volume of coarse aggregate solids and voids).




Imagine a unit volume of concrete consisting entirely of coarse aggregate. Everything else in the concrete mixture (i.e., mortar) would be limited to filling the spaces (voids) between coarse aggregate particles.

A concrete mixture consisting entirely of coarse aggregate and only enough mortar to fill the voids between coarse aggregate particles would have poor workability.



To increase workability, the coarse aggregate particles need to be dispersed. Thus, in order to maintain the same unit volume of concrete, some of the coarse aggregate needs to be removed.

If we add mortar to replace what was removed, we will have a more workable concrete mixture because the unit volume of concrete now has enough mortar to disperse and lubricate the coarse aggregate particles.

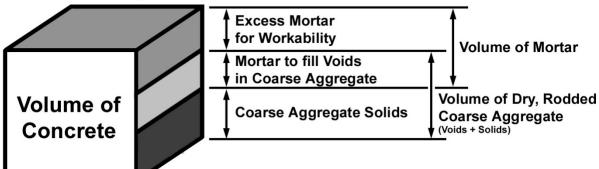


MORTAR FACTOR = Volume of Mortar

Volume of Dry, Rodded Coarse Aggregate


To quantify the concept of Mortar Factor, first determine the volume fraction of coarse aggregate solids based on the volume of voids (*V*) in a unit volume of dry rodded coarse aggregate:

Volume Fraction of Coarse Aggregate Solids = 1 - V

For example, consider a unit volume of crushed stone with V equal to 0.40. The mortar can fill the voids between coarse aggregate particles as illustrated in the figure below, but this will not result in a workable mixture.

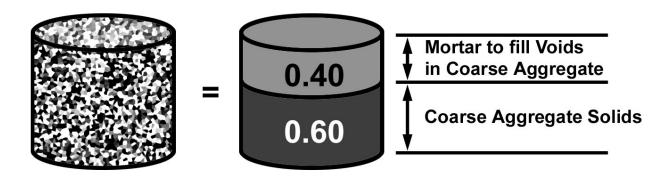

An additional volume of mortar must be added. The amount of mortar added for workability is represented as a fraction of the volume of dry rodded coarse aggregate volume as illustrated in the figure below.

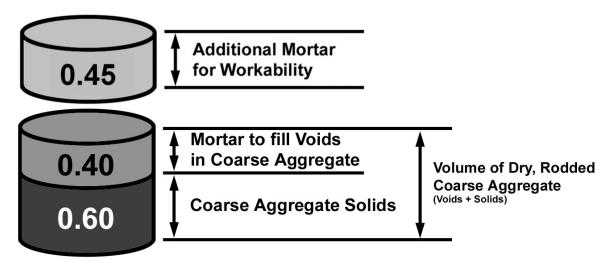

The volume fraction of mortar to fill the voids plus the volume fraction of mortar added for workability is the Mortar Factor (0.40 + 0.45 = 0.85).

In terms of the resulting unit volume of concrete, the total volume fraction of mortar per unit volume of concrete can be determined as follows:

Volume Fraction of Mortar Per Unit Volume of Concrete 
$$= \frac{\text{Mortar Factor}}{\text{CA Solids} + \text{CA Voids} + \text{Additional Mortar}}$$
$$= \frac{0.85}{0.60 + 0.40 + 0.45} = 0.59$$

Alternatively, the previous equation can be revised to use the inputs determined by test (Voids, *V*) and selected by the mix designer (Mortar Factor) as follows:

Volume Fraction of Mortar
Per Unit Volume of Concrete
$$= \frac{\text{Mortar Factor}}{(1 - \text{V}) + \text{Mortar Factor}}$$

$$= \frac{0.85}{(1 - 0.40) + 0.85} = 0.59$$

### 2.7.2.2 Design Mortar Factor

This concept of Mortar Factor is unique to the Department's mix design method; for example, the ACI or PCA methods do not utilize mortar factor as a design input. For the Department mix design method, mortar factors are selected based on construction application and experience with local materials. Refer to Table 2.7.2.2 for allowable mortar factor ranges, as well as allowable coarse aggregate gradations, per Class of Concrete or type of construction.

Changing the mortar factor will adjust the coarse and fine aggregate proportions; for example, increasing the mortar factor will decrease the coarse aggregate content and increase the fine aggregate content. A higher mortar factor may be used to facilitate placement and finishing, and to improve the finish of formed surfaces. A higher mortar factor may also be needed to ensure sufficient sand content to entrain air.

A new mix design will be required if the mortar factor is changed  $\pm$  0.05 or more from the original mix design value.

As noted in Table 2.7.2.2, for self-consolidating concrete, in order for the fine aggregate proportion to be a maximum 50 percent by weight of the total aggregate used, the maximum mortar factor shall not apply. In most cases, for the fine aggregate proportion to be 50 percent by weight of the total aggregate used, the mortar factor will be greater than 1.00.

Another case in which the mortar factor may be greater than 1.00 is when proportioning structural lightweight concrete (i.e., unit weight between 90 and 115 lb/ft<sup>3</sup>) using lightweight coarse aggregate. In this case, the mortar factor can be greater than 1.00 so as to adjust the proportions to achieve the desired unit weight of concrete, pumpability, strength, and so on.

Table 2.7.2.2 Design Mortar Factor

able 2.1.2.2 Design Mortal 1 detor				
Class or Type of Concrete	Coarse Aggregate Gradation <sup>1</sup> Mortar Factor Ran Department Mix D			
PV	CA 5 & CA 7, CA 5 & CA 11, CA 7, CA 11, or CA 14 0.70 – 0.90 <sup>5</sup>			
PP-1 <sup>2</sup> , PP-2 <sup>2</sup> , PP-3 <sup>2</sup> , PP-4 <sup>2</sup> ,	CA 7, CA 11,	$0.70 - 0.93^{5}$		
PP-5 <sup>2</sup>	CA 13, CA 14, or CA 16	$0.79 - 0.99^{5}$		
RR	CA 7, CA 11, or CA 14	$0.70 - 0.90^{5}$		
BS <sup>2,3,7</sup>	CA 7, CA 11, or CA 14	$0.70 - 0.86^{5,6}$		
PC <sup>7</sup>	CA 7, CA 11, CA 13, CA 14, CA 16, or CA 7 & CA 16	0.70 - 0.905		
PS <sup>7</sup>	CA 11 <sup>4</sup> , CA 13, CA 14, or CA 16 <sup>4</sup>	$0.79 - 0.99^{5}$		
DS <sup>7,8</sup>	CA 13, CA 14, CA 16, or a blend of these gradations	Not Applicable		
SC	CA 3 & CA 7, CA 3 & CA 11, CA 5 & CA 7, CA 5 & CA 11, CA 7, or CA 11	$0.79 - 0.90^5$		
SI <sup>7,9</sup>	CA 3 & CA 7, CA 3 & CA 11, CA 5 & CA 7, CA 5 & CA 11	0.71 – 0.83		
OI .	CA 7, CA 11, CA 13, CA 14, or CA 16	$0.70 - 0.90^5$		
Deck Slab Repair	Refer to PP-1, 2, 3, 4, and 5	Refer to PP-1, 2, 3, 4, and 5		
Formed Concrete Repair	CA 16	Refer to Class SI Concrete		
Concrete Wearing Surface	Refer to Class BS Concrete	Refer to Class BS Concrete		
Bridge Deck Fly Ash or GGBF Slag Concrete Overlay	CA 11, CA 13, CA 14, or CA 16	Refer to Class BS Concrete		
Bridge Deck Microsilica Concrete Overlay	CA 11, CA 13, CA 14, or CA 16	0.88 – 0.92		
Bridge Deck High-Reactivity Metakaolin Concrete Overlay	CA 11, CA 13, CA 14, or CA 16	0.88 - 0.92		
Bridge Deck Latex Concrete Overlay <sup>10</sup>	CA 13, CA 14, or CA 16	Not Applicable		

### Notes:

- 1. Alternate combinations of gradation sizes may be used with the approval of the Engineer. Refer also to Article 1004.02(d) for additional information on combining sizes.
- 2. For Class BS or PP concrete used in bridge deck patching, the coarse aggregate gradation shall be CA 13, CA 14, or CA 16, except CA 11 may be used for full-depth patching.
- 3. When Class BS concrete is to be pumped, the coarse aggregate gradation shall have a minimum of 45 percent passing the 1/2 in. sieve. The Contractor may combine two or more coarse aggregate sizes, consisting of CA 7, CA 11, CA 13, CA 14, and CA 16, provided a CA 7 or CA 11 is included in the blend.
- 4. The nominal maximum size permitted is 3/4 in. Nominal maximum size is defined as the largest sieve which retains any of the aggregate sample particles.
- 5. If the fine aggregate is one hundred percent stone sand, the maximum mortar factor shall be 0.85.
- 6. May be increased to 0.95 if slipformed.
- 7. For self-consolidating concrete, the coarse aggregate gradations shall be CA 11, CA 13, CA 14, CA 16, or a blend of these gradations. However, the final gradation when using a single coarse aggregate or combination of coarse aggregates shall have 100 percent pass the 1 in. sieve, and minimum 95 percent pass the 3/4 in. sieve. The fine aggregate proportion shall be a maximum 50 percent by weight of the total aggregate used. Therefore, the maximum mortar factor shall not apply.
- 8. The coarse aggregate shall be 55 to 65 percent by weight of total aggregate. The only exception is self-consolidating concrete. See Note 7.
- 9. CA 3 or CA 5 may be used when the nominal maximum size does not exceed two-thirds the clear distance between parallel reinforcement bars, or between the reinforcement bar and the form. Nominal maximum size is defined in Note 4.
- 10. The coarse aggregate shall be 42 to 50 percent by weight of total aggregate.

### 2.7.3 Coarse Aggregate Absolute Volume Calculation

Knowing the volume fraction of mortar, the absolute volume in cubic yards of coarse aggregate can be determined as follows:

English:

Absolute Volume of Coarse Aggregate,  $V_{CA} = 1$  - Volume Fraction of Mortar

For example, continuing the example in 2.7.2.1:

Absolute Volume of Coarse Aggregate,  $V_{CA}$  = 1 - Volume Fraction of Mortar = 1 - 0.59 = 0.41

The absolute volume of coarse aggregate per cubic yard of concrete is a total encompassing all coarse aggregates used. If more than one coarse aggregate is used, the total coarse aggregate absolute volume is multiplied by the percentage (as a decimal) of each coarse aggregate to be used; this will provide the absolute volume of each coarse aggregate. Typically, two coarse aggregates are blended to improve a gap graded coarse aggregate. The more uniformly graded combined aggregate will reduce water demand and improve the pumping characteristics of the mix. Refer to Appendix E "Aggregate Blending" for additional information.

Note: The equation below is used in the Department's Excel PCC Mix Design program to simplify the calculation from two steps (calculating volume fraction of mortar to calculate absolute volume of coarse aggregate) to one:

Absolute Volume of Coarse Aggregate, 
$$V_{CA} = \frac{1}{1 + \left(\frac{\text{Mortar Factor}}{1 - \text{Voids}}\right)}$$

### 2.7.4 Fine Aggregate Absolute Volume Calculation

Knowing the volumes of cement, finely divided minerals, water, air, and coarse aggregate, the only unknown is the volume of fine aggregate. This is easily found by subtracting all of the known absolute volumes from 1.

English:

The absolute volume of fine aggregate = 1 -  $(V_{Cement} + \sum V_{FDM} + V_{Water} + V_{Air} + V_{CA})$ 

The absolute volume of fine aggregate per cubic yard of concrete is a total encompassing all fine aggregates used. If more than one fine aggregate is used, the total fine aggregate absolute volume is multiplied by the percentage (as a decimal) of each fine aggregate to be used. This will provide the absolute volume of each fine aggregate. Two fine aggregates may be blended for economic purposes such as when using a natural sand and a stone sand. Blending of fine aggregate may also be done to improve the overall gradation of the mix for air entrainment and pumping. Refer to Appendix E "Aggregate Blending" for additional information.

### 2.7.5 Converting Aggregate Absolute Volume to Weight

Finally, to convert the absolute volume of aggregate to pounds, the saturated surface-dry (SSD) specific gravity of the aggregate is required, which can be found on the Department's Specific Gravity (Gsb) List available online at <a href="http://idot.illinois.gov/">http://idot.illinois.gov/</a>, Doing Business, Material Approvals, Aggregate, Qualified Product Lists. Refer to the Portland Cement Concrete Level II Technician Course manual for additional information on SSD specific gravity. If it is suspected that the SSD specific gravity has changed or is incorrect, notify the District.

Whenever the specific gravity of any aggregate deviates by more than 0.02 from the original mix design value, a new mix design will be required.

English:

Weight = absolute volume × SSD specific gravity × unit weight of water

Where the "unit weight of water" is 1,683.99 lb/yd3.

### 2.8 EXAMPLE PROBLEM

### Given:

- Continuous reinforced portland cement concrete pavement to be built using central mixed concrete and slipform equipment.
- Type IL cement with >0.60 alkalies will be used.
- Class C fly ash with a calcium oxide (CaO) of 25.1 percent and specific gravity of 2.61 will be used.
- A fine aggregate (027FA01) with saturated surface-dry specific gravity of 2.66 will be used. The alkali-silica reaction expansion for the fine aggregate sand is in the >0.16% – 0.27% range.
- A crushed stone coarse aggregate (022CA11) with saturated surface-dry specific gravity of 2.68 will be used. The coarse aggregate voids are 0.39. The alkalisilica reaction expansion for the coarse aggregate limestone is an assigned value of 0.05%. The aggregate is freeze/thaw durable.
- A water-reducing admixture will be used to take advantage of a cement reduction and meet the w/c ratio requirement.

### **Significant Digits:**

- Whole Number: Cement, Water, Finely Divided Minerals, Coarse and Fine Aggregate
- One Digit to Right of Decimal: Basic Water Requirement, Air Content
- Two Digits to Right of Decimal: Specific Gravity, Unit Weight, Water/Cement Ratio, Mortar Factor, Voids
- Three Digits to Right of Decimal: Absolute Volume

### Rounding:

 When the digit next beyond the last place to be retained is equal to or greater than 5, increase by 1 the digit in the last place retained.

### 2.8.1 Example Calculations

- Step 1 Determine the absolute volume of cement and finely divided minerals.
  - From Table 2.2.1 "Cement Factor for Class or Type of Concrete," the minimum cement factor is 5.65 cwt/yd³ for Class PV concrete from a central mixed plant.
  - From 2.2.2 "Allowable Cement Factor Reduction Admixture," the cement factor may be reduced by 0.30 cwt/yd³ when using a water-reducing admixture.

The resulting cement factor is  $5.65 - 0.30 = 5.35 \text{ cwt/yd}^3$ 

• From 2.4.1.1 "Fly Ash," the Class C fly ash can replace up to 30 percent of the cement. From 2.4.3 "Mitigation of Alkali Silica Reaction with Finely Divided Minerals," it is determined that the aggregate combination is in Group II. Because the cement has equivalent alkali content greater than 0.60 percent, Mixture Option 2 is necessary, and thus, replacement with a minimum 25.0 percent Class C fly ash is required to reduce the risk of a deleterious alkali silica reaction. It is decided to use 25 percent fly ash.

The calculation is  $5.35 \times 0.25 = 1.34 \text{ cwt/yd}^3$  of fly ash.

The calculation for the cement is  $5.35 - 1.34 = 4.01 \text{ cwt/yd}^3$ 

After rounding up to the nearest 5 lb/ yd³, the values are 4.05 cwt/yd³ for cement and 1.35 cwt/yd³ for fly ash.

```
The absolute volume of cement per cubic yard of concrete = (4.05 \text{ cwt/yd}^3 \times 100 \text{ lb/cwt}) \div (3.15 \times 1,683.99 \text{ lb/yd}^3) = 0.076 \text{ yd}^3
```

```
The absolute volume of fly ash per cubic yard of concrete = (1.35 \text{ cwt/yd}^3 \times 100 \text{ lb/cwt}) \div (2.61 \times 1,683.99 \text{ lb/yd}^3) = 0.031 \text{ yd}^3
```

- Step 2 Determine the absolute volume of water.
  - From 2.5 "Water-to-Cement Ratio and Water Content," the w/c ratio range for Class PV concrete is 0.32 0.42. It is decided to use a w/c ratio of 0.42 in order to determine the maximum total water content allowed for this design.
  - As determined in Step 1, the sum of cement and finely divided mineral contents is 405 lb/yd³ + 135 lb/yd³ = 540 lb/yd³.

```
Thus, the design water = 0.42 \times 540 = 227 \text{ lb/yd}^3 of water when rounded.
```

The absolute volume of water per cubic yard of concrete =  $227 \text{ lb/yd}^3 \div (1.00 \times 1,683.99 \text{ lb/yd}^3)$ =  $0.135 \text{ yd}^3$ 

- Step 3 Determine the absolute volume of air.
  - From 2.6 "Air Content," the midpoint of the air content range for Class PV concrete is 6.5 percent.

The absolute volume of air per cubic yard of concrete = 6.5 percent  $\div 100 = 0.065$  yd<sup>3</sup>

Determine the absolute volume of coarse aggregate. Step 4

- Select a mortar factor for Class PV concrete from 2.7.2.1 "Design Mortar Factor." A mortar factor value of 0.83 is a good starting point.
- As given, the coarse aggregate voids are 0.39.

From 2.7.3 "Coarse Aggregate Absolute Volume Calculation," there are two ways to calculate the absolute volume of coarse aggregate:

From the following equation, the absolute volume of coarse aggregate per cubic yard of concrete

$$= \frac{1}{1 + \left(\frac{\text{Mortar Factor}}{1 - \text{Voids}}\right)} = \frac{1}{1 + \left(\frac{0.83}{1 - 0.39}\right)} = 0.424 \text{ yd}^3$$

Or with respect to the mortar volume, the absolute volume of coarse aggregate per cubic yard of concrete

= 1 - Volume Fraction of Mortar = 
$$1 - \frac{\text{Mortar Factor}}{(1-V) + \text{Mortar Factor}}$$
  
=  $1 - \frac{0.83}{(1-0.39) + 0.83} = 0.424 \text{ yd}^3$ 

Step 5 Determine the absolute volume of fine aggregate.

> The absolute volume of fine aggregate is found by subtracting all of the known volumes from 1.

Therefore, the absolute volume of fine aggregate per cubic yard = 
$$1 - (0.076 + 0.031 + 0.135 + 0.065 + 0.424) = 0.269 \text{ yd}^3$$

Convert the absolute volume of the coarse and fine aggregate to pounds. Step 6

Coarse aggregate =  $0.424 \text{ yd}^3 \times 2.68 \times 1,683.99 \text{ lb/yd}^3 = 1,914 \text{ lb}$ 

Fine aggregate =  $0.269 \text{ yd}^3 \times 2.66 \times 1,683.99 \text{ lb/yd}^3 = 1,205 \text{ lb}$ 

Step 7 Summarize the mix design.

> Cement  $= 4.05 \text{ cwt/yd}^3 \text{ or } 405 \text{ lb/yd}^3$  $= 1.35 \text{ cwt/yd}^3 \text{ or } 135 \text{ lb/yd}^3$ Fly Ash

= 227 lb/yd<sup>3</sup> or (227 lb/yd<sup>3</sup>  $\div$  8.33 lb/gal = 27 gal/yd<sup>3</sup>)

rıy Asn = 1.35 cwt/yd³ or 135 lb/yd³ Water (Maximum) = 227 lb/yd³ or (227 lb/yd³ ÷ Air Content (Target) = 6.5% Coarse Aggregate = 1,914 lb/yd³ Fine Aggregate = 1,205 lb/yd³ Admixture = water-reducing admixture a Slump (Target) = 1-1/2 in. (see 7.1 "Slump") Strength (Minimum) = 3500 psi at 14 days (Article Water/Cement Ratio = 0.42

= water-reducing admixture and air entraining admixture

= 3500 psi at 14 days (Article 1020.04, Table 1)

Water/Cement Ratio = 0.42

To confirm the proportions will produce a satisfactory mix (i.e., meeting workability and constructability expectations, in addition to specification requirements), perform a trial mixture (see 7.0 "Concrete Mix Design—Trial Mixture" for more information).

### 2.9 SUMMARY OF MIX DESIGN EQUATIONS

Volume of Cement & Finely Divided Minerals	Variable	Definition
•	V <sub>Cement</sub>	Absolute Volume of Cement, yd <sup>3</sup>
Absolute Volume, $V_{Cement}$ or $V_{FDM} = \frac{Weight}{G_{sp} \times 1,683.99}$	V <sub>FDM</sub>	Absolute Volume of Finely Divided Minerals, yd³
Absolute volume, verment of $V_{FDM} = G_{so} \times 1,683.99$	Weight	Weight of Material (lb)
<b>J</b>	$G_{sp}$	Specific Gravity of Material*
	1,683.99	Unit Weight of Water (lb/yd³)
Water Content		
	W/C	Water/Cement Ratio
Water Content, lb/yd <sup>3</sup> = $W/C \times (Cement + \Sigma FDM)$	Cement	Weight of Cement, lb/yd3
, , , , , , , , , , , , , , , , , , ,	ΣFDM	Sum of Weight of Finely Divided Minerals, lb/yd³
Volume of Water		
Absolute Volume, $V_{Water} = \frac{Weight}{1,683.99}$	Weight	Weight of Water (lb)
1,683.99	1,683.99	Unit Weight of Water (lb/yd³)
Volume of Entrained Air		
%Air	V <sub>Air</sub>	Absolute Volume of Air, yd <sup>3</sup>
Absolute Volume, $V_{Air} = \frac{\% Air}{100}$	% Air	Air Content (percent)
Volume Fraction of Coarse Aggregate & Mortar		
Fraction of CA Solids, $F_{CA} = 1 - V$	V	Voids in Coarse Aggregate
Volume Fraction of Mortar = $\frac{M_{\rm O}}{M_{\rm O} + F_{\rm CA}}$	M <sub>○</sub>	Mortar Factor
Volume of Coarse Aggregate  Absolute Volume, V <sub>CA</sub> = 1 – Volume Fraction of		
Mortar $V_{CA} = 1 - V_{Old Tile}$	$V_{CA}$	Absolute Volume of Coarse Aggregate, yd <sup>3</sup>
OR	Мо	Mortar Factor
$V_{CA} = \frac{1}{\sqrt{1 + \frac{1}{2}}}$	7770	Wortan Factor
$V_{CA} = \frac{1}{1 + \left(\frac{M_{O}}{1 - V}\right)}$	V	Voids in Coarse Aggregate
Volume of Fine Aggregate		
	$V_{FA}$	Absolute Volume of Fine
		Aggregate, yd <sup>3</sup>
	V <sub>Cement</sub>	Absolute Volume of Cement, yd <sup>3</sup>
Absolute Volume,	$\Sigma V_{FDM}$	Sum Total of Absolute Volume
$V_{FA} = 1 - (V_{Cement} + \sum V_{FDM} + V_{Water} + V_{Air} + V_{CA})$	V <sub>Water</sub>	of Finely Divided Minerals, yd <sup>3</sup> Absolute Volume of Water, yd <sup>3</sup>
	V Water V <sub>Air</sub>	Absolute Volume of Air, yd <sup>3</sup>
		Absolute Volume of Coarse
	$V_{CA}$	Aggregate, yd <sup>3</sup>
(continue	\d\	

(continued)

Aggregate Content		
	V <sub>CA</sub>	Absolute Volume of Coarse Aggregate, yd <sup>3</sup>
Weight of Aggregate (lb) = $V_{CA} \times G_{SSD} \times 1,683.99$	V <sub>FA</sub>	Absolute Volume of Fine Aggregate, yd³
$= V_{FA} \times G_{SSD} \times 1,683.99$	G <sub>SSD</sub>	Specific Gravity of Aggregate at Saturated Surface-Dry Condition
	1,683.99	Unit Weight of Water (lb/yd³)

<sup>\*</sup> For cement and finely divided minerals, there are no pores for the material to absorb water. Therefore, a saturated surface-dry condition cannot exist as it can for aggregates. Thus, the term "apparent specific gravity" may be used to describe this type of specific gravity.

### 3.0 SPECIALTY MIXTURES

### 3.1 HIGH-EARLY STRENGTH CONCRETE MIXTURES

Projects will frequently have requirements for high-early-strength concrete pavement (jointed and continuously reinforced), base course, and base course widening. A high-early-strength portland cement concrete mix is defined as follows: "A concrete mix that will meet mix design strength requirements prior to the test of record. Typically, the concrete strength is obtained in 3 days or less."

Projects requiring high-early-strength concrete mixtures frequently involve intersections and entrances to business establishments. In addition, concrete railroad crossings are always a high-early-strength mixture because the required strength is to be obtained in 48 hours. The accelerated strength is needed to minimize disruptions to the public.

The following options are used to obtain a high-early-strength concrete mixture. The Contractor may submit other options for approval by the Engineer.

- Option 1. Replace the cement with Type III high-early-strength cement.
- Option 2. Increase the amount of cement to "7 bags," which translates to 658 lb/yd³. However, such mix designs typically use 650-655 lb/yd³.
  - In addition, limit the w/c ratio to a maximum 0.42. As a result of the water limitation, a water-reducing admixture is frequently used.
- Option 3. Use a non-chloride accelerator. Normally, only a non-chloride accelerator is allowed in new concrete construction. For concrete repairs, the District has the option to allow a chloride accelerator, which is normally only done for Class PP-2 concrete. Refer also to 6.1 "Required Use of Admixtures" and 6.2 "Optional Use of Admixtures" for additional information on accelerators.

### 3.2 OTHER MIXTURES

The following appendices provide additional information on other specialty mixtures:

- Appendix F "CEMENT AGGREGATE MIXTURE (CAM) II"
- Appendix G "CONTROLLED LOW STRENGTH MATERIAL (CLSM)"
- Appendix H "STAMPED OR INTEGRALLY COLORED CONCRETE
- Appendix I "CONCRETE REVETMENT MATS"
- Appendix J "INSERTION LINING OF PIPE CULVERTS (GROUT)"
- Appendix K "INSERTION LINING OF PIPE CULVERTS (CELLULAR CONCRETE)"
- Appendix L "CLASS SI CONCRETE BETWEEN PRECAST CONCRETE BOX CULVERTS"
- Appendix M "PERVIOUS CONCRETE"
- Appendix P "BRIDGE DECK LATEX CONCRETE OVERLAY MIX DESIGN"

### 3.3 SYNTHETIC FIBERS

The Department may require synthetic fibers for thin concrete overlays (on pavement or bridge decks). The fibers are used as reinforcement to improve the concrete's resistance to cracking. Contractors also have the option to use synthetic fibers in slipformed concrete for gutter, curb, median, and paved ditch. The synthetic fibers reduce concrete tearing, which is a labor savings for finishing operations.

In terms of mix design, it is suggested to ensure adequate mortar is available to coat the fibers. This may require a slightly higher mortar factor, or a small increase in the total amount of cement and finely divided minerals in the mixture. It is best to consult with the supplier of the fibers when developing the mix design. The Level III PCC Technician is also reminded that the slump test is not a good indicator of workability for a mixture containing fiber reinforcement.

### 4.0 TERNARY CONCRETE MIX DESIGNS

A ternary concrete mix design consists of cement and two finely divided minerals. Article 1020.05(c)(5) provides the specification for mixtures with multiple finely divided minerals. The Department encourages the use of a high percentage of finely divided minerals in a mix design for the following reasons:

- The risk of alkali-silica reaction is further reduced.
- The concrete permeability will be lower which increases the time before steel reinforcement will corrode.
- Improved workability and less slump loss in hot weather.
- Higher long term strengths.
- A more economical and environmentally friendly mix.

The one disadvantage of concrete mixtures with a high percentage of finely divided minerals is during cool weather, when slower strength gain can occur.

### 5.0 MASS CONCRETE MIX DESIGNS

According to Article 1020.15, the Contractor shall control the heat of hydration for concrete structures when the least dimension for a foundation, footing, substructure, or superstructure concrete pour exceeds 5.0 ft, or for a drilled shaft exceeding 8.0 ft in diameter. There are two primary purposes for controlling heat of hydration in large pours:

- 1) to control volume changes that may crack the concrete induced by the high concrete temperatures developed during hydration
- 2) to mitigate against a phenomenon known as delayed ettringite formation (DEF), which is an expansive distress that will crack the concrete caused when concrete achieves very high temperatures early in its life. This ettringite will form after the concrete has hardened, provided there is adequate moisture.

In terms of designing a mass concrete pour mix design, specifications recommend a uniformly graded mix with preference given to larger size aggregate. The purpose is to reduce the total amount of cement and finely divided minerals required to coat the aggregate surface area, which will also help reduce the total heat of hydration. Per Department specifications, the total required cement and finely divided minerals may be lower for mass concrete pours.

Mass concrete pour mix designs will also normally have a high percentage of finely divided minerals to control the heat of hydration. For example, the finely divided minerals may constitute a maximum of 65.0 percent of the total cement and finely divided minerals in a mix design.

If the Level III PCC Technician is required to develop a mass concrete pour mix design, the Department recommends the use of a Consultant that specializes in this area. Various field methods for pre-cooling and post-cooling the concrete are available, and these methods will dictate the required mix design.

### 6.0 CONCRETE ADMIXTURES

According to Article 1020.05(b), the Contractor shall be responsible for using admixtures and determining dosages for all Classes of concrete, cement aggregate mixture II (CAM II), and controlled low-strength material (CLSM) to produce a mixture with suitable workability, consistency, and plasticity.

To view or download the Qualified Product List of Air-Entraining Admixtures for Controlled Low-Strength Material, Qualified Product List of Concrete Admixtures, and Qualified Product List of Corrosion Inhibitors, go to <a href="http://idot.illinois.gov/">http://idot.illinois.gov/</a>; Doing Business; Material Approvals; Concrete; Qualified Product Lists.

Remember when batching to consider the water content in admixtures, which is most often significant when using a high range water-reducing admixture (superplasticizer), calcium chloride accelerator, or latex admixture. Generally, when water from admixtures is significant, Article 1020.05(b) states the Contractor shall calculate 70 percent of the admixture dosage as water. Refer to the Portland Cement Concrete Level II Technician Course manual for additional information on water in admixtures. Also note that accounting for the water in latex admixture is a special case; thus, refer to Appendix P for more information.

### 6.1 REQUIRED USE OF ADMIXTURES

The following information on admixtures is found in Article 1020.05(b).

### Air-Entraining Admixture

Except for Class SC concrete (see 6.2 "Optional Use of Admixtures") and bridge deck latex concrete overlays, all concrete and CAM II shall contain entrained air. Normally, an air-entraining admixture is used in lieu of air-entraining cement.

For CLSM, based on the mix design selected, an air-entraining admixture may be required (refer to Article 1019.02).

### Retarding Admixture

When the atmospheric or concrete temperature is 65 °F or higher, a retarding admixture shall be used for Class BS concrete and concrete bridge deck overlays.

For Class PP-4 concrete, a retarding admixture shall be used for stationary or truck-mixed concrete.

For Class DS concrete, a retarding admixture shall be used. In addition, the concrete mixture shall be designed to remain fluid throughout the anticipated duration of the pour plus one hour.

### Water-Reducing Admixture

A water-reducing admixture shall be used for cement aggregate mixture II.

If Class C fly ash or GGBF slag is used in Class PP-1 or RR concrete, a water-reducing or high range water-reducing admixture shall be used.

For Class DS concrete involving dry excavations 10 ft or less, a high range water-reducing admixture may be replaced with a water-reducing admixture if the concrete is vibrated.

### High Range Water-Reducing Admixture (Superplasticizer)

A superplasticizer shall be used for Class PP-2, PP-3, PP-4, PP-5 concrete, formed concrete repair, bridge deck, concrete wearing surface, bridge deck fly ash or GGBF slag overlay, bridge deck microsilica concrete overlay, or bridge deck high-reactivity metakaolin concrete overlay.

If Class C fly ash or GGBF slag is used in Class PP-1 or RR concrete, a water-reducing admixture or superplasticizer shall be used.

A superplasticizer shall be used for Class DS concrete, except a water-reducing admixture may be used as discussed in the previous paragraph.

### Accelerating Admixture

A non-chloride accelerating admixture shall be used for Class PP-2, PP-3, and PP-5 concrete. For Class PP-2 concrete, the non-chloride accelerating admixture shall be calcium nitrite when the air temperature is less than 55 °F. For Class PP-3 concrete, the accelerating admixture shall be calcium nitrite.

A calcium chloride accelerator is allowed only by special provision in the contract. If a special provision is used, it normally involves Class PP-2 concrete.

### Latex Admixture

A latex admixture shall be used for bridge deck latex concrete overlay. The latex admixture dosage is 24.5 gal/yd³. Also, refer to Appendix P regarding latex admixture in bridge deck latex concrete overlay mix designs.

### **Corrosion Inhibitor**

In some instances, the contract documents may require the use of a corrosion inhibitor. Refer to Article 1020.05(b)(10).

### Other Applications

The Contractor shall be responsible for using admixtures and determining dosages for all Classes of concrete that will produce a mixture with suitable workability, consistency, and plasticity.

### 6.2 OPTIONAL USE OF ADMIXTURES

The following information on admixtures is found in Article 1020.05(b).

### Air-Entraining Admixture

An air-entraining admixture may be used in Class SC concrete at the option of the Contractor.

### Retarding Admixture

A retarding admixture may be used in Class PP-4 concrete when using a mobile portland cement concrete plant, provided it is approved by the Engineer.

### Water-Reducing Admixture

A water-reducing admixture may be used in Class PV, PP-1, PP-2, PP-3, PP-4, RR, BS, SC, and SI concrete. This also applies to bridge deck microsilica concrete overlay and bridge deck high-reactivity metakaolin concrete overlay.

### High-Range Water-Reducing Admixture (Superplasticizer)

A high range water-reducing admixture may be used in Class PP-1 or RR concrete.

### Accelerator

A non-chloride accelerator may be used in Class PP-1 or RR concrete. The non-chloride accelerating admixture shall be calcium nitrite when the air temperature is less than 55 °F.

### Other Applications

The Contractor has the option to determine the use of additional admixtures in the various concrete Classes and other applications. However, the Contractor shall obtain the approval from the Engineer to use an accelerator when the concrete temperature is greater than 60 °F, except for Class PP, RR, PC, and PS concrete. Note that a calcium chloride accelerator is only allowed by special provision.

### 7.0 CONCRETE MIX DESIGN—TRIAL MIXTURE

Once a mix design is completed, a trial mixture is recommended to verify the mix design will meet slump, air content, and strength requirements. If a trial mixture is performed, it is a good idea to notify the Department's District office. The District may wish to observe the trial mixture or possibly perform some of its own testing.

A trial mixture differs from a trial batch (see 10.0 "Department Concrete Mix Design Verification") in that it is initiated and performed at the mix designer's discretion, not the Engineer's. Thus, it should be considered an opportunity for the mix designer to pre-verify that his or her design meets expectations for workability, strength, and specification requirements. Furthermore, allowing the District a chance to observe the trial or providing test results from it may alleviate any concerns the Engineer might have that would cause him or her to require a trial batch.

### 7.1 SLUMP

The slump test (Illinois Modified AASHTO T 119) is used to determine the batch-to-batch consistency of concrete. Per Article 1020.04, different slump ranges are specified for different construction applications (also refer to Table 7.1).

Mix design target slump values near the maximum of the specified range are recommended to aid finishing and handwork, as well as potentially improving the effectiveness of air-entraining admixtures (that is, additional water benefits air-entraining admixtures). Furthermore, high slumps at the plant can help anticipate slump loss due to high temperature and long haul times, which otherwise could result in a mixture that may be difficult to place and finish in the field. For example, experience has shown that for slipformed pavement construction on a very hot day, a slump of 2-1/2 inches at the plant can fall up to 1-1/2 inches by the time it reaches the paver. A slump of 1/2 to 1-1/2 inches at the paver is typical for slipform construction, but many Contractors desire 1-1/2 inches to obtain a smooth pavement.

### 7.2 STRENGTH

One of the most important properties of concrete is its strength. The purpose of strength testing is to verify the strength potential of the concrete. Per Article 1020.04, different minimum strengths are specified for different construction applications (also refer to Table 7.2).

Additional information regarding determining target strength can be found in 8.0 "Determining the Concrete Mix Design Target Strength."

Table 7.1 Slump

	01
Class or Type of Concrete	Slump inches
PV	<b>2-4</b> <sup>1,2</sup>
PP-1	2-4 <sup>2</sup>
PP-2	2-6 <sup>2</sup>
PP-3	2-4 <sup>2</sup>
PP-4	2-6 <sup>2</sup>
PP-5	2-8
RR	2-4 <sup>2</sup>
BS	2-4 <sup>2</sup>
PC	Wet Cast: 1-4 <sup>2</sup>
PC	Dry Cast: 0-1
PS	1-4 <sup>2,3</sup>
DS	6-8 <sup>4</sup>
SC	3-5 <sup>2,5</sup>
SI	2-4 <sup>2</sup>
Deck Slab Repair	Refer to PP-1, 2, 3, 4, and 5
Formed Concrete Repair	5-7
Concrete Wearing Surface	Refer to Class BS Concrete
Bridge Deck Fly Ash or GGBF Slag Concrete	Refer to Class BS Concrete
Overlay	Neiel to Class B3 Colletete
Bridge Deck Microsilica Concrete Overlay	3-6
Bridge Deck High-Reactivity Metakaolin Concrete Overlay	3-6
Bridge Deck Latex Concrete Overlay	3-7 <sup>6</sup>

### Notes:

- 1. The slump range for slipform construction shall be 1/2-2 1/2 in.
- 2. The maximum slump may be increased to 7 in., when a high range water-reducing admixture is used.
- 3. For Class PS, the maximum slump may be increased to 8 1/2 in. if the high range water-reducing admixture is the polycarboxylate type.
- 4. If concrete is placed to displace drilling fluid, or against temporary casing, the slump shall be 8-10 in. at the point of placement. If a water-reducing admixture is used in lieu of a high range water-reducing admixture according to Article 1020.05(b)(7), the slump shall be 2-4 in.
- 5. The maximum slump may be increased to 8 in., when a high range water-reducing admixture is used.
- 6. Maximum slump may be exceeded if there are no visible signs of segregation.

Table 7.2 Strength

Class or Type of Concrete	Compressive Strength	Flexural Strength
Class or Type of Concrete	psi	psi (kPa)
PV	3,500 <sup>1,2</sup>	650 <sup>1,2</sup>
PP-1	3,200 at 48 hrs <sup>3</sup>	600 at 48 hrs <sup>3</sup>
PP-2	3,200 at 24 hrs <sup>3</sup>	600 at 24 hrs <sup>3</sup>
PP-3	3,200 at 16 hrs <sup>3</sup>	600 at 16 hrs <sup>3</sup>
PP-4	3,200 at 8 hrs <sup>3</sup>	600 at 8 hrs³
PP-5	3,200 at 4 hrs <sup>3</sup>	600 at 4 hrs <sup>3</sup>
RR	3,500 at 48 hrs	650 at 48 hrs
BS	4,000 <sup>1</sup>	675 <sup>1</sup>
PC	Refer to Section 1042	Refer to Section 1042
PS	Refer to Section 1020	Refer to Section 1020
DS	4,000 <sup>1</sup>	675 <sup>1</sup>
SC	3,500 <sup>1</sup>	650 <sup>1</sup>
SI	3,500 <sup>1</sup>	650 <sup>1</sup>
Deck Slab Repair	Refer to PP-1, 2, 3, 4, and 5	Refer to PP-1, 2, 3, 4, and 5
Formed Concrete Repair	4,000 <sup>1</sup>	675 <sup>1</sup>
Concrete Wearing Surface	Refer to Class BS Concrete <sup>4</sup>	Refer to Class BS Concrete <sup>4</sup>
Bridge Deck Fly Ash or GGBF Slag Concrete Overlay	Refer to Class BS Concrete	Refer to Class BS Concrete
Bridge Deck Microsilica Concrete Overlay	4,000 <sup>1</sup>	675 <sup>1</sup>
Bridge Deck High-Reactivity Metakaolin Concrete Overlay	4,000 <sup>1</sup>	675 <sup>1</sup>
Bridge Deck Latex Concrete Overlay	4,000 <sup>1</sup>	675 <sup>1</sup>

### Notes:

- 1. 14-day strength
- 2. If Type III cement is used, the indicated strength shall be achieved in 3 days.
- 3. For Class PP concrete used in bridge deck patching, the mix design shall have 72 hours to obtain a 4,000 psi compressive or 675 psi flexural strength.
- When Steel Bridge Rail is used in conjunction with concrete wearing surface, the 14 day mix design shall be replaced by a 28 day mix design with a compressive strength of 5,000 psi and a flexural strength of 800 psi.

### 7.3 PROCEDURE FOR TRIAL MIXTURE

The applicable test methods for a conventional concrete trial mixture are Illinois Modified AASHTO R 60, R 100, T 22, T 119, T 121, T 152, T 177, T 196, and Illinois Modified ASTM C 1064. A summary of test methods is shown in Table 7.3. Testing should be performed or overseen by an individual who has successfully completed the Portland Cement Concrete Level I Technician training.

For self-consolidating concrete, applicable test methods for a trial mixture are Illinois Test Procedures SCC-1, SCC-2, SCC-3, SCC-4, SCC-6, and Illinois Modified AASHTO R 60, R 100, T 22, T 121, T 152, T 177, T 196, and Illinois Modified ASTM C 1064. Refer to Article 1020.04 to review the self-consolidating concrete specifications.

A unit weight test (Illinois Modified AASHTO T 121), which also provides yield, should be performed to check the accuracy of proportioning.

The Contractor is reminded that when a trial mixture is done, the water in admixtures should be taken into account.

A trial mixture may be mixed in the laboratory according to AASHTO R 39 or in the field. The volume of the laboratory trial mixture is determined by the laboratory equipment. The volume of the field trial mixture should be a minimum of 2 yd<sup>3</sup>, but 4 yd<sup>3</sup> is strongly recommended to more accurately evaluate the influence of mixing.

The laboratory used to perform a trial mixture should be approved according to the Bureau of Materials Policy Memorandum, "Minimum Private Laboratory Requirements for Construction Materials Testing or Mix Design." Field equipment used to perform a trial mixture should be approved according to the Bureau of Materials Policy Memorandum, "Approval of Concrete Plants and Delivery Trucks."

For the trial mixture, it is recommended to batch the mixture at or near the maximum w/c ratio. The air content should be within 0.5 percent of the maximum allowable specification value. Since it is difficult to entrain air in slipformed concrete, a value below the midpoint of the range is permissible. The slump should be within the allowable specification range. If batching self-consolidating concrete (SCC), applicable SCC tests should be within the allowable specification range.

Determine the concrete temperature. Concrete temperature will have a significant influence on strength gain. If a cold weather concrete mix is being developed, a concrete temperature in the 50 to 60 °F range may be more appropriate for the trial mixture. Similarly, a warm weather concrete mix should be developed with a concrete temperature in the 80 to 90 °F range.

Once the mix design is within the allowable tolerance for slump and air content, or applicable SCC tests, evaluate the mix for consistency, plasticity, and workability. After this is done, make strength specimens. The Contractor has the option to make compressive or flexural specimens, or a combination of both. The Contractor is advised that in some instances flexural strength is specified, and compressive strength may be used only with the approval of the Engineer (refer to Articles 503.05 and 503.06). As a minimum, make strength specimens to determine the test of record. The test of record shall be the day indicated in the Standard Specifications and is the minimum required strength. However, the Department recommends the development of a strength curve with testing at 3, 7, 14, 28, and 56 days. (Note: A

56-day break is not needed for a mixture that does not include finely divided minerals.) In the case of patching mixes, testing is measured in terms of hours. Therefore, a strength curve should be generated as recommended by the Engineer.

Strength will be based on the average of a minimum two 6- by 12-in. cylinder breaks, three 4- by 8-in. cylinder breaks, or two beam breaks tested according to Illinois Modified AASHTO T 22 or T 177. Per Illinois Modified AASHTO R 100, cylinders shall be 6 by 12 in. when the nominal maximum aggregate size of the coarse aggregate exceeds 1 in. Nominal maximum size is defined as the largest sieve which retains any of the aggregate sample particles.

After the Contractor has evaluated the test results for specification compliance and the characteristics of the mix for field placement, the Contractor can accept it as is, adjust it, or re-design it. If the mix design is adjusted or re-designed, another trial mixture is recommended.

**Table 7.3 Test Methods** 

Test Method	Title
IL Mod. AASHTO R 60	Sampling Freshly Mixed Concrete
IL Mod. AASHTO R 100	Making and Curing Concrete Test Specimens in the Field
IL Mod. AASHTO T 22	Compressive Strength of Cylindrical Concrete Specimens
IL Mod. AASHTO T 119	Slump of Hydraulic Cement Concrete
IL Mod. AASHTO T 121	Weight per Cubic Foot, Yield, and Air Content (Gravimetric) of Concrete
IL Mod. AASHTO T 152	Air Content of Freshly Mixed Concrete by the Pressure Method
IL Mod. AASHTO T 161	Resistance of Concrete to Rapid Freezing and Thawing
IL Mod. AASHTO T 177	Flexural Strength of Concrete (Using Simple Beam with Center Point Loading)
IL Mod. AASHTO T 196	Air Content of Freshly Mixed Concrete by the Volumetric Method
IL Mod. ASTM C 672	Scaling Resistance of Concrete Surfaces Exposed to Deicing Chemicals
IL Mod. ASTM C 1064	Temperature of Freshly Mixed Portland Cement Concrete
ITP SCC-1	Sampling, Determining Yield and Air Content, and Making and Curing Strength Test Specimens of Self-Consolidating Concrete
ITP SCC-2	Slump Flow and Stability of Self-Consolidating Concrete
ITP SCC-3	Passing Ability of Self-Consolidating Concrete by J-Ring and Slump Cone
ITP SCC-4	Passing Ability of Self-Consolidating Concrete by L-Box
ITP SCC-6	Static Segregation of Hardened Self-Consolidating Concrete Cylinders

### 8.0 DETERMINING THE CONCRETE MIX DESIGN TARGET STRENGTH

Since the Department's mix design method is very conservative, often resulting in strength test results exceeding the minimum strength requirement, a statistical analysis of strength test results is not normally performed. However, the American Concrete Institute (ACI) has developed a statistical method to determine a mix design target strength.

The mix design target strength ( $f'_{cr}$ ) is defined as the average strength the concrete mix must attain to ensure the specified strength ( $f'_{c}$ ) is met. Note that "average" strength implies that half of the samples tested are stronger than the average, and half of the samples tested are weaker than the average. Thus, the mix design target strength must be a value greater than the minimum strength requirement.

The mix design target strength is based on statistics and will vary between concrete producers. The purpose of the target strength is to allow for variations in water, air content, aggregate gradation, concrete mixing, producer quality control, and other parameters which affect strength. The mix design target strength ensures that the variations will not cause individual strength test results to drop below the minimum specification strength requirement.

Ultimately, the adjustment of the average to obtain the target strength for a given mix design depends on the precision of test results. The precision is quantified as the standard deviation from a series of test results on a similar mix design. Refer to Appendix N "Average and Standard Deviation" for additional information.

Procedures for determining the mix design target strength from the minimum specification strength requirement can be found in the ACI 301 "Specifications for Structural Concrete," summarized below:

- The average strength of any three consecutive tests\* may not be below the specified value of compressive strength,  $f'_c$ .
- The strength of any one test\* may not exceed 500 psi below  $f'_c$  when  $f'_c$  is 5000 psi or less; or may not exceed 0.10 $f'_c$  below  $f'_c$  when  $f'_c$  is more than 5000 psi.
- \* One test is the average of two 6- by 12-in. cylinder breaks or three 4- by 8-in. cylinder breaks.

Using the above criteria, there is only a 1 percent chance that the average of any three consecutive test values will be less than the specified strength ( $f'_c$ ). In addition, there is only a 1 percent chance that the strength of any one test will be more than 500 psi below the specified strength ( $f'_c$ ) when  $f'_c$  is no more than 5000 psi; or will be more than 10 percent below the specified strength ( $f'_c$ ) when  $f'_c$  is more than 5000 psi.

In order to calculate the mix design target strength, the standard deviation (S) must be determined. The standard deviation shall be based on: actual tests of the mix design using materials, quality control procedures, and conditions similar to those expected; test results within 1,000 psi of the strength requirement for the mix design; and at least 30 consecutive tests or two groups of consecutive tests totaling at least 30 tests are required (no group having less than 10 tests). For 30 tests, this means that 30 separate batches of concrete have been tested. The time period for the 30 tests may be up to one year, or as determined by the Engineer.

The standard deviation shall be based on at least 30 test results. Smaller data sets may be used when a modification factor (m) is applied to S as follows:

Number of Tests	Modification Factor (m)
≥ 30	1.00
25	1.03
20	1.08
15	1.16

After the standard deviation is determined, the mix design target strength ( $f'_{cr}$ ) can be determined using the larger value calculated from the following two equations:

For 
$$f_c^{'} \leq 5000$$
 psi:  $f_{cr}^{'} = f_c^{'} + (1.34 \times mS)$ , or  $f_{cr}^{'} = f_c^{'} + (2.33 \times mS) - 500$  psi For  $f_c^{'} > 5000$  psi:  $f_{cr}^{'} = f_c^{'} + (1.34 \times mS)$ , or  $f_{cr}^{'} = 0.90f_c^{'} + (2.33 \times mS)$ 

If there are less than 15 tests or no test data available, the mix design target strength ( $f'_{cr}$ ) is determined as follows:

Less Than 15 Tests or No Test Data Available:	Mix Design Target Strength
If $f_c^{'} < 3,000 \text{ psi}$	$f_{cr}^{'} = f_{c}^{'} + 1,000 \text{ psi}$
If $f_c^{'}$ is 3,000 – 5,000 psi	$f_{cr}^{'} = f_{c}^{'} + 1,200 \text{ psi}$
If $f_{c}^{'} > 5,000 \text{ psi}$	$f_{cr}^{'} = 1.10 f_{c}^{'} + 700 \text{ psi}$

Per ACI,  $f'_c$  is based on 28 day tests or as otherwise specified. For Department mix designs,  $f'_c$  will frequently be based on 14 day tests when  $f'_c$  is no more than 4000 psi and 28 day tests when  $f'_c$  is greater than 4000 psi.

### 9.0 REQUIREMENTS FOR CONCRETE DURABILITY TEST DATA

The Department does not normally test concrete for freeze/thaw and salt scaling durability because of the following:

- Concrete mix design procedures are specified.
- Concrete mix design parameters are specified, such as minimum cement, maximum finely divided minerals, maximum w/c ratio and amount of air entrainment.
- Concrete coarse aggregates are specified to be freeze/thaw durable for certain construction items.

If the Contractor desires to create a new concrete mix design which is not within the mortar factor limits as listed in 2.7.2.2 "Design Mortar Factor," durability test data may be required by the Engineer. In no case shall the mortar factor exceed 0.86 for Class BS concrete, except when using structural lightweight concrete as noted in 2.7.2.2. Furthermore, in no case shall the fine aggregate portion exceed a maximum 50 percent by weight (mass) of the total aggregate used.

The Contractor shall have the durability tests performed by an independent laboratory accredited by the AASHTO Accreditation Program for AASHTO T 161 and ASTM C 672. Durability test data shall consist of the following:

- The new concrete mix design shall be tested according to AASHTO T 161, Procedure A or B. The new concrete mix design shall have a relative dynamic modulus of elasticity which is a minimum 80 percent of the initial modulus after 300 cycles.
- The new concrete mix design shall be tested according to Illinois Modified ASTM C 672. An identical control mix shall be tested, except it shall have 565 lb/yd³ of cement and no finely divided minerals. The average visual rating of the new mix design divided by the average visual rating of the control mix design shall not exceed 0.8 after 60 cycles.

### 10.0 DEPARTMENT CONCRETE MIX DESIGN VERIFICATION

### 10.1 VERIFICATION BY THE ENGINEER

A new concrete mix design will be verified by the Engineer from test information provided by the Contractor (optional), testing performed by the Engineer, applicable Department historical test data, target strength calculations, and previous Department experience.

For a mix design previously developed by the Engineer or Contractor, the Engineer will verify the mix design if the Department's historical test data shows compliance with specification requirements.

Verification of a mix design shall in no manner be construed as acceptance of any mixture produced. Tests performed at the jobsite will determine if a mix design can meet specifications.

### 10.2 TESTING PERFORMED BY THE ENGINEER

For a new mix design to be verified, the Engineer may require the Contractor to provide a batch of concrete for testing if one of the following applies:

- When the Engineer has a concern the mix design will not meet minimum strength requirements. As an example, this may occur for a mix that will be used in cool weather or requires high-early-strength.
- When the Engineer has a concern the mix design will not provide adequate workability, consistency, and plasticity in the field. As an example, this may occur when the mix is to be pumped or stone sand is to be used.
- When the District lacks experience or historical test data for the design parameters, gradations, or material sources used in the mix design.
- When the Contractor desires to use a mortar factor outside the limits as listed in 2.7.2.1 "Design Mortar Factor." Refer to 9.0 "Requirement for Concrete Durability Test Data" for additional information.

In addition, the Engineer may require the Contractor to provide a trial batch per Articles 1001.01(b); 1001.01(c); 1020.04, Table 1, Note 12; 1020.05(c)(1)d.; and 1020.05(c)(2)c.

The batch of concrete shall be provided at no cost to the Department.

The Engineer may require the Contractor to provide material, at no cost to the Department, to perform durability testing according to ITP 161 and Illinois Modified ASTM C 672.

### 10.2.1 Procedure for Trial Batch

The procedure that follows shall be used to perform a trial batch unless specified otherwise in the contract plans.

The trial batch shall be performed in the presence of the Engineer, and the Engineer will perform all tests. The Contractor has the option to perform their own tests. The volume of the trial batch shall be a minimum of 2 yd³, but 4 yd³ is strongly recommended to more accurately evaluate the influence of mixing. If

the mixer has a capacity less than 2 yd³, then the volume of the trial batch shall be no less than the capacity of the mixer.

For conventional concrete, batch at or near the maximum water/cement ratio or as requested by the Engineer. The air content should be within 0.5 percent of the maximum allowable specification value or as requested by the Engineer. Since it is difficult to entrain air in slipformed concrete, consult with the Engineer on an acceptable value. The slump should be within the allowable specification range. Testing will be performed according to Illinois Modified AASHTO R 60, R 100, T 119, T 152 or T 196, and Illinois Modified ASTM C 1064.

For self-consolidating concrete, batch at or near the maximum water/cement ratio or as requested by the Engineer. The air content should be within 0.5 percent of the maximum allowable specification value or as requested by the Engineer. The slump flow, visual stability index, and J-ring value or L-box blocking ratio should be within the allowable specification range. Testing will be performed according to Illinois Test Procedures SCC-1, SCC-2, SCC-3, SCC-4, SCC-6, and Illinois Modified AASHTO R 60, R 100, T 152 or T 196, and Illinois Modified ASTM C 1064. Refer to Article 1020.04 to review the self-consolidating concrete specifications.

For all trial batches, strength will be determined for the test of record or at other ages determined by the Engineer. The test of record shall be the day indicated in Article 1020.04 or as specified. In all cases, strength will be based on the average of a minimum two 6- by 12-in. cylinder breaks, three 4- by 8-in. cylinder breaks, or two beam breaks tested according to Illinois Modified AASHTO T 22 or T 177. Per Illinois Modified AASHTO R 100, cylinders shall be 6 by 12 in. when the nominal maximum aggregate size of the coarse aggregate exceeds 1 in. Nominal maximum size is defined as the largest sieve which retains any of the aggregate sample particles.

As an option for all trial batches, Illinois Modified AASHTO T 121 may be performed.

### 10.2.1.1 Verification of Trial Batch, Voids Test, and Durability Test Data

The trial batch will be verified by the Engineer if Department test results meet specification requirements. The coarse aggregate voids will be verified by the Engineer if the Department test result is within 0.02 of the Contractor's value. The Contractor's durability test data will be verified by the Engineer if Department test results meet the requirements of 9.0 "Requirements for Concrete Durability Test Data."

Note: Based on the concrete temperature used in the trial batch, the Engineer may request another trial batch to take into consideration the year round use of a mix design. For example, a mix design evaluated at a warm concrete temperature may need another evaluation at a cool concrete temperature to show the mix design is appropriate for cold weather.



# PORTLAND CEMENT CONCRETE LEVEL III TECHNICIAN COURSE

# <u>APPENDICES</u>

Revised: January 1, 2025

# **APPENDIX A**

### **CONCRETE MIX DESIGN – DEPARTMENT PROVIDED (Check Sheet #31)**

Effective: January 1, 2012 Revised: April 1, 2016

For the concrete mix design requirements in Article 1020.05(a) of the Standard Specifications, the Contractor has the option to request the Engineer determine mix design material proportions for Class PV, PP, RR, BS, DS, SC, and SI concrete. A single mix design for each class of concrete will be provided. Acceptance by the Contractor to use the mix design developed by the Engineer shall not relieve the Contractor from meeting specification requirements.

This Page Reserved

# <u>APPENDIX B</u>

### IDOT PCC MIX DESIGN SOFTWARE TUTORIAL Version X1.0

For help, comments, and/or suggestions, please contact:

IDOT Bureau of Materials 126 East Ash Street Springfield, Illinois 62704 Phone: (217) 782-7200

email: DOT.PCCMIX@illinois.gov

### General

This spreadsheet is designed to calculate and report PCC mix designs for submittal to IDOT. The spreadsheet is comprised of data inputs based on the mix design methodology provided in the PCC Level III Technician course manual.

The spreadsheet is organized across a series of tabs. To navigate from one input screen to another, please use the tabs found at the bottom of the Excel screen.

The blue-shaded areas are cells which require data input, green-shaded areas are optional (unless required by your District), and white cells are calculation fields, which are password protected from accidental overwriting.

Throughout the spreadsheet, comments have been interspersed to offer hints on where to find relevant information. To view comments, hold the cursor over the red tags found in the upper right-hand corner of commented cells, as shown below. These comments generally refer to sections of the Course Manual; however, it should be noted that the Department's Standard Specifications and Special Provisions take precedence.

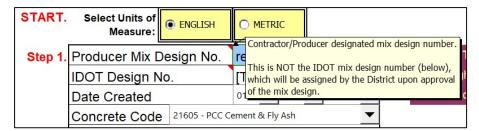



Figure 1. Example of a comment; note red flag, which indicates the cell has a comment.

### **Tutorial Mix Design**

This tutorial also includes notes for how to input the example mix design discussed in Section 2.8 of the Course Manual. If you follow the notes in order as they are presented herein, you should successfully create a basic PCC paving mix design while also being introduced to all of the spreadsheet's functions and capabilities.

### **Step 1. Design Information**

The Design Information page is important to establish the who-what-where of the mix design. This is where the designer decides in which units of measure the mix will be designed, what type of concrete it is, for what Classes of concrete it is valid, and those responsible for the mix design.

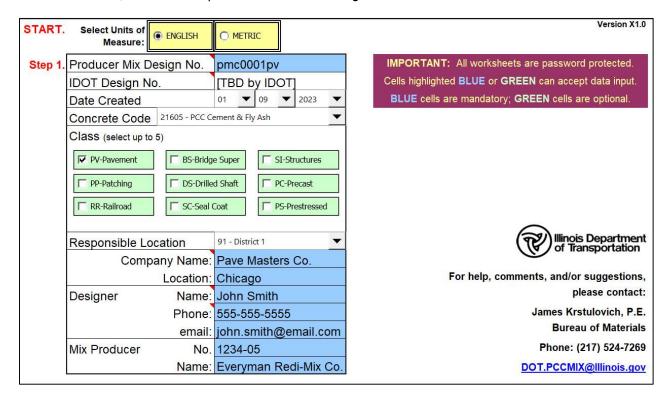

English/Metric [toggle]: Toggle button for selecting the units of measure for the mix design's inputs. All data inputs will have to be entered in the chosen units of measure. However, the design will be reported in **both** units of measure on the different final mix design reports generated.

### **EXAMPLE PROBLEM**

Assuming most of us are more comfortable using English units of measure (lbs, yd3, etc.), the example mix design will be designed using English units.

Click on the **ENGLISH** toggle button.

Mix Design No.:

Alphanumeric designation (up to nine characters in length). This is the Producer's or Contractor's self-designated mix design number; this is not the mix design number assigned by IDOT, see "IDOT Mix Design No." below.

### **EXAMPLE PROBLEM**

Because this is the Producer's or Contractor's mix design number, any reasonably succinct and unique identifier can be used here, as long as it is no more than nine characters long. For this example, we will use PMC0001PV (i.e., Pave Masters Co. paving mix #1).

Nine-character alphanumeric mix design number reported to the Department's CMMS IDOT Mix Design No.: database. This number will be assigned by your District to an approved mix design.

**EXAMPLE** Because this mix design number is assigned by the District upon approval, this cell reads **PROBLEM** Not yet assigned.

Date Created: The date the mix design was created.

### Step 1. Design Information (continued)

Concrete Code: Select the appropriate material code. This code is used by the Department's CMMS

database to designate the type of concrete.

**EXAMPLE** Because this mix will utilize Type I portland cement and Class C fly ash, the appropriate **PROBLEM** Concrete Code to select from the drop-down list is **21605**.

Class: Select up to five Classes of concrete.

**EXAMPLE**PROBLEM
Because this mix will be used for a continuously reinforced portland cement concrete pavement, the appropriate Class to select is **PV**.

Responsible Location: District responsible for mix design's use; for example, "91" for District 1.

**EXAMPLE** Select one of the nine IDOT Districts with which you typically work; for example, select **PROBLEM** 91 if you often work with District 1 in the Chicago area.

<u>Company Name</u>: Name of laboratory responsible for creation and/or testing of mix design.


<u>Location</u>: Nearest municipality to Lab/Company.

<u>Designer:</u> Name, phone number, and email of person that created the design.

Mix Design Producer: IDOT-assigned producer number and name of producer.

### Step 2. Design Variables

The Design Variables page is where the designer first begins to determine the mix design's parameters that factor into the mix design calculations.

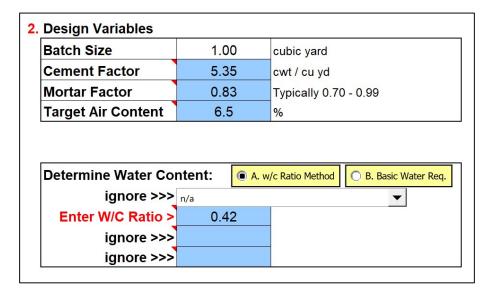

<u>Batch Size:</u> Batch size in cubic yards (cubic meters). All mix designs are created per 1 yd<sup>3</sup> (1 m<sup>3</sup>).

<u>Cement Factor</u>: Cement quantity in hundredweight per cubic yard (kilograms per cubic meter).

From Table 2.2.1 in the Course Manual, the cement factor for Class PV concrete from a central mixed plant is **5.65 cwt/yd³**.

Also, from Section 2.2.2, a cement factor reduction of **0.30 cwt/yd³** can be applied because a water-reducing admixture will be used.

Thus, the final, adjusted cement factor is reduced to **5.35 cwt/yd³**.

Mortar Factor: Refer to Table 2.7.2.2 Design Mortar Factor in the Course Manual.

EXAMPLE	From Table 2.7.2.2 in the Course Manual, a mortar factor can be selected for Class
PROBLEM	PV concrete.
	Enter <b>0.83</b> as a reasonable starting point.

<u>Target Air Content:</u> Percentage of entrained air in the concrete to improve durability. Refer to Table 2.6 *Air Content* in the Course Manual.

EXAMPLE	From Table 2.6 in the Course Manual, the midpoint of the air content range for
<b>PROBLEM</b>	Class PV concrete is <b>6.5%</b> .

### Step 2. Design Variables (continued)

### **Determine Water Content**


First, using the toggle switch, select either the w/c Ratio Method or the Basic Water Requirement Method.

The *w/c Ratio Method* will determine water content based on the w/c ratio entered and the total content of cement and finely divided minerals. No water adjustment needs to be entered as it will be back-calculated based on the w/c ratio and assumed aggregate water requirements (see Note).

Alternatively, the *Basic Water Requirement* method requires the fine and coarse aggregate water requirements, as well as percent water reduction. Refer to Appendix Q *Basic and Adjusted Water Requirement Method* in the Course Manual for more information. **See next page for when using the** *Basic Water Requirement* **method**.

Note: Because the Department's original method for determining water content used the *Basic Water Requirement* Method, its MISTIC database requires data related to the basic water requirement method. Thus, when the "w/c Ratio Method" is selected, the spreadsheet will provide 'dummy' values in the design reports assuming a Type B fine aggregate with basic water requirement of 5.3 gal/cwt (0.44 L/kg).

### If the W/C Ratio Method has been selected:

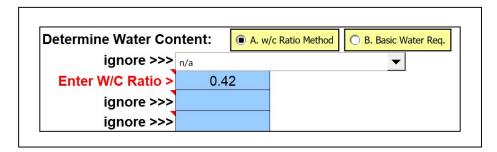


Enter W/C Ratio:

When *w/c Ratio Method* is toggled, this field appears. Enter the target w/c ratio that the design water content will be based on; for example, 0.42.

EXAMPLE	In this example, per <b>Table 2.5</b> in the Course Manual, the maximum w/c for
PROBLEM	Class PV concrete is <b>0.42</b> .

### Step 2. Design Variables (continued)

### If the Basic Water Requirement Method has been selected:

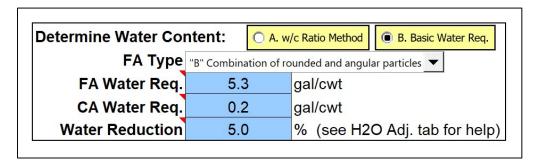

### FA Type:

Select fine aggregate type.

EXAMPLE	Assume this mix will utilize a Type "B" fine aggregate, select <b>B</b> from the
	drop-down list.

### FA Water Req.:

Water requirement for fine aggregate in gallons per hundredweight (liters per kilogram) of cement and finely divided minerals. This value is based on the type of fine aggregate.

EXAMPLE	Assuming this mix will utilize a Type "B" fine aggregate, enter <b>5.3 gal/cwt</b> .
PROBLEM	

### CA Water Req.:

Water requirement for coarse aggregate in gallons per hundredweight (liters per kilogram) of cement and finely divided minerals material. This value is based on the type of coarse aggregate.

EXAMPLE	Because this mix will utilize a crushed stone, enter <b>0.2 gal/cwt</b> .
PROBLEM	

### Water Reduction:


Percentage of water adjustment (typically a reduction) accounting for various factors, such as admixture use, cement and finely divided mineral content, air content, etc. Note that because this input is referred to as a "<u>reduction</u>," the value entered may seem counterintuitive; that is, a water reduction should be entered as a positive value, while a water addition should be entered as a negative value. For example, enter "10.0" for a 10 percent water reduction, and enter "-10.0" for a 10 percent water addition.

For help determining a reasonable water adjustment, refer to Appendix Q Basic and Adjusted Water Requirement Method in the Course Manual.

EXAMPLE PROBLEM	Because this mix will utilize a water-reducing admixture to provide a target water reduction of 10%, enter <b>10.0</b> .
	Note: If for some reason this mix needed a 10 percent water <u>addition</u> , you would have entered -10.0.

#### Step 3. Aggregate Information

The Aggregate Information worksheet is where the designer enters all fine and coarse aggregate information.

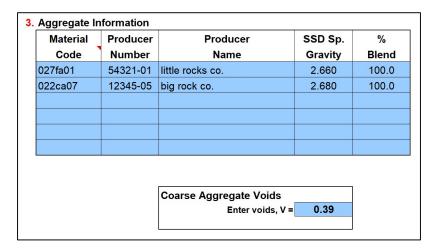

Material:

Aggregate material codes. Coarse and fine aggregates may be entered in any order, except as required by your District.

# **EXAMPLE**PROBLEM

- Fine aggregate: Enter **027FA01**. This material code is for an "A" quality natural sand meeting the gradation criteria for FA 1 per Article 1003.01(c).
- Coarse aggregate: Enter **022CA07**. This material code is for an "A" quality crushed stone meeting the gradation criteria for CA 7 per Article 1004.01(c).

<u>Producer Number:</u> Aggregate producer number. This field is required for all aggregate components.

<u>Producer Name:</u> Aggregate producer name.

Specific Gravity: Saturated Surface Dry (SSD) specific gravity of each aggregate.

**EXAMPLE** The example problem in the Course Manual indicates that the saturated surface-dry specific gravities for the fine and coarse aggregate components are **2.66** and **2.68**, respectively.

% Blend:

Percent blend for aggregate components. If only using one coarse aggregate and one fine aggregate material, enter "100" for each. On the other hand, if blending coarse aggregate materials, say, CA 11 and CA 16 at 75 and 25 percent, respectively, enter a "75" for the CA 11 and a "25" for the CA 16. Similarly, if blending fine aggregate materials. Do not blend coarse and fine aggregate, except as noted below for CAM II:

**Note for CAM II designs** *only*—Recommended % Blend of coarse-to-fine aggregate: 50-50 when using CA 7, CA 9, or CA 11; 75-25 when using CA 6; and 100-0 (i.e., no fine aggregate) when using CA 10. For example, when using CA 6 and FA 1, enter "75" for the CA 6 and "25" for the FA 1.

**EXAMPLE** PROBLEM

Because this mix is utilizing one coarse aggregate and one fine aggregate (and the mix is not CAM II), enter **100** for coarse aggregate and **100** for fine aggregate, as well.

Coarse Aggregate Voids:

Voids in coarse aggregate. Refer to the District office verifying your mix design for guidance on what value to use. **Important:** Enter "1.00" for any mix design that does not contain coarse aggregate.

**EXAMPLE** The example problem in the Course Manual notes that the Voids for the coarse aggregate is **0.39**.

### **Step 4.** Finely Divided Minerals & Admixtures Information

This worksheet is where the designer enters all information pertaining to cement and finely divided minerals, as well as chemical admixtures (e.g., air-entraining water-reducing admixtures, etc.).

Ma	iterial		Produce	r Producer	Specific	Percent	Replacement
C	ode		Number	Name	Gravity	Blend	Ratio
37708 Type IL Lim	estone	•	555-01	Big Cement, Co.	3.150	75.0	
37801 Fly Ash Clas	ss C	•	43215-01	Ash Marketers, Inc.	2.610	25.0	
Select Slag		▼					
Select Other FDM		_					
Admixture	1					100%	1
Admixture   Material	Information Admixt		Type	Product Name	Rem	arks	
	1	ure		Product Name			
Material	Admixt	ure u c		A: DI V		arks	
Material Code	Admixt (AST)	ure M C ing	494)			arks	
Material Code 42000	Admixt (ASTN AEA - Air Entraini	ure M C ing	494)	Air Plus X		arks	
Material Code 42000	Admixt (AST) AEA - Air Entraini A - Water Reduce	ure M C ing	494)	Air Plus X Water Reducto 2000		arks	
Material Code 42000	Admixt (AST) AEA - Air Entraini A - Water Reduce n/a	ure M C ing	494)	Air Plus X Water Reducto 2000	(e.g. dos	narks sage rate)	Information
Material Code 42000 43000	Admixt (ASTI) AEA - Air Entraini A - Water Reduce n/a n/a	ure M C ing	494)	Air Plus X Water Reducto 2000	(e.g. dos	narks sage rate)	Information g
<b>Code</b> 42000	Admixt (ASTI) AEA - Air Entraini A - Water Reduce n/a n/a marks	Ure M C ing er	494)	Air Plus X Water Reducto 2000	(e.g. dos	dmixture osage	

Material:

Cement and finely divided mineral (FDM) material codes. Each line is dedicated to a specific material: Line 1 for cement, Line 2 for fly ash, Line 3 for GGBF slag, and Line 4 for miscellaneous (e.g., microsilica, high-reactivity metakaolin, etc.).

<b>EXAMPLE</b>	Because this mix will utilize a Type IL cement and Class C fly ash, Lines 1 and 2 will be
PROBLEM	used.
	Cement: select 37708 Type IL Limestone from the drop-down list.
	• Fly ash: select 37801 Fly Ash Class C from the dron-down list

<u>Producer Number:</u> Material producer number. This field is required for all finely divided minerals.

<u>Producer Name:</u> Material producer name.

Specific Gravity: Specific gravity of each material. The specific gravity of cement is normally assumed to be

3.15 for ordinary portland cement or portland-limestone cement. However, for portland-pozzolan or portland-slag cements, this value should be verified with the District. Specific gravity values for finely divided minerals can be obtained from the Qualified Producer List

of Finely Divided Minerals.

EXAMPLE PROBLEM

The example problem as given in the Course Manual notes that the specific gravity for the fly ash component is **2.61**.

The specific gravity of cement is assumed to be 3.15.

### **Step 4. Finely Divided Minerals & Admixtures Information** (continued)

Percent Blend:

The blend percentage must be entered for each material, totaling 100. For example, when blending fly ash and cement at 20 and 80 percent, respectively, enter "20" for the fly ash and "80" for the cement.

# **EXAMPLE PROBLEM**

First, we have to determine if we need to mitigate for alkali-silica reaction (ASR):

From Section 2.4.3 in the Course Manual, it is determined that the component aggregates are **Group II** (fine aggregate expansion in the **>0.16% - 0.27%** range and coarse aggregate expansion **≤0.16%**). Thus, we are required to use Mix Option 1, 2, 3, 4, or 5.

Because the example problem as given notes that the mix will utilize a cement with alkali content >0.60% and a Class C fly ash, we will use **Mix Option 2**.

Mix Option 2 requires a minimum 25.0 percent Class C fly ash.

Furthermore, from Section 2.4.1.1 in the Course Manual, the Class C fly ash component can replace up to 30 percent of the cement.

Thus, it is decided to use **25 percent** fly ash since a larger replacement would reduce the portland cement content below 400 lb/yd<sup>3</sup>. Because the total Percent Blend must equal 100, enter **75.0** for the cement and **25.0** for the fly ash.

Replacement Ratio:

(Optional) Enter the replacement ratio for each finely divided mineral, if applicable. If left blank, the default value of "1.00" will be used.

#### **Step 5.** Admixtures Information

Material Code: Enter admixture material codes here. The 5-digit material code for admixtures can be

found on the Approved/Qualified Product List of Concrete Admixtures.

Admixture Type: Choose admixture type.

Product Name: Enter admixture product name here.

Remarks: Enter key information regarding proposed dosage rates, dosing procedures, etc.

#### **Step 6.** General Mixture Remarks

Remarks: Enter any pertinent information not already covered. When required to mitigate for alkali-

silica reaction (ASR), indicate the mixture option selected.

**EXAMPLE** PROBLEM

Because we are required to mitigate for alkali-silica reaction, we must indicate the mixture option selected.

Enter ASR Mix Option 2, 25% fly ash.

<u>Latex Admixture Information</u> (only required for mix designs using a latex admixture)

<u>Batch Dosage:</u> Enter latex admixture dosage in terms of gallons per cubic yard (liters per cubic meter).

Specific Gravity: Enter manufacturer's specific gravity for the latex admixture.

% Solids: Enter manufacturer's percent solids for the latex admixture.

<u>Design Report</u>
Given the inputs, the mix design proportions are calculated and reported. Two design reports are generated: one in English units of measure and one in metric (SI).

# **FNGLISH LINITS DESIGN REPORT**

	EN	GLISH UNITS DESIGN PCC DESIGN MIX	N REPORT			
IDOT MIX #:	[TBD by IDOT]	100 DEDION IIIA	CEMENT	FACTOR	, cwt/yd3:	5.35
PRODUCER MIX #:					AR FACTOR:	
MATERIAL CODE:	21605				CA VOIDS:	0.39
CLASS(ES):	PV				% AIR:	6.5
RESP. DISTRICT:	91			7	W/C RATIO:	0.44
						Weight (SSD
AGGREGATE	Producer No.	Producer Name		Sp. G.	% Blend	lbs / cu yo
027FA01	54321-01	LITTLE ROCKS CO.		2.66	100	1183
022CA07	12345-05	BIG ROCK CO.		2.68	100	1912
	99					
CEMENTITIOUS	Producer No.	Producer Name		Sp. G.	% Blend	lbs / cu yo
37708	555-01	BIG CEMENT, CO.		3.15	75	405
37801	43215-01	ASH MARKETERS, INC.		2.61	25	135
					lbs/cu yd)	· ·
	1004.05		TOTAL BAT	CH WT (	lbs/cu yd)	3869
PRODUCER NO.:		MIN GO	TURO			20.0
PRODUCER NAME:	EVERYMAN REDI-	-MIX CO.	THEO.	WATER (	gal/cu yd)	28.2
REMARKS: ASR Mix	Option 2, 25%	fly ash				
<u> </u>						
DESIGNER: JOHN SM	IITH					
PHONE: 555-555						
EMAIL: john.sm	nith@email.com					
ADMIXTURES:	Code Type	Name	Remarks			
	42000 AEA	AIR PLUS X			8	
	43000 A	WATER REDUCTO 2000	10	-	ī.	
	8			-		
	28			9	4	

# **METRIC UNITS DESIGN REPORT**

		PCC DESIGN MIX			
IDOT MIX #:	[TBD by IDO	r]	CEMENT FACT	OR, kg/m <sup>3</sup> :	320
PRODUCER MIX #:	PMC0001PV		MORT	AR FACTOR:	0.83
MATERIAL CODE:	21605M			CA VOIDS:	0.39
CLASS(ES):	PV			% AIR:	6.5
RESP. DISTRICT:	91			W/C RATIO:	0.44
					Weight (SSD)
AGGREGATE	Producer No	. Producer Name		% Blend	kg / cu m
027FAM01	54321-01	LITTLE ROCKS CO.	2.66	100	702
022CAM07	12345-05	BIG ROCK CO.	2.68	100	1135
CEMENTITIOUS	Producer No	. Producer Name	Sp. G.	% Blend	kg / cu m
37708M	555-01	BIG CEMENT, CO.	3.15	75	240
37801M	43215-01	ASH MARKETERS, INC.	2.61	25	80
		- W			
N.		\$0	THEO. WATER		140
PRODUCER NO.:	1224 OF		TOTAL BATCH WT	(kg/cu m)	2297
	EVERYMAN RE	DI-MIX CO.	THEO. WATE	R (L/cu m)	139.6
REMARKS: ASR Mix	Option 2, 25	% fly ash			
87					
DESIGNER: JOHN SM					
PHONE: 555-555					
EMAIL: john.sm	nith@email.com				
ADMIXTURES:	Code Type	Name	Remarks		
	42000 AE.	A AIR PLUS X			
	43000 A	WATER REDUCTO 2000		-	
				-	
			-	-	

Additionally, there is a tab for help determining the percent water adjustment taking into account various factors. However, this table is for informational purposes only. The water adjustment calculated using this table is not referenced by any of the spreadsheet's mix design calculations. To use the water adjustment calculated using this table, the value *must be entered* on the *Design Variable* tab.

There are many factors that can be taken into account when determining a mix's water requirement. The table below allows you to estimate the percentage of water adjustment (typically a reduction) based on the mix's constituent materials. **IMPORTANT:** This table is for informational purposes only. The water adjustment calculated here is not referenced by any mix design calculations. **To use the water adjustment calculated here, it must be entered on the Design Variables tab.** 

Water Adjus	stment	Suggested Range	Adjustment Percentage
Combined aggregate grading:			
	Well-graded	(-10 to 0%)	
	Gap-graded	(0 to +10%)	
Admixture(s):	The second control of	- Control of	
Air entraining admixture	1 to 3% air content	(0%)	
Minimum air content specified:	4 to 5% air content	(-5%)	
290	6 to 10% air content	(-10%)	
Norma	I water-reducing admixture	(-10 to -5%)	
Mid-range	water-reducing admixture	(-15 to -8%)	
High range water-re	educing admixture (Note 1)	(-30 to -12%)	
Finely Divided Minerals:		5	
	Fly Ash (Note 2)	(-10 to 0%)	
	Microsilica	(0 to +15%)	
High-R	eactivity Metakaolin (HRM)	(-5 to +5%)	
Ground Granulated E	Blast Furnace (GGBF) Slag	(0%)	
Other factors:			
Coarse cement, water	(-10 to 0%)		
concrete te	(-10 (0 0%)		
Fine cement, water	er/cement ratio < 0.40, and	(0 to +10%)	
concrete te	emperature > 80 °F (27 °C)	(0 (0 + 10 %)	
	Cumu	lative Adjustment (%)	0
Reference: Appendix Q, Table 1.2 "Adju in the PCC Level III Technicican Course		ment"	0 %

**Note 1:** A polycarboxylate superplasticizer may reduce the water content up to 40%.

**Note 2:** For each 10% of fly ash, it is recommended to allow a water reduction of at least 3%.

# **APPENDIX C**

# **RESERVED**

This Page Reserved

# **APPENDIX D**

#### WORKABILITY

#### 1.0 PRINCIPLE FACTORS OF WORKABILITY

Workability is related to the ease of motion of one coarse aggregate particle relative to adjacent particles. The lubricating ability of the mortar depends on the thickness of the mortar layer and the viscosity of the mortar. Refer Figure 1.0.

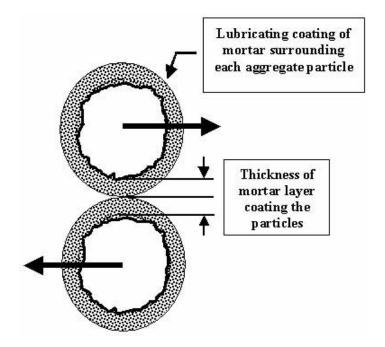


Figure 1.0 Mortar Layer Around Coarse Aggregate Particles

The thickness of the mortar layer depends on:

- Volume of coarse aggregate.
- Size and surface area of coarse aggregate.
- Shape and surface texture of aggregate particles.
- Volume of mortar.

The mortar volume depends on:

- Water content.
- Volume of cement and finely divided minerals.
- Volume of air.
- Volume of fine aggregate.


The viscosity of the mortar depends on:

- Water content.
- Volume of cement and finely divided minerals.
- Particle shape and fineness of cement and finely divided minerals.
- Shape and fineness of fine aggregate.
- Air content.
- Water-reducing admixtures.
- Rate of hydration (accelerating and retarding admixtures, concrete temperature, cement type and type of finely divided minerals).


#### 2.0 MORTAR AND WORKABILITY

The following sections illustrate the role of mortar and its influence on workability.

# 2.1 Mortar Illustration




Concrete with low mortar content. This results in increased contact between coarse aggregate particles and decreases workability.



Concrete with high mortar content. This results in decreased contact between coarse aggregate particles and increases workability.


#### 2.2 Mortar and Wall Effect

A higher mortar content is required at rigid boundaries, where the "wall effect" occurs. Examples of boundaries include structural members and pipe walls for pumping.

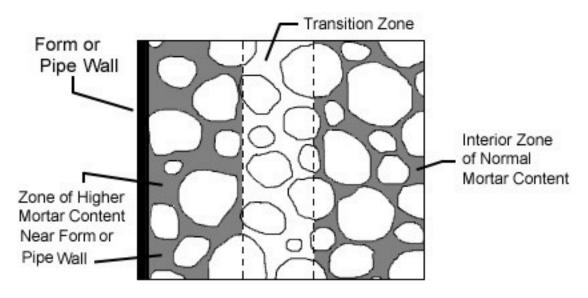


#### 2.2.1 Mortar and Structural Member

The volume of mortar required for a smooth finish against formed surfaces (i.e., without honeycombing or "bug" holes) depends on the surface area to concrete volume ratio. For example, the volume of concrete decreases as the width of the structural member decreases (assuming all other dimensions are unchanged). However, the wall surface area remains the same. Thus, the reduced concrete volume has less mortar available to ensure a smooth finish. Therefore, a thinner structural member will require a higher mortar content.

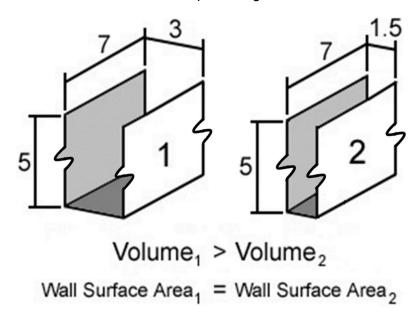

As another example, two different structural members may have different dimensions, but require the same volume of concrete. A higher mortar content is required for the structural member with the higher surface area.

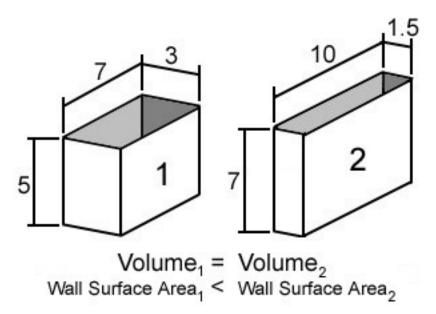

#### 2.2.2 Mortar and Pipe Wall

A higher mortar content is required for smaller diameter concrete pump pipelines. For example, a 4 in. diameter pipe has a higher surface area to concrete volume ratio than a 5 in. diameter pipe.

This Page Reserved

# **APPENDIX E**

#### AGGREGATE BLENDING

#### 1.0 AGGREGATE BLENDING

The grading, or particle size distribution, of an aggregate can have a significant influence on a concrete mixture. The two types of grading are as follows:

- Uniformly Graded Aggregates which do not have a large deficiency or excess of any particle size. Also known as Well Graded or Continuously Graded.
- Gap Graded Aggregates which have specific particle sizes omitted or are minimal.

Many Illinois coarse aggregates are gap graded, typically having a small amount of material passing the 1/2 in. sieve. Experience has shown that when the percent finer than 1/2 in. is below 40 percent, placement problems (such as when pumping) may occur. In order to improve workability and minimize potential problems, a second coarse aggregate is blended in to fill the gap.

Furthermore, the combined gradation of the coarse and fine aggregate has a significant impact on several mix characteristics: ease of placing, pumping, consolidating, and finishing, as well as water demand of the mix.

Blending aggregates may be specified as per Article 1004.02(d), or alternate combinations of gradation sizes may be used with the approval of the Engineer according to Article 1020.04, Table 1. Note 14.

# 1.1 Aggregate Blending Characterization

Over the years, a number of analytical methods have been developed to characterize the combined aggregate gradation, or blend. Three such methods will be discussed further in this section: the "8-18" Rule, the "Tarantula" Curve, and the 0.45 Power Curve.

First, it is necessary to know how to calculate the aggregate blend when combining aggregates. The formula for determining the total blend on a particular sieve is as follows:

TB = 
$$(\frac{a}{100} \times A) + (\frac{b}{100} \times B) + (\frac{c}{100} \times C) + ...$$

Where: TB = Total Blend of Aggregate either Passing or Retained on the Sieve,

a, b, c... = Percent of Total Aggregate, and

A, B, C... = Percent of Aggregate either Passing or Retained on the Sieve

For example, the percent passing the 3/8 in. sieve of the aggregate blend described in Table 1.1.1 is calculated as follows:

TB = 
$$(\frac{60}{100} \times 11\%) + (\frac{40}{100} \times 100\%)$$

TB = 6.6 + 40

TB = 46.6, or 47 percent after rounding

Table 1.1.1 is an illustration of a single coarse aggregate (gap graded) with a single fine aggregate. As described in Table 1.1.2, a second coarse aggregate (in this case, CA 16) is used to improve the aggregate blend. This data will be used to illustrate the "8-18" Rule, the "Tarantula" Curve, and 0.45 Power Curve.

**Table 1.1.1 Gap Graded Aggregate Mix Design** 

	CA 07,	a = 60%	FA 01, b = 40%		Aggregate Blend	
Sieve Size	%	%	%	%	Aggrega	ite biellu
(English)	Passing A	Retained A	Passing B	Retained B	%Passing TB	%Retained TB
1	100	0	100	0	100	0
3/4	86	14	100	0	92	8
1/2	37	49	100	0	62	30
3/8	11	26	100	0	47	15
No. 4	2	9	97	3	40	7
No. 8	2	0	89	8	37	3
No. 16	2	0	77	12	32	5
No. 30	2	0	53	24	22	10
No. 50	2	0	12	41	6	16
No. 100	2	0	2	10	2	4
No. 200	1.4	0.6	0.5	1.5	1.0	1

**Table 1.1.2 Blended Aggregate Mix Design** 

Sieve Size	CA a = 4			CA 16, b = 15%		01, 10%	Aggregate Blend		
(English)	% Pass. A	% Ret. A	% Pass. B	% Ret. B	% Pass. C	% Ret. C	% Passing TB	% Retained TB	
1	100	0	100	0	100	0	100	0	
3/4	86	14	100	0	100	0	94	6	
1/2	37	49	100	0	100	0	72	22	
3/8	11	26	96	4	100	0	59	13	
No. 4	2	9	28	68	97	3	44	15	
No. 8	2	0	5	23	89	8	37	7	
No. 16	2	0	3	2	77	12	32	5	
No. 30	2	0	3	0	53	24	23	9	
No. 50	2	0	2	1	12	41	6	17	
No. 100	2	0	2	0	2	10	2	4	
No. 200	1.4	0.6	1.9	0.1	0.5	1.5	1.1	0.9	

#### 1.1.1 The "8-18" Rule

The "8-18" Rule is one method to characterize an aggregate blend. In this rule, the percent retained on every sieve (except the top two and bottom two sieves) should be between 8 and 18 percent. This ensures that the peaks and valleys are not too severe. Figure 1.1.1.2 illustrates a typical gap graded aggregate mix design based on the data in Table 1.1.1. On the other hand, using the improved aggregate blend in Table 1.1.2, Figure 1.1.1.3 illustrates the benefits of blending another aggregate to normalize the peaks and valleys.

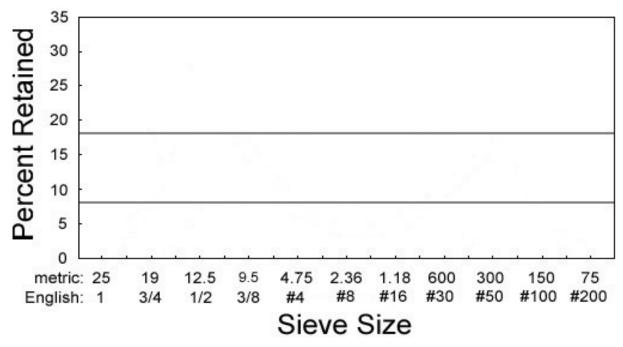


Figure 1.1.1.1 The "8-18" Rule

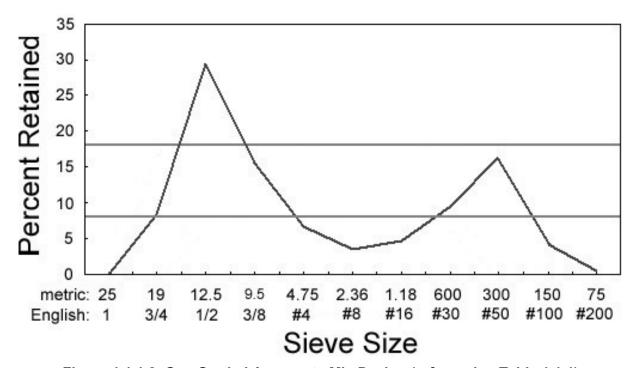


Figure 1.1.1.2 Gap Graded Aggregate Mix Design (referencing Table 1.1.1)

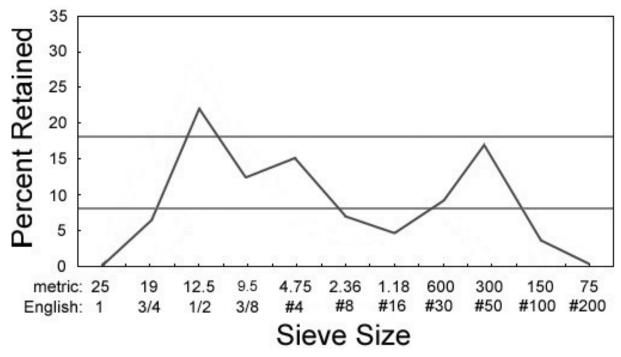


Figure 1.1.1.3 Blended Aggregate Mix Design (referencing Table 1.1.2)

Illinois aggregates cannot normally be combined to stay within the "8-18" rule, but they can be blended to lower the peak typically present on the 1/2 in. sieve. For example, as demonstrated in the figures, a CA 16 aggregate can be blended with a gap graded CA 07 or CA 11 to reduce the amount of material retained on the 1/2 in. sieve. As a rule of thumb, it is recommended to keep the difference between two sieves at 13 percent or less.

With most FA 01 and FA 02 aggregates, there will be a peak at the No. 50 sieve and a valley just before this peak, between the No. 8 and No. 16 sieves. Knowing this, it is important to remember that the amount of material passing the No. 30 sieve but retained on the No. 50 sieve is critical for holding entrained air bubbles in the mix. In addition, material between the No. 30 and No. 100 sieves is the most effective for entraining air.

As a final comment on the "8-18" rule, the 8 percent and 18 percent limits should be used only as a guide. Aggregate angularity (round vs. angular) and aggregate particle shape (flat and elongated) are not reflected in the "8-18" rule. For example, if the 3/8 in. to No. 16 sieve range contains 18 percent angular material, the concrete mixture would be gritty and difficult to finish. If the aggregate is flat and elongated, it may be more appropriate to have 4 to 8 percent retained on a given sieve.

# 1.1.2 The "Tarantula" Curve

Similar in concept to the "8-18" Rule, the "Tarantula" Curve is the result of research at Oklahoma State University for the Oklahoma DOT, and has been corroborated by data provided by the Iowa and Minnesota DOTs. Essentially, it provides a series of limits on percent retained for a combined gradation suited specifically to slipform construction.

The research suggests a minimum 15 percent cumulatively retained on the No. 8, No. 16, and No. 30 sieves; however, the amount retained on the No. 8 and No. 16 sieves individually should not exceed 12 percent. Furthermore, it is recommended to have 24 to 34 percent of the total aggregate volume between the No. 30 and No. 200 sieves. Refer to Figure 1.1.2.

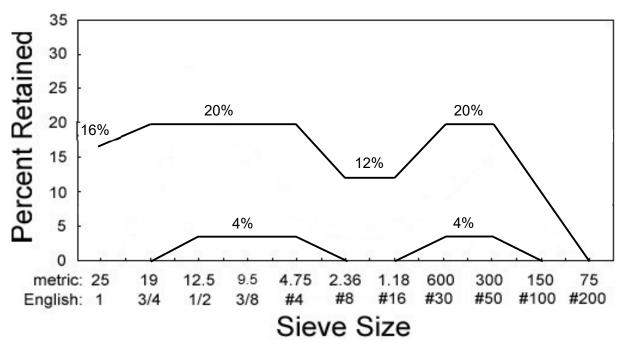


Figure 1.1.2 The "Tarantula" Curve (Oklahoma State University)

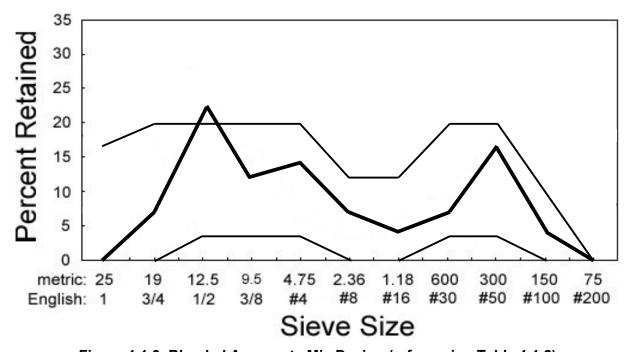


Figure 1.1.3 Blended Aggregate Mix Design (referencing Table 1.1.2)

# 1.1.3 The 0.45 Power Curve

The 0.45 Power Curve is another method to characterize an aggregate blend. Gap graded aggregate and blended aggregate gradation mix designs are plotted together on the 0.45 power curve in Figure 1.1.2, using Tables 1.1.1 and 1.1.2. When a second coarse aggregate material (CA 16) is blended with the gap graded aggregate, the plotted line shifts closer to the theoretical optimum, indicating a more uniform combined gradation. The theoretical optimum gradation line originates at the bottom left corner and extends upward to the nominal maximum size. If the

plotted line is located to the left of the theoretical optimum gradation line, this indicates a finer gradation. If the plotted line is located to the right of the theoretical optimum gradation line, this indicates a coarser gradation.

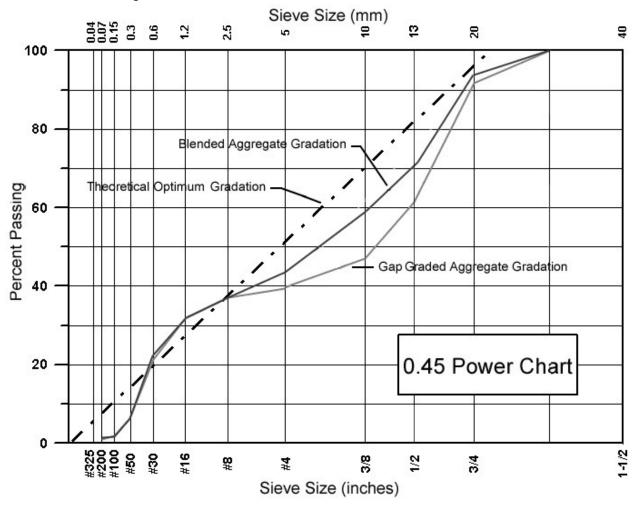


Figure 1.1.3 Gap Graded Aggregate Mix Design (Table 1.1.1) and Blended Aggregate Mix Design (Table 1.1.2) Example on 0.45 Power Curve

#### 1.2 Fineness Modulus

Though not strictly related to aggregate blending, fineness modulus is a potentially useful method for characterizing aggregate gradation, particularly for fine aggregate. Fineness modulus is defined in ASTM C 125 as "a factor obtained by adding the percentages of material in the sample that is coarser than each of the following sieves (cumulative percentages retained), and dividing the sum by 100:" No. 100, No. 50, No. 30, No. 16, No. 8, No. 4, 3/8 in., 3/4 in., 1 1/2 in., 3 in., 6 in. (see also ASTM C 136). Thus, for fine aggregate, the fineness modulus is calculated by dividing by 100 the sum of the cumulative percents retained on the sieves listed in Table 1.2.1 (refer also to Table 1.2.2 for an example calculation).

The fineness modulus is typically used in conjunction with the nominal maximum coarse aggregate size to determine the volume of dry rodded coarse aggregate per unit volume of concrete according to the ACI method for mix design (ACI 211.1). That is, it can be used to determine the initial aggregate proportions of a concrete mixture.

Table 1.2.1 Sieves Required to Calculate Fineness Modulus for Fine Aggregate

Sieve Size (English)				
3/8 inch				
No. 4				
No. 8*				
No. 16				
No. 30*				
No. 50				
No. 100				

<sup>\*</sup> The sieve is not required by the "Required Sampling and Testing Equipment for Concrete" document, and would have to be acquired.

**Table 1.2.2 Calculating Fineness Modulus for Fine Aggregate** 

Sieve Size (English)	Percent Passing	Percent Retained	Cumulative Percent Retained
3/8 inch	100	0	0
No. 4	98	2	2
No. 8	85	13	15
No. 16	65	20	35
No. 30	45	20	55
No. 50	21	24	79
No. 100	3	18	97
		Sum =	283
		Calculation	283/100
		FM =	2.83


The fineness modulus allows an individual to quickly identify a change in fine aggregate gradation, such as when it increases, the gradation becomes coarser. In addition, a fine aggregate with a high fineness modulus may result in a tendency for the concrete mixture to lose air. If the fine aggregate fineness modulus changes more than 0.2, changes in the mix proportions are probably needed to provide the same workability.

A good application for monitoring fineness modulus occurs when concrete is pumped. For example, ACI Committee 304 recommends the fine aggregate fineness modulus to be between 2.40 and 3.00 with at least 15 to 30 percent passing the No. 50 sieve and 5 to 10 percent passing the No. 100.


# 1.3 Aggregate Blending Worksheet

				AG	GREG	ATE BI	AGGREGATE BLENDING WORKSHEET	G WOR	KSHE	<u> </u>					
Sieves	ves	ပိ	arse A	Coarse Aggregate	te	Inter	Intermediate Aggregate	Aggre	gate		ine Ag	Fine Aggregate	6	Aggregate Blend	te Blend
English	metric	% Pass,	% Pass,	% <b>of Total</b> (a = %)	Total %)	% Pass,	Ą,	% of Total (b = %)	Total %)	% Pass,	% Pass,	% of Total (c = %)		% Pass,	% Ret.,
		∢	Δ	Pass	Ret.	∢	Ω	Pass	Ret.	∢	m	Pass	Ret.	<u> </u>	
2 1/2 in.	63 mm														
2 in.	50 mm														
1 3/4 in.	45 mm														
1 1/2 in.	37.5 mm														
1 in.	25 mm														
3/4 in.	19 mm														
5/8 in.	16 mm														
1/2 in.	12.5 mm														
3/8 in.	9.5 mm														
1/4 in.	6.3 mm														
No. 4	4.75 mm														
No. 8	2.36 mm														
No. 16	1.18 mm														
No. 30	009 mm														
No. 40	425 µm														
No. 50	300 µm														
No. 100	150 μm														
No. 200	75 μm														
P/	PAN														
* *	*TB = $(\frac{a}{x} \times A) + (\frac{b}{x} \times B)$	-) +	x B	+	+ (C × C) +	+									
1	,_ ,100 ,,	<del>٢</del>	, ,	-	`` <b>0</b>	:									


# 1.4 "8-18" Rule Worksheet

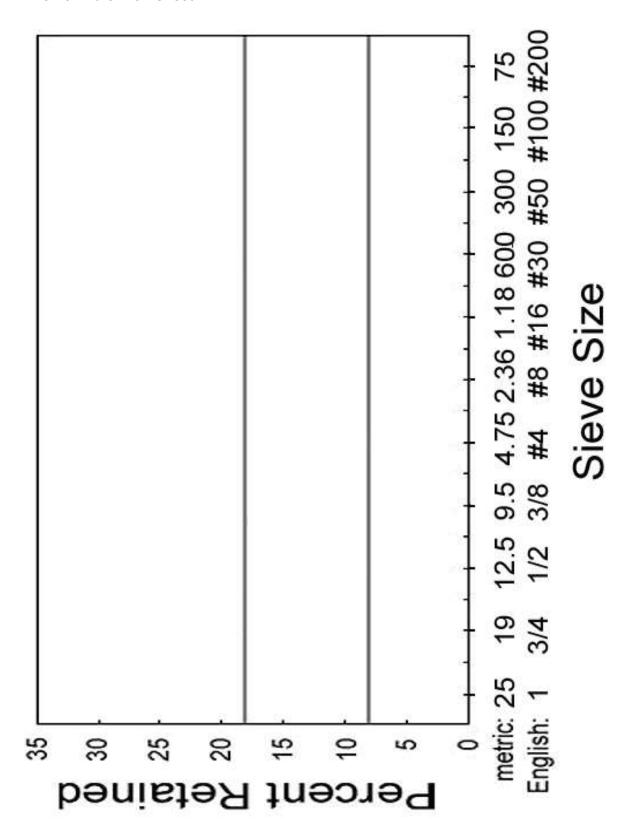

# 1.5 "Tarantula" Curve Worksheet

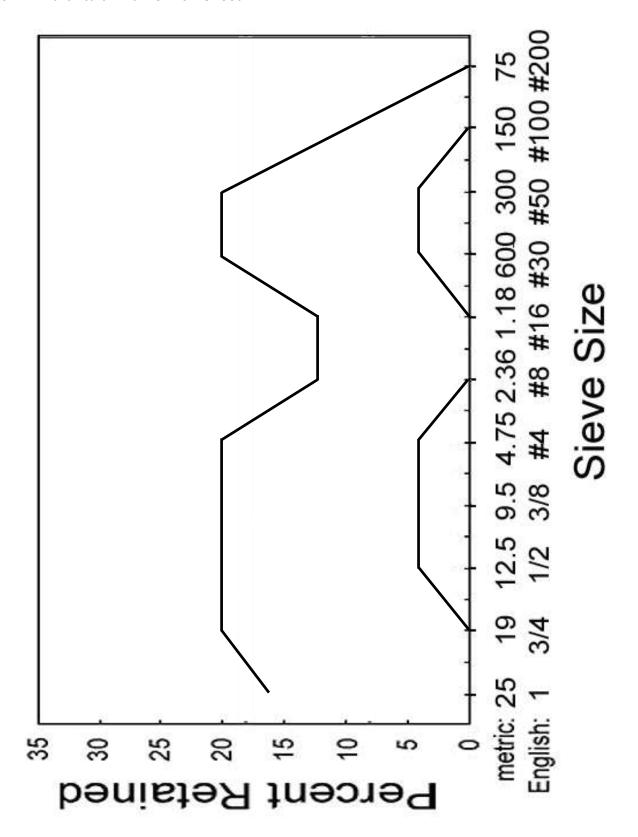

# 1.6 0.45 Power Curve Worksheet

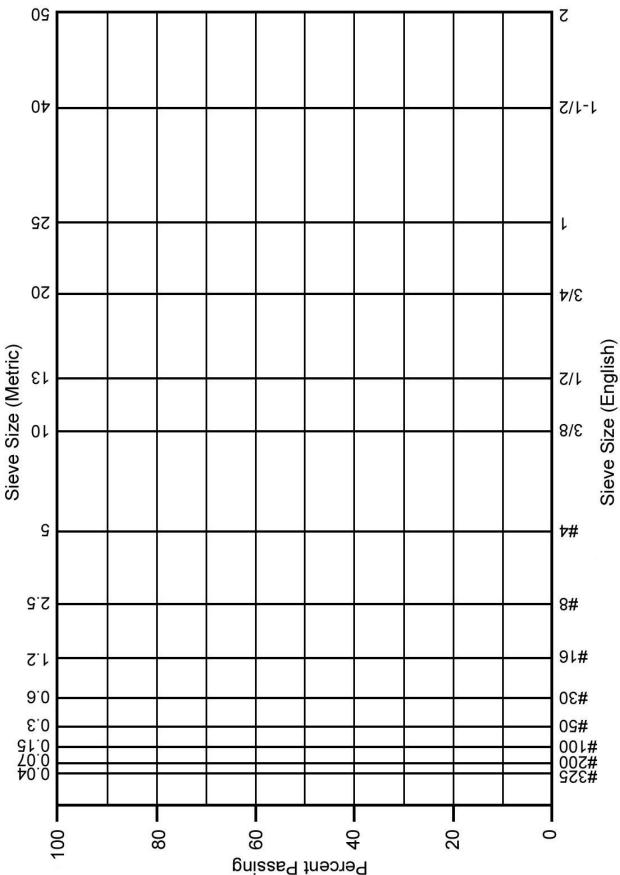

This Page Reserved

# **APPENDIX F**

# **CEMENT AGGREGATE MIXTURE (CAM) II**

# 1.0 CEMENT AGGREGATE MIXTURE (CAM) II MIX DESIGN DEVELOPMENT

The development of a CAM II mix design is similar to that of the Department's conventional concrete mix design. However, a fine aggregate water requirement, a coarse aggregate water requirement, and a mortar factor are not used.

Per Article 312.09, the Engineer will determine the proportions of materials for the mixture, or the Contractor may propose their own mix design. The Department recommends developing three mix designs for a cement-only mixture, or three mix designs for a cement and fly ash mixture, as follows:

Mixture Type	Mix Design	English Units,	W/C	Ratio
wixture Type	Option	lb/yd <sup>3</sup>	CA 6, 9, 10	CA 7, 11
0 + O - h -	1	200	1.2	1.1
Cement Only	2	250	1.1	1.0
Mixture	3	300	1.0	0.9
Camantand	1	170, 60	1.2	1.1
Cement and Fly Ash Mixture	2	205, 70	1.1	1.0
Fig Asii Mixture	3	245, 85	1.0	0.9

The procedure for developing a CAM II mix design is as follows:

- 1. Calculate the absolute volume of the cement and fly ash (V<sub>Cement</sub> and V<sub>Ash</sub>). The mixture shall have a cement content minimum of 200 lb/yd³, except a maximum 25 percent Class F ash or 30 percent Class C ash may replace the cement. However, per Article 312.09, the replacement shall not result in a mixture with a cement content less than 170 lb/yd³. Furthermore, based on laboratory experience, the Department recommends a maximum cement content of 300 lb/yd³, or maximum 330 lb/yd³ of cement and fly ash combined.
- Calculate the absolute volume of water (V<sub>Water</sub>). The water/cement ratio indicated in the table in step 1 is only a starting point. Department experience has shown the water/cement ratio to range from 0.60 to 1.60. No matter what water/cement ratio is selected, a water-reducing admixture shall be used.
- 3. Calculate the absolute volume of air (V<sub>Air</sub>). An air-entraining admixture shall be used to produce an air content of 7.0 to 10.0 percent. Design using the midpoint of this range (i.e., 8.5 percent).
- 4. Calculate the absolute volume of combined aggregate (V<sub>Agg</sub>). Article 312.09 indicates the volume of fine aggregate shall not exceed the volume of coarse aggregate.

$$V_{Agg} = 1 - [V_{Cement} + V_{Ash} + V_{Water} + V_{Air}]$$

5. Calculate the absolute volume of the constituent aggregates (V<sub>CA</sub> and V<sub>FA</sub>). The absolute volume of combined aggregate is multiplied by the percentage of each aggregate to obtain their respective absolute volumes.

Absolute volume of coarse aggregate: 
$$V_{CA} = V_{Agg} \times \frac{\%CA}{100}$$
  
Absolute volume of fine aggregate:  $V_{FA} = V_{Agg} \times \frac{\%FA}{100}$ 

Department lab experience has shown a 50-50 percent blend of coarse aggregate to fine aggregate is a reasonable starting point when the coarse aggregate is CA 7, CA 9, or CA 11. For CA 6, the Department recommends 75 percent coarse aggregate and 25 percent fine aggregate. For CA 10, the Department recommends starting with 100 percent coarse aggregate and no fine aggregate. As an alternative to these starting points, refer to Appendix E for developing a uniformly graded mixture.

As a word of caution, the coarse aggregate may be Class D quality or better. The risk is more clay material in Class B, C, or D quality aggregate as compared to Class A quality aggregate. Clay can make it more difficult to entrain air, which is why Class A quality aggregate is normally specified for concrete.

6. Convert the absolute volumes of fine aggregate and coarse aggregate to pounds.

Weight of Aggregate (lb/yd<sup>3</sup>) = 
$$V \times G_{SSD} \times 1,683.99$$

Where V = Absolute volume of coarse aggregate ( $V_{CA}$ ) or fine aggregate ( $V_{FA}$ )  $G_{SSD}$  = Specific gravity of coarse aggregate or fine aggregate

- 7. A trial batch should be performed for each mix design. The slump shall range from 1 in. to 3 in., and the air content shall range from 7.0 to 10.0 percent. If the slump and air content cannot be batched within the specified range, revise the mix design. It should also be noted that CAM II has no strength requirements. However, it is recommended to make three 4- x 8-in. cylinders for strength testing at 14 days. A value from 750-1500 psi is desired, but a mix outside this range is perfectly acceptable.
- 8. Submit the mix design to the Department for freeze/thaw testing according ITP 161.

# 1.1 EXAMPLE PROBLEM FOR CEMENT AGGREGATE MIXTURE (CAM) II MIX DESIGN

#### Given:

- Type IL cement with ≤ 0.60 alkalies will be used.
- Class C fly ash with calcium oxide of 26.0 percent and specific gravity of 2.70 will be used.
- A fine aggregate (FA 1) with a saturated surface-dry specific gravity of 2.65 will be used. The alkali-silica reaction expansion for the fine aggregate is in the >0.16% – 0.27% range.
- A crushed stone coarse aggregate (CA 6) with a saturated surface-dry specific gravity of 2.69 will be used. The alkali-silica reaction expansion for the coarse aggregate limestone is an assigned value of 0.05 percent per Article 1004.02(g)(1).

### 1.1.1 Example Calculations

Step 1 Determine the absolute volume of cement and finely divided minerals.

- The minimum required cement is 170 lb/yd³ if the cement is replaced with fly ash.
- The Class C fly ash can replace up to 30 percent of the cement.
- From 2.4.3 "Mitigation of Alkali-Silica Reaction with Finely Divided Minerals," it is determined that the aggregate is in Group II. Thus, a minimum 25.0 percent Class C fly ash is required to reduce the risk of a deleterious alkali-silica reaction.

Thus, the Department's default cement and fly ash mix design option 1 is selected. This mix design has 170 lb/yd³ of cement and 60 lb/yd³ of fly ash, and satisfies the minimum fly ash needed for the reactive aggregate without exceeding the maximum replacement as follows.

The calculation to determine the percent replacement

= 
$$60 \text{ lb/yd}^3 \div (170 \text{ lb/yd}^3 + 60 \text{ lb/yd}^3) = 26\% \text{ Class C fly ash.}$$

The absolute volume of cement per cubic yard

= 170 lb/yd<sup>3</sup> ÷ 
$$(3.15 \times 1,683.99 \text{ lb/yd}^3)$$
 = 0.032

The absolute volume of fly ash per cubic yard

= 
$$60 \text{ lb/yd}^3 \div (2.70 \times 1,683.99 \text{ lb/yd}^3) = 0.013$$

Step 2 Determine the absolute volume of water.

Assume a water/cement ratio of 1.10 which takes into account that a water-reducing admixture will be used.

The calculation is 1.10  $\times$  (170 lb/yd<sup>3</sup> + 60 lb/yd<sup>3</sup>) = 253 lb/yd<sup>3</sup>

The absolute volume of water per cubic yard

= 253 lb/yd<sup>3</sup> ÷ 
$$(1.0 \times 1,683.99 \text{ lb/yd}^3) = 0.150$$

Step 3 Determine the absolute volume of air.

The midpoint of the air content range for CAM II is 8.5 percent.

The absolute volume of air per cubic yard = 8.5 percent  $\div 100 = 0.085$ 

Step 4 Determine the absolute volume of the combined fine and coarse aggregates.

The absolute volume of combined fine and coarse aggregates per cubic yard 
$$= 1 - (0.032 + 0.013 + 0.150 + 0.085) = 0.720$$

Step 5 Determine the absolute volumes of the constituent aggregates.

For a CA 6, use the Department's recommendation of a 75-25 percent blend of coarse aggregate to fine aggregate.

The absolute volume of coarse aggregate per cubic yard

$$= 0.720 \times (75 \text{ percent} \div 100) = 0.540$$

The absolute volume of fine aggregate per cubic yard

$$= 0.720 \times (25 \text{ percent} \div 100) = 0.180$$

Step 6 Convert the absolute volumes of the coarse and fine aggregate to pounds.

Coarse aggregate =  $0.540 \text{ yd}^3 \times 2.69 \times 1,683.99 \text{ lb/yd}^3 = 2,446 \text{ lb/yd}^3$ 

Fine aggregate =  $0.180 \text{ yd}^3 \times 2.65 \times 1,683.99 \text{ lb/yd}^3 = 803 \text{ lb/yd}^3$ 

Step 7 Summarize the mix design.

Cement (3.15\*) =  $170 \text{ lb/yd}^3$ Fly Ash (2.70\*) =  $60 \text{ lb/yd}^3$ Water =  $253 \text{ lb/yd}^3$ 

or

= 253 lb/yd $^3$  ÷ 8.33 lb/gallon = 30 gallons/yd $^3$ 

Air Content (Target) = 8.5 percent Coarse Aggregate (2.69\*) = 2,446 lb/yd<sup>3</sup> Fine Aggregate (2.65\*) = 803 lb/yd<sup>3</sup>

Admixture = water-reducing admixture

Slump (Target) = 2 inches Water/Cement Ratio = 1.10

# 2.0 DEPARTMENT CEMENT AGGREGATE MIXTURE (CAM) II MIX DESIGN VERIFICATION

### 2.1 Verification by the Engineer

A new cement aggregate mixture (CAM) II mix design will be verified by the Engineer from test information provided by the Contractor (optional), testing performed by the Engineer, applicable Department historical test data, and previous Department experience.

For a CAM II mix design previously developed by the Engineer or Contractor, the Engineer will verify the mix design if the Department's historical test data shows compliance with specification requirements.

### 2.2 Testing Performed by the Engineer

Per Article 312.09, constituent materials for CAM II mixtures are submitted to the Department for testing. The Department will verify all materials meet specification requirements.

Additionally, when the portland cement content exceeds 300 lb/yd³, CA 6, CA 9, and CA 10 gravel aggregates will be screened by the Department for alkali reaction per Article 1004.02(g), and the mixture will be evaluated to meet the requirements of Article 1020.05(d).

The CAM II mixture shall meet the test requirements in Article 312.09 for relative durability (freeze/thaw resistance), air-entrainment, and slump. The mix design with the lowest cement content or cement and fly ash contents that meets the requirements will be reported to the District. Once one mix design is approved for a contract, no additional mixtures will be tested for that contract.

#### 2.2.1 Testing Proportions Determined by the Engineer

The Engineer will test either a cement only mixture or a cement and fly ash mixture. For the selected mixture type, the Engineer will develop proportions for three mix design options. Refer to 1.0 "Cement Aggregate Mixture (CAM) II Mix Design Development." In the event all three mix designs fail to meet specification requirements, one additional round of testing may be performed by the Engineer.

<sup>\*</sup>Specific Gravity

# 2.2.2 Testing Proportions Determined by the Contractor

The Engineer will test either a cement only mixture or a cement and fly ash mixture. For the selected mixture type, the Contractor can develop the proportions for up to three mix design options. The mix designs may be different from those suggested in 1.0 "Cement Aggregate Mixture (CAM) II Mix Design Development." In the event all three mix designs fail to meet specification requirements, one additional round of testing (comprised of three mix design options) may be performed by the Engineer using proportions determined by the Engineer.

#### 2.2.3 Unacceptable Materials

In some cases, all three mix design options fail due to material deficiencies that can be identified after the first round of testing. For example, high fines in an aggregate can make it impossible to properly entrain air, or very poor freeze/thaw durable aggregate can make it impossible to meet relative durability requirements. The Engineer may discontinue further testing of some or all materials determined to be of questionable quality after evaluating a minimum of three mix design options (one round of testing).

This Page Is Reserved

Revised January 1, 2025

# **APPENDIX G**

# CONTROLLED LOW-STRENGTH MATERIAL (CLSM)

# 1.0 CONTROLLED LOW-STRENGTH MATERIAL (CLSM) MIX DESIGN DEVELOPMENT

For CLSM, there is no formal mix design procedure. However, the principle of volumetric mix design, designing in terms of a standard unit volume, still applies. The absolute volumes of cement, fly ash, water, air, and aggregate shall equal one. In addition, the mix shall comply with the mix design criteria. For more details concerning the mix design criteria and submittal of the mix design, refer to Section 1019 of the Standard Specifications.

The Contractor is advised that CLSM does not normally pump well.

# 2.0 DEPARTMENT CONTROLLED LOW-STRENGTH MATERIAL (CLSM) MIX DESIGN VERIFICATION

# 2.1 Verification by the Engineer

A new controlled low-strength material (CLSM) mix design will be verified by the Engineer according to Article 1019.06 of the Standard Specifications.

For a CLSM mix design previously developed by the Engineer or Contractor, the Engineer will verify the mix design if the Department's historical test data shows compliance with specification requirements.

This Page Reserved

# **APPENDIX H**

#### STAMPED OR INTEGRALLY COLORED CONCRETE

Stamped or integrally colored concrete shall be done according to contract specifications. The following is for informational purposes when stamped or integrally colored concrete is used.

#### **Stamped Concrete**

A minimum cement factor of 6.05 cwt/yd³ for central-mixed, truck-mixed or shrink-mixed concrete is recommended.

A slump range of 3 in. to 5 in. is recommended.

A coarse aggregate gradation of CA 11, CA 13, CA 14, or CA 16 is recommended.

A mortar factor of 0.88 to 0.90 is recommended.

### Integrally Colored Concrete

The pigment for colored concrete has no influence on the mix design.

The following guidance may help prevent color variations.

- Maintaining a water/cement ratio within ± 0.02 of the target value is recommended.
- A calcium chloride accelerating admixture shall not be used.

This Page Reserved

# **Appendix I**

#### **CONCRETE REVETMENT MATS**

#### 1.0 CONCRETE REVETMENT MAT MIX DESIGN DEVELOPMENT

For concrete revetment mats, there is no formal mix design procedure, and Section 285 of the Standard Specifications provides very few mix design parameters. However, the principle of volumetric mix design, designing in terms of a standard unit volume, still applies. The absolute volumes of cement, fly ash, water, air, and fine aggregate (there is no coarse aggregate) shall equal one.

For an air content between 6.0 and 9.0 percent, the following mix design parameters should be used to meet the required 28-day compressive strength of 2500 psi.

### **Cement Only Mix Design**

•	Cement	650 – 800 lb/yd³
•	Water/Cement Ratio	Maximum 0.60
•	Fine Aggregate (saturated surface dry condition)	Adjust for $V_{Cement}$ , $V_{Water}$ , and $V_{Air}$
•	Air Content (Target)	7.5 percent
•	Water-Reducing or HRWR Admixture	Optional

# Cement and Fly Ash Mix Design

•	Cement	470 – 610 lb/yd³
•	Total Cement Plus Fly Ash*	725 – 825 lb/yd <sup>3</sup>
•	Water/Cement Ratio	Maximum 0.60
•	Fine Aggregate (saturated surface dry condition)	Adjust for $V_{Cement}$ , $V_{Water}$ , and $V_{Air}$
•	Air Content (Target)	7.5 percent
•	Water-Reducing or HRWR Admixture	Optional

<sup>\*</sup>It is recommended to keep the fly ash at a maximum 35 percent of the total cement plus fly ash.

Section 285 states the mixture shall be proportioned to provide a pumpable slurry. A flow cone test according to ASTM D 6449 is a good method to determine pumpability. It is recommended the efflux time range from 9 to 12 seconds.

# 2.0 DEPARTMENT CONCRETE REVETMENT MAT MIX DESIGN VERIFICATION

### 2.1 Verification by the Engineer

A new concrete revetiment mat mix design will be verified by the Engineer from test information provided by the Contractor (optional), testing performed by the Engineer, applicable Department historical test data, target strength calculations, and previous Department experience.

For a concrete revetment mat mix design previously developed by the Engineer or Contractor, the Engineer will verify the mix design if the Department's historical test data shows compliance with specification requirements.

# 2.2 Testing Performed by the Engineer

The Engineer may require the Contractor to provide a batch of concrete revetment mat mixture at no cost to the Department.

#### 2.2.1 Procedure for Trial Batch

The procedure that follows shall be used to perform a trial batch unless specified otherwise in the contract plans.

The trial batch shall be performed in the presence of the Engineer, and the Engineer will perform all tests. The Contractor has the option to perform their own tests. The volume of the trial batch shall be a minimum of 2.0 yd³, but 4.0 yd³ is strongly recommended to more accurately evaluate the influence of mixing. Batch at or near the maximum water/cement ratio as requested by the Engineer. The air content should be within 0.5 percent of the maximum allowable specification value or as requested by the Engineer. Strength will be determined for the test of record, or at other ages as determined by the Engineer. The test of record shall be the day indicated in Section 285. In all cases, strength will be based on the average of a minimum two 6- by 12-in. cylinder breaks or three 4- by 8-in. cylinder breaks. In addition to air and strength testing, concrete temperature will be determined by the Engineer. Testing will be performed according to Illinois Modified AASHTO R 60, R 100, T 22, T 152 or T 196, and Illinois Modified ASTM C 1064. As an option for additional information, Illinois Modified AASHTO T 121 and ASTM D 6449 may be performed.

#### 2.2.2.1 Verification of Trial Batch

The trial batch will be verified by the Engineer if Department test results meet specification requirements and the mixture is pumpable.

# **APPENDIX J**

## **INSERTION LINING OF PIPE CULVERTS (GROUT)**

# 1.0 GROUT MIXTURE MIX DESIGN DEVELOPMENT FOR INSERTION LINING OF PIPE CULVERTS

For the grout mixture used in insertion lining of pipe culverts, there is no formal mix design procedure. However, the principle of volumetric mix design, designing in terms of a standard unit volume, still applies. The absolute volumes of cement, fly ash, water, air, and fine aggregate (there is no coarse aggregate) shall equal one. According to Section 543 of the Standard Specifications, the mix design parameters are as follows:

The grout mixture shall be 6.50 cwt/yd³ of portland cement plus fine aggregate and water. Fly ash may replace a maximum of 5.25 cwt/yd³ of the portland cement. The water/cement ratio, according to Article 1020.06, shall not exceed 0.60. An air-entraining admixture shall be used to produce an air content, according to Article 1020.08, of not less than 6.0 percent nor more than 9.0 percent of the volume of the grout. The Contractor shall have the option to use a water-reducing or high range water-reducing admixture.

As indicated by the mix design parameters, there are few variables for developing the mix design. The Contractor shall use a target air content of 7.5 percent, and vary the cement, fly ash, and water proportions to obtain a flowable mix. In addition, the grout mixture shall have a minimum 28 day compressive strength of 150 psi.

# 2.0 DEPARTMENT GROUT MIXTURE FOR INSERTION LINING OF PIPE CULVERTS MIX DESIGN VERIFICATION

The mix design is normally be done by the Department, but the Contractor has the option to submit a mix design for a Quality Control/Quality Assurance project.

# 2.1 Verification by the Engineer

A new insertion lining of pipe culverts mix design will be verified by the Engineer from test information provided by the Contractor (optional), testing performed by the Engineer, applicable Department historical test data, target strength calculations, and previous Department experience.

For a insertion lining of pipe culverts mix design previously developed by the Engineer or Contractor, the Engineer will verify the mix design if the Department's historical test data shows compliance with specification requirements.

# 2.2 Testing Performed by the Engineer

The Engineer may require the Contractor to provide a batch of insertion lining of pipe culverts mixture at no cost to the Department.

#### 2.2.1 Procedure for Trial Batch

The procedure that follows shall be used to perform a trial batch unless specified otherwise in the contract plans.

The trial batch shall be performed in the presence of the Engineer, and the Engineer will perform all tests. The Contractor has the option to perform their own tests. The volume of the trial batch shall be a minimum of 2.0 yd³, but 4.0 yd³ is strongly recommended to more accurately evaluate the influence of mixing. Batch at or near the maximum water/cement ratio as requested by the Engineer. The air content should be within 0.5 percent of the maximum allowable specification value or as requested by the Engineer. Strength will be determined for the test of record, or at other ages as determined by the Engineer. The test of record shall be the day indicated in Section 543. In all cases, strength will be based on the average of a minimum of two breaks. In addition to air and strength testing, concrete temperature will be determined by the Engineer. Air and concrete temperature testing will be performed according to Illinois Modified AASHTO R 60, T 152 or T 196, and Illinois Modified ASTM C1064. Strength testing will be performed according to ASTM C 1107 and C 109. As an option for additional information, Illinois Modified AASHTO T 121 may be performed.

#### 2.2.2.1 Verification of Trial Batch

The trial batch will be verified by the Engineer if Department test results meet specification requirements and the mixture is flowable.

# Appendix K

## **INSERTION LINING OF PIPE CULVERTS (CELLULAR CONCRETE)**

# 1.0 CELLULAR CONCRETE MIX DESIGN DEVELOPMENT FOR INSERTION LINING OF PIPE CULVERTS

Cellular concrete (sometimes called engineered fill) is a special mix which relies on foam to make the concrete low strength or light weight.

The mix designs are proprietary in nature, and therefore, their development will not be discussed within this manual. However, the principle of volumetric design, designing in terms of a standard unit volume, still applies. The absolute volume of materials shall equal one.

## Cement Only Mix Design for Strength Range of 30 - 350 psi

Cement 400 – 650 lb/yd³
 Water/Cement Ratio 0.50 – 0.60

Foam Admixture
 Consult Manufacturer for Dosage

Homogenous Void or Air Cell Structure 20 – 70 percent

#### **Comments:**

- Cement replacement with fly ash may reach as high as 65 percent.
- The use of fine aggregate is optional, but is not normally utilized when low strength or light weight is desired.

# 2.0 DEPARTMENT CELLULAR CONCRETE FOR INSERTION LINING OF PIPE CULVERTS MIX DESIGN VERIFICATION

#### 2.1 Verification by the Engineer

The mix design will be verified by the Engineer from test information provided by the Contractor showing that the mix is flowable and meets compressive strength requirements.

This Page Reserved

# **APPENDIX L**

#### CLASS SI CONCRETE BETWEEN PRECAST CONCRETE BOX CULVERTS

# 1.0 CLASS SI CONCRETE MIX DESIGN DEVELOPMENT (WHEN MIXTURE IS USED BETWEEN PRECAST CONCRETE BOX CULVERT SECTIONS)

For the Class SI concrete used between precast concrete box culvert sections, Article 540.06 states "The Class SI concrete shall be according to Section 1020, except the maximum size coarse aggregate shall be ¾ in. (10 mm)." This requirement is also in the Guide Bridge Special Provision "Three Sided Precast Concrete Structure." Thus, the principle of volumetric mix design discussed in this manual applies. The key point is that the specification essentially states to use a fine aggregate only. According to Article 1003.01, fine aggregate has a maximum size of ¾ in. To develop the mix design, the absolute volumes of cement, finely divided minerals, water, and air are calculated and added together. The resultant value is subtracted from one to get the volume of aggregate. Since the coarse aggregate proportion has been replaced with fine aggregate, the water demand will be higher. It is suggested to use a coarse aggregate basic water requirement of 0.4 gal/cwt as a starting point in developing the mix design.

# 2.0 DEPARTMENT CLASS SI CONCRETE MIX DESIGN VERIFICATION (WHEN MIXTURE IS USED BETWEEN PRECAST CONCRETE BOX CULVERT SECTIONS)

# 2.1 Verification by the Engineer

A new Class SI concrete (used between precast concrete sections) mix design will be verified by the Engineer from test information provided by the Contractor (optional), testing performed by the Engineer, applicable Department historical test data, target strength calculations, and previous Department experience.

For a Class SI concrete (used between precast concrete sections) mix design previously developed by the Engineer or Contractor, the Engineer will verify the mix design if the Department's historical test data shows compliance with specification requirements.

## 2.2 Testing Performed by the Engineer

The Engineer may require the Contractor to provide a batch of Class SI concrete (used between precast concrete sections) mixture at no cost to the Department.

#### 2.2.1 Procedure for Trial Batch

The procedure that follows shall be used to perform a trial batch unless specified otherwise in the contract plans.

The trial batch shall be performed in the presence of the Engineer, and the Engineer will perform all tests. The Contractor has the option to perform their own tests. The volume of the trial batch shall be a minimum of 2 yd³, but 4 yd³ is strongly recommended to more accurately evaluate the influence of mixing. Batch at or near the maximum water/cement ratio or as requested by the Engineer. The air content should be within 0.5 percent of the maximum allowable specification value or as requested by the Engineer. The slump should be within the allowable specification range. Strength will be determined for the test of record, or at other ages determined by the Engineer. The test of record shall be the day indicated in Article 1020.04 or as specified. In all cases, strength will be based on the average of a minimum two 6- by 12-in. cylinder breaks, three 4- by 8-in. cylinder breaks, or two beam breaks. In addition to slump, air, and strength testing,

concrete temperature will be determined by the Engineer. Testing will be performed according to Illinois Modified AASHTO R60, R 100, T 119, T 152 or T 196, T 22 or T 177, and Illinois Modified ASTM C 1064. As an option for additional information, Illinois Modified AASHTO T 121 may be performed.

## 2.2.1.1 Verification of Trial Batch, Voids Test, and Durability Test Data

The trial batch will be verified by the Engineer if Department test results meet specification requirements.

# **APPENDIX M**

#### **PERVIOUS CONCRETE**

Pervious concrete shall be done according to contract specifications, and there is no formal mix design procedure. However, the principle of volumetric mix design, designing in terms of a standard unit volume, still applies. The absolute volumes of cement, finely divided minerals, water, air, and aggregate shall equal one.

When the contract specifications specify freeze/thaw durability, improved durability may be achieved by entraining air in the cement paste.

This Page Reserved

# **APPENDIX N**

#### AVERAGE AND STANDARD DEVIATION

#### 1.0 AVERAGE STRENGTH

"Average" strength implies that half of the samples tested are **stronger than average** and half are **weaker than average**. Thus, the average strength of a concrete mix must be **greater** than the minimum required strength.

The quantitative difference between the average, or mix design target strength and the minimum required strength, depends on the accuracy and precision of the test results. The accuracy and precision of the test results must be calculated before the mix design target strength can be determined.

## 1.1 Accuracy and Precision

Accuracy refers to the average of the performance with reference to the target: a measure of how near the results are to the target.

Precision refers to the consistency of the performance itself: a measure of how near the results are to each other regardless of the target. That is, though the results may not be near the target, amongst themselves they are tightly grouped.

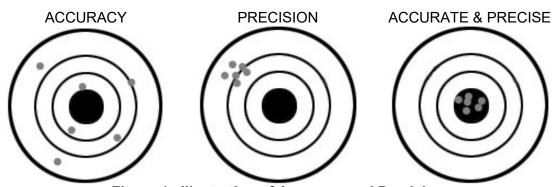


Figure 1. Illustration of Accuracy and Precision

Accuracy is typically measured by the mean, or average, of the test results as follows:

Average, 
$$\overline{X} = \frac{X_1 + X_2 + X_3 + \dots + X_n}{n}$$

Where  $x_i$  is an individual test result, and n is the total number of test results

Precision, or "measure of dispersion," is measured by the standard deviation, which indicates width, spread, clustering, and consistency, and is defined as follows:

Standard Deviation, 
$$S = \sqrt{\frac{\sum (\overline{X} - x_i)^2}{(n-1)}}$$

# Example:

Tost Pagard (nsi)		Deviation		Square of Deviation	
	Test Record (psi)	$\overline{X} - x_i$		$(\overline{X} - X_i)^2$	
1	3000	4058 - 3000	= 1058	1,119,364	
2	3450	4058 - 3450	= 608	369,664	
3	3600	4058 - 3600	= 458	209,764	
4	4650	4058 - 4650	= -592	350,464	
5	4750	4058 - 4750	= -692	478,864	
6	4900	4058 - 4900	= -842	708,964	
sum =	$\sum_{i \to n}^{n=6} x_i = 24,350$		$sum = \sum_{i \to n}^{n=6} (\overline{X} - x_i)^2$	= 3,237,084	
	rage, $\frac{\text{sum}}{n} = \frac{4058 \text{ psi}}{n}$		standard deviation, $S = \sqrt{\frac{\text{sum}}{(n-1)}}$	805 psi	

## 2.0 THE NORMAL DISTRIBUTION—The Bell Curve

Characteristics in any statistical sample population, such as compressive strength test results, can be grouped around some central tendency, or average, as illustrated in Figure 2.

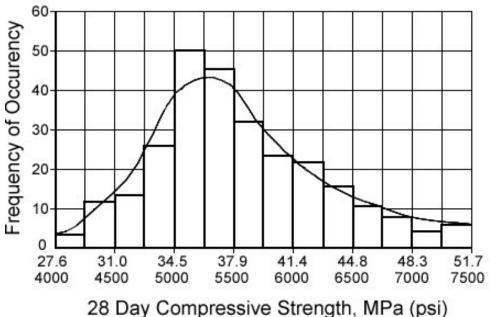


Figure 2. Example of Normal Distribution Histogram

Figure 2. is an example of a histogram, a graph of the frequency of occurrences per subdivision of the complete range of test results. For example, there were 50 occurrences of test results within 5000 and 5250 psi.

Now, a smooth bell-shaped curve can be drawn through the histogram. This "Bell Curve" is known as the Normal Distribution, characterized by a distinct central tendency toward the center, which is the average. The Bell Curve quantitatively illustrates how test results have an equal chance to be above or below the average.

The characteristics of the Normal Distribution are as follows:

- 68 percent of all results fall within 1 standard deviation from either side of the average
- 95 percent of all results fall within 2 standard deviations from either side of the average
- 99.7 percent of all results fall within 3 standard deviations from either side of the average
- 99 percent of all results fall above the value that is 2.33 standard deviations below the average

The figures on the next page illustrate an example of how greater precision can help production. Figure 3 shows three mixes with the same target strength but different standard deviations (i.e., precision). Even with the different levels of precision, all three mixes can be expected to meet the minimum specified strength of 4000 psi. However, as illustrated in Figure 4, increased precision allows the target strengths for two of the mixes to be reduced (e.g., via reduced total cement) without fear of violating the minimum specified strength.


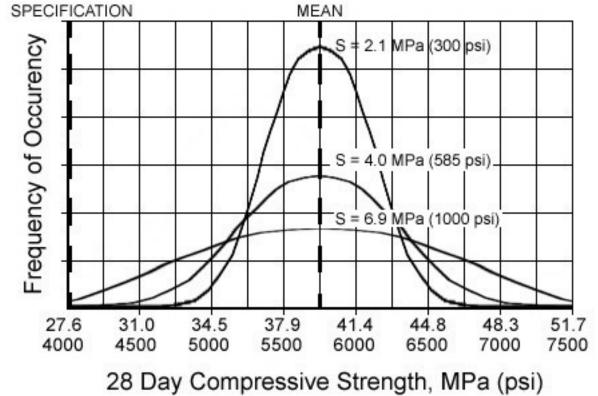


Figure 3 Example of Normal Distribution Plots for Mixes with the Same Target Strength but Differing Standard Deviations

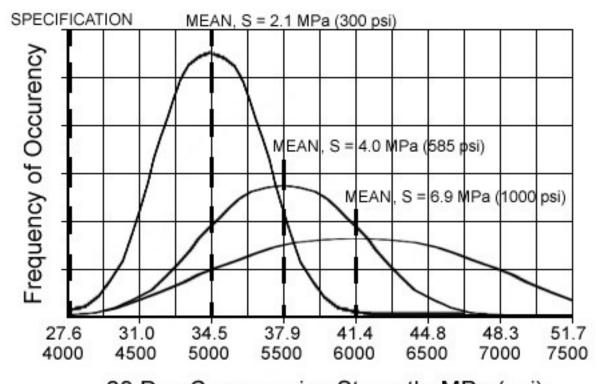



28 Day Compressive Strength, MPa (psi)

Figure 4 Example of Normal Distribution Plots for Mixes with Adjusted Target Strengths to Account for the Differing Standard Deviations

# **APPENDIX O**

#### **ALKALI-SILICA REACTION MITIGATION FLOW CHART**

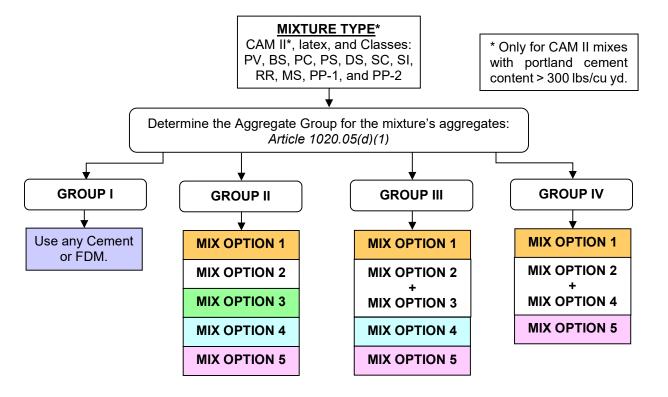

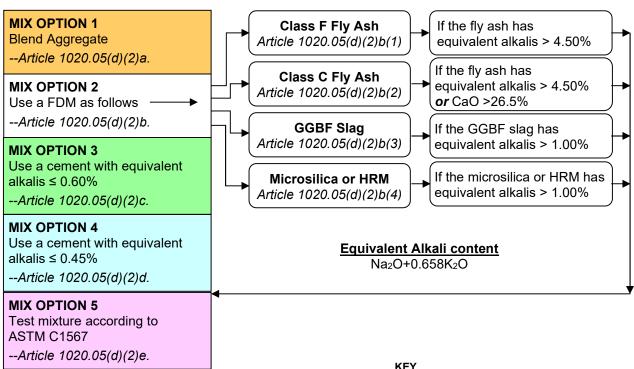

<sup>\*</sup> Not applicable: concrete revetment mat, insertion lining of pipe culvert, portland cement mortar fairing course, CLSM, miscellaneous grouts that are not prepackaged, and Classes PP-3, PP-4, PP-5.

KEY

CAM: Cement Aggregate Mixture (e.g., CAM II)
CLSM: Controlled Low Strength Material

FDM: Finely Divided Mineral

GGBF: Ground Granulated Blast Furnace (slag)

HRM: High Reactivity Metakaolin

This Page Reserved

# **APPENDIX P**

#### BRIDGE DECK LATEX CONCRETE OVERLAY MIX DESIGN

Latex concrete shall be done according to the Guide Bridge Special Provision for Bridge Deck Latex Concrete Overlay, which provides basic mix design criteria. The principle of volumetric mix design, designing in terms of a standard unit volume, still applies. Thus, it is important to note that the solids and nonsolids contained in the latex admixture may contribute significantly to the volume of the mix design. To account for the volumetric contribution made by the latex admixture, the absolute volumes of coarse aggregate and water can be reduced to accommodate the volumes of solids and nonsolids, respectively, of the latex admixture.

First, the mix design is calculated as though there is no latex admixture included; this will help ensure the intended 42 to 50 percent coarse aggregate content (by weight) is established. Then, the volume of solids in the latex admixture is calculated and subtracted from the volume of coarse aggregate. Similarly, the volume of nonsolids in the latex admixture is subtracted from the volume of water in the mix. Finally, the weights of all components can be recalculated based on their specific gravities as usual.

For example, calculate the adjusted batch weights for a latex concrete mixture using a latex admixture with specific gravity 1.01 and percent solids 46%:

**Given:** Latex Admixture Dosage – 24.5 gal/cu yd

Fine and Coarse Aggregate Specific Gravities - 2.65

		Design ex admixture)		d Design admixture)
	Absolute Volume (yd³)	Batch Weight, SSD (lb/yd³)	Absolute Volume (yd³)	Batch Weight, SSD (lb/yd³)
Fine Aggregate	0.346	1544	0.346	1544
Coarse Aggregate	0.339	1513	0.283	1263
Cement	0.124	658	0.124	658
Air (5%)	0.050	0	0.050	0
Water	0.143	240	0.078	131
Latex			0.121	206
Total	1.00		1.00	

## **Adjustment Calculations:**

Batch Weight of Latex Admixture = 24.5 gal/yd<sup>3</sup> × (1.01 × 8.33 lb/gal) = 206 lb/yd<sup>3</sup>

Absolute Volume of Latex Admixture =  $206 \div (1.01 \times 1683.99) = 0.121 \text{ yd}^3$ 

Absolute Volume of Latex Solids =  $0.121 \times (46/100) = 0.056 \text{ yd}^3$ 

Absolute Volume of Latex Nonsolids =  $0.121 - 0.056 = 0.065 \text{ yd}^3$ 

Adjusted CA Absolute Volume =  $0.339 - 0.056 = 0.283 \text{ yd}^3$ 

Adjusted CA Batch Weight =  $0.283 \times 2.65 \times 1683.99 = 1263 \text{ lb/yd}^3$ 

Adjusted Water Absolute Volume = 0.143 - 0.065 = 0.078 yd3

Adjusted Water Batch Weight =  $0.078 \times 1.00 \times 1683.99 = 131 \text{ lb/yd}^3$ 

The Department's Excel PCC Mix Design program accounts for the latex admixture contribution in this way based on the following required design inputs:

- Batch Dosage: latex admixture dosage in terms of gal/yd³ (L/m³).
- Specific Gravity: manufacturer's specific gravity for the latex admixture.
- % Solids: manufacturer's percent solids for the latex admixture.

This Page Reserved

# **APPENDIX Q**

## **BASIC AND ADJUSTED WATER REQUIREMENT METHOD**

Note: The following information is provided for historical purposes.

## 1.0 BASIC AND ADJUSTED WATER REQUIREMENT METHOD

The Department's original method to determine the amount of water to use in a mix is based on the angularity of the aggregates in the mix: as the angularity increases, the amount of water required in the concrete increases. This method determines a "Basic Water Requirement," which can then be adjusted as necessary based on admixtures used, finely divided mineral content, and other factors.

**Reminder:** The Department's "PCC Mix Design" Excel spreadsheet provides both the "w/c Ratio Method" and the "Basic Water Requirement Method" to determine the water content for a mix.

## 1.1 Basic Water Requirement

The basic water requirement is the summation of the water required based on fine and coarse aggregate angularity. The Basic Water Requirement is measured in gallons per hundredweights (liters per kilograms) of total cement and finely divided minerals.

# 1.1.1 Fine Aggregate Basic Water Requirement

For fine aggregate, the Department would classify the aggregate as Type A, B, or C, according to the Illinois Method for Fine Aggregate Classification:

FA Type (particle description)	Basic Water Requirement
"A" (rounded)	5.1 gal/cwt (0.42 L/kg)
"B" (mixture of rounded and angular)	5.3 gal/cwt (0.44 L/kg)
"C" (angular)	5.5 gal/cwt (0.46 L/kg)

If blending fine aggregates that are not the same Type, select the highest water requirement.

Historical fine aggregate classification information can be provided by the District.

## 1.1.2 Coarse Aggregate Basic Water Requirement

Due to greater surface area, crushed coarse aggregate will require more water than rounded. Similarly, flat and elongated coarse aggregate particles will increase water demand because of greater surface area. Illinois Test Procedure 4791 can be used to determine the percentage of flat and elongated particles.

Based on experience, the Department attributes 0.2 to 0.4 gal/cwt (0.017 to 0.033 L/kg) for coarse aggregate as follows:

CA Type (particle description)	Basic Water Requirement
Rounded Gravel	0.0 gal/cwt (0.000 L/kg)
Crushed Gravel and Stone	0.2 gal/cwt (0.017 L/kg)
Lightweight Slag Aggregate	0.4 gal/cwt (0.033 L/kg)

# 1.1.3 Basic Water Requirement Calculation

An example calculation for determining basic water requirement is as follows:

**Given:** Type B Fine Aggregate

Crushed Stone

#### **Calculations:**

English:

Basic Water Requirement Total = 5.3<sub>FA</sub> + 0.2<sub>CA</sub> = 5.5 gallons/cwt

Metric:

Basic Water Requirement Total =  $0.44_{FA} + 0.017_{CA} = 0.46$  liter/kg

Remember, the Basic Water Requirement is determined in terms of gallons per hundredweight (liters per kilogram) of total cement and finely divided minerals. Thus, for batching, if the total cementitious content is 5.65 cwt/yd³ (335 kg/m³), the amount of water needed by the basic water requirement is as follows:

English:

 $5.65 \text{ cwt/yd}^3 \times 5.5 \text{ gal/cwt} = 31.1 \text{ gal/yd}^3 \text{ (or } 31.1 \text{ gal/yd}^3 \times 8.33 \text{ lb/gal} = 259 \text{ lb/yd}^3)$ 

Metric:

 $335 \text{ kg/m}^3 \times 0.46 \text{ L/kg} = 154.1 \text{ L/m}^3 \text{ (or } 154.1 \text{ L/m}^3 \times 1 \text{ kg/L} = 154.1 \text{ kg/m}^3)$ 

# 1.2 Adjusting the Basic Water Requirement

The Basic Water Requirement can be adjusted using Table 1.2 "Adjustment to Basic Water Requirement". An example calculation is as follows:

**Given:** The basic water requirement is 5.5 gal/cwt (0.46 L/kg). A water-reducing admixture is used, and the water content reduction desired is 10 percent.

#### Calculations:

Adjusted Basic Water Requirement = Basic Water Req't  $\times (1 - \frac{\% Adjustment}{100})$ 

English:

Adjusted Basic Water Requirement =  $5.5 \times (1 - \frac{10}{100}) = 5.5 \times 0.9 = 5.0$  gal/cwt

Metric:

Adjusted Basic Water Requirement =  $0.46 \times (1 - \frac{10}{100}) = 0.46 \times 0.9 = 0.41$  L/kg

Thus, continuing the previous example, the amount of batch water after adjustment is as follows:

*English*:

 $5.65 \text{ cwt/yd}^3 \times 5.0 \text{ gal/cwt} = 28.3 \text{ gal/yd}^3 \text{ (or } 28.3 \text{ gal/yd}^3 \times 8.33 \text{ lb/gal} = 236 \text{ lb/yd}^3)$ 

Metric:

 $335 \text{ kg/m}^3 \times 0.41 \text{ L/kg} = 137.4 \text{ L/m}^3 \text{ (or } 137.4 \text{ L/m}^3 \times 1 \text{ kg/L} = 137.4 \text{ kg/m}^3)$ 

Table 1.2 Adjustment to Basic Water Requirement

Water Adjustment	Suggested Range	Percent Adjustment
Combined aggregate grading:		
Well-graded	(-10 to 0%)	
Gap-graded	(0 to +10%)	
Admixture(s):		
Air-entraining admixture 1 to 3%	(0%)	
Note: Use allowable minimum specification air content 4 to 5%	(-5%)	
to select the appropriate range at right. 6 to 10%	(-10%)	
Normal range water-reducing admixture	(-10 to -5%)	
Mid-range water-reducing admixture	(-15 to -8%)	
High range water-reducing admixture/superplasticizer (Note 1)	(-30 to -12%)	
Finely Divided Minerals:		
Fly Ash (Note 2)	(-10 to 0%)	
Microsilica	(0 to +15%)	
High-Reactivity Metakaolin (HRM)	(-5 to +5%)	
Ground Granulated Blast-Furnace (GGBF) Slag	(0%)	
Other factors:		
Coarse cement, water/cement ratio >0.45, and	(-10 to 0%)	
concrete temperature <60 °F (15 °C)	(-10 to 0 70)	
Fine cement, water/cement ratio <0.40, and	(0 to +10%)	
concrete temperature >80 °F (27 °C)	(0 10 + 10 //)	
Enter the sum of the adjustment percentages. The suggested m		
reduction recognizing overlapping effects of individual factors is		
required minimum water/cement ratio also needs to be considered	ed.	

#### Notes:

- 1. A polycarboxylate high range water-reducing admixture may be able to reduce the water content up to 40%.
- 2. For each 10% of fly ash in the total cementitious, it is recommended to allow a water reduction of at least 3%.

## 2.0 ADJUSTED BASIC WATER REQUIREMENT AND WATER/CEMENT RATIO

An example calculation for determining w/c ratio based on the adjusted basic water requirement is as follows:

**Given:** Adjusted Basic Water Requirement = 5.0 gal/cwt (0.41 L/kg)

#### **Calculations:**

$$w/c = (5.0 \text{ gal/cwt} \times 8.33 \text{ lb/gal}) \div 100 \text{ lb/cwt} = 0.42$$


Metric:

$$w/c = 0.41 L/kg \times 1 kg/L = 0.41$$


This Page Is Reserved

Revised January 1, 2025

# PCC Level III PowerPoint Handout Main Presentation 2024-2025





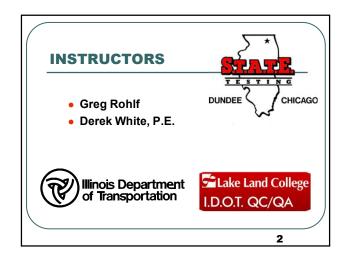



Follow the PowerPoint Notes

Last tabbed divider Course Manual

MY POWERPOINT PRESENTATION IS A VISION OF BEAUTY AND PERSUASION.

AND PERSUASION.

4

#### **OBJECTIVES**

- Be able to perform mix design per IDOT Mortar Factor method
- Identify and understand IDOT PCC specifications
- Improve understanding of how ingredient materials affect PCC mix design and performance
- Introduce IDOT mix design spreadsheet

5

#### **Administration**


- Two Day Class
- Test 2 1/2 hours, open book
- 70% needed to pass
- You will be notified of results by mail
- Re-test by August 31
- 12 Professional Development Hours (PDH)

6

5

PCC III 2-08-21

6

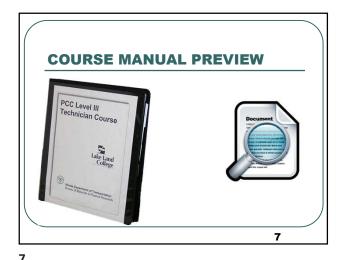

**Table of Contents - Reference** 

- Course Evaluation Forms Please fill out before you leave.
- Definitions
- Applicable Specifications
- Classes of Concrete
- Units of Measure
- Significant Digits and Rounding

8

R

10

# Table of Contents (Page vii) Main Content (Page 1 of 38)

- 1.0 Mix Design Overview
- 2.0 Mix Design
  - Walk thru specifications and design steps
  - Example problems
- 3.0 Specialty Mixes (2<sup>nd</sup> day)
- 4.0 Ternary Mix Designs
- 5.0 Mass Concrete
- **6.0 Concrete Admixtures**
- 7.0 Trial Mixtures

9

**Table of Contents (more)** 

- 8.0 Target Strength
- 9.0 Durability Testing
- 10.0 Mix Design Verification

Appendices TOC (Page ix)




#### Last tabs

- Worksheets for Homework and Problems
- PowerPoint Handout

10

9

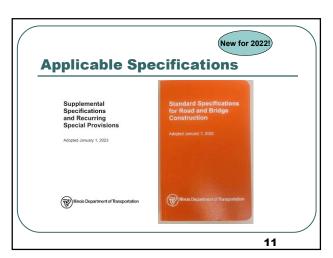

Resources:
www.idot.illinois.gov

Comerce di Prillate

Illinois Department of Transportation

And EST\* Dough Busines\* Transl Information\* Transportation Systems

THINK BEFORE YOU THROW.

HELP US KEEP-ILLINOIS ROADS GLEAN AND SAFE.

Think before you throw. Help us keep Illinois roads clean and safe.

11 12

PCC III 2-08-21 2







www.idot.illinois.gov
Material Approvals

Cement
Finely Divided Minerals (Fly ash, etc.)
Admixtures
Aggregate ASR and Freeze Thaw Rating
Proprietary repair and specialty mixes

Updated weekly – Subscribe to Email Updates!


15



17 18

PCC III 2-08-21 3

16

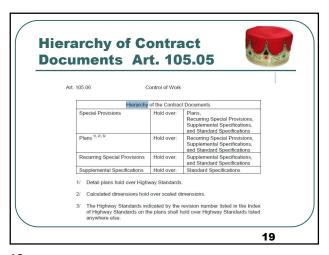

**GBSP** 

**Guide Bridge Special Provisions** 

Issued by the Bureau of Bridges and Structures
Inserted into Project Manual

- Deck Slab Repair
- Bridge Deck Overlays Microsilica, Latex, High-Reactivity Metakaolin, Fly Ash, GGBF Slag
- Concrete Wearing Surface
- Structural Repair of Concrete

20

19

# **BDE Special Provisions** (Bureau of Design and Environment)

- Haul time for Non-Agitator trucks
- Blended Finely Divided Minerals

Inserted in Project Manual. Look for Updates on IDOT website Revised alternate lettings.

21

Special Provisions → Supplemental Specs → Standard Specs




22

21

22

20

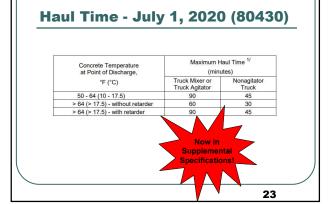

#### **Haul time - 2023**

1020.11 Mixing Portland Cement Concrete. Revise Article 1020.11(a)(7) to read:

"(7) Haul Time. Haul time shall begin when the delivery ticket is stamped. The delivery ticket shall be stamped no later than five minutes after the addition of the mixing water to the cement, or after the addition of the cement to the aggregate when the combined aggregates contain free moisture in excess of two percent by weight (mass). If more than one batch is required for charging a truck using a stationary mixer, the time of haul shall start with mixing of the first batch. Haul time shall end when the truck is emptied for incorporation of the concrete into the work. The maximum haul time shall be as follows.

Concrete Temperature	Maximum Haul Time 1/ (minutes)		
at Point of Discharge, °F (°C)	Truck Mixer or Truck Agitator	Nonagitato Truck	
50 - 64 (10 - 17.5)	90	45	
>64 (>17.5) - without retarder	60	30	
>64 (>17.5) - with retarder	90	45	

24

23

24

PCC III 2-08-21 4

# **Blended Finely Divided Minerals** - April 1, 2021 (80436)

"1010.06 Blended Finely Divided Minerals. Blended finely divided minerals shall be the product resulting from the blending or intergrinding of two or three finely divided minerals. Blended finely divided minerals shall be according to ASTM C 1697, except as follows.

- (a) Blending shall be accomplished by mechanically or pneumatically intermixing the constituent finely divided minerals into a uniform mixture that is then discharged into a silo for storage or tanker for transportation.
- (b) The blended finely divided mineral product will be classified according to its predominant constituent or the manufacturer's designation and shall meet the chemical requirements of its classification. The other finely divided mineral constituent(s) will not be required to conform to their individual standards."

25

26

28

#### **Concrete Mix Design – Department** Provided (Checksheet #31) Appendix A

- Contractor has the option to request the Engineer determine mix design material proportions for all classes of concrete (except PS)
- A single mix design for each class of concrete will be provided.
- Contractor must still meet specification requirements.
- **District Option** to include in contracts

26

25

# PCC in SSRBC - Article 1020

- Classes of concrete & mix design criteria
- Rules for Fly Ash/GGBFS replacement & ternary mixes
- Use of concrete admixtures (Also Article 1021)
- Alkali-Silica (ASR) mitigation (Appendix O)
- Mix time, use of multiple plants, curing, temperature restrictions
- **Curing and protection**
- Heat of hydration control for mass structures

27

#### PCC in SSRBC - Article 1020

**Supplemental Specifications amend Section 1020** of Standard Specifications for Road & Bridge Construction (Except when Standard Specifications are newly issued)

Most now in Article 1020 of SSRBC

28

27

#### Added to SSRBC in 2022

- Clarification of class DS concrete
- Temperature control for placement (85 F) maximum ambient or concrete temperature for bridge decks)
- **Curing and protection**

29

# **Recurring Special Provisions** (Check Sheets)

Included in Supplemental Specifications book District option to include - Must be "checked" in project manual to apply.

#21 Calcium Chloride Accelerator for PP-2 #22 QC/QA for PCC at the plant

#23 QC/QA Special Provision (QC Plan, required tests & frequencies, procedures)

#28 PCC Overlay or Inlay (Whitetopping)


#31 Department-provided mix designs

30

29

30

PCC III 2-08-21 5

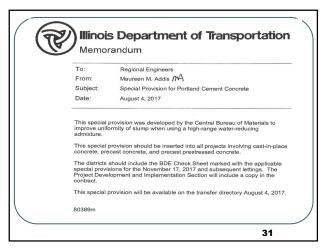

BDE Special Provision - 2017


PORTAND CEMENT CONCRETE (BDE)

Effective: November 1, 2017

Revise the Art Content % of Class PP Concrete in Table 1 Classes of Concrete and Mix Design Criteria in Article 100.04 of the Blandard Specifications to read.


TABLE TOWNS AND ARTICLES OF CONCRETE AND CLASSES OF CONCRETE AND CLA


31 32

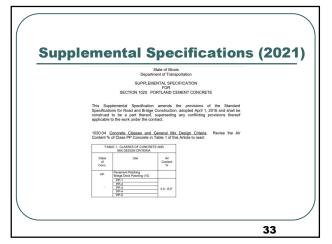

| Payement Patching | Bridge Deck Patching (10) | PP-1 | 412 | 0.50 | 0.7 50 | 0.32 - 0.044 | 2-4 | at 48 hours | PP-3 | PP-4 | PP-5 | PP-5 | 0.575 (9) | 0.575 (9) | 0.32 - 0.05 | 2-6 | at 8 hours | 4.0 - 8.0 | PP-5 | 0.755 (9) | 0.575 (9) | 0.32 - 0.05 | 2-6 | at 8 hours | 4.0 - 8.0 | PP-5 | PP

33

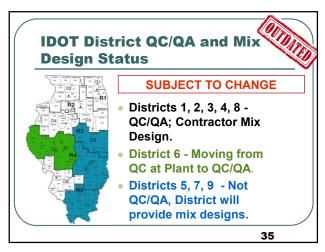

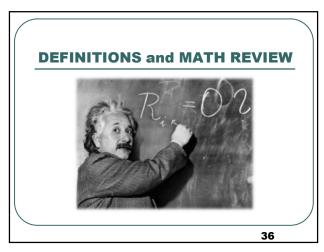

35 36

PCC III 2-08-21 6

p. xviii

Abbreviations

BDE......Bureau of Design and Environment FDM.....Finely Divided Mineral GBSP....Guide Bridge Special Provision MF......Mortar Factor CWT.....Hundredweight SSD.....Saturated Surface Dry SG......Specific Gravity GGBFS...Ground Granulated Blast Furnace Slag HRM.....High-Reactivity Metakaolin CBM.....Central Bureau of Materials

**Abbreviations, continued** 

ASR.....Alkali Silica Reaction FCA.....Fraction of Coarse Aggregate

FM.....Fineness Modulus

SCC......Self Consolidating Concrete CAM II....Cement Aggregate Mixture II

CLSM.....Controlled Low-Strength Material

VCA.....Voids in Coarse Aggregate

ITP.....IDOT Test Procedure

38

**37** 

## Abbreviations, continued

MISTIC...Materials Integrated System for Test Information and Communication

Replaced with:

CMMS – Construction and Materials Management System

39

37

38

p. xvii

**Significant Digits / Rounding** 

Retain 0.XXX until end.

#### **Whole Number**

- Cement, Finely Divided Minerals (550 LB) (round up to next 5 LB)
- Coarse and Fine Aggregate (1,986 LB)
- Water

#### One Digit to Right of Decimal

Air Content, Basic Water Requirement

40

39

40

# **Significant Digits / Rounding**

## Two Digits to Right of Decimal

- Specific Gravity, Unit Weight (2.68, 146.35 ncf)
- Water/Cement Ratio, Mortar Factor, VCA (0.44, 0.80, 0.41)

#### **Three Digits to Right of Decimal:**

Absolute Volume (0.116)

41

**Water/Cement Ratio** 

W/C ratio =

All liquids, including water in admixtures
All cement and cementitious materials

42

7

41

42

PCC III 2-08-21

#### **Yield**

Volume of concrete batch expressed in volume (FT<sup>3</sup>)

Sum of Batched Material Weight (LB) Unit Weight of Concrete Mix (LB/FT3).

43

#### **Shrink Mix**

- PCC is mixed in plant mixer before discharge into truck mixer
- Short mixing period in the plant reduces the bulk volume Typically, 1.3 yd<sup>3</sup> fully mixed PCC requires about 2.07 yd3 of individual (ACPA)
- Thus, more PCC can be loaded into each truck
- The amount of mixing should be determined via mixer uniformity tests

44

43

44

#### **Concrete Math**

- Concrete is batched by weight, sold by volume (Level II)
- Designed by volume, batched by weight (Level III)



45

**IMPORTANT CONCEPT #1 IDOT DESIGN** 

> The sum of volume of all ingredients is **ONE CUBIC** YARD!

**VOLUME** 




1 Cubic Yard "box"

46

45


46

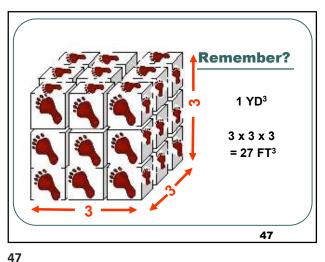



**IDOT Design Volume =** 1 Cubic Yard + Aggregate + Cement + Other cementitious materials (FDM's) + Water + Air + Admixtures 1 Cubic Yard


PCC III 2-08-21 8


48

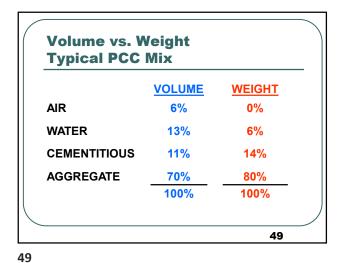


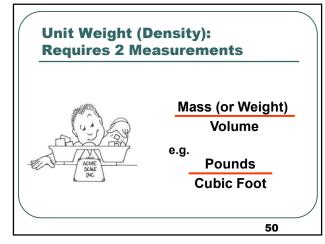

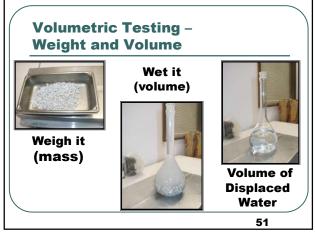


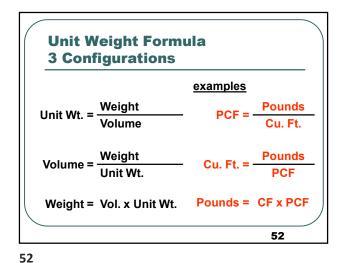


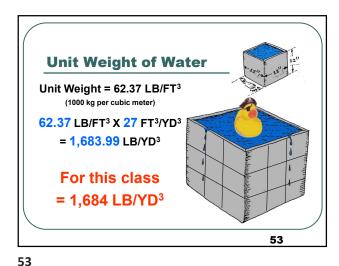


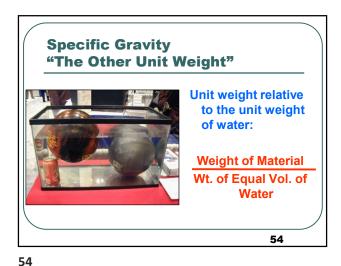



PCC III 2-08-21

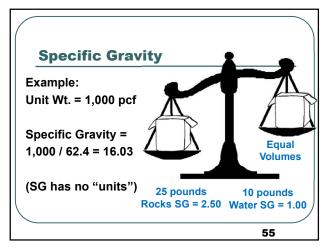


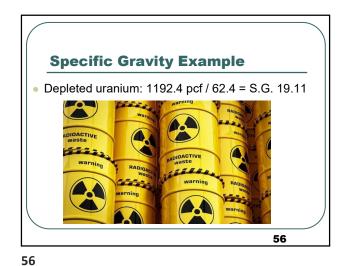

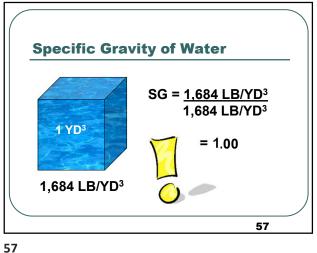


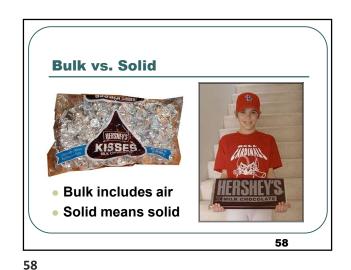


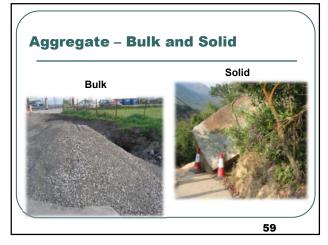


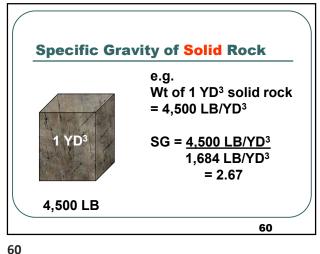


PCC III 2-08-21 

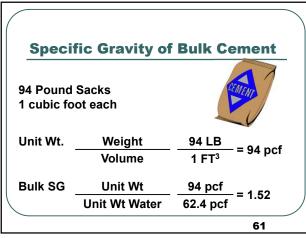

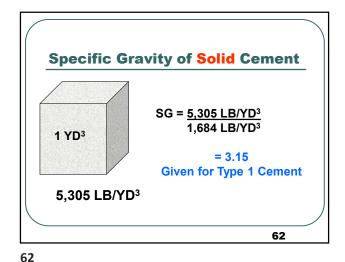

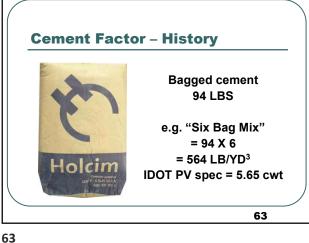

**Cement Factor: Weight of Cement per Cubic Yard** Expressed as cwt per cubic yard or cwt cwt = 100 pounds of cement e.g. 5.65 cwt/yd3 or (shortcut) 5.65 cwt x 100 to get "Cement Content" of mix  $cwt \times 100 = 565 LB/YD^3$ . 64

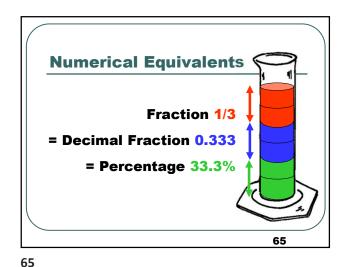


**Important Concept #2 Absolute Volume (2.1)**  The solid volume of each ingredient material in the design volume Calculated based on mass & S.G. Ratio of loose weight to solid weight Percent expressed as a decimal fraction (0.XXX) Total of all ingredients = 1.000

66

PCC III 2-08-21 11


64

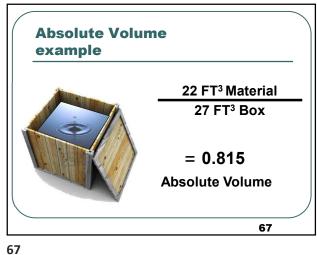

**Absolute Volume = Another way** to express percentage **Typical PCC Mix Absolute Percent** 6.5% .065 AIR WATER 12.5% .125 **CEMENTITIOUS** 11.0% .110 AGGREGATE 70.0% .700 100% 1.000 68


68


70

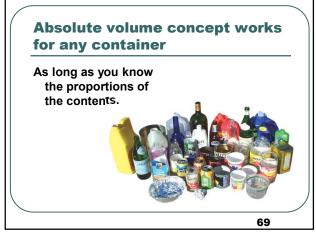


69

**Absolute Volume of Liquid**  Container 40% Full Absolute Volume Liquid = 0.400 Absolute Volume Air = 0.600 70

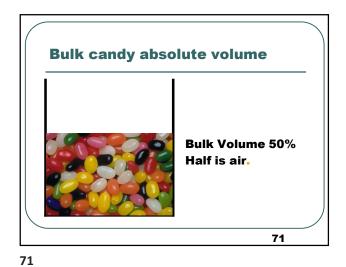

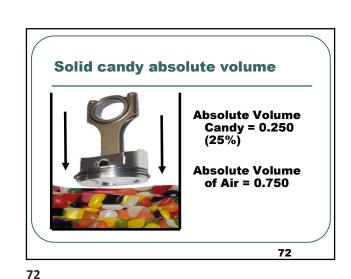

PCC III 2-08-21 12

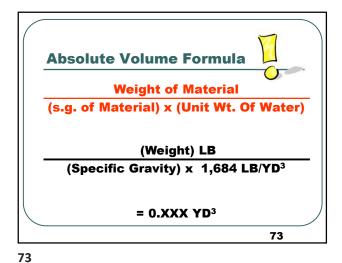



Properties of Concrete Aggregates


- Quality
- Nominal size
- Gradation
- Specific gravity
- Absorption
- Voids in coarse aggregate (VCA)



PCC AGGREGATE DURABILITY

ASR


"D" Cracking

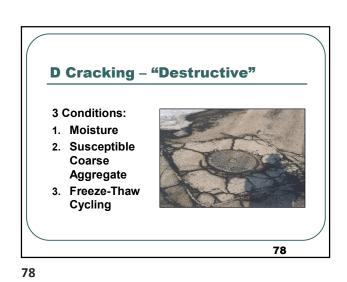

PCC III 2-08-21

77

**75** 

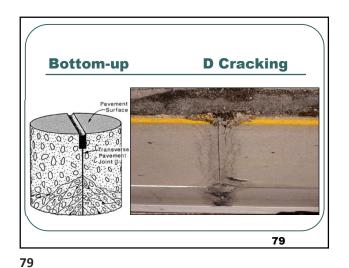

**Freeze-Thaw Rated Coarse** Aggregate - On Grade Pavement Driveway Base course Sidewalk

Curb, Gutter, Base course

widening Combination curb Shoulders and gutter

& repair Median

Paved ditch

80

80

# "D" Cracking Mitigation

Use Coarse Aggregate per IDOT Freeze-**Thaw Rating Approved list:** 

- 20-Year All on-grade PCC
- 30-Year Extended Life Pavement\*
- 40-Year Extended Life Pavement\* \*via Special Provision

81

**Fine Aggregate Quality** SSRBC (1003.01)

FINE AGGREGATE QUAL	.ITY			
QUALITY TEST	- 1	CLASS		
QUALITI TEST	Α	В	С	
Na <sub>2</sub> SO <sub>4</sub> Soundness 5 Cycle, ITP 104, % Loss max.	10	15	20	
Minus No. 200 (75 μm) Sieve Material, ITP 11, % max.	3	6 1/	10 1/	
Organic Impurities Check, ITP 21	Yes 2/			
Deleterious Materials: 3/ 5/				
Shale, % max.	3.0	3.0		
Clay Lumps, % max.	1.0	3.0		
Coal, Lignite, & Shells, % max.	1.0	3.0		
Conglomerate, % max.	3.0	3.0		
Other Deleterious, % max.	3.0	3.0		
Total Deleterious, % max.	3.0	5.0		

82

81

82

# **Coarse Aggregate Quality SSRBC** - (1004.01)

(b) Quality. The coarse aggregate shall be according to the quality standards listed in the following table.


QUALITY TEST	CLASS			
QUALITYTEST	Α	В	С	D
Na <sub>2</sub> SO <sub>4</sub> Soundness 5 Cycle, Illinois Modified AASHTO T 104 <sup>1/</sup> , % Loss max.	15	15	20	25 <sup>2</sup>
Los Angeles Abrasion, Illinois Modified AASHTO T 96, % Loss max.	40 3/	40 4/	40 5/	45
Minus No. 200 (75 µm) Sieve Material, Illinois Modified AASHTO T 11	1.0 6/		2.5 7/	
Deleterious Materials 10/				
Shale, % max.	1.0	2.0	4.0 8/	
Clay Lumps, % max.	0.25	0.5	0.5 8/	-
Coal & Lignite, % max.	0.25			
Soft & Unsound Fragments, % max.	4.0	6.0	8.0 8/	
Other Deleterious, % max.	4.0 9/	2.0	2.0 8/	
Total Deleterious, % max.	5.0	6.0	10.0 8/	


83

**Particle size** 

83 84

PCC III 2-08-21 14

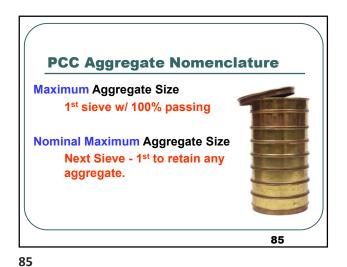

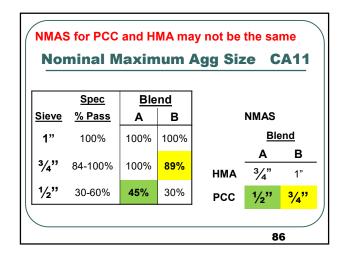




1. Oven Dry (G<sub>a</sub>)


87

- Specific Gravity of Dry Aggregate
- Used to determine Voids in Coarse Aggregate (coming up later)
- 2. Saturated Surface Dry (G<sub>SSD</sub>)
  - Specific gravity, including absorbed and damp-surface water
  - Used in PCC design and production

87

**Oven-Dry Bulk Specific Gravity** Mass (Dry Agg) Vol (Agg + Surf Voids) Vol. of water-perm. voids **Surface Voids (empty)** 88 88

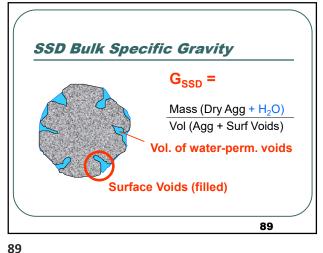

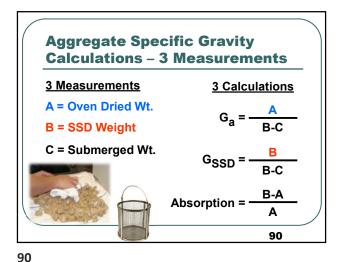



**Types of Cements** 

- Type I Normal
- Type 1L Limestone Cement
- Type II Sulfate Resistant
- Type III High Early Strength
- Type IV Low Heat
- Type V High Sulfate Resistant
- Type IA Air Entraining

92

91

92

94

### **Type 1L Cement**

- Rapidly becoming Now is predominant cement
- Interchangeable with Type I
- See IDOT Qualified Cement list
- 10% cement replaced with limestone

93

**Blended Cements** 

- Type IP (Portland-Pozzolan)
- Type IS (Portland blast-furnace slag cement)
- Type IT –Ternary blended cement
  - e.g. Type IT(S25)(P15) contains 25% slag and 15% pozzolans (fly ash)
- Type IL (Limestone cement) \*\*

94

93

Cement Factors for IDOT Mixes (Pg. 4)

 Table 2.2.1 Cement Factor for Class or Type of Concrete

 Class or Type of Concrete
 Minimum Cement Factor cwtlyd³
 Maximum Cement Factor cwtlyd³

 PV
 5.65 ¹²
 7.05

 6.05 ¹³
 7.05

 PP-1
 6.50 ¹
 7.50

 6.20 ¹⁴
 7.20 ⁴

 PP-2
 7.35 °
 8.20

 PP-3
 7.35 °
 7.35 °

 PP-4
 6.00 °
 6.25 °


 PP-5
 6.75 °
 6.75 °


 RR
 6.50 ¹
 7.50

BS

96

95 96

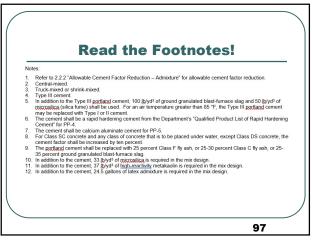

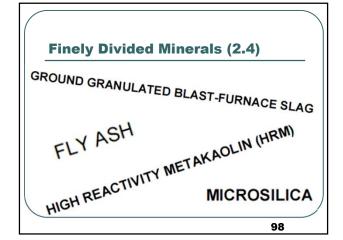

### **Finely Divided Minerals "FDMs"**

"Cementitious Material"

Fly Ash

97

99

- Ground Granulated Blast Furnace Slag
- Microsilica
- High-Reactivity Metakaolin

Used for cement replacement and mix enhancement

99

**Supplementary Cementitious Materials** 

Another term for FDM

**IDOT uses "FDM"** 



100

100

98

### Fly Ash

Coal plant by-product

- Increases workability
- Lowers heat of hydration
- Delays set
- Reduces permeability
- Decreases air content
- Lower early strength Higher long-term strength
- Supply is running out!

101

### Fly Ash Classes

Class C - From Lignite/Subbituminous (brown) coal –
Cementitious and Pozzolanic properties

- More commonly used in IL
- Usually allowed


Class F – From Anthracite/Bituminous (black) coal - Pozzolanic properties

- Burned from harder, older coal
- More restrictions on use

Class F/C blended - From known sources

102

101 102

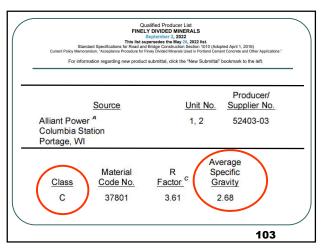

Seurce Unit No. Supplier No.

Alliant Utilities B
Burlington Station
Burlington, IA

A/... the average calcium oxide (CaO) of the Class C
fly ash from this source is ≥18% to < 26.5%, and the
loss on ignition (LOI) is less than 2.0%.

B/...the average calcium oxide (CaO) of the Class C
fly ash from this source is ≥26.5%, and the loss on
ignition (LOI) is less than 2.0%.

103 104

	sh as Cement Re emental Spec (S	•
Fly Ash	Concrete Class	Max. Cement Replacement by weight (mass)
Class F	PV, BS, PC, PS, DS, SC, SI	25 percent
Class C	PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, SI	30 percent
		105

**Ground Granulated Blast Furnace Slag (GGBFS)** 

- Increases workability
- Lowers heat of hydration
- Delays set
- Reduces permeability
- Lower early strength Higher long term strength.

106

105

### **GGBFS** as Cement Replacement

	Concrete Class	Max. Cement Replacement by weight (mass)
GGBFS	PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC and SI	35 percent

107

106

### Microsilica (Silica Fume)

**Electric arc furnace by-product** 

- Reduces Permeability of bridge decks
- Decreases air content
- Reduces workability
  - Requires Super
- Higher early and long term strength
- Dense, Brittle
- Required for PP-3 and microsilica overlay

108

107 108

### **High-Reactivity Metakaolin (HRM)**

Processed by calcining (heating) purified kaolinite (a clay).

- Increases PCC strength, durability
- Reduces permeability, mitigates ASR
- Enhances workability and finishing
- Reduces shrinkage, due to "particle packing" making concrete denser
- Can be used in HPC and lightweight concrete
- Finer than cement, not as fine as microsilica

109

109

# Concrete Class Max. Cement Replacement by weight All \* 5.0 percent \* Class PP-3 concrete HRM All 5.0 percent 5.0 percent

**Microsilica and HRM** 

as Cement Replacement

110

### **4.0 TERNARY CONCRETE MIXTURES**

A mix that includes Portland cement and two FDM's



**Chicago's Wacker Drive** 

111

# Ternary concrete mixtures can be designed for:

- Higher strength
- Lowered permeability
- Corrosion resistance
- Sulfate resistance
- ASR mitigation
- Elimination/reduction of thermal cracking
- Better economics

112

110

111

112

### Use of FDMs in Ternary Mixes Supplemental Spec (Section 1020)

Class PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, and S	
	Maximum Cement Replacement
Combined FDMs 1/	35% of total cementitious
Class C Fly Ash	30%
Class F Fly Ash	25%
Class C + F Fly Ash	30%
GGBF Slag	35%
Microsilica or HRM	10% individual or combined
1/ FDM in Blended cen	nents count toward 35% total.

113

### **Ternary Mix Example**

Portland cement: 400#

Fly ash: 100#GGBFS: 75#

114

113 114

### **Ternary Mix Example**

Mix Design	3*	4*
Cement	445 (264)	445 (264)
GGBF Slag***	90 (53)	90 (53)
Microsilica Solids	25 (15)	
HRM	-	27 (16)

115

**Options:** 

**IDOT Cement / FDM Selection** 

1. Straight cement, per Table 2.2.1



3. Use Ternary Mix




NOTE: Mix Design must comply with ASR mitigation requirements (Article 1020).

116

115

116

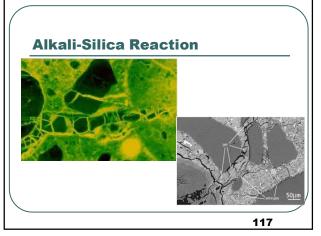

**Alkali Silica Reaction** 



- Reaction of alkalies in cement with siliceous material in some aggregate
- Requires water
- Gel forms expands and cracks concrete
- Affects strength, stiffness, serviceability, safety, and stability
- Difficult to recognize, identify and monitor
- Not universal or completely predictable

118

117

118

### **Alkali-Silica Reaction**

- First discovered by Thomas Stanton in 1930's
- Cases documented in 1950's
- 1957 1<sup>st</sup> case in Canada reported



119

**Alkali-Silica Reaction** 



120

119

120

# Alkali-Silica Reaction Mitigation (Article 1020/Appendix O)

### Applies to all projects

- Department tests coarse and fine aggregates for "Aggregate Expansion Value" ASTM C 1260, ASTM C 1293
- Ranges posted on IDOT web page
- Fine aggregate: Limestone and Dolomite = 0.03
- Coarse aggregate: Limestone and Dolomite = 0.05
- Combined values determines "Group"
- Affects material selection

121

ASR Mitigation (Standard Specs Section 1020)

- 1. Identify Aggregate Groups
- Evaluate Mitigation Options
- 3. Apply Options



122

121

IDOT ASR Rating List Gives Ranges

Illinois Department of Transportation
Defined of Identifies
ALKALI-SILICA POTENTIAL REACTIVITY RATING LIST
JANUARY 22, 2021
This list supersedon to Control N. 2020 let. Nucl. Changes are not high eighted on this list.
The following black on bottom bill Mindfeld ASTAY Cl. 258 are reach.
The following black are haved an illimit Medifield ASTAY Cl. 258 are reach.
Please Note: Each cover aggregate illineates or delamint shall have an exisped expansion while of 6.95% and each fine aggregate delamine interactive and each shall have an exisped expansion while of 6.95% and each fine aggregate delamine interactive and each shall have an exisped expansion while of 6.95%, natice softerwise untot below.

Please Note: Each coarse aggregate linearies of solitoits for a suggest expansion value of \$8.5%, and each fine aggregate linearies or dolution that line are suggest expansion value of \$8.5%, and each fine aggregate linearies or dolution that linearies are assigned expansion value of \$0.5%, and each fine aggregate linearies or dolution time immediately stone sandy shall have an assigned expansion value of \$0.5%, andexs otherwise noted below.

ASR

ASR

 P/S No.
 Ledge Description
 Material Code
 Rating\*

 52600-07
 ABOVE WATER
 027FA02
 B

A = < 0.16 B = 0.17 - 0.27 C = > 0.28

Contact individual sources for ASR Expansion Value

123

122

**ASR Rating List** 

Illinois Department of Transportation
Bureau of Materials and Physical Research
ALKALI-SILICA POTENTIAL REACTIVITY RATING LIST

This list supersedes the April 10, 2015 list. Note: Changes are not high-lighted on this list.

The following values are based on Illinois Modified ASTM C 1260 test results.

Plans Vote: Each course aggregate limentone or shimite shall have an assigned expansion value of 40%; and each first aggregate delimite (manufactured stone sand) shall have an assigned expansion value of 40%; anics softenies noted below.

ASR Te
st. Producer Name Location PIS No. Ledge Description Material Code Rather's Fit.

 54 RIVERDOE INSTERNALS
 CHILLICOTHE IL
 \$150,048
 BELOWINATER ROUNDED
 0207401
 B
 3
 3
 3

 54 SAND HILL MATERNALS
 ELISMILE, L
 5507107
 ABOVE BELOWINTER ROUNDED
 0277401
 B
 2
 5

 54 SPCONERVERS & G
 SEPALLE, L
 550707
 ABOVE WATER ROUNDED
 0277401
 B
 1
 2

SASTARY ABOVE 9 DELONWHATED DOLLNOED

124

Page 18 of 23

123

124

The state of the s

| District | Constitution | Constitu

ASS Raing - Indicates ASS Engention Visha Engr. A = 6 ts. B = 17 - 127. C= 5 121. Hear contactistrical sources for ASS Engention Visha, when not "22 by Proposing 3 ts. study to model with 3 set are completed. 15 study to 3017. 3 study to 3016 (Sets only 1 study to september 40 years indicated "\*\*\*Prine applicable, ASTMCTED small used. Register ASTMCTED with with 5 th. Resumple regard through your indicated."

ASR

CONONI DIVIED C 9 C

CENTE I

### **Evaluate Mitigation Options**

- 1. Blend Aggregates to improve "group"
- 2. Mitigate with FDM's
- 3. Use low alkali cement (≤ 0.60%)
- 4. Use Lower alkali cement (≤ 0.45%)
- 5. Verify mitigation: Test highest expansive aggregate with ASTM C 1567

126

125

PCC III 2-08-21 **21** 

126



ASTM C 1293 / 1 Year Test

127 128

**ASR Identify Aggregate Groups** COARSE Fine Aggregate **AGGREGATE** or Fine Aggregate Blend **Blend ASTM C 1260 Expansion ASTM C 1260** >0.16% - 0.27% Expansion ≤0.16% >0.27% ≤0.16% Group II Group I **Group III** >0.16% - 0.27% Group II **Group II Group III** >0.27% Group III **Group III Group IV** 129

**ASR Valid Options** AGG **Mitigation Option GROUP** Use any cement or finely divided mineral. Ш Υ Υ Υ Υ **Combine Option 2** Ш Υ Υ Υ plus Option 3 Option 2 Option 2 Invalid plus plus Υ Option Option 4 Option 4 130

129 130

ASR Option 1
Blend Aggregates

Weighted Expansion Value =  $(a/100 \times A) + (b/100 \times B) + (c/100 \times C) + ...$ 

Where:

a, b, c... = percentage of aggregate in the blend; A, B, C... = expansion value for that aggregate


Look at CA and FA separately.

131

**ASR Expansion Value Blending Gradation** CA 07 CA 16 <u>Total</u> % total mix 45% 15% 60% (a) % of CA 75% 25% 100% (A) Exp Value 0.05 0.19  $(a/100) \times (A) =$ 0.04 0.05 0.09

131 132

### **ASR Option 2 Mitigate with FDM**



133



133

### **Mitigation with Class C Fly Ash** Low Alkali

	CAM II, Class PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, SI
Class C	Poplace 25% Coment
Fly Ach	Replace 25% Cement

Class Fly Ash maximum total equivalent available alkali content (Na<sub>2</sub>O + 0.658K<sub>2</sub>O)  $\leq$  4.50% and the calcium oxide ≤ 26.50%.

134

134

### Mitigation with Class F Fly Ash

	CAM II, Class PV, BS, PC, PS, MS, DS, SC, SI
Class F	Replace 25% Cement
Fly Ash	Replace 25% Cement

Class F Fly Ash maximum total equivalent available alkali content (Na<sub>2</sub>O +  $0.658K_2O$ )  $\leq 4.50\%$ 

135

135 136

### **Mitigation with GGBF Slag**

	PV, PP-1, PP-2, RR, BS, PC, PS, DS, SC, and SI
GGBF Slag	Replace 25% Cement

GGBF Class F Fly Ash maximum total equivalent available alkali content (Na<sub>2</sub>O + 0.658K<sub>2</sub>O) ≤ 1.00%

**Mitigation with Microsilica or** 

**High Reactivity Metakaolin** 

	All Concrete Classes
Microsilica or High Reactivity Metakaolin	Replace 5% Cement

Maximum total equivalent available alkali content (Na2O  $+ 0.658 K_2 O) \le 1.00\%$ 

137

**ASR Option 3 and 4** FDM + Low Alkali Cement

The cement used shall have a maximum total equivalent alkali content of

**Option 3: 0.60%** Option 4: 0.45%

FDM alkali content per Option 2.

138

137 138

# ASR Option 5 Test the Combination of Materials

The proposed cement or FDM may be used if the ASTM C 1567 expansion value is ≤0.16 percent when performed on the aggregate in the concrete mixture with the highest ASTM C 1260 test result.

139

ASR - Don't ignore this!

Know your material:

Aggregate Expansion values


Cement - Alkali %

FDM - Alkali %

140

139

140

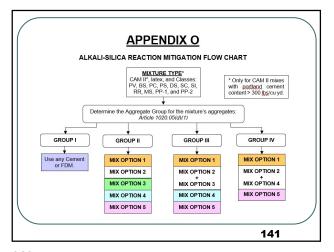

MIX OPTION 1
Blend Aggregate

-Article 1020.05(d)(2)a

MIX OPTION 3

Use a FDM as follows

-Article 1020.05(d)(2)b(1)

-Article 1020.05(d)(2)b(1)

MIX OPTION 3

Use a cement with equivalent alkalis > 0.05%

-Article 1020.05(d)(2)b(2)

MIX OPTION 3

Use a cement with equivalent alkalis > 0.05%

-Article 1020.05(d)(2)b(2)

MIX OPTION 4

Use a cement with equivalent alkalis > 0.05%

-Article 1020.05(d)(2)b(2)

MIX OPTION 4

Use a cement with equivalent alkalis > 0.05%

-Article 1020.05(d)(2)b(2)


MIX OPTION 6

Test mixture according to ASTM C15GT

-Article 1020.05(d)(2)e

-Not applicable concrete revelment mat. insertion lining of pipe culvert, godfand, cement morat fairing course. Call of the course of the co

141 142

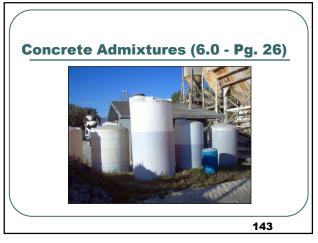

Admixtures - Function

Reduce cost
Modify concrete properties
Maintain quality during mixing, transporting, placing, and curing
Mitigate some production emergencies

143 144

# 6.1/6.2 Required/Optional Use of Admixtures (Section 1020.05)

- Air-Entrainer
- Water reducer
- Retarder
- Superplasticizer
- Accelerator

145

### **Specialty Admixtures**

- Corrosion inhibitor
- Shrinkage reducer
- Viscosity modifier
- Latex
- Workability enhancers
- Bonding
- Damp Proofing
- Coloring

146

146

145

### **Approved Admixture List**

Qualified Product List
CONCRETE ADMIXTURES
October 14, 2022
This list supersedes the March 4, 2022 list.

Standard Specifications for Road and Bridge Construction, Section 1021 (Adopted January 1, 2022)

For information regarding new product submittal, click the "New Submittal" bookmark to the left,

AIR ENTRAINING ADMIXTURES
TYPE A: WATER REDUCING ADMIXTURES
TYPE B: RETARDING ADMIXTURES
TYPE C: ACCELERATING ADMIXTURES

TYPE D: MATER REDUCING AND RETARDING ADMIXTURES
TYPE E: WATER REDUCING AND ACCELERATING ADMIXTURES
TYPE E: WATER REDUCING AND ACCELERATING ADMIXTURES
TYPE F: HIGH RANGE WR ADMIXTURES (SUPERPLASTICIZERS)
TYPE G: HIGH RANGE WR & RETARDING ADMIXTURES (SUPER)
TYPE F: ONE COMPONENT SELF-CONSOLIDATING (FOR SCC)
TYPE F/S: TWO-COMPONENT SCC ADMIXTURE SYSTEM (VMA)
TYPE S: RHEOLOGY-CONTROLLING ADMIXTURE

147

**Admixture Approval and Use** 

- Admixtures approved based on manufacturer's certified tests
- The admixture technical representative shall be consulted when determining an admixture dosage from this list
- The dosage shall be within the range indicated on the approved list (unless other circumstances warrant otherwise)

148

147

148

### **DOSAGE RATE** – (Approved List)

### AIR ENTRAINING ADMIXTURES

Producer / Supplier Number	Brand Name	Admixture Dosage Range Based on Cementitious mL/100 kg (oz/cwt.) **
4695-01	Catexol AE 260	6.5-391 (0.1-6)
4695-01	Catexol AE 360	32.6-391.2 (0.5-6.0)
4179-04	MB AE 90	16.3-260.8 (0.25-4.0)
4179-04	MBVR Concentrate*	16.3-260.8 (0.25-4.0)
4179-04	MBVR Standard *	16.3-260.8 (0.25-4.0)

149

### **Air Entrainment**

All PCC shall contain entrained air

 Except SC, Seal coat (optional) and Latex-Modified

150

149

150

# **Cement Reduction with Water- Reducing Admixtures**

For class PV, PP-1, RR, SC, SI concrete: Cement factor may be reduced by a maximum of 0.30 cwt (except under water)

PCC III Manual, Pg. 5

(This is Step 1 in Mix Design)

151

### **Class BS Concrete Admixtures**

Class BS and bridge deck overlays

- 1. Retarder at ≥ 65°F (air or concrete)
- 2. Water-reducer (Optional)

152

151

152

### **Accelerating Admixtures**

- Non-chloride accelerator <u>required</u> for PP-2, PP-3, and PP-5
- Optional for PP-1 or RR concrete.
- PP-1, PP-2, RR calcium nitrite when air <55°F</li>
- PP-3 calcium nitrite only.
- Calcium chloride allowed only by special provision in the contract; normally for PP-2.

153

**Water Content of Admixtures** 

When determining water in admixtures for water/cement ratio, the Contractor shall calculate 70 percent of the admixture dosage as water, except a value of 50 percent shall be used for a latex admixture used in bridge deck latex concrete overlays. (Section 1020.05)

See: Appendix P - Check with manufacturer

154

153

154

### Fibers (3.3 - Pg. 23)

- Req'd for whitetopping
- Optional for slipformed curb, paved ditch, etc. (per Special Provision)
- IDOT Approved List
- Not a mix design component
- Report in "comments" in mix design submittal



155

155 156

### **Typical Unit Costs**

Type I Cement \$ 120-140 / Ton Type III Cement \$ 150-170 / Ton C Fly Ash: \$ 95-105 / Ton GGBF Slag \$ 90-100 / Ton

Microsilica \$ 0.70-0.80 / lb (\$1,500/ton)

CA: \$ 20 / Ton FA: \$ 18 / Ton

157

### **Conversion Example**

- If cattle feed is \$290 per ton...
- \$290 / 2000 # per ton =\$0.145 per pound



158

157

### **FDM Replacement Calculation**

\$\frac{\\$/\text{T} \\$/\text{Ib} \text{Ib/cy} \\$/\text{cy}}{\\$130 \\$0.065 x \ 575 = \\$37.38

Cement

30% Fly Ash Ty C Replacement
70% Cement \$130 \$0.065 x 405 = \$26.33
30% Fly Ash \$100 \$0.05 x 175 = \$8.75

580 \$35.08

 $(\$/lb = \$/T \div 2000 lb/T)$ 

159

158

# Voids in Coarse Aggregate VCA



Percent Voids in a compacted sample of Coarse Aggregate. Expressed as a decimal (0.XX)

160

159

160

### **Voids in Coarse Aggregate**

- VCA is an AGGREGATE PROPERTY!
- Not related to voids in aggregate particles
- District provides VCA for design
- IL Modified AASHTO T19



161

**Voids in Coarse Aggregate** 

Loose
Coarse Agg.

Compact

Voids
or
Solids

VCA = Vol. Voids / Vol. Bucket

162

161

PCC III 2-08-21 **27** 

162



Crushed: 0.39 - 0.45Uncrushed: 0.36 - 0.41

163

165

- ➤ Aggregate size is not a big factor
- > Similar for CM-07, -11, -13, -16

District will provide CA voids 2.7.1 (p. 11)

163

165

Fraction Coarse Aggregate (F<sub>CA</sub>)

F<sub>CA</sub> + V<sub>CA</sub> = 1.000

V<sub>CA</sub> = 0.37

F<sub>CA</sub> = 1.00 - 0.37 = 0.63


0.37

V<sub>CA</sub>

0.63

F<sub>CA</sub>

164

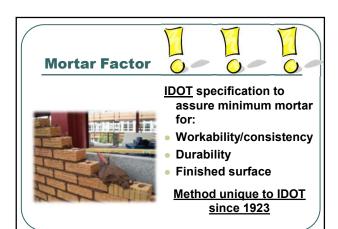


What is paste?

+ Cement
+ Finely Divided Minerals
(Fly ash, GGBFS, etc.)
+ Water
+ Air

Ø Fine Aggregate
Ø Coarse Aggregate




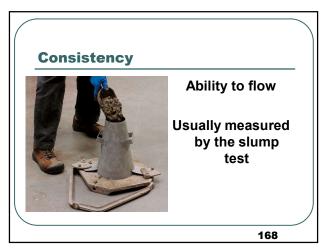



167 168


PCC III 2-08-21 28


166

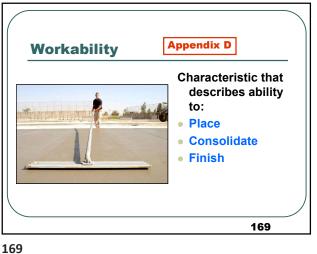


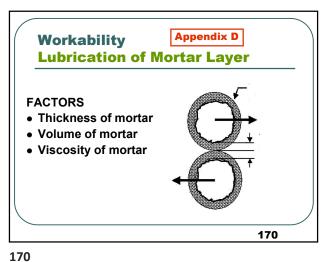


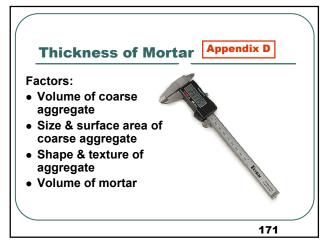


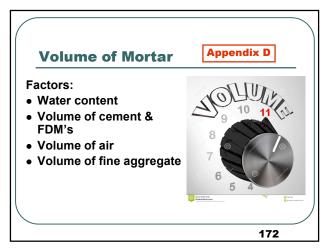

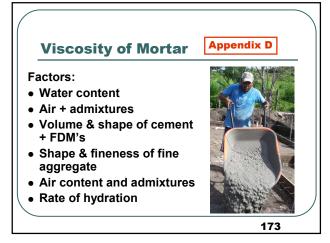

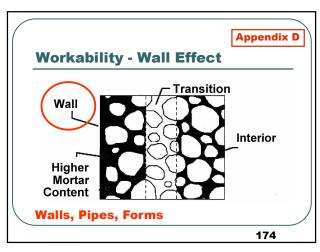

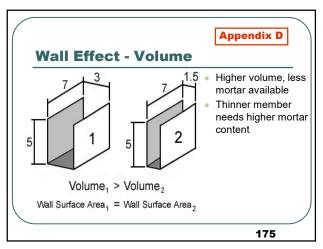

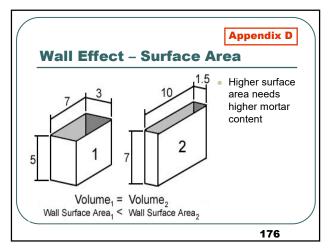




INITIAL SET – The point of time where the concrete begins to become firm. This will typically occur 2 to 4 hours after batching the concrete.

FINAL SET – The point of time where the concrete is no longer plastic and finishing no longer can take place. This will typically occur 5 to 8 hours after batching the concrete.

177

177

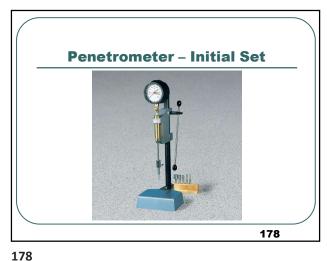


Mortar Factor Defined
"Volum





"Volume of mortar per volume of dry rodded coarse aggregate"


179

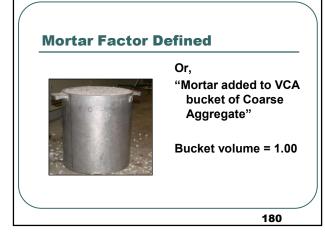



179 180

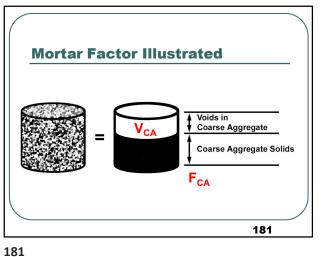


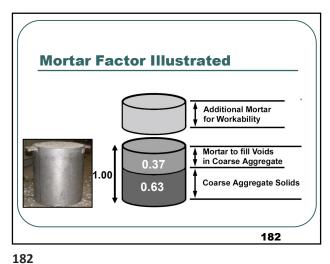


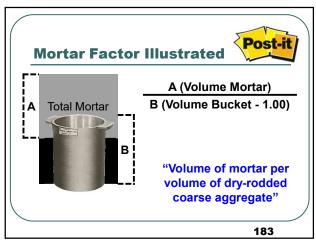


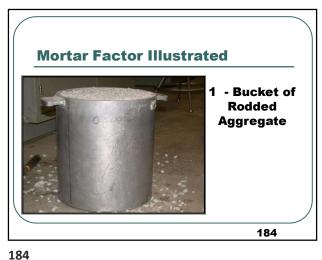


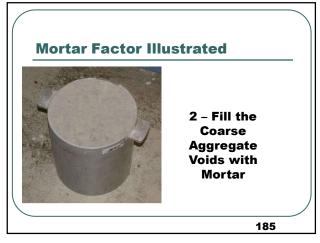


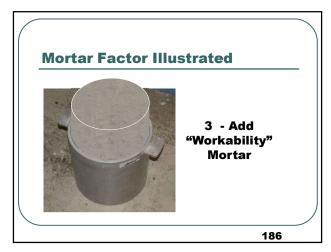

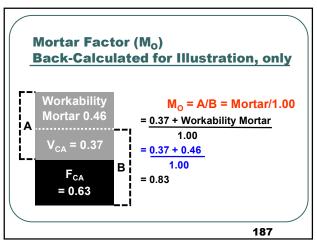


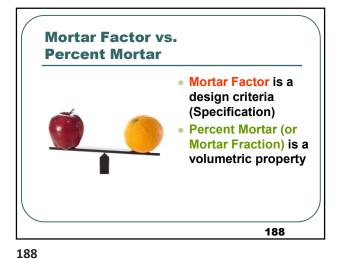


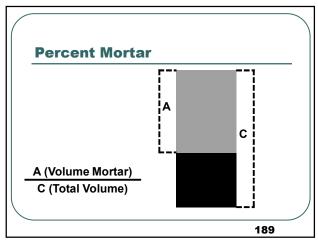

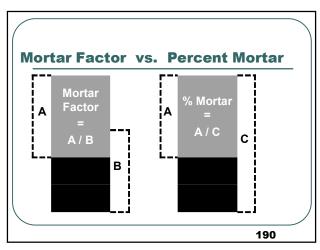

189

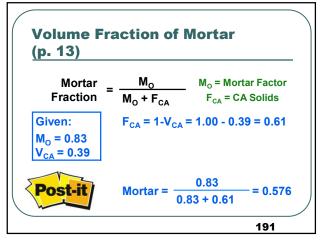

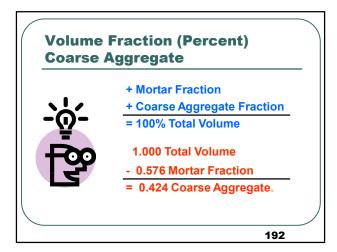

191 192

PCC III 2-08-21 32

190

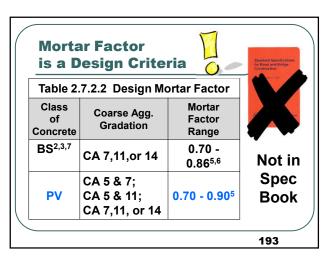


Table 2.7.2.2
Typical Mortar Factor values

CLASS	Spec	<u>Typical</u>
BS	0.70-0.86*	0.83
PV	0.70-0.90	0.86 Formed
		0.88 Slipformed
PP (CA11)	0.70-0.93	0.83
PP (CA13)	0.79-0.99	0.90
SI	0.70-0.90	0.85-0.90
*except for st	ructural lightwe	iaht

\*except for structural lightweight

194

196

194

193

195

Placement method affects Mortar Factor

Paving Machine 0.83
Chute 0.85
5 inch pump 0.86
4 inch pump 0.90

MIX DESIGN

196

PAGE 1

### 1.0 VOLUMETRIC MIX DESIGN

- IDOT Mortar Factor method
- Volumetric method more accurate than design by weight
- Based on:
  - Decades of IDOT experience
  - Established material properties

197


195

**Mix Design Steps** 

- 1. PCC III Manual and course
- 2. "PCC Mix Design" EXCEL spreadsheet
- 3. Mix design on paper, calculations
- 4. Trial mix, submittals
- 5. Verification, trial batch

198

197 198

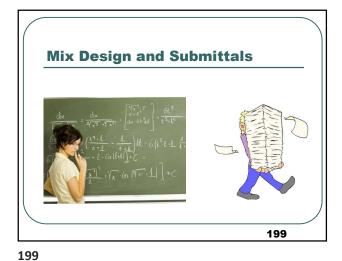

Understanding the Mix Specification – Job #1

- Class of concrete
- Type of cement
- Component material specs
- Cement factor
- Water/Cement ratio
- ASR mitigation
- Mortar factor
- Air content
- SlumpRequired
  - Required admixtures
- Aggregate allowed
- Minimum strength

200

200

PAGE 3

### **Concrete Mix Design (2.0)**

- + Aggregate
- + Cement
- + FDM's
- + Water
- + Air
- + Admixtures.



201

**Section 2.0 of Manual** 

- Combines PCC material specifications from Section 1020 and the GBSP's
- In effect April 2023
- Will be modified by future Special Provisions and course manuals.


202

202

201

203

### **Absolute Volume Concept**



- Serves as the basis of concrete proportioning
- ALWAYS expressed as a decimal; e.g., 14.1% = absolute volume 0.141

**Weight of Material** 

S.G. of Material x Unit Wt. Of Water

203

Absolute Volume Concept

Absolute volume is percent expressed as a decimal

X.XXX format – always carry decimal 3 places
Example: 56.1% = 0.561 absolute volume

204

### **Mix Design - Order of Operations**

- 1) Cement factor from Table 2.2.1
- 2) Cement reduction with water-reducing admixtures
- 3) Cement replacement with FDM's
- 4) Water requirement and W/C ratio
- 5) Air content
- 6) Aggregate proportions

205

### 2.2 Cement Factor

### Step 1 - Check the Spec!

Specification always governs:

- Minimum Strength and durability
- Maximum Minimize shrinkage cracking

206

205

### **Note re: Manual Tables**

Similar to Table 1 in Section 1020 (Standard Specs) and Special Provisions with more detail



- GBSP mixes added to Manual
- Contains information not in **Supplemental Specs**
- Always read the fine print and footnotes!





207

### **Table 2.2.1 (Pg. 4)**

206

Class or Type of Concrete	Minimum Cement Factor (cwt/yd³)	Maximum Cement Factor (cwt/yd³)
BS	6.05	7.05
PV	5.65 <sup>1,2</sup> 6.05 <sup>1,3</sup>	7.05

<sup>/1</sup>Cement reduction <sup>/2</sup> Central-mixed <sup>/3</sup> Truck mixed or shrink-mixed

207

### **Allowable Cement Factor Reduction with W-R Admixture** 2.2.2 (Pg. 5)

Available for most mixes - PV, PP-1, RR, SC, SI:

- Using water reducing or high-range WR admixture may reduce minimum cement factor by 0.30 cwt/yd3
- Since most mixes contain water reducer...usually take the reduction when
- Not available for BS mixes

209

### **Cement Factor Reduction**

e.g.

208

- Cement Factor for PV = 6.05
- 0.30 Reduction for Water-Reducer

**Revised Cement Factor:** 

= 6.05 - 0.30 = 5.75

210

209

210

### 2.3 Cement Absolute Volume

### **Weight of Material**

S.G. of Material x Unit Wt. Of Water

5.75 (Cement Factor) x 100 (LB/cwt) 3.15 (S.G.) x 1,684 (LB/YD<sup>3</sup>)

 $= 0.108 (YD^3)$ 

211

Cement Replacement with FDM 2.4.1 (Page 6)

212

211

### **Cement Replacement with FDMs**

### Replacement Rate;

- Varies by mix class
- Varies for different FDM's

### **Replacement Factors:**

- 1. Cement replacement percentage
- 2. FDM Replacement ratio is always 1:1 (since 2012)

213

2.4.1 Type C Fly Ash

Max. 30% Cement Replacement

For Class PV and most other classes

214

213

e.g. FDM Replacement

- Revised Cement Factor = 5.75S.G. = 2.61
- 30% allowable replacement
- $5.75 \text{ cwt/YD}^3 \times 30\% = 1.71 \text{ cwt/YD}^3$
- Round UP to next 5 LB ---- 175 LB/YD³

215

**Fly Ash Absolute Volume** 

Weight of FDM s.g. of FDM x Unit Wt. Of Water

e.g.  $\frac{175 \text{ LB}}{2.61 \text{ x } 1,684 \text{ LB/YD}^3}$ = 0.040 YD<sup>3</sup>.

216

215

216

214

# 2.3 Cement Absolute Volume, revisited

- Using our example:
- Cement factor = 5.75
- 30% replaced with fly ash
- 70% x 5.75 = 4.03 (Round up to 4.05)

4.05 (Cement Factor) x 100 (LB/cwt) 3.15 (S.G.) x 1,684 (LB/YD<sup>3</sup>)

Absolute volume = 0.076 (YD3)

217

2.5 Water

218

218

217

### 2.5 Water


Since cement content is generally controlled by the specifications, the amount of water is the most important variable of the design. Includes:

- Batch water
- Free moisture
- Admixture water

219

2.5 Water

Fine aggregate H<sub>2</sub>O demand



= Total concrete water demand

Water reduction was applied based on overlapping factors



220

219

220

### 2.5 Water/Cement Ratio

Weight of Water
Weight of Cementitious Material

- Water includes ALL FREE water
- "Cementitious" includes FDM's

See Table 2.5 (Pg. 8)

221

### 2.5 Water/Cement Ratio



### **Minimum**

- Need adequate water to hydrate cement (≈0.32)
- Extra water is needed for workability
- Excess water creates pore space, reducing strength and durability

### **Maximum**


- Normal maximum spec: 0.40 0.44
- If not specified, min. = 0.32; max. = 0.45


222


221

222

ater-Cement Ratio	(Da 2)
ater-cement Ratio	(Fg. 0)
Table 2.5 Water/Cement Ratio	
Class or Type of Concrete	Water/Cement Ratio
PV	0.32 - 0.42
PP-1	0.32 - 0.44
PP-2	0.32 - 0.38
PP-3	0.32 - 0.35
PP-4	0.32 - 0.50
PP-5	0.32 - 0.40
RR	0.32 - 0.44
BS	0.32 - 0.44
PC	Wet Cast: 0.32 - 0.44
PG	Dry Cast: 0.25 - 0.40
PS	0.32 - 0.44
DS	0.32 - 0.44
SC	0.32 - 0.44
SI	0.32 - 0.44
Deck Slab Repair	Refer to PP-1, 2, 3, 4, and 5
Formed Concrete Repair	Refer to Class SI Concrete
Concrete Wearing Surface	Refer to Class BS Concrete
Bridge Deck Fly Ash or GGBF Slag Concrete Overlay	Refer to Class BS Concrete
Bridge Deck Microsilica Concrete Overlay	0.37 - 0.41
Bridge Deck High-Reactivity Metakaolin Concrete Overlay	0.37 - 0.41
Bridge Deck Latex Concrete Overlay	0.30 - 0.401

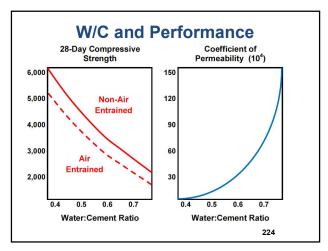

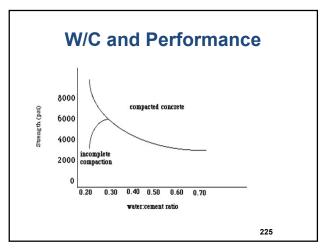

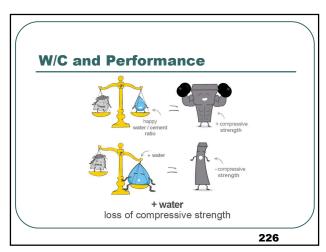

225 226

Choosing a W/C Ratio

| Table 2.5 Water/Cement Ratio | Class or Type of Concrete | Water/Cement Ratio | 0.32 - 0.42 |

| Many designs use a w/c ratio in the 0.40-0.44 | range to ensure complete hydration of the cement

| A new mix design will be required if the w/c ratio is increased more than 0.04 | from the original mix design value. The value shall not exceed specified limits.


Water/Cement Ratio Calculation


Using 0.42 w/c as a starting point:


Mix has 405# cement and 175# fly ash:


0.42 x 580# = 244# water


227 228

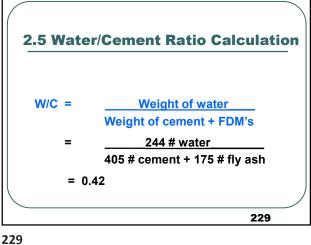


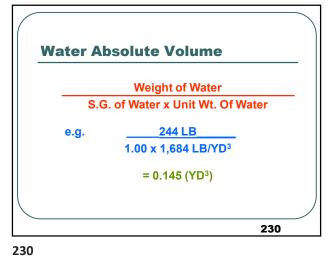

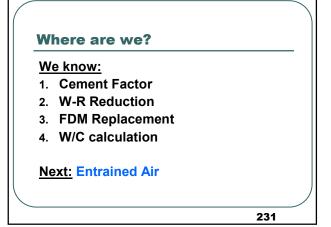

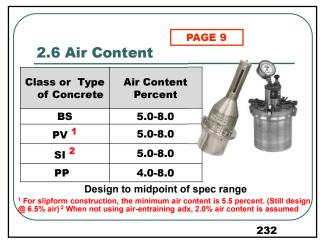

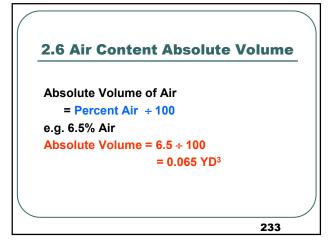

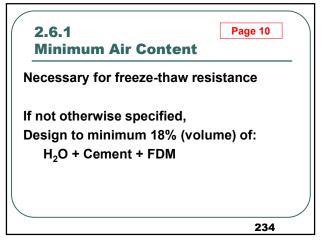

# Minimum Air Content example

$$Air_{MIN} = [0.18 \times (V_{H2O} + V_{cement} + V_{FDM})] \times 100$$

e.g. V<sub>H2O</sub> = 0.134

V<sub>cement</sub> = 0.071

 $V_{FDM} = 0.038$ 

Air%= [0.18 x (0.134+0.071+0.038)] x 100 = 4.3%.

235

Placing and Consolidating (Art. 503.07)

BDE 80316 Concrete Placement

- Maximum air loss caused by pumping operation shall be 3.0%
- Minimum air at the point of discharge shall be per Article 1020.04.



236

235

Where are we?

## We know all about the Paste:

- 1. Cement Factor
- 2. Water
- 3. FDM
- 4. W/C Calculation

### Next:

- Add the Paste to the aggregate
- Using V<sub>CA</sub> and Mortar Factor

237

\_\_\_\_

Refresher

 Mortar Factor is related to the VCA bucket



 Mortar Fraction is related to the Design Box



238

237

238

236

V<sub>C</sub>

Loose Coarse Agg. → Compact

**∖**gg. t Voids r Solids

V<sub>CA</sub> = Vol. Voids / Vol. Bucket

239

**Design Mortar Factor** 

Select Mortar Factor based on Table 2.7.2.2 and experience with local materials and construction applications.

A new mix design is required if MF changes by ±0.05 from original value.

240

239

240

# 2.7.2.2 Design Mortar Factor Class or Type Coarse Mortar E

Class or Type of Concrete	Coarse Aggregate Gradation	Mortar Factor Range 0.70 - 0.86 <sup>5,6</sup>	
BS <sup>2,3,7</sup>	CA-7, CA-11, or CA-14		
PV	CA-5 & CA-7, CA-5 & CA 11, CA-7, CA-11, or CA-14	0.70 - 0.90 <sup>5</sup>	

 $^3$  CA minimum 45% passing  $\frac{1}{2}$  when pumped  $^5$  Max = 0.85 if FA is Stone Sand

241

241

### **Exceptions to the Rule**

- MF >1.00 for structural lightweight (90-115 lb/ft³) using lightweight coarse aggregate (2.7.2.2)
- MF >1.00 for SCC or latex
- MF >0.86 for BS concrete using lightweight coarse aggregate

242

242

### **Volume Fraction (%) of Mortar**

### We know:

- Mortar Factor M<sub>O</sub> (0.83 given)
- V<sub>CA</sub> (0.37 provided by IDOT)

### Calculate:

- 1. Mortar Fraction (% Mortar)
- 2. Coarse Aggregate Fraction.



243

**Mortar Volume Fraction** 

% Mortar =



Example:  $M_O$  Mortar Factor = 0.83  $V_{CA} = 0.37$  ( $F_{CA} = 0.63$ )

% Mortar = 
$$\frac{0.83}{0.83 + 0.63}$$
  
= 0.568 (56.8%)

244

243

**Mortar Absolute Volume** 

Mortar Fraction = 0.568
This is also the Absolute
Volume of the mortar.

Mortar is everything but coarse aggregate.: Cementitious + Water + Air + Fine

Aggregate



245

Absolute Volume of Aggregate







246

245

246

244

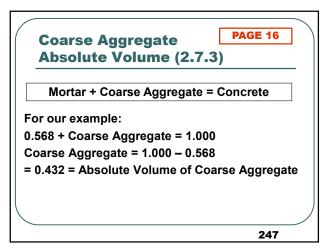

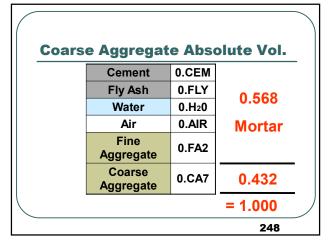

Fine Aggregate
Absolute Volume (2.7.4)

This is the last unknown:
Subtract everything else from 1.000
= 1.000- (Cement + FDM + H<sub>2</sub>O + Air + CA)
e.g.
= 1.000- (0.076 + 0.040 + 0.145 + 0.065+0.432)
= 0.242 (Fine aggregate absolute volume)

Converting Aggregate Volume to Weight (2.7.5)

Given:


Given:

Absolute volume of aggregate

Calculate Weight:

Wt. = Absolute Vol. x SG<sub>SSD</sub> x Unit Wt<sub>H2O</sub>

249 250

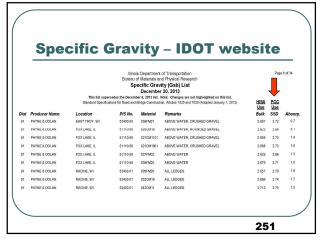


Converting Coarse Aggregate
Volume to Weight (2.7.5)


Weight = Abs. Vol. x SG<sub>SSD</sub> x Unit Wt<sub>H2O</sub>
e.g.

• CA Absolute Volume = 0.432
• SG<sub>SSD</sub> = 2.68

Wt. = 0.432 (YD<sup>3</sup>) x 2.68 x 1,684 (LB/YD<sup>3</sup>)
= 1,950 LB

251 252

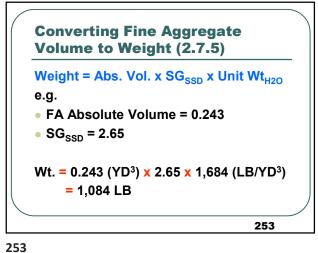

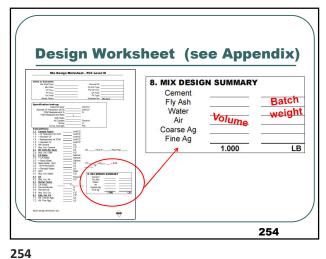

	Vorkbook and Class					
ustratio	n Problem					
8. MIX DESIGN SUMMARY						
	Absolute Vol.	WEIGHT				
Cement	0.076	405				
FDM1	0.031	135				
FDM2		82 07557007				
Water	0.135	227				
Air	0.065	0				
Coarse Ag	0.424	1,914				
Fine Ag	0.270	1,205				
	1.000	3,886				
F= 0.83 VC		3,886				

**PV Example Problem** 2.8 Page 17 (Solution App. HW-1) Mix Class: PV (Slip)
Coarse Agg: 022CM11
Fine Agg: 027FA01 Gsso: FDM2 CA Voids: Aggr. Group: Cement Factor Allowed CF Reduction (W-R) 25% FDM replacement required for ASR Min. Comp. Strength 3,500 @ 14 PSI @ days 256

255 256

### 2.8 EXAMPLE PROBLEM (Pg. 17)

### Given:

- Continuous reinforced slipformed concrete pavement (CRCP)
- Central mix plant using dumps
- Type IL cement with >0.60 alkalies (S.G. 3.15)

V<sub>CA</sub> Coarse Aggregate Voids = 0.39

**Example - Aggregates** 

ASR expansion value 0.20% (>0.16%-0.27%)

Coarse aggregate – 022CM11 (crushed stone)

 $SG_{SSD} = 2.66$ 

258

Fine aggregate - 027FA01

ASR value = 0.05%

•  $SG_{SSD} = 2.68$ 

258

257

257

### **Example Problem - Fly Ash**

- Class C
- S.G. = 2.61
- CaO = 25.1%
- Ignition loss = 1.0%

259

**Significant Digits & Rounding** 

- Whole number: Cement & FDM's, Water, Coarse and fine aggregates
- One digit: Air content
- Two digits: SG, W/C ratio, Unit weight, MF, voids
- Three digits: Absolute volume
- Round cement & FDM's up to next 5#
- When digit beyond last place is ≥ 5, then round up next digit by one

260

259

**ASR Identify Aggregate Groups** COARSE Fine Aggregate **AGGREGATE** or Fine Aggregate Blend **Blend** ASTM C 1260 Expansion **ASTM C 1260** ≤0.16% >0.16% - 0.27% Expansion >0.27% **≤**0.16% Group I Group II 👍 **Group III** >0.16% - 0.27% Group II Group II **Group III** >0.27% Group III Group III **Group IV** 261

**ASR Group II - Valid Options** (Will mitigate with FDM's) **AGG Mitigation Option GROUP** 3 Use any cement or finely divided mineral. Χ × X X X **Combine Option 2** Ш Х Х Х plus Option 3 Option 2 Option 2 Invalid plus Х plus Х Option Option 4 Option 4 262

261

262

260

### **Step 1.1 – Choose Cement Factor**

### **Standard Cement Factor**

(Table 2.2.1 - Pg. 4)

- PV (paving) mix
- Cement Factor = 5.65<sup>2</sup>

Footnote: <sup>2</sup> Central-mixed

263

### **Step 1.2 Reduce Cement Factor**

### Allowable reduction for W-R admixture

(from 2.2.2 Pg. 3)

0.30 cwt./YD3 reduction allowed

The use of water reducer is a designer option, based on spec, guidelines, and experience

**Revised cement factor:** 

 $5.65 - 0.30 = 5.35 \text{ cwt/YD}^3$ 

264

263

264

# Step 1.3 – Cement Replacement 2.4.1 (Pg. 6)

### **Allowable Cement Replacement with Fly Ash**

Up to 30% replacement allowed for Class C fly ash

 $5.35 \times 0.25 = 1.34 \text{ cwt/YD}^3$ 

**Revised Cement:** 

 $5.35 - 1.34 = 4.01 \text{ cwt/YD}_3$ 

Rounds up to 4.05 cwt/YD3 (405 lbs)

265

265

# Step 1.4 – Cement Absolute Volume Absolute Volume = Weight ÷ (SG x 1,684)

Weight = 405 pounds SG = 3.15

405 LB 3.15 x 1,684

= 0.076

266

268

266

### Step 1.5 - Fly Ash

### **Absolute Volume**

1.34 cwt/YD<sup>3</sup> or 134 lbs (Rounds <u>up</u> to 135) SG = 2.61

= Weight / S.G. x 1,684

= 135 2.61 x 1,684

= 0.031

267

267

### **Step 2.1 -Water Calculation**

Range for PV concrete (from 2.5) is 0.32-0.42

Given: W/C ratio of 0.42 to be used

Remember, use TOTAL cementitious to calculate water...

268

### **Step 2.1 - Water Calculation**

- W/C ratio 0.42
- Total cementitious 405 + 135 = 540
- 0.42 x 540 = 226.8
- Remember rounding rule...
- Total water 227# per yard

269

### Step 2.2 - Water Absolute Volume

### **Absolute Volume**

= <u>Weight</u> SG x 1,684

= <u>227 LB</u> 1.00 x 1,684 LB/YD<sup>3</sup>

= 0.135

270

269

270

```
Step 3.1 - Air

(From Table 2.6 - Pg. 9)

Spec = 5.0-8.0%

Midpoint = 6.5%

Absolute Volume = % air / 100

= 0.065
```

Step 4.1 – Percent Mortar  $M_{O}$ : Mortar Factor = 0.83 (from 2.7.2.2) VCA = 0.39  $F_{CA} = 1.00 - 0.39 = 0.61$ % Mortar =  $100 \times M_{O}$   $M_{O} + F_{CA}$ =  $100 \times 0.83$  0.83 + 0.61= 57.6 % (Absolute Volume = 0.576 YD<sup>3</sup>)

271

```
Step 4.2 – Coarse Aggregate
Absolute Volume

CA Absolute Volume
```

= 1.000 - (Mortar Absolute Volume) = 1.000 - 0.576

= 0.424 YD3 CA absolute volume

Step 5.1 - Fine Aggregate
Absolute Volume

= 1.000
- V<sub>Cement</sub> (0.076)
- V<sub>FDM</sub> (0.031)
- V<sub>Water</sub> (0.135)
- V<sub>Air</sub> (0.065)
- V<sub>CA</sub> (0.424)
= 0.269 YD<sup>3</sup>

273 274

273

```
Step 6.1 - Determine Aggregate
Weights

Weight = Abs Vol x S.G. x 1,684
Coarse Aggregate
= 0.424 YD<sup>3</sup> x 2.68 x 1,684 LB/YD<sup>3</sup>
= 1,914 LB
Fine Aggregate
= 0.269 YD<sup>3</sup> x 2.66 x 1,684 LB/YD<sup>3</sup>
= 1,205 LB
```

Step 7.1 - Mix Design Summary

Cement - 405 lbs.
Fly Ash - 135 lbs.
Water - 227 lbs.
Air - 6.5%
CA - 1,914 lbs.
FA - 1,205 lbs.

Step 7.1 - Mix Design Summary

0.83
CA Voids - 0.39
W/C Ratio - 0.42

Later - Slump & Strength

275 276

PCC III 2-08-21 46

272

# Where are we? • VCA test ☑ • Mix Design Proportions ☑ • Trial Mix □ • Trial Batch □

277

7.0 Trial Mixture (Pg. 29)

### **Contractor's** pre-verification of:

- Slump (7.1 Pg. 32)
- Air (2.6 Pg. 9)
- Minimum strength (7.2 Pg. 33)


Minimum 2 cubic yards (4 recommended)
Recommended near-max W/C ratio for trial
Recommended strength curves at 3, 7, 14, 28,
and 56 days


At contractor's discretion (Tip: Notify IDOT)

278

277


278

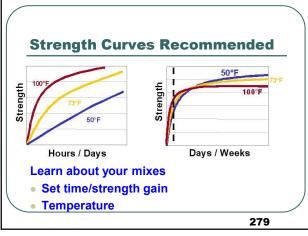

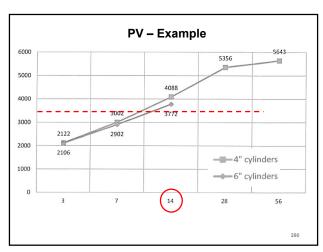

279

280

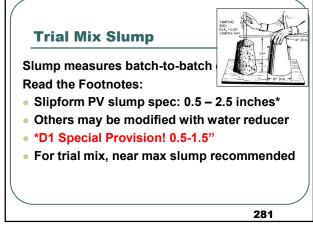

Slipform Slump Specification

SLIPFORM PAVING (D-1)
Effective: November 1, 2014

Revise Article 1020.04 Table 1, Note (5) of Standard Specifications to read:

"The slump range for slipform construction shall be 1/2 to 1 1/2 in."

Revise Article 1020.04 Table 1 (metric), Note (5) of Standard Specifications to read:

"The slump range for slipform construction shall be 13 to 40 mm."

281 282

### **Trial Mix Air**



Trial results within 0.5% of spec max (except for slipformed mixes)

283

### **Trial Mix Strength**



Must meet minimum strength on day of record for trial mix

However, in the field, IDOT has discretion to wait for strength

284

283

284

### **Trial Mix Concrete Temperature**

- For cold-weather mixes, a concrete temperature of 50-60 may be appropriate
- For warm-weather mixes, a temperature of 80-90 may be appropriate

285

### 7.3 Laboratory

### p. 32

- Approved for QC per Bureau of Materials Policy Memorandum on minumum lab requirements
- (AASHTO accreditation is not required)
- QC/QA Trained Technicians

286

285

286

### **Design Lab Steps**

- 1. Batch
- 2. Evaluate / adjust for air, slump
- 3. Evaluate for consistency, plasticity, and workability
- 4. Evaluate for yield
- Make strength specimens cylinders or beams
- 6. Document test of record

287

### 9.0 Durability Testing (Pg. 36)

Not required for most mixes because IDOT policy provides:

- Specified mix design procedures
- Specified mix parameters
  - Cement, FDM, W/C, Air content
- Specified material quality
  - Aggregate quality, Freeze-thaw requirements

288

287

288

### **Durability Testing**

Required for unique mix designs if Mortar Factor is not within spec limits. Only spec change that will be considered.

- For Class BS concrete, MF ≤ 0.86
- FA portion ≤ 50% of total aggregate

**Employ Accredited Lab; Perform:** 

- 300 Cycle Freeze-Thaw IL Method
- Salt Scaling IL Method.

289

### Where are we?

- VCA test ☑
- Mix Design Proportions ☑
- Trial Mix ☑
- Department Verification/Trial Batch □

290

### 10.0 Department Verification (Pg. 37)

### **Considerations:**

289

291

- Proportions / calculations
- Strength test results
- Historical test data for similar mixes
- Target strength calculations
- Department experience
- Trial batch

291

Trial Batch (Pg. 37)

### **Department Option**

- If concerns with strength, workability, history
- MF outside limits
- Mix: Contractor's expense
- **Testing: Department** expense



292

292

290

### **Trial Batch Procedure**

- 2 yd<sup>3</sup> Minimum (4 yd<sup>3</sup> Preferred)
- Air within 0.5% of upper spec limit (or as requested by IDOT)
- Air for slipform trial batch TBA
- For SCC, w/c at or near max
- Temperature per IDOT specs
- Strength on specified day (Usu. 14 days)
- All Tests per Manual of Test Procedures

### **IDOT Verification Tests**

- Air
- Slump
- Strength (cylinders or beams)
- Temperature
- Yield (optional)
- Durability (TBA)
- CA voids
- Extra testing for SCC (Flow, J-ring,etc.)

293 294

### **Trial Batch Verification**

Batch verified if test results meet specification requirements.

295

296

298

**Materials Control** New mix design required when...

• Cement or FDM s.g. change > 0.05 (Pg. 5)

296

295

Source	Unit No.	Producer/ Supplier No.	Class	Material Code No.	R Factor A	Average Specific Gravity
Alliant Power <sup>B,D</sup> Columbia Station Portage, WI	1, 2	52403-03	С	37801	3.17	2.63
Alliant Power <sup>B,D</sup> Edgewater Station Sheboygan, WI	5	52403-05	С	37801	2.99	2.67
EME Midwest Generation <sup>B,D</sup> Joliet Station Joliet, IL	7, 8	51973-64	С	37801	4.03	2.76
Muscatine Power & Water <sup>B,E</sup> Muscatine Station Muscatine, IA	9	52203-04	С	37801	3.93	2.76
NRG Energy, Inc. <sup>8,E</sup> Will County Generating Station Romeoville, IL	4	51973-18	С	37801	4.63	2.81

297

2.9 Summary **Mix Design Equations** Page 20

298

297

**Water/Cement Ratio** 

**Total Weight Water Total Weight Cementitious** 

**Unit = 0.XX** 

299

**Absolute Volume** 

**Volume of Cement & Finely Divided Minerals** 


 $\frac{\textit{Weight}}{\textit{G}_{\textit{sp}} \times 1,683.99}$ Absolute Volume,  $V_{Cement} =$ English  $V_{FDM} = \frac{Weight}{G_{sp} \times 1,683.99}$ 


Unit = 0.XXX


300

299

300

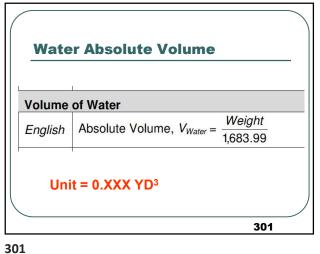


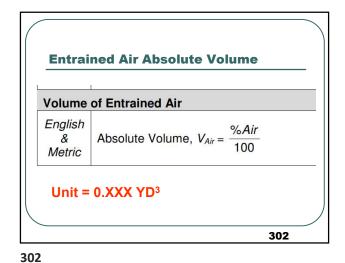


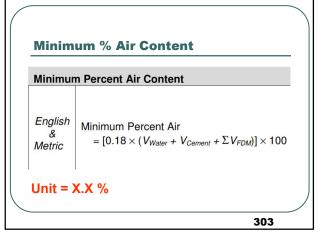


**Volume CA Solids and Mortar** Volume Fraction of Coarse Aggregate & Mortar Fraction of Coarse Aggregate Solids, English = 1- V Volume Fraction of Mortar =  $\frac{M_O}{M_O + F_{CA}}$ Metric V = VCAUnit = 0.XXX304

303 304

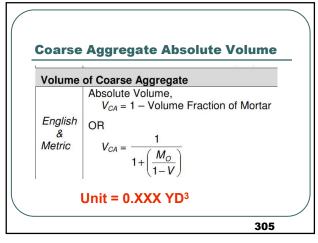

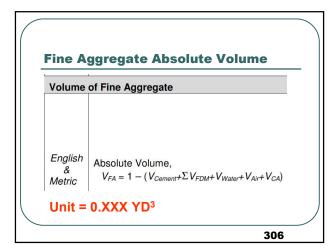

305 306

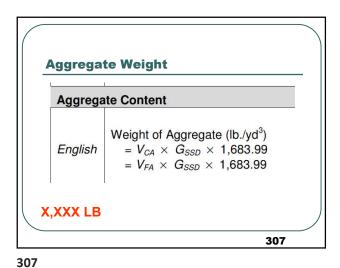

Aggregate Blending Appendix E

- Aggregate grading
- Fineness Modulus of fine aggregate
- "8-18 Rule"
- Tarantula curve
- 0.45 Power Curve

308

308

**Types of Aggregate Grading** 

- \* Uniformly graded
  - Balance of sieve sizes



\* Gap graded

309

- Imbalance of sieve sizes



309

Aggregate grading (particle size distribution) affects:

- Ease of placing
- Pumping
- Consolidating
- Finishing
- Water demand

310

310

## **Illinois Coarse Aggregates**

"Problems occur when % passing 12.5 mm is less than 40%."

<b>Product</b>	P 12.5 mm
CA-05	0-10%
CA-07	30-60%
CA-11	30-60%
CA-14	80-100%
CA-16	100%

311

**Coarse Aggregate for Bridge Decks** (1004.01)

(1) When Class BS concrete is to be pumped, the coarse aggregate gradation shall have a minimum of 45 percent passing the 1/2 in. (12.5 mm) sieve. The Contractor may combine two or more coarse aggregate sizes, consisting of CA 7, CA 11, CA 13, CA 14, and CA 16, provided a CA 7 or CA 11 is included in the blend.

When placing Class BS concrete with a pump, the discharge end of the pump shall have an "S" shaped flexible or rigid conduit, a 90 degree elbow with a minimum of 10 ft (3 m) of flexible conduit placed parallel to the deck, or a similar configuration approved by the Engineer.

312

311 312

# **Fine Aggregate Gradation**

### Affects:

- Air retention
- Workability
- Pumping capacity
- Finishing
- Bleeding

313

Fineness Modulus of Fine Aggregate

**Cumulative Sum:** 

Retained (3/8 through #100 sieve) 100

314

313

314

Passing Retained  $\Sigma$  Retained FΜ Sieve 3/8 100 0 0 #4 2 2 98 #8 85 13 15 #16 65 #30 45 #50 21 #100 3 Sum 315

Sieve	Passing	Retained	$\Sigma$ Retained	FM
3/8	100	0	0	
#4	98	2	2	
#8	85	13	15	
#16	- 65	= 20		
#30	45			
#50	21			
#100	3			
		Sum		
				316

315

316

Sieve	Passing	Retained	Σ Retained	FM
3/8	100	0	0	
# 4	98	2	2	
#8	85	13	+ 15	
#16	65	+ 20	= 35	
#30	45			
#50	21			
#100	3			
		Sum		<i>— )</i>
			;	317

	Sieve	Passing	Retained	Σ Retained	FM
	3/8	100	0	0	
	#4	98	2	2	
	#8	85	13	15	
	#16	65	20	35	
	#30	\- 45 <i>)</i>	20	55	
	#50	21			
	#100	3			
			Sum		
_					318

317

318

١.	Sieve	Passing	Retained	Σ Retained	FM
	3/8	100	0	0	
	# 4	98	2	2	
	#8	85	13	15	
	#16	65	20	35	
	#30	45	20	55	
	#50	21	24	79	
	#100	3			
			Sum		— <i>)</i>
					319

Sie	/e	Passing	Retained	Σ Retained	FM
3/8	3	100	0	0	
# 4	1	98	2	2	
# 8	3	85	13	15	
#1	6	65	20	35	
#3	0	45	20	55	
#5	0	21	24	79	
#10	0	3	18	97	
			Sum	283	2.83

319

**Fineness Modulus** 

- Higher FM = coarser
- FM range typically 2.0 to 4.0
- ACI recommends 2.4 to 3.0
- ACI recommends 2.7 to 3.5 for slipform
- 0.2 change is significant workability may be affected
- Very high FM may result in lost air
- May need to change FA &/or raise MF

321

Fineness Modulus Class Exercise						
Ι.	Sieve	Passing	Retained	Σ Retained	FM	
	3/8	100	0	0		
	#4	97				
	#8	89				
	#16	77				
	#30	53				
	#50	12				
	#100	2				
			Sum		_	/
					322	

322

320

Fineness Modulus Class Exercise						
Sieve	Passing	Retained	Σ Retained	FM		
3/8	100	0	0			
# 4	97	3	3			
#8	89	8	11			
#16	77	12	23			
#30	53	24	47			
#50	12	41	88			
#100	2	10	98			
		Sum	270	2.70		
				323		

How to Blend Numbers
(Appendix E)

For:

1. Gradation
2. Specific Gravity
3. ASR Expansion
Value

323 324

# **Blending Aggregate Gradations**

TB =  $(a / 100) \times A + (b / 100) \times B + \dots$ Where:

TB = Total blend on each sieve

a, b... = Percent of aggregate product

A, B ... = Percent on that sieve

Valid for % Passing or Retained.



325

# Gradation Blending Calculate for each sieve:

<b>Gradation</b>	CA 07	<u>CA 16</u>	FA 01	<u>Total</u>
(a) % mix	45%	15%	40%	100%
(A) P 3/8"	11%	96%	100%	
$(a/100) \times (A) =$	5%	14%	40%	59%

Total P 3/8" in Aggregate Blend =

5% + 14% + 40% = 59%



325

326

### **Specific Gravity Blending**

<u>Gradation</u> % total mix	CA 07 45%	<u>CA 16</u> 15%	<u>Total</u> 60%
(a) %CA	75%	25%	100%
(A) S.G.	2.60	2.45	
$(a/100) \times (A) =$	1.95	0.61	2.56



327

### **ASR Expansion Value Blending**

<b>Gradation</b>	CA 07	<u>CA 16</u>	<u>Total</u>
% total mix	45%	15%	60%
(a) % of CA	75%	25%	100%
(A) Exp Value	0.05	0.19	
(a/100) × (A) =	0.04	0.05	0.09

328

328

# Aggregate Blend Gradation Characterization

- 1. "8-18" Rule
- 2. Tarantula Curve
- 3. 0.45 Power Curve

329

# **"8-18" Rule**


"Percent retained on all sieves, except top and bottom two, should fall with between 8 and 18"

Rule of Thumb: Keep difference between sieves ≤ 13% (p. E-5).

330

329

330

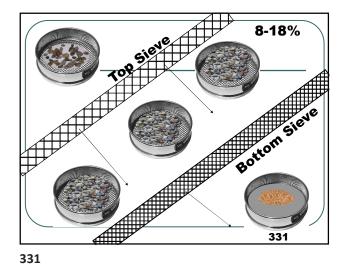


Sieve	Pass	Retain	8-18?
1 inch	100%	0	N/A
3/4 inch	92%	8%	N/A
1/2 inch	62%	30%	N
3/8 inch	47%	15%	Υ
No. 4	40%	7%	N
No. 8	37%	3%	N
No. 16	32%	5%	N
No. 30	22%	10%	Υ
No. 50	6%	16%	Υ
No. 100	2%	4%	N/A
No. 200	1.0%	1%	N/A


332

Sap Graded
'
2.36 1.18 600 300 150 75 #8 #16 #30 #50 #100 #200 PSize

Ta	able 1.2.2	2 Blended	CA	
Sieve	Pass	Retain	8-18?	1
1 inch	100%	0	N/A	1
3/4 inch	94%	6%	N/A	
I/2 inch	72%	22%	N	
3/8 inch	59%	13%	Υ	
No. 4	44%	15%	Υ	
No. 8	37%	7%	N	
No. 16	32%	5%	N	
No. 30	23%	9%	Υ	
No. 50	6%	17%	Υ	
No. 100	2%	4%	N/A	
No. 200	1.0%	0.9%	N/A	334

333 334

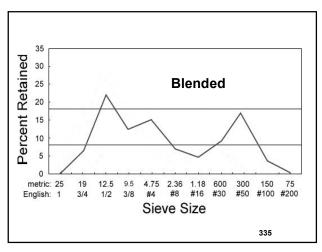

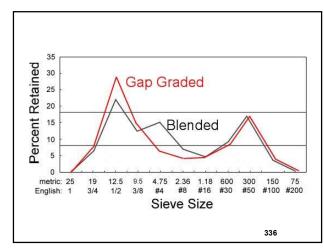

335 336

### **Fine Aggregate and Air**

Amount passing #30 and retained on the #50 is critical for holding entrained air.

### For this blend:

P#30 = 23%

P#50 = 6%

Retained on #50 = 17%

337

# **Tarantula Curve**

- Similar to "8-18" rule
- Developed by Tyler Ley at Oklahoma State University

OKLAHOMA A 1 E UNIVERSITY

338

337

# Tarantula Curve

- For slipform, recommended that 15% total be retained on the #8, #16, and #30 sieves, and 24-34% between the #30 and #200
- For non-slipform, recommended that 20% total be retained on the #8, #16, and #30 sieves, and 25-40% between the #30 and #200
- For either, the amount individually retained on the #8 and #16 should not exceed 12%

339

Tarantula Curve Gradation Limits

Sieve	Upper Limit	Lower Limit	% Retained
1" / 25mm	16	0	0.0
3/4* / 19mm	20	0	6.1
1/2" / 12.5mm	20	4	18.5
3/8" / 9.5mm	20	4	9.8
#4 / 4.75mm	20	4	20.6
#8 / 2.36mm	12	0	9.5
#16 / 1.18mm	12	0	5.3
#30 / 600µm	20	4	5.4
#50 / 300µm	20	4	12.9
#100 / 150µm	10	0	9.2
#200 / 75µm	2	0	1.0

%Retained on #8, #16, and #30? %Retained between #30 and #200?

20.2 28.5

340

339

340

338

# 


### 0.45 Power Curve

- Y = Percent Passing each Sieve
- X = Sieve Size raised to the 0.45 power
- Maximum density line plotted from origin to Nominal Maximum Aggregate Size (NMAS) for PCC.

342


341


342

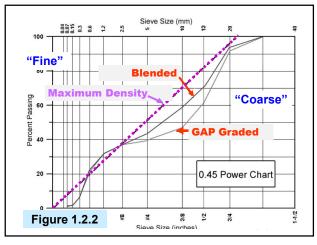





343

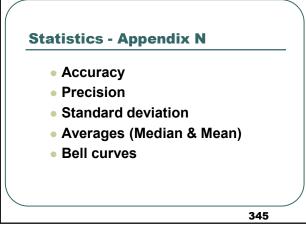

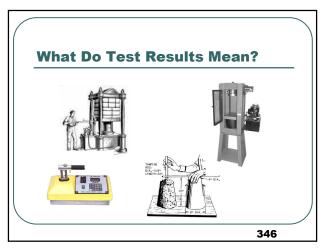


345

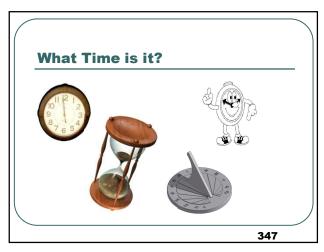


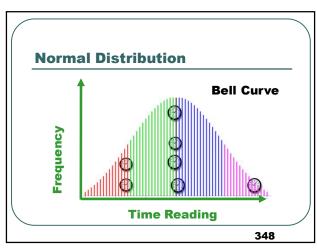

347 348


PCC III 2-08-21 58

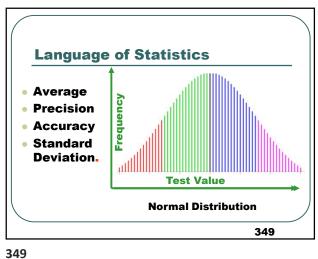


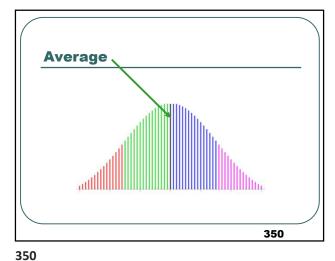

**Precision and Accuracy**  Precision - Variability of repeating same measurement Accuracy - Conformity to the <u>true value</u> • Bias - Deviation from the true value 351 351


**Precise Good Precision** Bias . **Poor Accuracy** (Biased) (Average off Center) 352

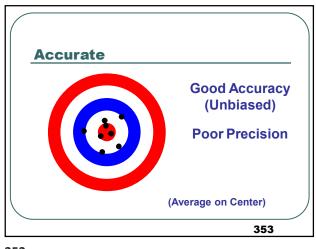


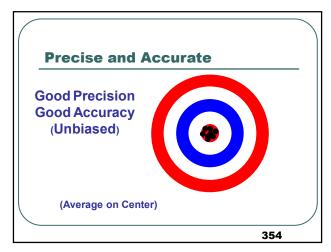


353 354

PCC III 2-08-21 59

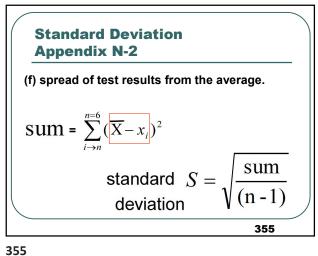


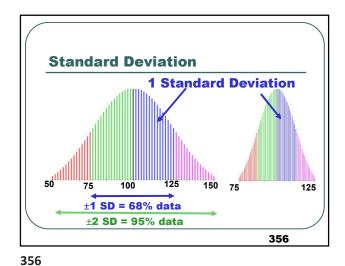

**Average Strength and Standard Deviation of 3 mixes** SPECIFICATION Frequency of Occurency 28 Day Compressive Strength, MPa (psi) 357

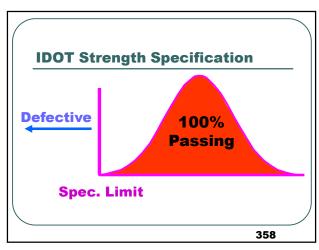


357

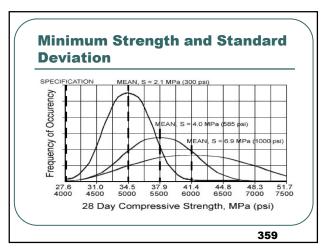

8.0 Design Target Strength (Pg. 36) **ACI 301 (Required for Ternary mix designs)** • Average of 3 tests may not be below minimum spec. (test = 2 cylinders) • No single test can exceed 500 psi below minimum spec @ 14 days for most IDOT mixes @ 28 days for > 4,000 psi design 360

359 360

PCC III 2-08-21 60

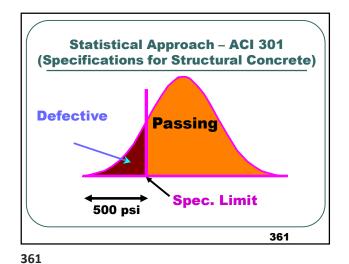

# Improving confidence in PCC Strength

- 1. Increase average strength, or
- 2. Decrease standard deviation

362

362

364

# **7.0 Statistical Analysis of Strength** (ACI 301)

 A statistical analysis of strength is strongly recommended when developing a new mix design

363


Less Than 15 Tests or No Test Data Available Mix Design Target Strength

If  $f_c' < 3,000 \text{ psi}$ If  $f_c' = f_c' + 1,000 \text{ psi}$ If  $f_c' = 5,000 \text{ psi}$ If  $f_c' = 5,000 \text{ psi}$ If  $f_c' = 5,000 \text{ psi}$ If  $f_c' = 1.10 f_c' + 700 \text{ psi}$ 


 $f'_{cr}$  may be adjusted based on statistical analysis per ACI 301 (>15 batches; 30+ optimum)

364

363

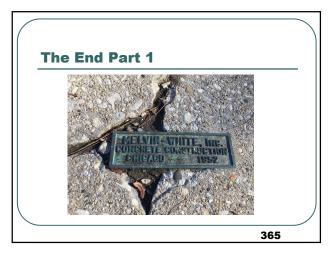


365



# PCC Level III PowerPoint Handout Specialty Mixes

202 -202





Specialty Mixes (Section 3.0 Pg. 22/ Appendices)

1

# **Specialty Mixes**

- High-Early Strength (Section 3.1)
- CAM II (Appendix F)
- CLSM (Appendix G)
- Stamped/Colored Concrete (Appendix H)
- Revetment Mats (Appendix I)
- Pipe Lining Grout (Appendix J)
- Cellular Concrete (Appendix K)
- Class SI Between Precast Boxes (Appendix L)

More >>>>

\_\_\_

1

More.....Specialty Mixes

- Pervious Concrete (Appendix M)
- Latex Concrete (Appendix P)
- Self-Consolidating Concrete (Section 1020)
- Mass Concrete (Section 5.0)
- Structural Concrete Mixes
- Patching Mixes
- White Topping
- Roller-Compacted Concrete

3

High-Early Strength Concrete (3.1 – Pg. 24)

Need 48-hr strength?

3 OPTIONS (Page 24):

- 1. Use Type III high-early strength cement
- 2. Use a higher cement content Type I cement mix
- 7-bag mix (658 Pounds Usually 650-660#)
- Limit w/c ratio to 0.42 or lower
- WR admixture or superplasticizer (if permitted)
- 3. Use approved accelerator

4

Post-it

2

4

### **Concrete Patches**

- PP-1
- PP-2
- PP-3
- PP-4
- PP-5



5

### **Concrete Patches**

PP-1 Standard patch - Type I cement (7.0 bag) 48 hr. strength.

Type C fly ash or GGBFS allowed (w/WR) Type III option w/lower cement content Most economical

PP-2 "Hot patch" – Type I cement (7.8 bag) 24 hr. strength

Non-chloride accelerator w/HRWR Chloride accelerator only via S.P. Lower durability, seldom used

6

5

### **Concrete Patches**

PP-3 Same-day Opening - 16 hr. strength Type III cement Slag & microsilica required Non-chloride accelerator required Higher durability, seldom used

PP-4 Rapid-hardening cement - 8 hr. strength Mobile mixer

7

9

PP-5

- Calcium Aluminate Cement High strength/ sensitive to admixtures
- 4-hour strength
- Mobile mixer required
- Suitable for low temperature placement
- Proprietary accelerator and superplasticizer

8

9

**Patch Opening Strength Specs Section 701.17** TABLE 1. CLASSES OF CONCRETE AND MIX DESI Pavement Patching 22.100 Bridge Deck Patching (10) (4150)**∤3,200 psi open** at 48 hours PP-2 at 24 hours PP-3 1,600 psi open at 16 hours at 8 hours 3,200 psi @ time PP-5 at 4 hours

### **Opening to Traffic (Section 701.17)**

Strength Tests. For patches constructed with Class PP-1 concrete, the pavement may be opened to traffic when test specimens have obtained a minimum flexural strength of 600 psi (4,150 kPa) or a minimum compressive strength of 3200 psi (22,100 kPa) according to Article 1020.09.

For patches constructed with Class PP-2, PP-3, PP-4, or PP-5 concrete, the pavement may be opened to traffic when test specimens have obtained a minimum flexural strength of 250 psi (1725 kPa) or a minimum compressive strength of 1600 psi (11,000 kPa) according to Article 1020.09. However, the concrete mixture shall obtain a minimum flexural strength of 600 psi (4150 kPa) or a minimum compressive strength of 3200 psi (22,100 kPa) in the time specified in Table 1 of Article 1020.04.

10

10

# **CAM II - Cement Aggregate Mixture (Appendix F)**

- Stabilized Subbase, Section 312.09
- No basic water, mortar factor, or strength requirement
- Minimum cement 170 lbs. per yard
- 6 mix options with and without fly
- Slump 1-3 inches
- Air 7-10%

**CAM II - Cement Aggregate Mixture (Appendix F)** Mix English Units, Mixture Type Design Option lb/yd3 CA 6, 9, 10 200 Cement Only Mixture 300

170, 60

1.0 1.0 0.9 1.2 1.1 1.0

CA 7, 11

W/C Ratio

12

11

11

12

Cement and

Fly Ash Mixture

### **CAM II**

- Dept. will conduct freeze-thaw tests
- ASR applies
- Trial batch for each design
- Procedure outlined in Appendix F

13

\_\_\_\_

### **CLSM**



14

13

# CLSM – Controlled Low Strength Material (Appendix G)

"Flowable Fill" - Section 1019

- No design procedure
- 3 proportion options offered
- Design criteria
  - ≥ 7 inch flow (IL Test Method)
  - 0-25% air
  - ≤ 1.5 in./blow dynamic cone penetrometer
  - 30-150 psi strength @ 28 and 180 days.

15

CLSM – Controlled Low Strength Material (Appendix G)

1019.06 Contractor Mix Design. A Contractor may submit their own mix design and may propose alternate fine aggregate materials, fine aggregate gradations, or material proportions. Article 1020.05(a) shall apply and a Level III PCC Technician shall develop the mix design.

hnician shall develop the mix design.
The mix design shall include the following information.

- (a) Source of materials.
- (b) Gradation of fine aggregate.
- (c) Specific gravities, material proportions, and any other parameters used in the mix design process.
- (d) Type and proposed dosage of admixtures.
- (e) Target flow and air content.
- (f) Test data indicating compressive strength at 28 and 180 days.

16

**15** 

16

14

# **CLSM Mix Properties**



- Self-leveling
- Self-compacting
- Able to readily fill voids
- Minimum bleeding and shrinkage

17


### **CLSM Uses**

- Backfilling utility trenches
- Backfilling abandoned vaults and pipes
- Backfilling underground tanks
- Structural backfill under/around overexcavated foundations
- Backfilling washed out or undermined areas

18

**17** 



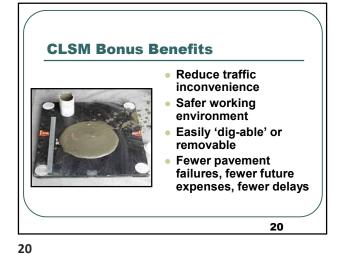

**CLSM Mix Design Options Mix 1** Mix 2 Mix 3 40 lb. Cement 50 lb. 125 lb. Fly Ash 125 lb. 125 lb. FA 2900 lb. 2500 lb. 2500 lb. Water 50-65 gal. 35-50 gal. 35-50 gal. 0 15-25 % Air 15-25 % 21

21

23

CLSM-Type Products

Flowable Fill
Flash Fill
FlowFill
Geofill
Redi-Fill
Redi-Fill
PRAIRE
MATERIAL REDI-FILL\*

CCELLULAR
CCOCCETE LIC
CONCRETE LIC
CO

22

24

Stamped/
Colored Concrete

Article 424.08 concrete no longer
required for domed
ramps.

Mix design guidelines
Appendix H.

See District for Special
Provision

Specialty Mixes Rev 3-23-23

# Stamped/Colored Concrete recommendations (Appendix H)

- 6.05 cwt/yd cement recommended
- Slump range 3-5" recommended
- CA11, CA13, CA14, or CA16
- MF 0.88 to 0.90
- For colored concrete, w/c ratio <u>+</u> 0.02 of target
- No calcium chloride accelerators

25

# Fabric Formed Revetment Mats (Appendix I)

- Section 285
- No formal mix design
- 2,500 psi, pumpable "mortar"
- Mix options:
  - 1. Cement only
  - 2. Cement + Fly Ash
- 6.0-9.0 % air

26

28

0.60 max. W/C ratio

26

25

# Pipe Lining Options BDE 80315

"SECTION 543. INSERTION LINING OF CULVERTS

543.02 Materials

(g) Grout Mixture10	24.01
(h) Portland Cement Concrete	. 1020
(i) Controlled Low-Strength Material	. 1019
(j) Cellular Concrete	. 1029
<del></del>	

27

# Pipe Lining - Grout Mixture (Appendix J)

- Article 1024.1
- 150 psi @ 28 days min.
- 6.50 cwt/yd³
- 80% fly ash replacement allowed
- 0.60 max. W/C ratio
- 6.0-9.0% air
- Trial Batch Required.

28

27

# Cellular Concrete (Appendix K)

- "Engineered Fill" Lightweight "foam" concrete
- Not Article 1029
- Proprietary mixes
- 4.0-6.5 cwt
- 65% Fly Ash replacement
- 0.50-0.60 W/C ratio
- 20-70% air voids structure
- Fine Aggregate is optional
- Proprietary foam admixture

29

# Class SI PCC Between Precast Concrete Box Culverts (Appendix L)


- Article 540.06 Multi-Cells (rows)
- "Maximum Agg. Size ¾inch"
- CM16 (finer) or 100% FA
- Higher H<sub>2</sub>O demand
- Start with CA basic water 0.4 gal/cwt.



3-inch space between rows

30

29

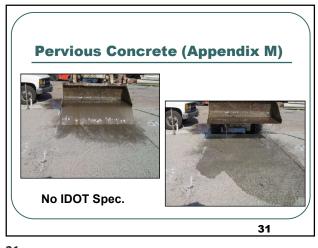

**Pervious Concrete** 

- No formal design procedure
- Project-specific Special Provision
- Single CA (usu. CM13)
- Typical: 450# Cement/100 # GGBFS + fibers
- Hydration stabilizer
- 2,000 3,000 psi
- 18-25% voids structure
- Can use transit mixer, mobile mixer, or dump

32

31



**Self-Consolidating Concrete (SCC)** 



34

33

34

32

### SCC

Can flow around reinforcement and consolidate without additional effort and without segregation



35

SCC for Cast-in-place Construction

Article 1020.04 Usage -BS, PC, PS, DS, & SI

Reduces:

- Equipment use
- Construction time
- Labor
- Construction noise, vibration
- Segregation, bug holes

36

35

# **Materials & Design**


- High range W-R, or
- High range W-R admixture + separate viscosity modifying admixture
- CA 100% <12.5 mm 95% <19 mm
- FA 50% Max. total aggregate
- Maximum cement factor 7.05 cwt/cu yd
- Maximum water/cement ratio 0.44
- Special design and QC tests

Visual Stability Index

38

37

37

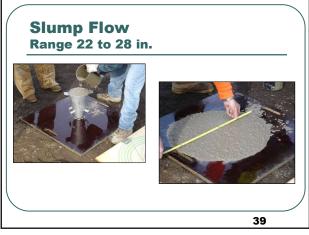

J-Ring (J-Ring Flow - Slump flow) ≤ 2"



38

40



40

39

L-Box
Blocking Ratio (A/B) min. 80%

B
A

41

**Hardened Visual Stability Index** 







42

42

# **Column Segregation**

- Optional Test
- Wash concrete from each section through #4 sieve
- Difference in retained weight of CA cannot exceed 15% Index



43

### 5.0 Mass Concrete (Pg. 27)

- Class MS concrete replaced with a spec for "massive" pours with least dimension >5 ft.
- Drilled shaft, foundation, footing, substructure, superstructure
- Temperature restrictions
- Pre-cooling & postcooling measures
- Larger aggregate, uniformly graded
- More FDMs allowed, less total cementitious

44

43

# Structural Concrete Mixes *Guide Bridge Special Provisions*

- Bridge Deck Microsilica Overlay
- Bridge Deck Latex Concrete Overlay
- Bridge Deck High-Reactivity Metakaolin Overlay
- Bridge Deck Thin Polymer Overlay
- High Performance Concrete Structures
- Deck Slab Repair

45

(Appendix P)

**Bridge Deck Latex Concrete** 

CM13 1,267 lbs. (42-50% by weight

of total aggregate)

FM02 1,544 lbs. (≥ 50% of agg.)

Cement 658 lbs.

Water 15.7 gal C.F. = 6.58

Latex 24.5 gal (c. 54% water) W/C = 0.37

Air 0

CA weights adjusted for solids in latex

46

45

46

44

# Whitetopping

CHECK SHEET #28

State of Illinois
Department of Transportation

SPECIAL PROVISION
FOR
PORTLAND CEMENT CONCRETE INLAY OR OVERLAY

Effective: November 1, 2008 Revised: January 1, 2022

47

### **Mix Characteristics**

- Class PV
- Variable design thickness (≥ 4 inches)
- Cement factor 6.05 cwt (Central-mixed)
- Cement factor reduction < 0.30 cwt</li>
- NMAS limited by thickness
- Minimum 3000 psi @ 14 days.
- Synthetic fibers < 5.0 lb/cu yd</li>

48

47



- No slump
- Blended coarse aggregate
- Impermeable



49

49

# RCC Roller Compacted Concrete


# ROLLER COMPACTED CONCRETE (BMPR) Effective: January 17, 2014

Item	Criteria	
Cement Factor, cwt/cu yd (kg/cu m)	5.35 (320) (Note 1)	
Water/Cement Ratio, lb/lb (kg/kg)	0.25 - 0.40	
Slump, in. (mm)	Not Applicable	
Air Content, %	Not Applicable	
Coarse Aggregate Gradations	CA11	
Intermediate Aggregate Gradations	CA13, CA14, CA16	
Fine Aggregate Gradations	FA01, FA02, FA20	
Mix Design Compressive Strength,	3,500 (24,000) at 7 days;	
psi (kPa), minimum	4.500 (31.000) at 28 days	


Notes: (1) The minimum portland cement content in the mixture shall be 400 lbs/cu yd (237 kg/cu m). A cement factor reduction for using a water-reducing admixture or a high range water-reducing admixture will not be allowed, and Articles 1020.05(c)(5)b. and 1020.05(c)(5)c. will not apply.

50


50

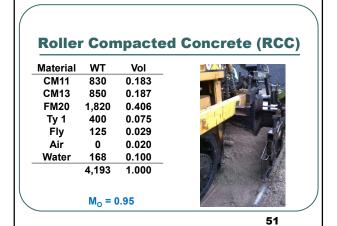


51

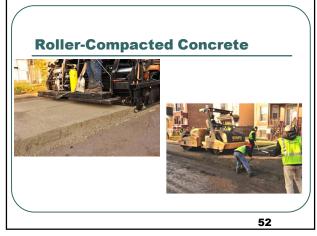


52

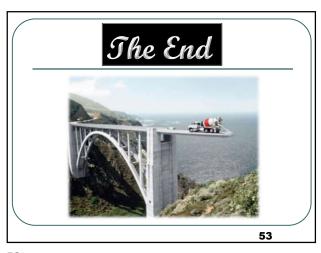




PCC Level III
PowerPoint
Handout
Mix Design
Software

2024-2025






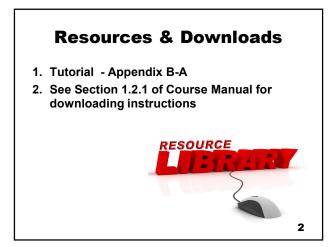

4





PCC Level III Technician Course Manual Revised April 1, 2023 **APPENDIX B** IDOT PCC MIX DESIGN SOFTWARE TUTORIAL Version X1.0 For help, comments, and/or suggestions, please contact: James M. Krstulovich, PE IDOT Bureau of Materials 126 East Ash Street Springfield, Illinois 62704 Phone: (217) 782-7200 email: DOT.PCCMIX@illinois.gov 4

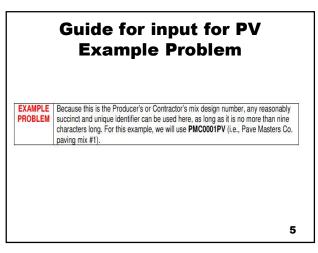

**Cell Format / Input** Input **Optional** Calculated / Locked m Contractor/Producer designated mix de **RED** Tags Northis is NOT the IDOT mix design numb 02 which will be assigned by the District up of the mix design. have 21622 - CONC PC FASH MSIL comments 6

5 6

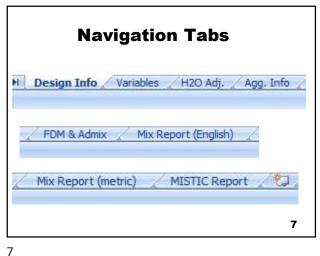


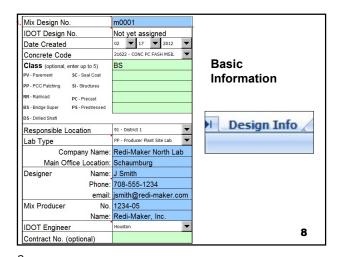


2. Design Variables **Batch Size** 1.00 cubic yard Cement Factor cwt / cu yd Mortar Factor Typically 0.70 - 0.99 **Target Air Content** Target Slump Determine Water Content: 


A. w/c Ratio Method

B. Basic Water Req. ignore >>> n/a Enter W/C Ratio > ignore >>> Water Adjustment Help ignore >>> Fineness Mod (optional) Admixture • Fly Ash Class Variables 9

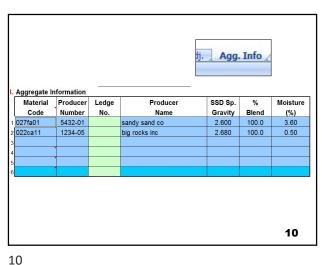

9

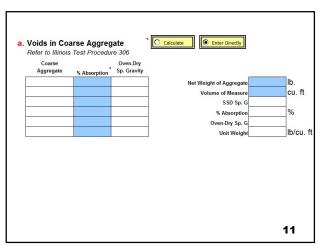


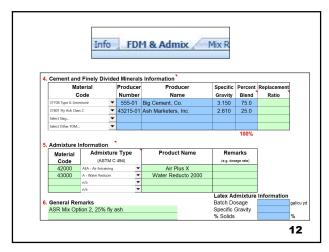


11 12


	C MIX	# Not Ass	signed	IX DESIG	ATERIAL:	21622	CONC PC	FASH MS	L		EF	FECTIVE:		Version 2.3.
		MODO1 DISTRIC		LAB	CLASS:	BS Producer Plant	Ste			REV	NEWED BY:			
BATCH	ADV	H2O% RED		56 AID	VOIDS	(Z)	MORTAR FACTOR	{TYF	E) FA		J/CWT)	(AB:	S. VOL) FAA	
1.00	W	8.0		6.5	0.41	6.05	0.86	C	В	5.30	0.00	0.4069	0.2580	]
											%MOIST /		/ CU YD]	[KG/CUM]
MATERI 027FA01		PROD		PRODIN				SP G		BLEND	REPL	SSD	ADJ	ADJ
027FA01		5432-01 1234-05			SAND CO			2.600		00.0	3.60 0.50	1130	1170 1846	698 1096
37601								3.150	-	76.5	1.00	465	465	275
37801		666-06		GENER	AL ELECT	RICAL		2.550	- 1	18.9	1.00	115	115	70
37852		777-07		SPECIA	LTY MATE	RIALS INC		2.200		4.6	1.00	28	28	17
											O (gal : lbs)		197	117
	(FA	4 + CA) N	IX-H2O	5.30		W/C RATIO	0.41		TC	TAL BATO	CH WT (lbs)	Į.	3821	2268
TOTAL	CEME	NTITIOU	S MATL	6.08						THEO. H2	O (gal : lbs)	29.6	247	]
			4-05	PRO	DD NAME:	REDI-MAKER	R, INC.							
	MRKS										_ (	CONTRACT	r	
	NAL II	NFORMA				KER NORTH			URG			Target		
Advier	Mat	Type			JSMITH	Remarks	_ Created:	02/17/12			Slump (in.)			
read(a).		- IJpe	TOUSE			- Contains					gner Phone:			
										Des	signer email:	jsmith@re	di-maker.com	
									,		Cc:	HOUSTON	1	3/15/201:
7							_							
	denis		Mix	Ren	ort (	English	1)	Mix Re						
8. A														

13 14

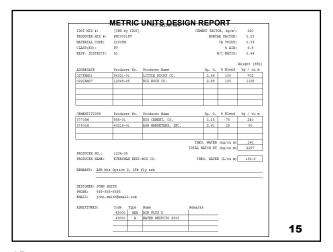

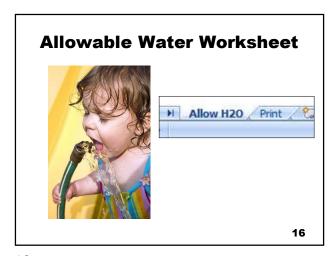

15 16

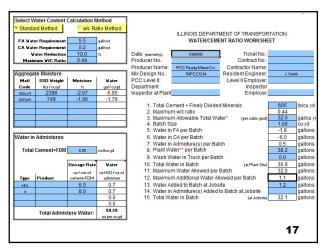

Select Water Content Calculation Method Standard Method w/c Ratio Method **FA Water Requirement** 5.5 gal/cwt **CA Water Requirement** 0.2 gal/cwt 10.0 % Water Reduction Maximum W/C Ratio 0.44 Aggregate Moisture SSD Weight Matl Moisture Water lbs / cu yd Code % gal / cu yd -2.07 2396 -5.95 022ca11 749 -1.96 -1.76027fa01 18

17 18

rater ii	n Admixtures			
Total	Cement+FDM	6.05	cwt/cu yd	
		Dosage Rate	Water	
Type Product		oz / cwt of cement+FDM	oz H2O / oz of admixture	
AEA		6.0	0.7	
Α		8.0	0.7	
			0.0	
			0.0	
	Total Admix	59.29		
	Total Autilia	ture water.	oz per cu yd	

1. Total Cement + Finely Divided Minerals 605 lb/cu yd 2. Maximum w/c ratio 0 44 3. Maximum Allowable Total Water\* (per cubic yard) 32.0 gal/cu yd 4. Batch Size 1.00 cu yd 5. Water in FA per Batch -1.8 gallons gallons 6. Water in CA per Batch -6.0 7. Water in Admixture(s) per Batch 0.5 gallons 8. Plant Water\*\* per Batch gallons 38.2 9. Wash Water in Truck per Batch 0.0 gallons 10. Total Water in Batch 30.9 gallons (at Plant Site) 11. Maximum Water Allowed per Batch 32.0 gallons 12. Maximum Additional Water Allowed per Batch gallons 1.1 13. Water Added to Batch at Jobsite 1.2 gallons 14. Water in Admixture(s) Added to Batch at Jobsite gallons 15. Total Water in Batch 32.1 gallons 20

19 20

PCC Ready-Mixed Co. 50PCC1234		
50PCC1234		
Ticket No.: Contract No.: Contractor Name: Resident Engineer: Level II Employer: Inspector	J. Smith	
₹	Contractor Name: esident Engineer: Level II Employer:	Contractor Name: esident Engineer: Level II Employer: Inspector

Illinois Department of Transportation Water/Cement Ratio Worksheet Producer Name: PCC Ready-Mixed Co. Mix Design No.: Resident Engineer: Level II Employer: PCC Level II: Department Inspector 605.0 lb/yd<sup>3</sup> (kg/m<sup>3</sup>) Maximum Allowable Water, gal/yd³ (L/m³)......
Engish: (Line 1 × Line 2) + 8.33
Metric: Line 1 × Line 2 4. Batch Size, yd3 (m3).... 1.00  $yd^3 (m^3)$  Water in Fine Aggregate per Batch, gal (L).......

Enalish: fl(%FA Moisture + 100) × FA lb/vd³l × Line 4) + 8.33 gal (L)


21 22


11.	Maximum Water Allowed per Batch, gal (L)
12.	Maximum Additional Water Allowed per Batch, gal (L)Line 11 - Line 10
13.	Water Added to Batch at Job Site, gal (L)
14.	Water in Admixture(s) Added to Batch at Job Site, gal (L) Refer to Line 7 for calculation.
15.	Total Water in Batch at Job Site, gal (L) Line 10 + Line 13 + Line 14
	23





23 24

3-23-23 **4** 

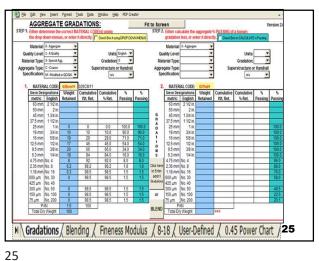

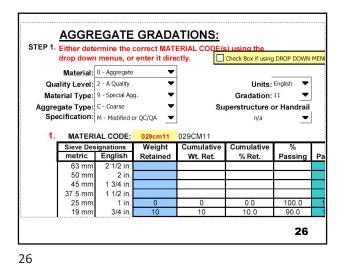

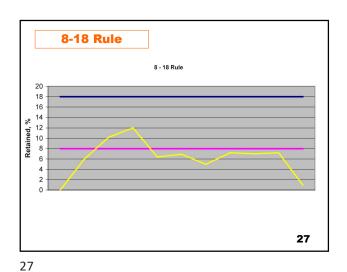

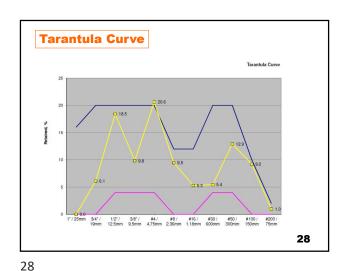


**0.45 Power Curve** 

80.0 70.0 60.0 40.0 30.0 29

29

**Other Design Software &** Information -(Section 1.2) COST - FHWA and NIST • COMPASS - The Transtec Group, Inc. through funding FHWA. ConcreteWorks - Concrete Durability Center at the Univ. of Texas 30

3-23-23 5

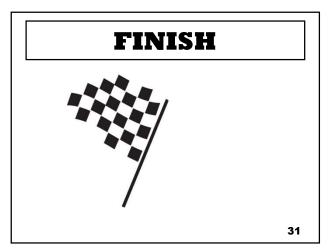


31

# **Table of Contents**

# **Homework and Forms**

	Page
Example Problem Solution	HW-1
BS Mix Homework Problem	HW-2
Ternary Mix Problem	HW-3
Homework Problem 1 – Blending	HW-4
8-18 Form for Blending homework	HW-5
0.45 Form for Blending homework	HW-6
Blank mix design worksheets	HW-7 <i>,</i> HW-8



# **Example Problem Solution - PCC Level III**

Given or Calculate:							
Mix Plant Type:	Central						
Mix Class:	PV (Slip)	•				ASR IN	FO
Coarse Agg:	022CM11	G <sub>SSD</sub> :	2.68	W/C Ratio	0.42	Exp. Value:	0.05
Fine Agg:	027FA01	G <sub>SSD</sub> :	2.66			Exp. Value:	0.20
Cement	Ty IL	SG:	3.15			Alkali:	>0.60
FDM1	Fly C	SG:	2.61				
FDM2		SG:					
CA Voids:	0.39	<u>.</u>				Aggr. Group:	II
Mortar Factor:	<u>0.83</u>						
Specification look-up:							
Cement Fa	actor 5.	65	cwt/YD <sup>3</sup>				
Allowed CF Reduction (V	Allowed CF Reduction (W-R) 0.30				replaceme	ent required fo	or ASR
FDM Replaceme	nt % <b>2</b>	5	%	Mitigation C	Option	2	
FDM Replacement F	FDM Replacement Ratio 1.0 (1:1)				Air Content	6.5 %	
W/C F	Ratio <b>0.32</b>	-0.42	Range	Та	rget Slump	0.5-2.5 ii	า.
			•	Min. Comp.	Strength	3,500 @ 14 PS	I @ days

### Calculations:

1.0	Cement		
1.1	Starting CF	5.65	cwt/YD <sup>3</sup>
1.2	- Reduction for W-R	0.30	cwt/YD3
1.3	= Revised CF	5.35	cwt/YD3
1.4	- Replacement w/ FDM1	1.34	cwt/YD3
1.5	- Replacement w/ FDM2		cwt/YD <sup>3</sup>
1.6	= Final Cement cwt	4.01	cwt/YD3
1.7	Wt. Cement	405	LB (5#)
1.8	Absolute Volume Cement	0.076	$YD^3$
2.0	FDMs		
2.1	Wt. FDM1	135	LB (5#)
2.2	Abs. Vol. FDM1	0.031	$YD^3$
2.3	Wt. FDM2		LB (5#)
2.4	Abs. Vol. FDM2		$YD^3$
3.0	Water		-
3.1	W/C ratio	0.42	<u>.</u>
3.1 3.2		227	LB
3.1	W/C ratio		LB YD³
3.1 3.2 3.3 <b>4.0</b>	W/C ratio Total Water Abs. Vol. Water Air	227 0.135	YD <sup>3</sup>
3.1 3.2 3.3	W/C ratio Total Water Abs. Vol. Water  Air Percent 6.5 Abs. Vol.	227 0.135 0.065	YD <sup>3</sup>
3.1 3.2 3.3 <b>4.0</b> 4.1 <b>5.0</b>	W/C ratio Total Water Abs. Vol. Water Air Percent 6.5 Abs. Vol. Mortar Mortar Factor	227 0.135 0.065 0.83	YD <sup>3</sup>
3.1 3.2 3.3 <b>4.0</b> 4.1 <b>5.0</b> 5.1	W/C ratio Total Water Abs. Vol. Water  Air Percent 6.5 Abs. Vol.  Mortar Mortar Factor  CA Voids 0.39 F <sub>CA</sub>	227 0.135 0.065 0.83 0.61	YD <sup>3</sup> YD <sup>3</sup> M <sub>0</sub>
3.1 3.2 3.3 <b>4.0</b> 4.1 <b>5.0</b> 5.1 5.2	W/C ratio Total Water Abs. Vol. Water  Air Percent 6.5 Abs. Vol.  Mortar Mortar Factor CA Voids 0.39 F <sub>CA</sub> % Mortar (Mo ÷ (Mo + F <sub>CA</sub> )	227 0.135 0.065 0.83 0.61 57.6	YD <sup>3</sup> YD <sup>3</sup> Mo
3.1 3.2 3.3 <b>4.0</b> 4.1 <b>5.0</b> 5.1 5.2 <b>6.0</b>	W/C ratio Total Water Abs. Vol. Water Air Percent 6.5 Abs. Vol. Mortar Mortar Factor CA Voids 0.39 FCA Mortar (Mo÷(Mo+FCA) Coarse Aggregate	227 0.135 0.065 0.83 0.61 57.6 42.4	YD <sup>3</sup> YD <sup>3</sup> Mo %
3.1 3.2 3.3 <b>4.0</b> 4.1 <b>5.0</b> 5.1 5.2 <b>6.0</b> 6.1	W/C ratio Total Water Abs. Vol. Water Air Percent 6.5 Abs. Vol. Mortar Mortar Factor CA Voids 0.39 F <sub>CA</sub> % Mortar (Mo÷ (Mo + F <sub>CA</sub> ) % Coarse Aggregate CA Abs. Vol.	227 0.135 0.065 0.83 0.61 57.6 42.4 0.424	YD <sup>3</sup> YD <sup>3</sup> Mo % YD <sup>3</sup>
3.1 3.2 3.3 <b>4.0</b> 4.1 <b>5.0</b> 5.1 5.2 <b>6.0</b> 6.1 6.2	W/C ratio Total Water Abs. Vol. Water  Air Percent 6.5 Abs. Vol.  Mortar Mortar Factor CA Voids 0.39 F <sub>CA</sub> % Mortar (Mo÷ (Mo + F <sub>CA</sub> )  % Coarse Aggregate CA Abs. Vol. CA Weight.	227 0.135 0.065 0.83 0.61 57.6 42.4 0.424 1,914	YD <sup>3</sup> Mo  % YD <sup>3</sup> LB
3.1 3.2 3.3 <b>4.0</b> 4.1 <b>5.0</b> 5.1 5.2 <b>6.0</b> 6.1 6.2 <b>7.0</b>	W/C ratio Total Water Abs. Vol. Water Air Percent 6.5 Abs. Vol. Mortar Mortar Factor CA Voids 0.39 FCA % Mortar (Mo÷ (Mo + FCA) % Coarse Aggregate CA Abs. Vol. CA Weight. FA Abs. Vol.	227 0.135 0.065 0.83 0.61 57.6 42.4 0.424 1,914 0.269	YD <sup>3</sup> Mo % YD <sup>3</sup> LB YD <sup>3</sup>
3.1 3.2 3.3 <b>4.0</b> 4.1 <b>5.0</b> 5.1 5.2 <b>6.0</b> 6.1 6.2	W/C ratio Total Water Abs. Vol. Water  Air Percent 6.5 Abs. Vol.  Mortar Mortar Factor CA Voids 0.39 F <sub>CA</sub> % Mortar (Mo÷ (Mo + F <sub>CA</sub> )  % Coarse Aggregate CA Abs. Vol. CA Weight.	227 0.135 0.065 0.83 0.61 57.6 42.4 0.424 1,914	YD <sup>3</sup> Mo  % YD <sup>3</sup> LB

· (	25 % x CF)		
(	% x CF)		
(100 x cw	t)		
(Wt ÷ (sg	x 1,684)		
(25	% x Wt Cement	535	x Repl. Ratio)
Wt.÷ (sg	x 1,684)		
(	% x Wt Cement		x Repl. Ratio)
Wt. ÷ (so	x 1,684)		_
W/C	0.42 x Total cement	/FDM <u>54</u>	<u>10</u>

## **8. MIX DESIGN SUMMARY**

	Absolute Vol.	<b>WEIGHT</b>
Cement	0.076	405
FDM1	0.031	135
FDM2		
Water	0.135	227
Air	0.065	0
Coarse Ag	0.424	1,914
Fine Ag	0.269	1,205
	1.000	3,886

# **Example Problem - PCC Level III**

or Calculate:			
· · · // ·			ASR INFO
	· 2.69	W/C Ratio <b>0.42</b>	Exp. Value: <b>0.05</b>
		W/O Natio	Exp. Value: <0.16
- 99			Alkali: <b>&gt;0.60</b>
			Alkali.
	J		Aggr. Group:
			Aggr. Group.
•	cwt/YD3		
		25% EDM roplacom	ont required for ASP
· · · · · · · · · · · · · · · · · · ·			n/a
·	<del></del>	_	
W/C Ratio Range	<u></u>		PSI @ days
ations:		wiin. Comp. Strength	FSI @ days
	cwt/YD3		
<del></del>			
			x CF)
<u> </u>		·	x CF)
		·	X CF)
		•	
	YD <sup>3</sup>	$(Wt \div (sg \times 1,684))$	
_			
		·	Cement x Repl. Ratio)
<del></del>			
		( % x Wt	Cement x Repl. Ratio)
Abs. Vol. FDM2	YD <sup>3</sup>	Wt. ÷ (sg x 1,684)	
Water			
W/C ratio		W/C x To	tal cement/FDM
Total Water	LB		
Abs. Vol. Water	YD <sup>3</sup>	8. MIX DESIGN SU	IMMARY
Air			Absolute Vol. WEIGHT
Percent 6.5 Abs. Vol.	$YD^3$	Cement	
		FDM1	
	%	_	
· · · · · · · · · · · · · · · · · · ·		_	
CA Weight.	LB	Fine Ag	
		1 1110 /39	
FA Abs. Vol.	YD <sup>3</sup>	_	1.000
f	Mix Plant Type: Central Mix Class: BS Coarse Agg: 022CM11 Fine Agg: 027FA02 Cement Ty IL FDM1 Fly C FDM2 CA Voids: 0.40 Mortar Factor: 0.86 Fication look-up: Cement Factor ed CF Reduction (W-R) FDM Replacement % DM Replacement Ratio W/C Ratio Range  ations: Cement Starting CF - Reduction for W-R = Revised CF - Replacement w/ FDM1 - Replacement w/ FDM2 = Final Cement cwt Wt. Cement Absolute Volume Cement FDMs Wt. FDM1 Abs. Vol. FDM1 Wt. FDM2 Abs. Vol. FDM1 Wt. FDM2 Abs. Vol. FDM2 Water W/C ratio Total Water Abs. Vol. Water Air Percent 6.5 Abs. Vol. Mortar Mortar Factor CA Voids 0.40 FCA % Mortar (Mo÷ (Mo + FCA) % Coarse Aggregate CA Abs. Vol.	Mix Plant Type:	Mix Plant Type:

# **Example Problem - PCC Level III**

Given	or Calculate:						
	Mix Plant Type: Truck-Mix						
	Mix Class: SI					ASR INFO	)
	Coarse Agg: 022CM11	Gssd:	2.68	W/C Ratio	0.42	Exp. Value:	<u>&lt;</u> 0.16
	Fine Agg: <b>027FA02</b>	Gssd:	2.65			Exp. Value:	<0.16
	Cement Ty IL	SG:	3.15			Alkali:	
	FDM1 Fly C	SG:	2.66			_	
	FDM2 GGBFS	SG:	2.95				
	CA Voids: <b>0.39</b>					Aggr. Group:	I
	Mortar Factor: 0.90						
Speci	fication look-up:						
-	Cement Factor		cwt/YD <sup>3</sup>				
Allow	red CF Reduction (W-R)		cwt/YD3	25% FDM r	eplacem	ent required for A	ASR
	FDM Replacement % 3	0	%	Mitigation O	otion	2	
F	DM Replacement Ratio 1.0 (	(1:1)	-	Target A	ir Content	<del></del> %	
	W/C Ratio Range		-	Tar	get Slump	in.	
			-	Min. Comp.	Strength	PSI @	2 days
Calcul	ations:						<del></del>
1.0	Cement						
1.1	Starting CF		cwt/YD	3			
1.2	<ul> <li>Reduction for W-R</li> </ul>	'	cwt/YD	3			
1.3	= Revised CF		cwt/YD	3			
1.4	- Replacement w/ FDM1		cwt/YD	<sup>3</sup> ( 2	0 %:	x CF)	
1.5	- Replacement w/ FDM2		cwt/YD	<sup>3</sup> ( 1	0 %:	x CF)	
1.6	= Final Cement cwt		cwt/YD	3		•	
1.7	Wt. Cement	-	LB (5#)				
1.8	Absolute Volume Cement	-	YD <sup>3</sup>	(Wt ÷ (sg )			
2.0	FDMs	-		(**** (***)	,,		
2.1	Wt. FDM1		LB (5#)	( 20	% x Wt	Cement	x Repl. Ratio
2.2	Abs. Vol. FDM1	-	YD <sup>3</sup>	\ <u></u> Wt.÷ (sg x			
2.3	Wt. FDM2		LB (5#)	( 10	% x Wt	Cement	x Repl. Ratio
2.4	Abs. Vol. FDM2	-	YD <sup>3</sup>	Wt. ÷ (sg )			_
2.4 3 <b>.0</b>	Water		10	•••. <del>-</del> (59)	. 1,004)		
3.1	W/C ratio			W/C	v To	tal cement/FDM	
3.2	Total Water		LB	VV/C		iai Ceillelli/FDM	
3.3	Abs. Vol. Water		YD <sup>3</sup>	8. MIX DE	SIGN SU	MMARY	
4. <b>0</b>	Air		15	J. WIIA DE		Absolute Vol.	WEIGH
<b>4.0</b> 4.1	Percent Abs. Vol.		$YD^3$	Cem		ADSOIGLE VOI.	44 LIGIT
5.0	Mortar Mortar Factor	0.9		FDN	_		
5.1	CA Voids 0.39 F <sub>CA</sub>	_	IVIO	FDN			
5.2	% Mortar $(M_0 \div (M_0 + F_{CA}))$		<u></u> %	Wat	_		
5.2 6.0	% Coarse Aggregate			Ai			_
6.1	CA Abs. Vol.		<sup>7</sup> % YD <sup>3</sup>	Coars	_		
6.2	CA Abs. voi. CA Weight.		LB	Fine	_		_
	<u> </u>		LD YD <sup>3</sup>	Fille	~y _	1 000	_
7.0	FA Abs. Vol.					1.000	
7.1	FA Weight		LB				

# Homework Problem 1 – Blending PCC Level III

# Instructions:


- Read Appendix E, "Aggregate Blending"
- Use the blank 8-18 and 0.45 Power Charts in Appendix E
- Plot the above product on the charts

The homework will be discussed on the morning of Day 2.


There may be questions about this exercise on the exam.

Blending Exercise "8	ding Exercise "8-18" and "0.45"				
Sieve	Pass	Retain			
1 inch	100%	0			
3/4 inch	94%	6%			
1/2 inch	78%	16%			
3/8 inch	60%	18%			
No. 4	44%	16%			
No. 8	35%	9%			
No. 16	27%	8%			
No. 30	20%	7%			
No. 50	6%	14%			
No. 100	2%	4%			
No. 200	1.0%	1.0%			

` HW-4

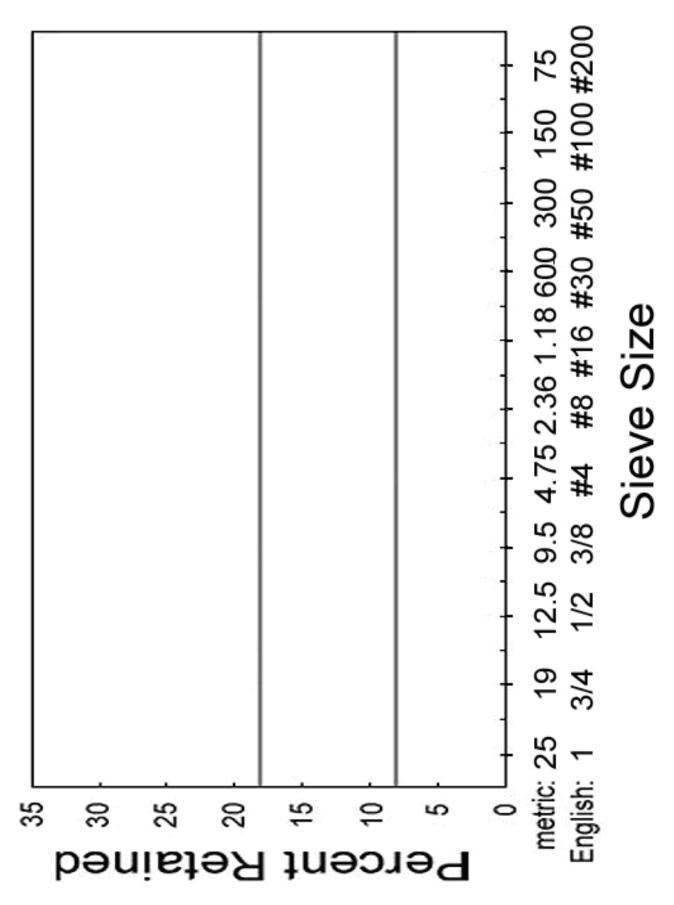

# 0.45 Power Curve Blank

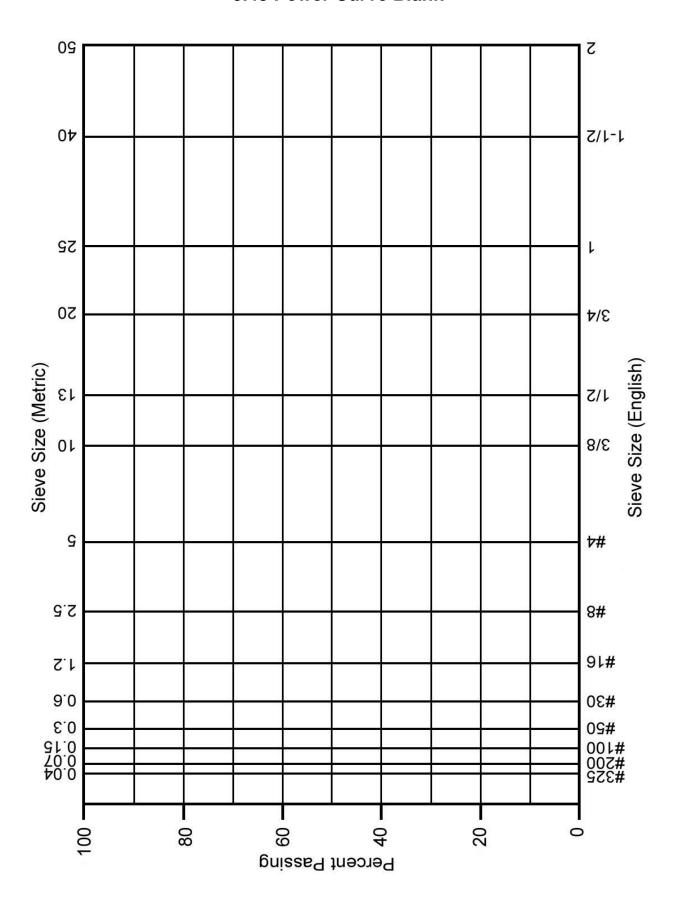

HW -6

# **Example Problem - PCC Level III**

Given	or Calculate:					
	Mix Plant Type:					
	Mix Class:				ASR IN	-O
	Coarse Agg:	Gssd:		W/C Ratio	Exp. Value:	
	Fine Agg:	G <sub>SSD</sub> :			Exp. Value:	
	Cement	SG:			Alkali:	
	FDM1	SG:				
	FDM2	SG:				
	CA Voids:				Aggr. Group:	
	Mortar Factor:					
Speci	fication look-up:					
	Cement Factor		cwt/YD <sup>3</sup>			
Allow	red CF Reduction (W-R)		cwt/YD <sup>3</sup>	_	cement required fo	r ASR
	FDM Replacement %		%	Mitigation Option		
F	FDM Replacement Ratio 1.0	(1:1)	-	Target Air Cor		
	W/C Ratio		Range	Target SI	·	
				Min. Comp. Stren	gth PSI	@ days
	ations:					
1.0	Cement					
1.1	Starting CF		cwt/YD <sup>3</sup>			
1.2	<ul> <li>Reduction for W-R</li> </ul>		cwt/YD <sup>3</sup>			
1.3	= Revised CF		cwt/YD <sup>3</sup>			
1.4	<ul> <li>Replacement w/ FDM1</li> </ul>		cwt/YD <sup>3</sup>	' (	% x CF)	
1.5	- Replacement w/ FDM2		cwt/YD <sup>3</sup>	(	% x CF)	
1.6	= Final Cement cwt		cwt/YD <sup>3</sup>		-	
1.7	Wt. Cement	-		(100 x cwt)		
1.8	Absolute Volume Cement		YD <sup>3</sup>	(Wt ÷ (sg x 1,6	84)	
2.0	FDMs			, , , , , , , , , , , , , , , , , , ,	•	
2.1	Wt. FDM1		LB (5#)	( % x	Wt Cement	x Repl. Rat
2.2	Abs. Vol. FDM1		YD³ ´	Wt.÷ (sg x 1,68		
2.3	Wt. FDM2	-	 LB (5#)		Wt Cement	x Repl. Rat
2.4	Abs. Vol. FDM2		YD <sup>3</sup>	Wt. ÷ (sg x 1,68		_ ·
3.0	Water				<del>/</del>	
3.1	W/C ratio			W/C x T	otal cement/FDM	
3.2	Total Water		 LB	11,0 X I		
3.3	Abs. Vol. Water		YD <sup>3</sup>	8. MIX DESIGN	N SUMMARY	
4.0	Air	-			Absolute Vol.	WEIG
4.1	Percent <b>6.5</b> Abs. Vol.		$YD^3$	Cement		<u></u>
5.0	Mortar Mortar Factor		M <sub>O</sub>	FDM1		<del></del>
5.1	CA Voids F <sub>CA</sub>			FDM2		<del></del>
5.2	% Mortar $(M_0 \div (M_0 + F_{CA}))$		<u></u> %	Water		
6.0	% Coarse Aggregate		%	Air		
6.1	CA Abs. Vol.		/0 YD <sup>3</sup>	Coarse Ag		
6.2	CA Weight.	-	LB	Fine Ag		<del></del>
7.0	FA Abs. Vol.	-	YD <sup>3</sup>	1 7	1.000	
7.1	FA Weight		LB	1	1.000	

# **Example Problem - PCC Level III**

Given or Calculate:					
Mix Plant Type:					
Mix Class:				ASR IN	FO
Coarse Agg:	Gssd:	·	W/C Ratio	Exp. Value:	
Fine Agg:				Exp. Value:	
Cement	SG:			Alkali:	
FDM1					
FDM2	SG:				
CA Voids:				Aggr. Group:	
Mortar Factor:					
Specification look-up:					
Cement Factor		cwt/YD <sup>3</sup>			
Allowed CF Reduction (W-R)		cwt/YD <sup>3</sup>	_	cement required for	or ASR
FDM Replacement %		%	Mitigation Option		
FDM Replacement Ratio	1.0 (1:1)		Target Air Co		
W/C Ratio		Range	Target S	· · · · · · · · · · · · · · · · · · ·	n.
			Min. Comp. Stren	gth PS	I @ days
Calculations:					
1.0 Cement					
1.1 Starting CF		cwt/YD <sup>3</sup>			
1.2 - Reduction for W-R		cwt/YD <sup>3</sup>			
1.3 = Revised CF		cwt/YD <sup>3</sup>			
1.4 - Replacement w/ FD		cwt/YD <sup>3</sup>	·	_ % x CF)	
1.5 - Replacement w/ FD	M2	cwt/YD <sup>3</sup>	(	_ % x CF)	
1.6 = Final Cement cwt		cwt/YD <sup>3</sup>			
1.7 Wt. Cement			(100 x cwt)		
1.8 Absolute Volume Ceme	ent	YD <sup>3</sup>	(Wt ÷ (sg x 1,6	84)	
2.0 FDMs					
2.1 Wt. FDM1		LB (5#)		Wt Cement	x Repl.
2.2 Abs. Vol. FDM1		YD <sup>3</sup>	Wt.÷ (sg x 1,68	<b>34)</b>	
2.3 Wt. FDM2		LB (5#)	( % x	Wt Cement	x Repl.
2.4 Abs. Vol. FDM2		YD <sup>3</sup>	Wt. ÷ (sg x 1,6	84)	
3.0 Water					
3.1 W/C ratio			W/C x T	otal cement/FDM	
3.2 Total Water		LB			
3.3 Abs. Vol. Water		YD <sup>3</sup>	8. MIX DESIGI		
4.0 Air				Absolute Vol.	<u>W</u> I
4.1 Percent <u>6.5</u> Abs. \		YD <sup>3</sup>	Cement		
<b>5.0 Mortar</b> Mortar F		Mo	FDM1		
5.1 CA Voids	F <sub>CA</sub>		FDM2		<u> </u>
5.2 % Mortar $(M_0 \div (M_0 + I)$	Fca <b>)</b>	%	Water		<u> </u>
6.0 % Coarse Aggregate		%	Air		<u> </u>
6.1 CA Abs. Vol.		YD³	Coarse Ag		
6.2 CA Weight.		LB	Fine Ag		
'.0 FA Abs. Vol.		$_{}$ YD $^3$		1.000	
7.1 FA Weight		I R			